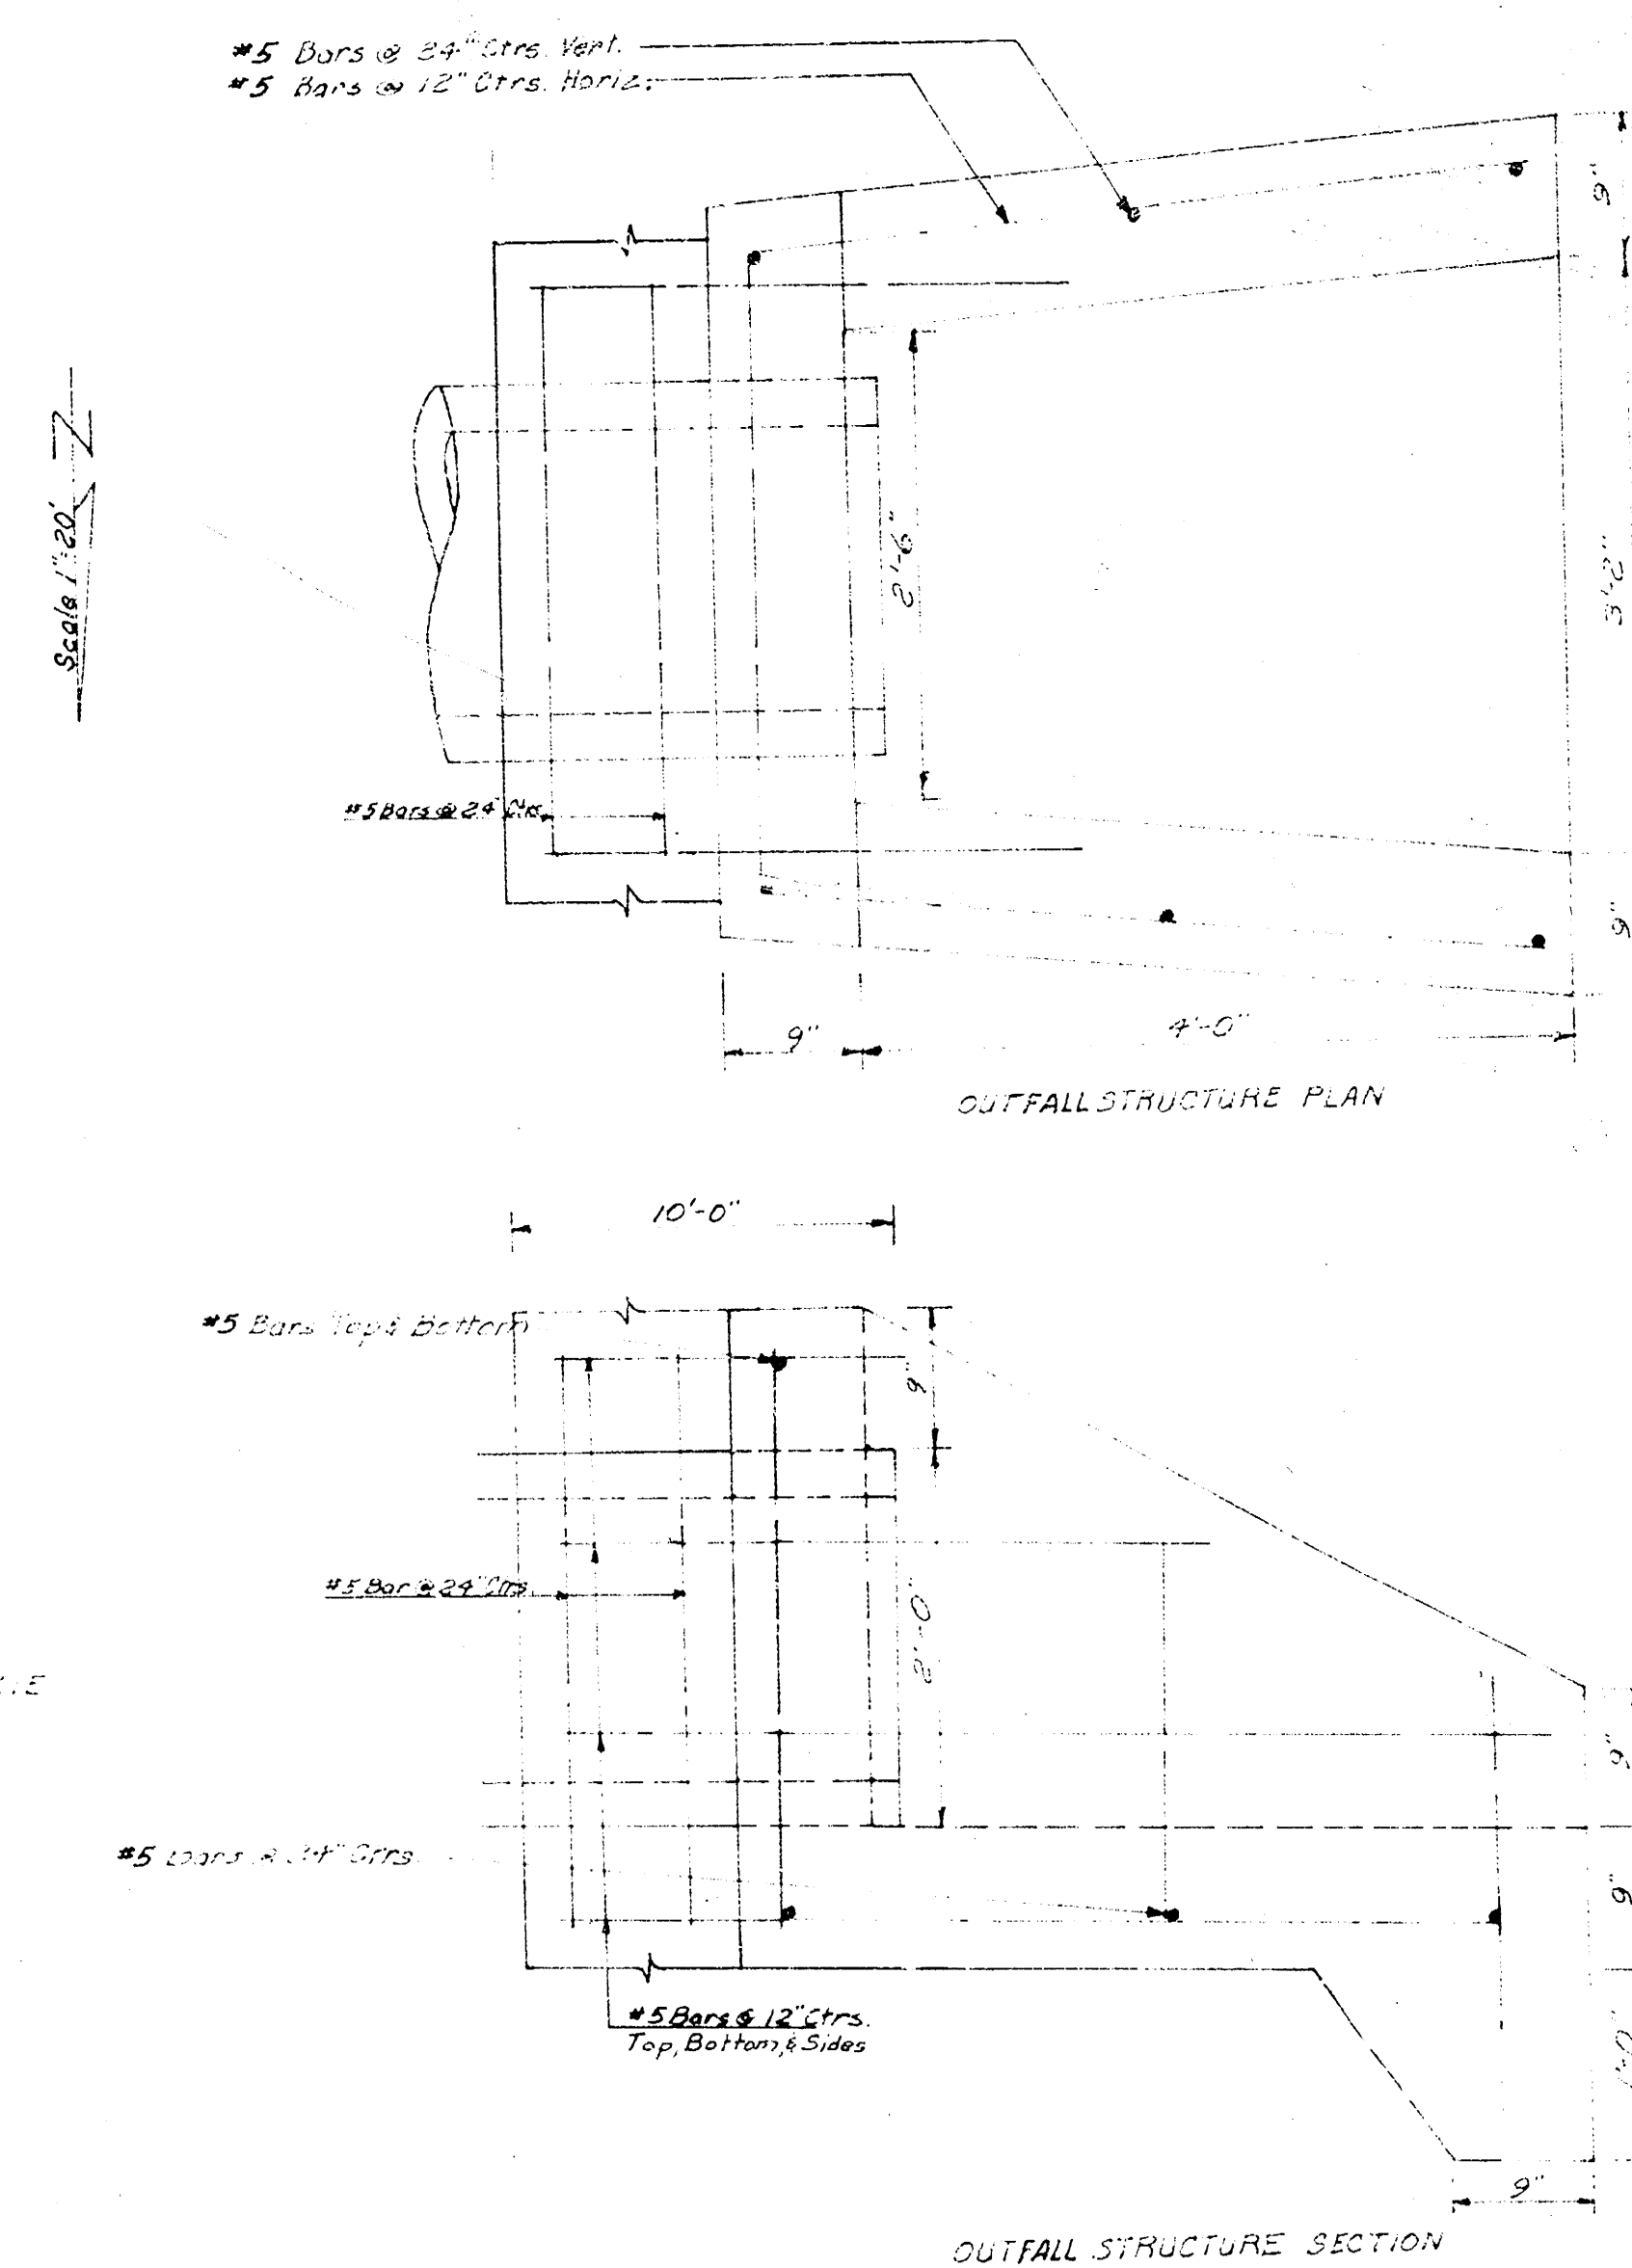
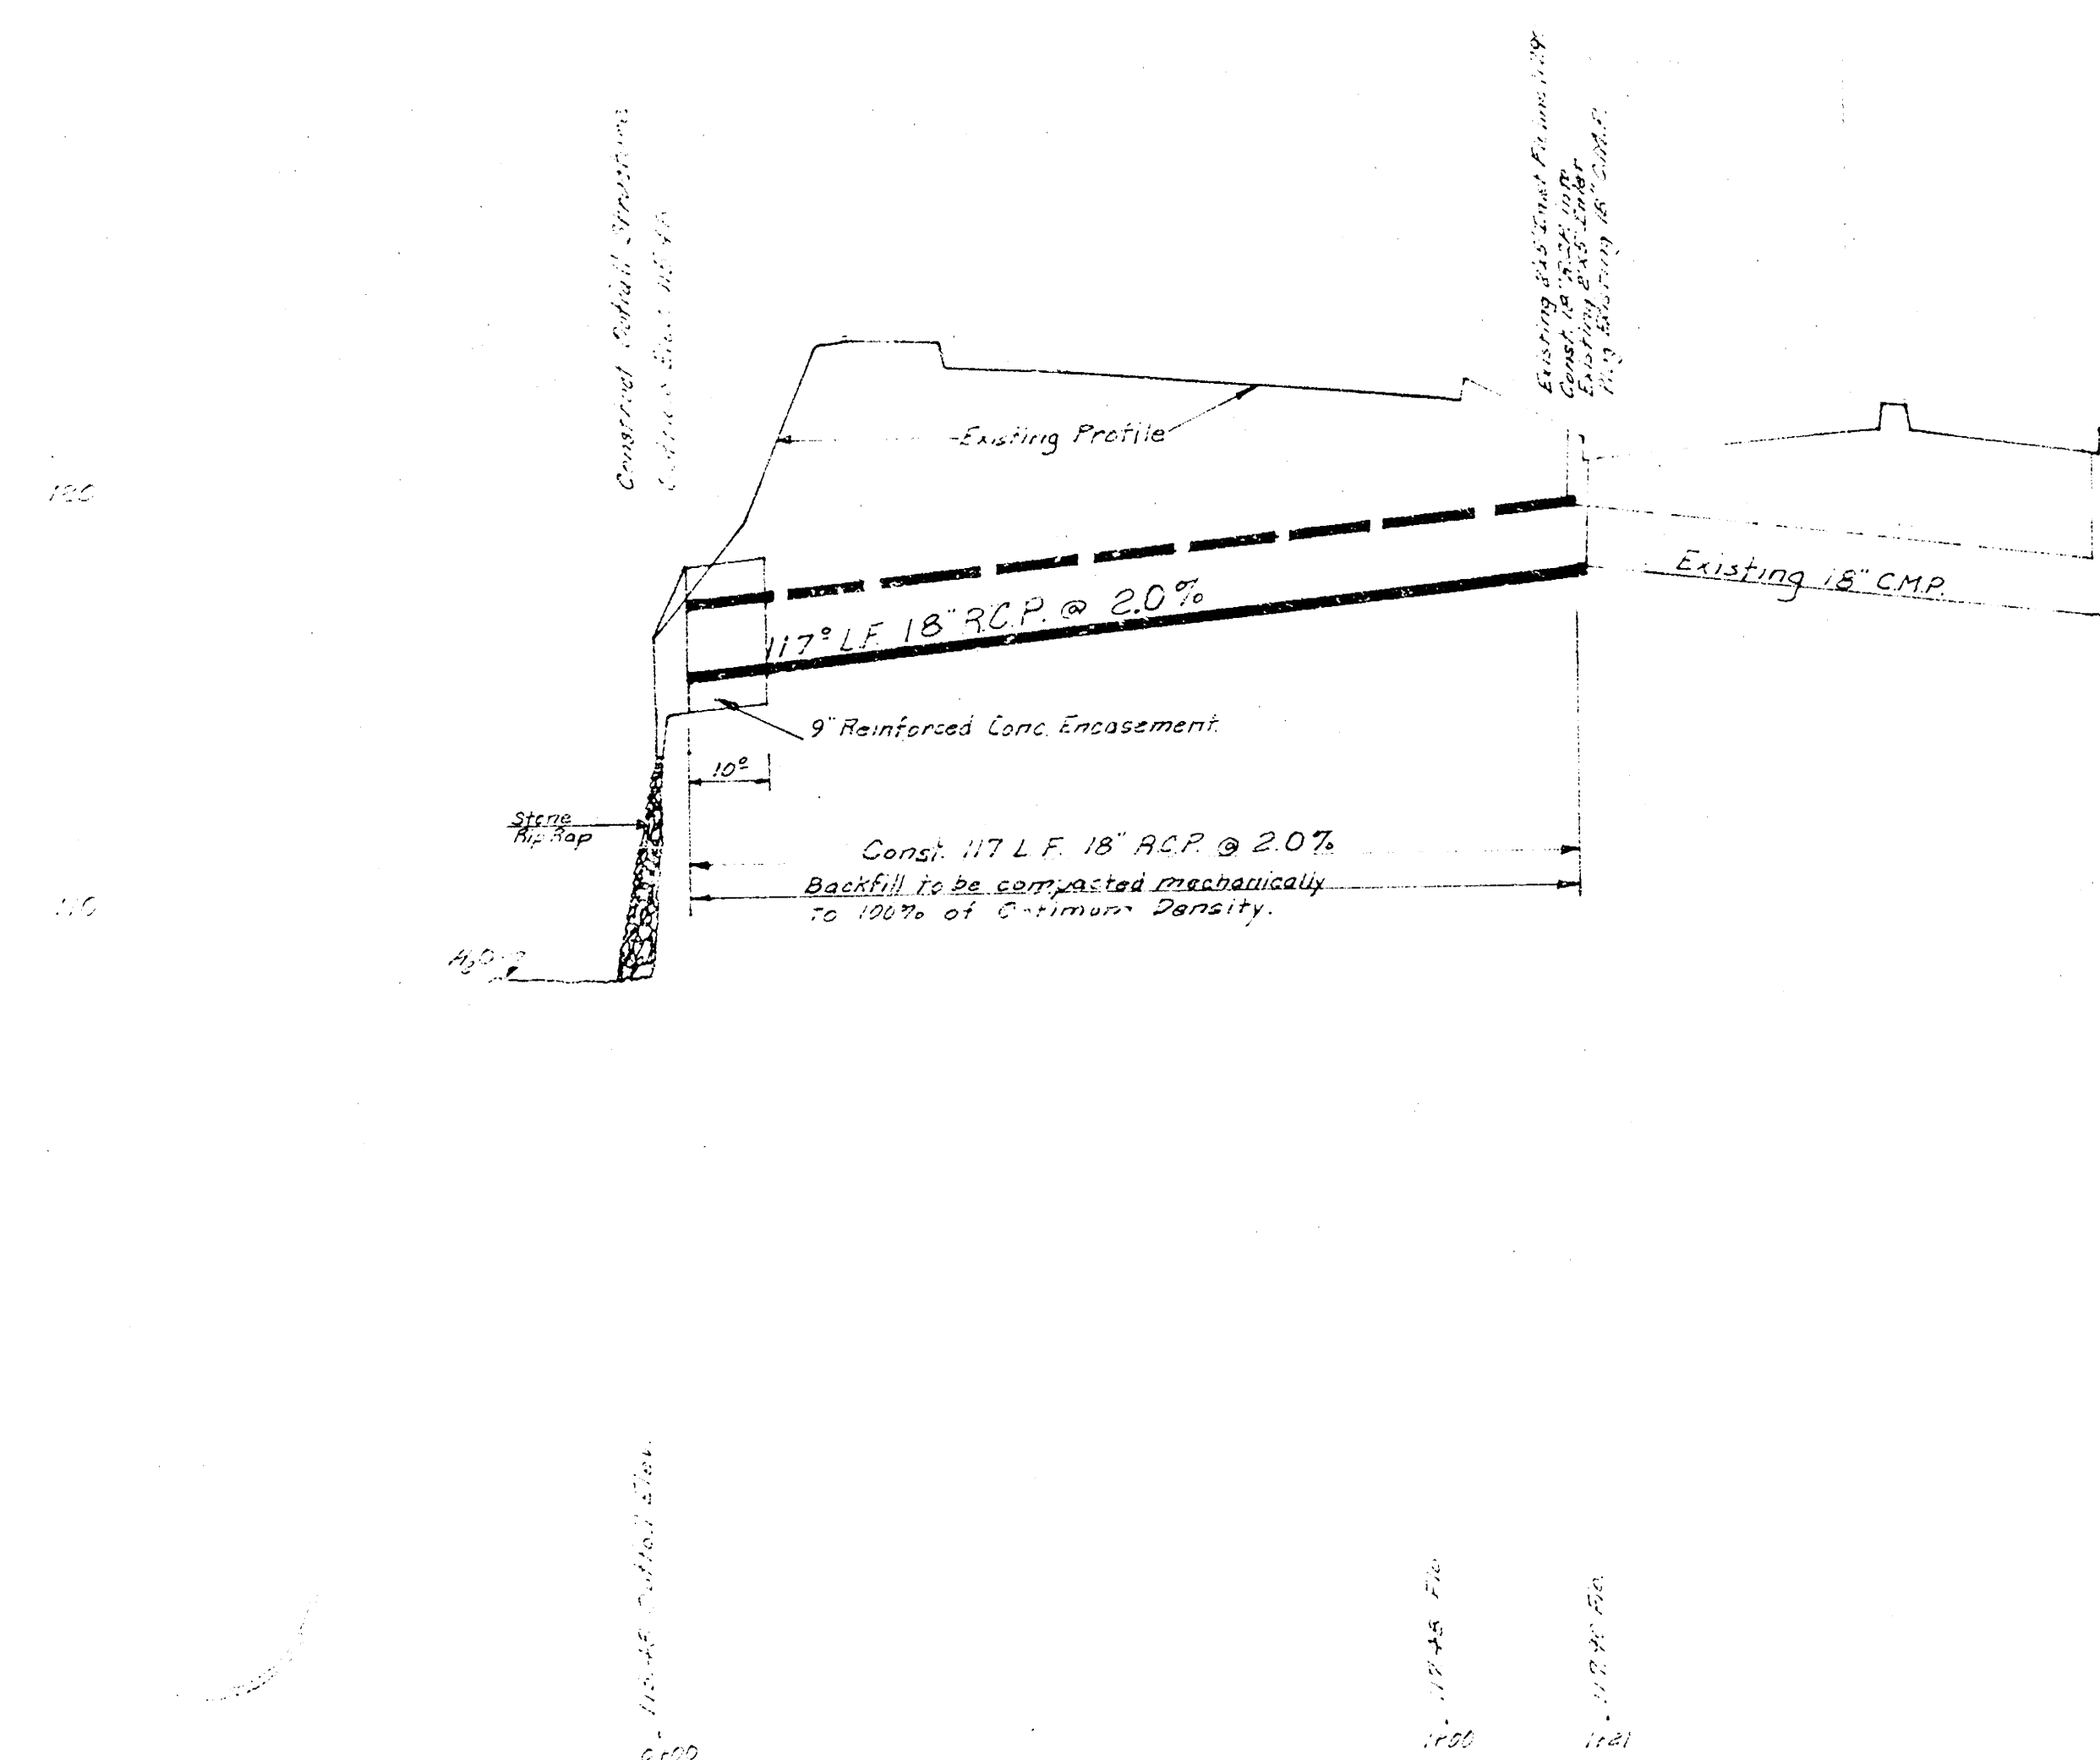
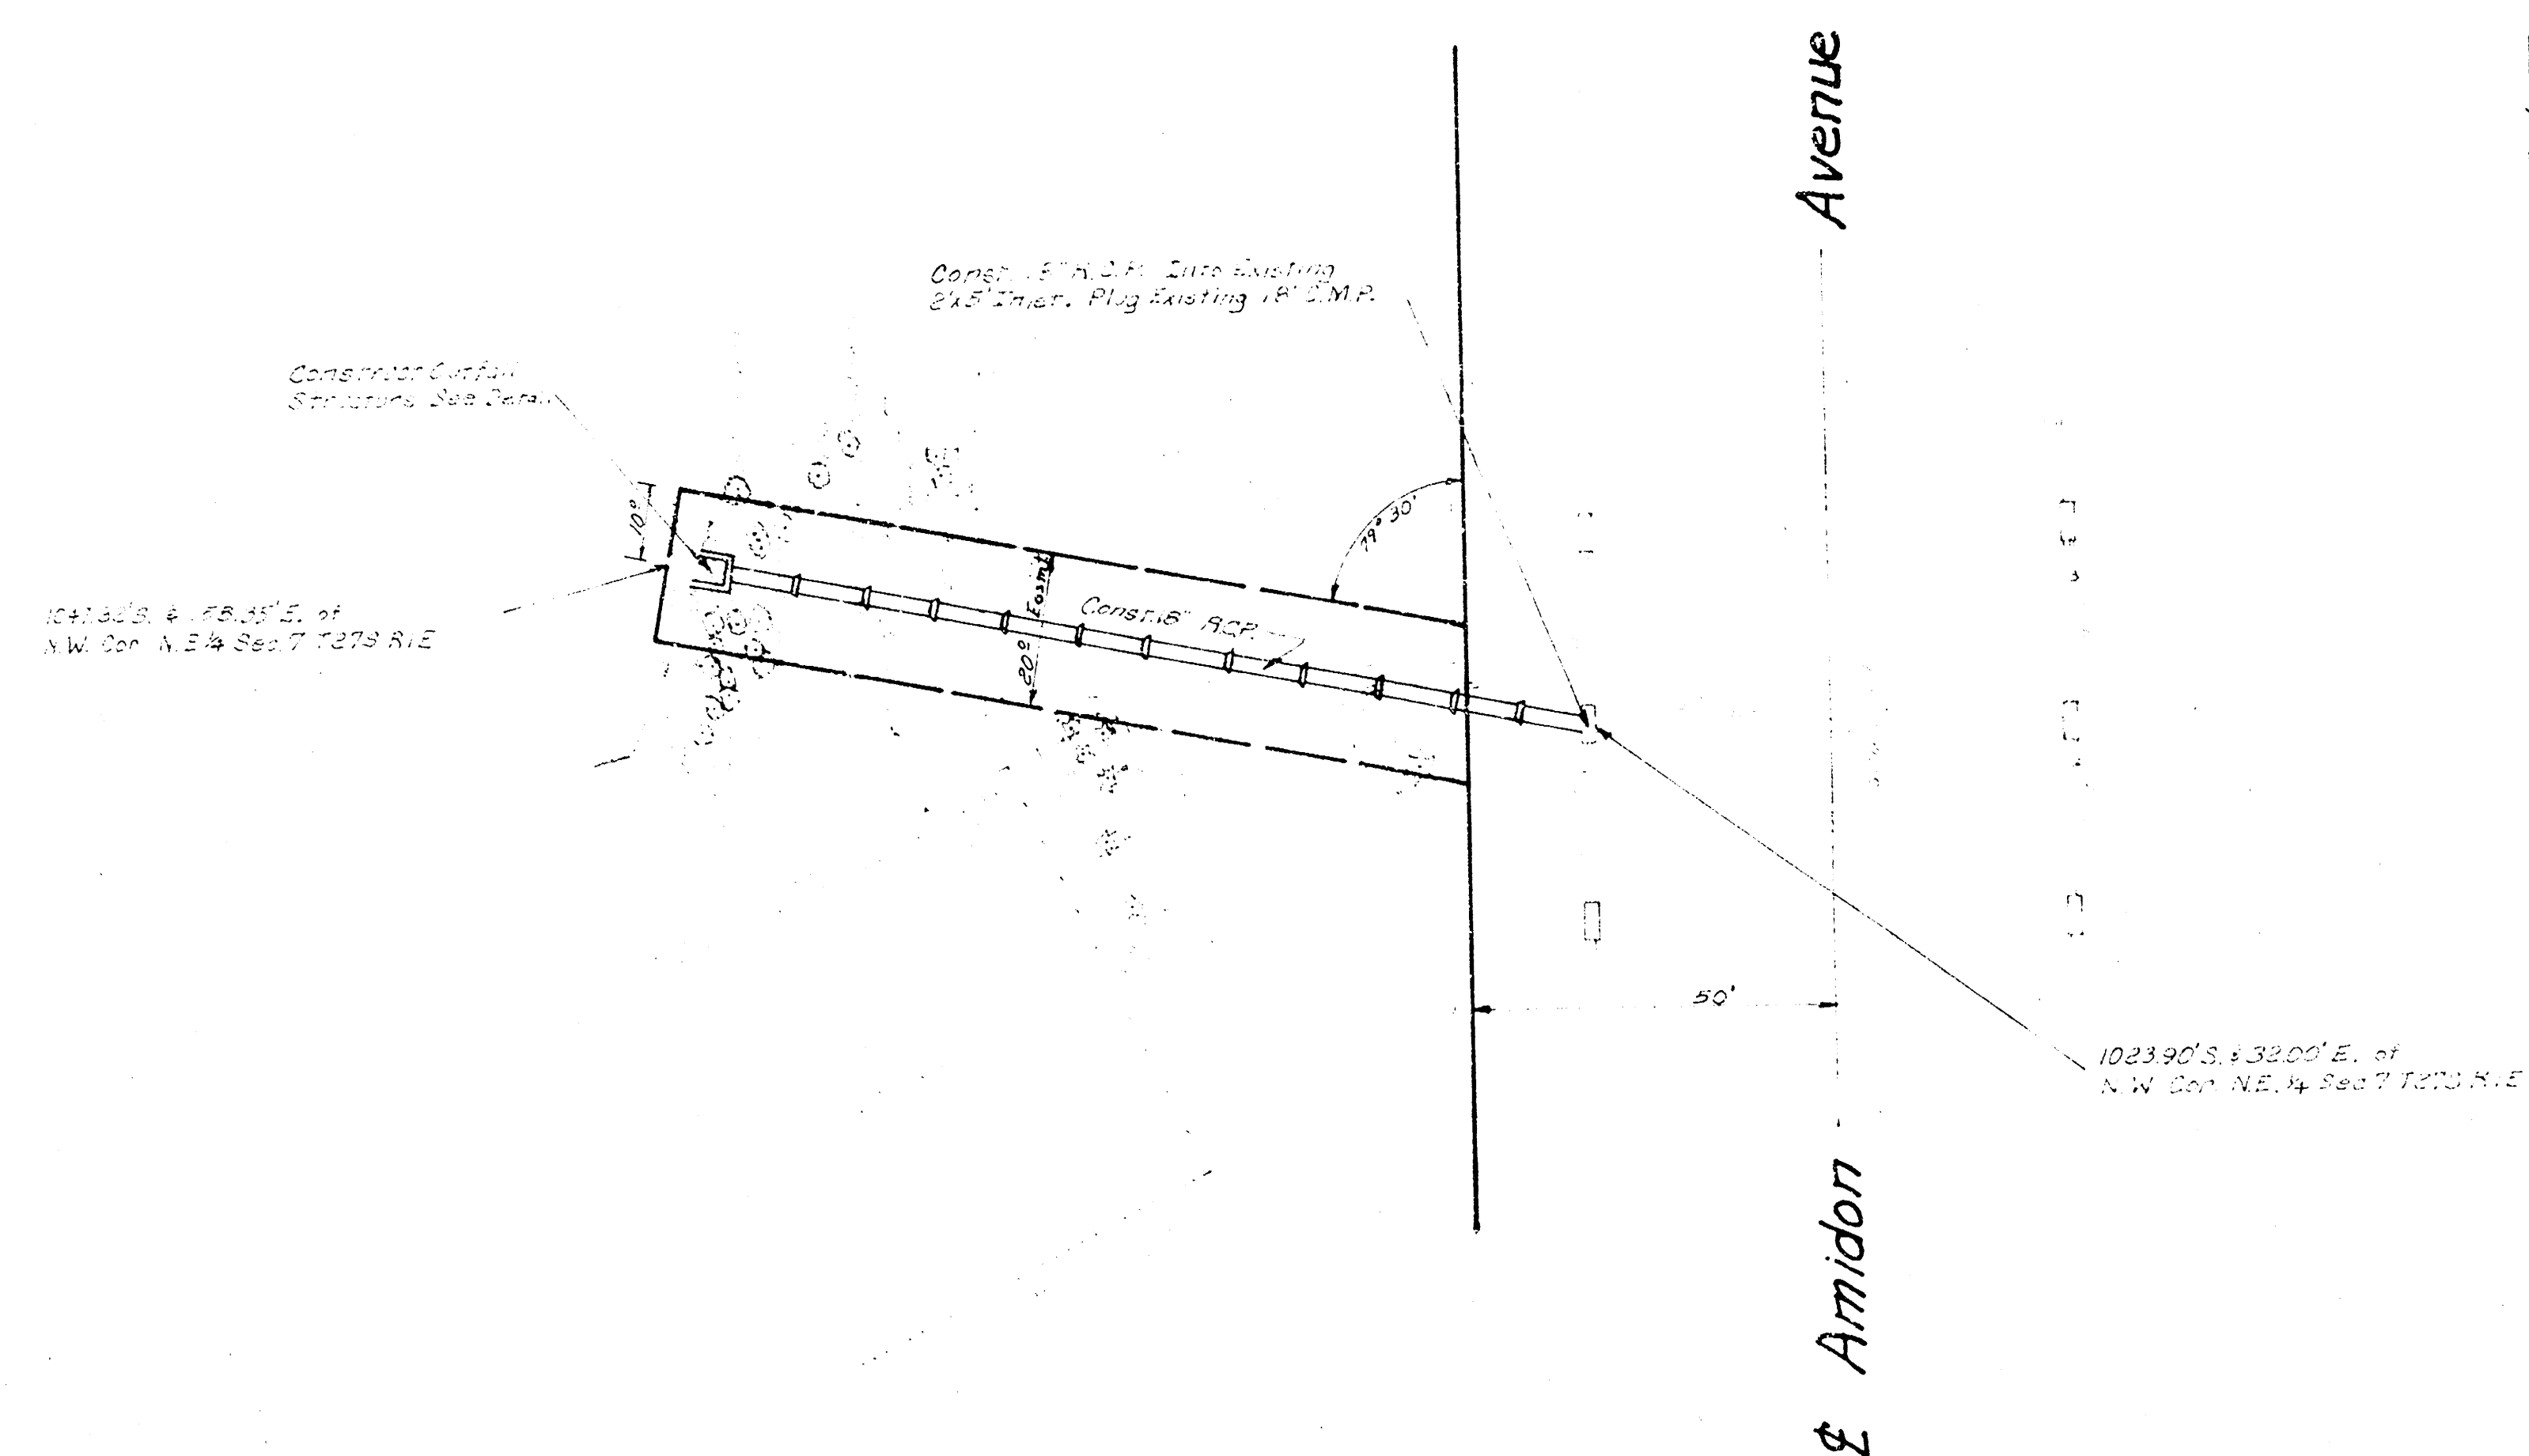


[illegible]

CONCRETE FOR CIRCULAR STRUCTURE SHALL BE
CLASS A/TYPE ONE CONCRETE WITH A MINIMUM
STRENGTH OF 4000 PSI. ALL REINFORCING STEEL SHALL
BE EPOXY COATED. THE MINIMUM TENSILE STRENGTH SHALL BE
60,000 PSI.

ALL REINFORCING STEEL SHALL BE #5 BARS.

ALL REINFORCING STEEL TEND CIRCULAR STRUCTURE
REINFORCED CONCREMENT SHALL BE 12" ON CENTER
CIRCULAR STRUCTURE.

ALL LAYS OF REINFORCING STEEL SHALL BE 12" ON CENTER
OF 20 BAR DIAMETERS.

RELOCATION OF EXISTING
DRAINAGE FACILITIES FOR
LAKEVIEW ESTATES 2ND ADD'N
CITY OF WICHITA, KANSAS
R. W. LINN, CITY ENGINEER
PRIVATE PROJECT
DATE: JULY 1977