

General Notes

- Utility service lines, poles, valve boxes, meters, etc. are to be adjusted as necessary by others prior to construction unless the plans specifically call for their adjustment by the Contractor or unless the plans specifically identify a utility to be adjusted by its owner during construction. Existing utilities and their location, as shown on the plans, represent the best information obtainable for design. The contractor will be required to work around existing utilities within the right-of-way which do not conflict with proposed construction.
- Rubble from the removal of miscellaneous structures and excess excavation which is to be wasted shall be disposed of on sites to be provided by the Contractor. These sites shall be approved by the Engineer as to suitability, appearance and site location. Locations that, in the opinion of the Engineer, will leave an unsightly appearance will not be approved. All disposal sites must be approved by the Kansas Department of Health and Environment. Material either stockpiled or disposed of in a flood plain would require a Kansas State Board of Agriculture permit. Any material dumped in waters of the United States or wetlands is subject to U.S. Corps of Engineers permitting regulations. Any material buried or stockpiled beyond approved construction limits would require additional archaeological investigations unless buried in a previously approved borrow location.
- Trees and shrubs in public right-of-way which are in direct conflict with proposed new construction shall be removed by the Contractor with the Engineer's approval. Trees and shrubs which are not in direct conflict with proposed new construction shall be saved and protected from damage.
- The Contractor shall be responsible for preserving property lines. The Contractor will be required to re-establish any property lines which are damaged or destroyed by his construction operations. Such lines shall be re-established by a licensed land surveyor in accordance with state laws.
- Traffic affected by construction on this project shall be handled in accordance with the latest edition of the Manual on Uniform Traffic Control Devices subject to approval by the Engineer. Traffic to be maintained on Ridge Road thru construction.
- All areas disturbed by construction shall be seeded with ryegrass immediately following construction in that area. Seed shall be applied at the rate of 350# per acre.
- Contractor will be required to provide notice to utility companies a minimum of twenty-four (24) hours prior to any excavation, as follows:
Kansas One-Call 687-2470
The Contractor must notify the following in case of an emergency:
Cablevision 262-4270
or 263-2081
K.P.L. Gas Service Company 263-7311
Kansas Gas & Electric Company 264-1141
Arkla Gas Company 942-8350
or 263-8161
Southwestern Bell Telephone Company 1-571-2611
City of Wichita Water Department 268-4908
City of Wichita Sewer Maintenance 268-4071
- The Contractor shall notify pipeline companies at least 24 hours in advance of any work being performed.
- All work shall conform to the specifications for stormwater sewer construction for the City of Wichita.
- The Contractor may elect to bore and jack the proposed 36" storm sewer across Ridge Road instead of the proposed cut and cover method; however, no adjustments in the contract unit items, quantities, or prices bid shall be allowed.
- The Contractor may elect to use aluminum steel pipe in place of reinforced concrete pipe. Use of such pipe shall be in accordance with City of Wichita specifications and subject to the City's approval. No adjustments in the contract unit items, quantities, or prices bid shall be allowed for the alternate use of aluminum steel pipe.
- All excavation dewatering costs shall be subsidiary to the bid items.
- Contractor to coordinate construction of Line 2 Type 1A inlet with site contractor for Lot 4. Contact Jerry Dieter 263-4557.

STORMWATER SEWER NO. 450 - PHASE 1 TO SERVE

LAKERIDGE COMMERCIAL 2ND ADDITION

Project Number


468-76-245-82878-000-000-001

Index Code

750804

CITY OF WICHITA, KANSAS


Michael E. Lindebak, City Engineer

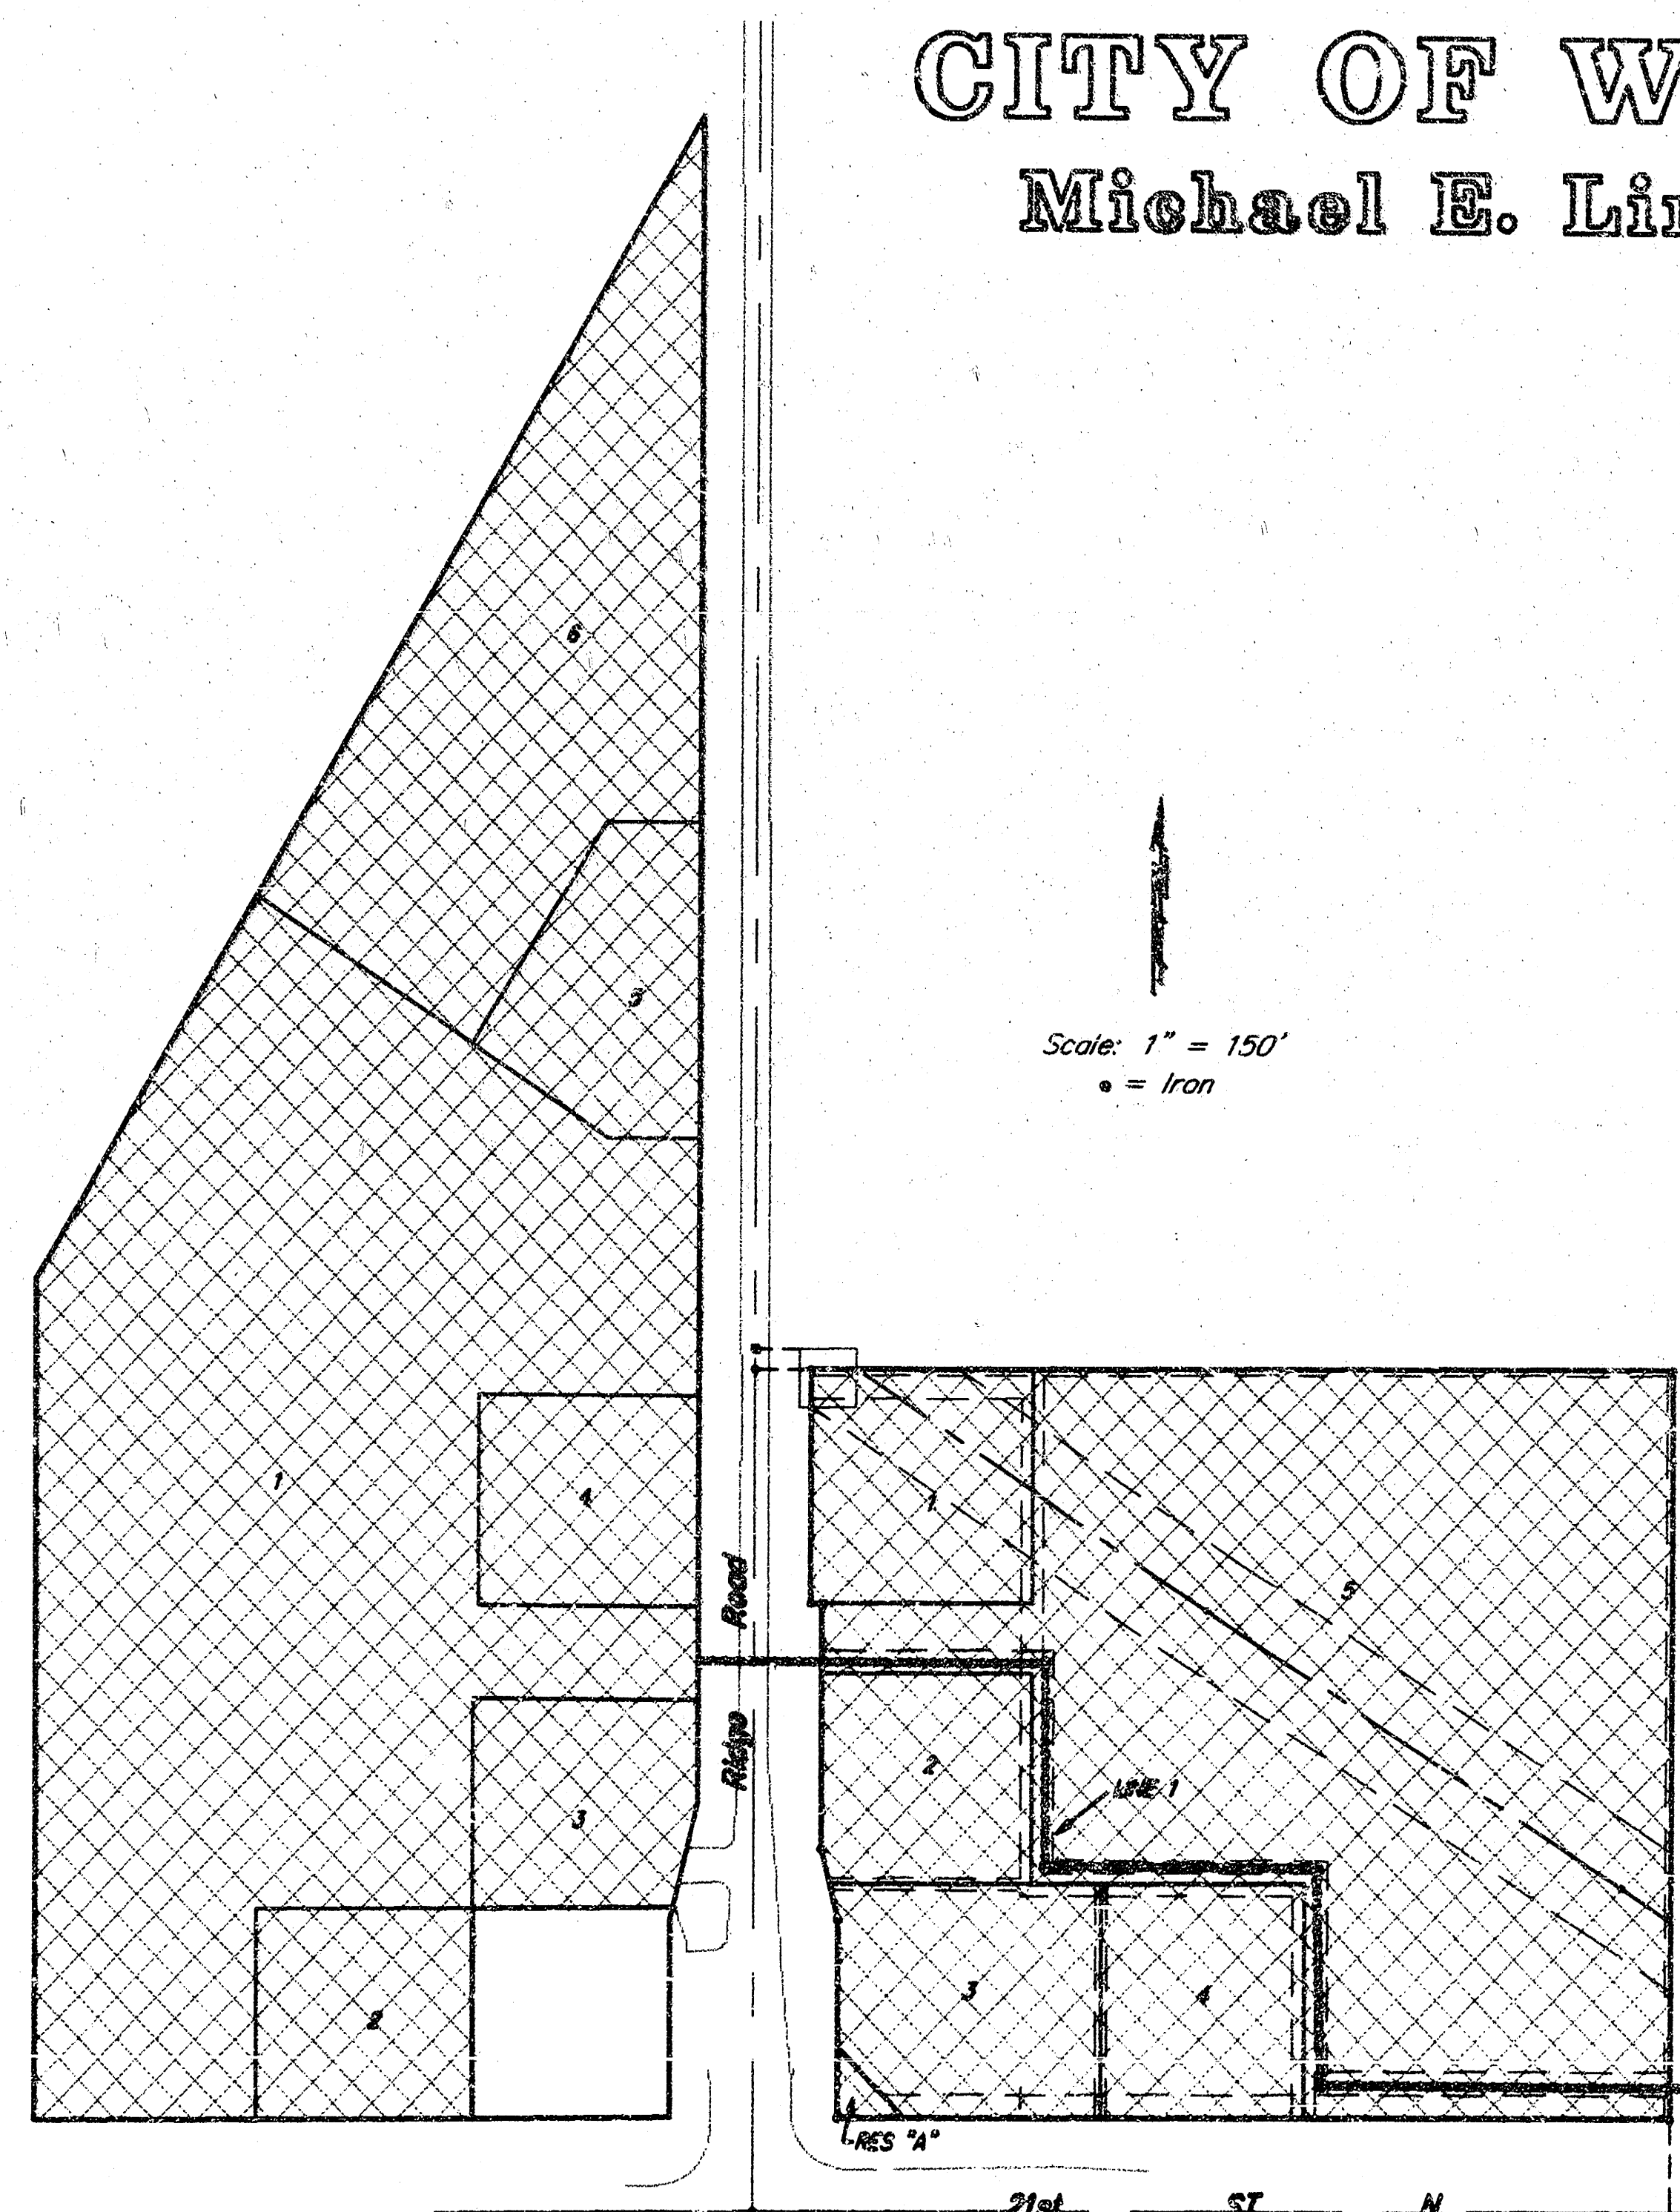

INDEX:

- | | |
|-----|-----------------|
| 1 | Title Sheet |
| 2-4 | Plan Sheets |
| 5-7 | Typical Details |
| 8 | Copy of Plot |

Benefit District:





BOOKED
7-24-95
MCG
D-258



LR/SW/SCOV

BAUGHMAN COMPANY P. A.
ENGINEERING SURVEYING & PLANNING
316/262-7271 • 315 ELLIS • WICHITA, KANSAS 67211

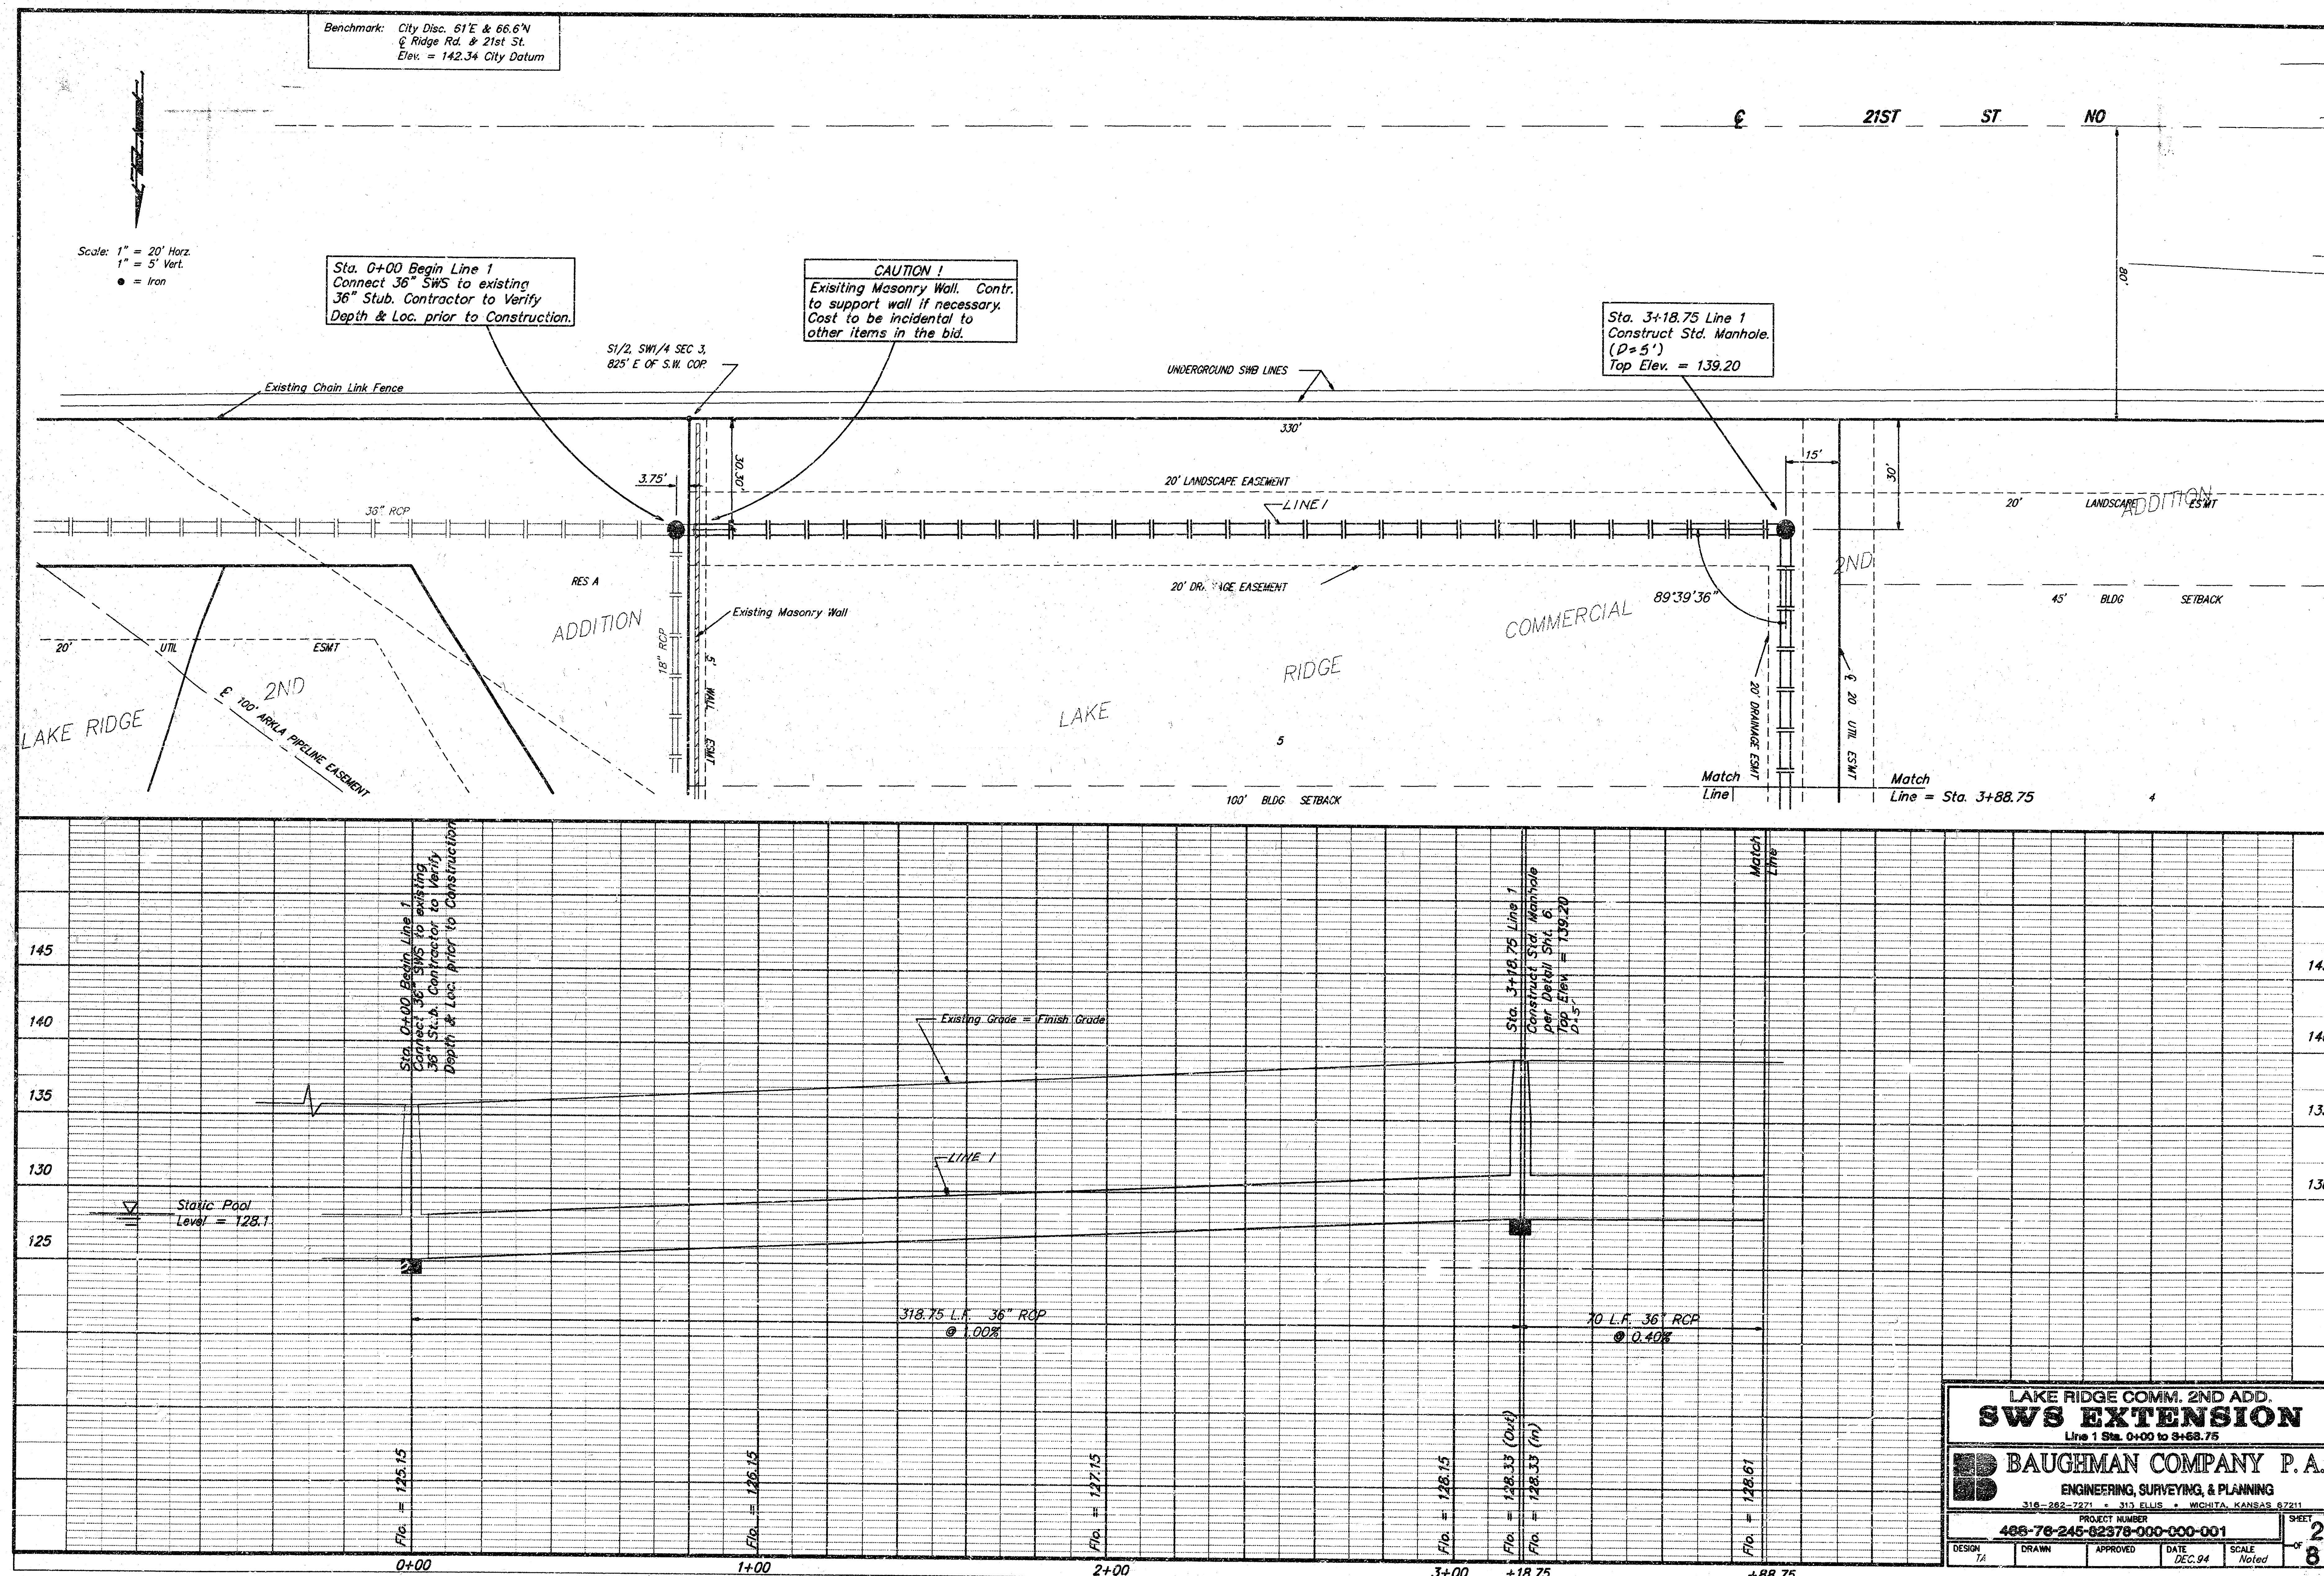

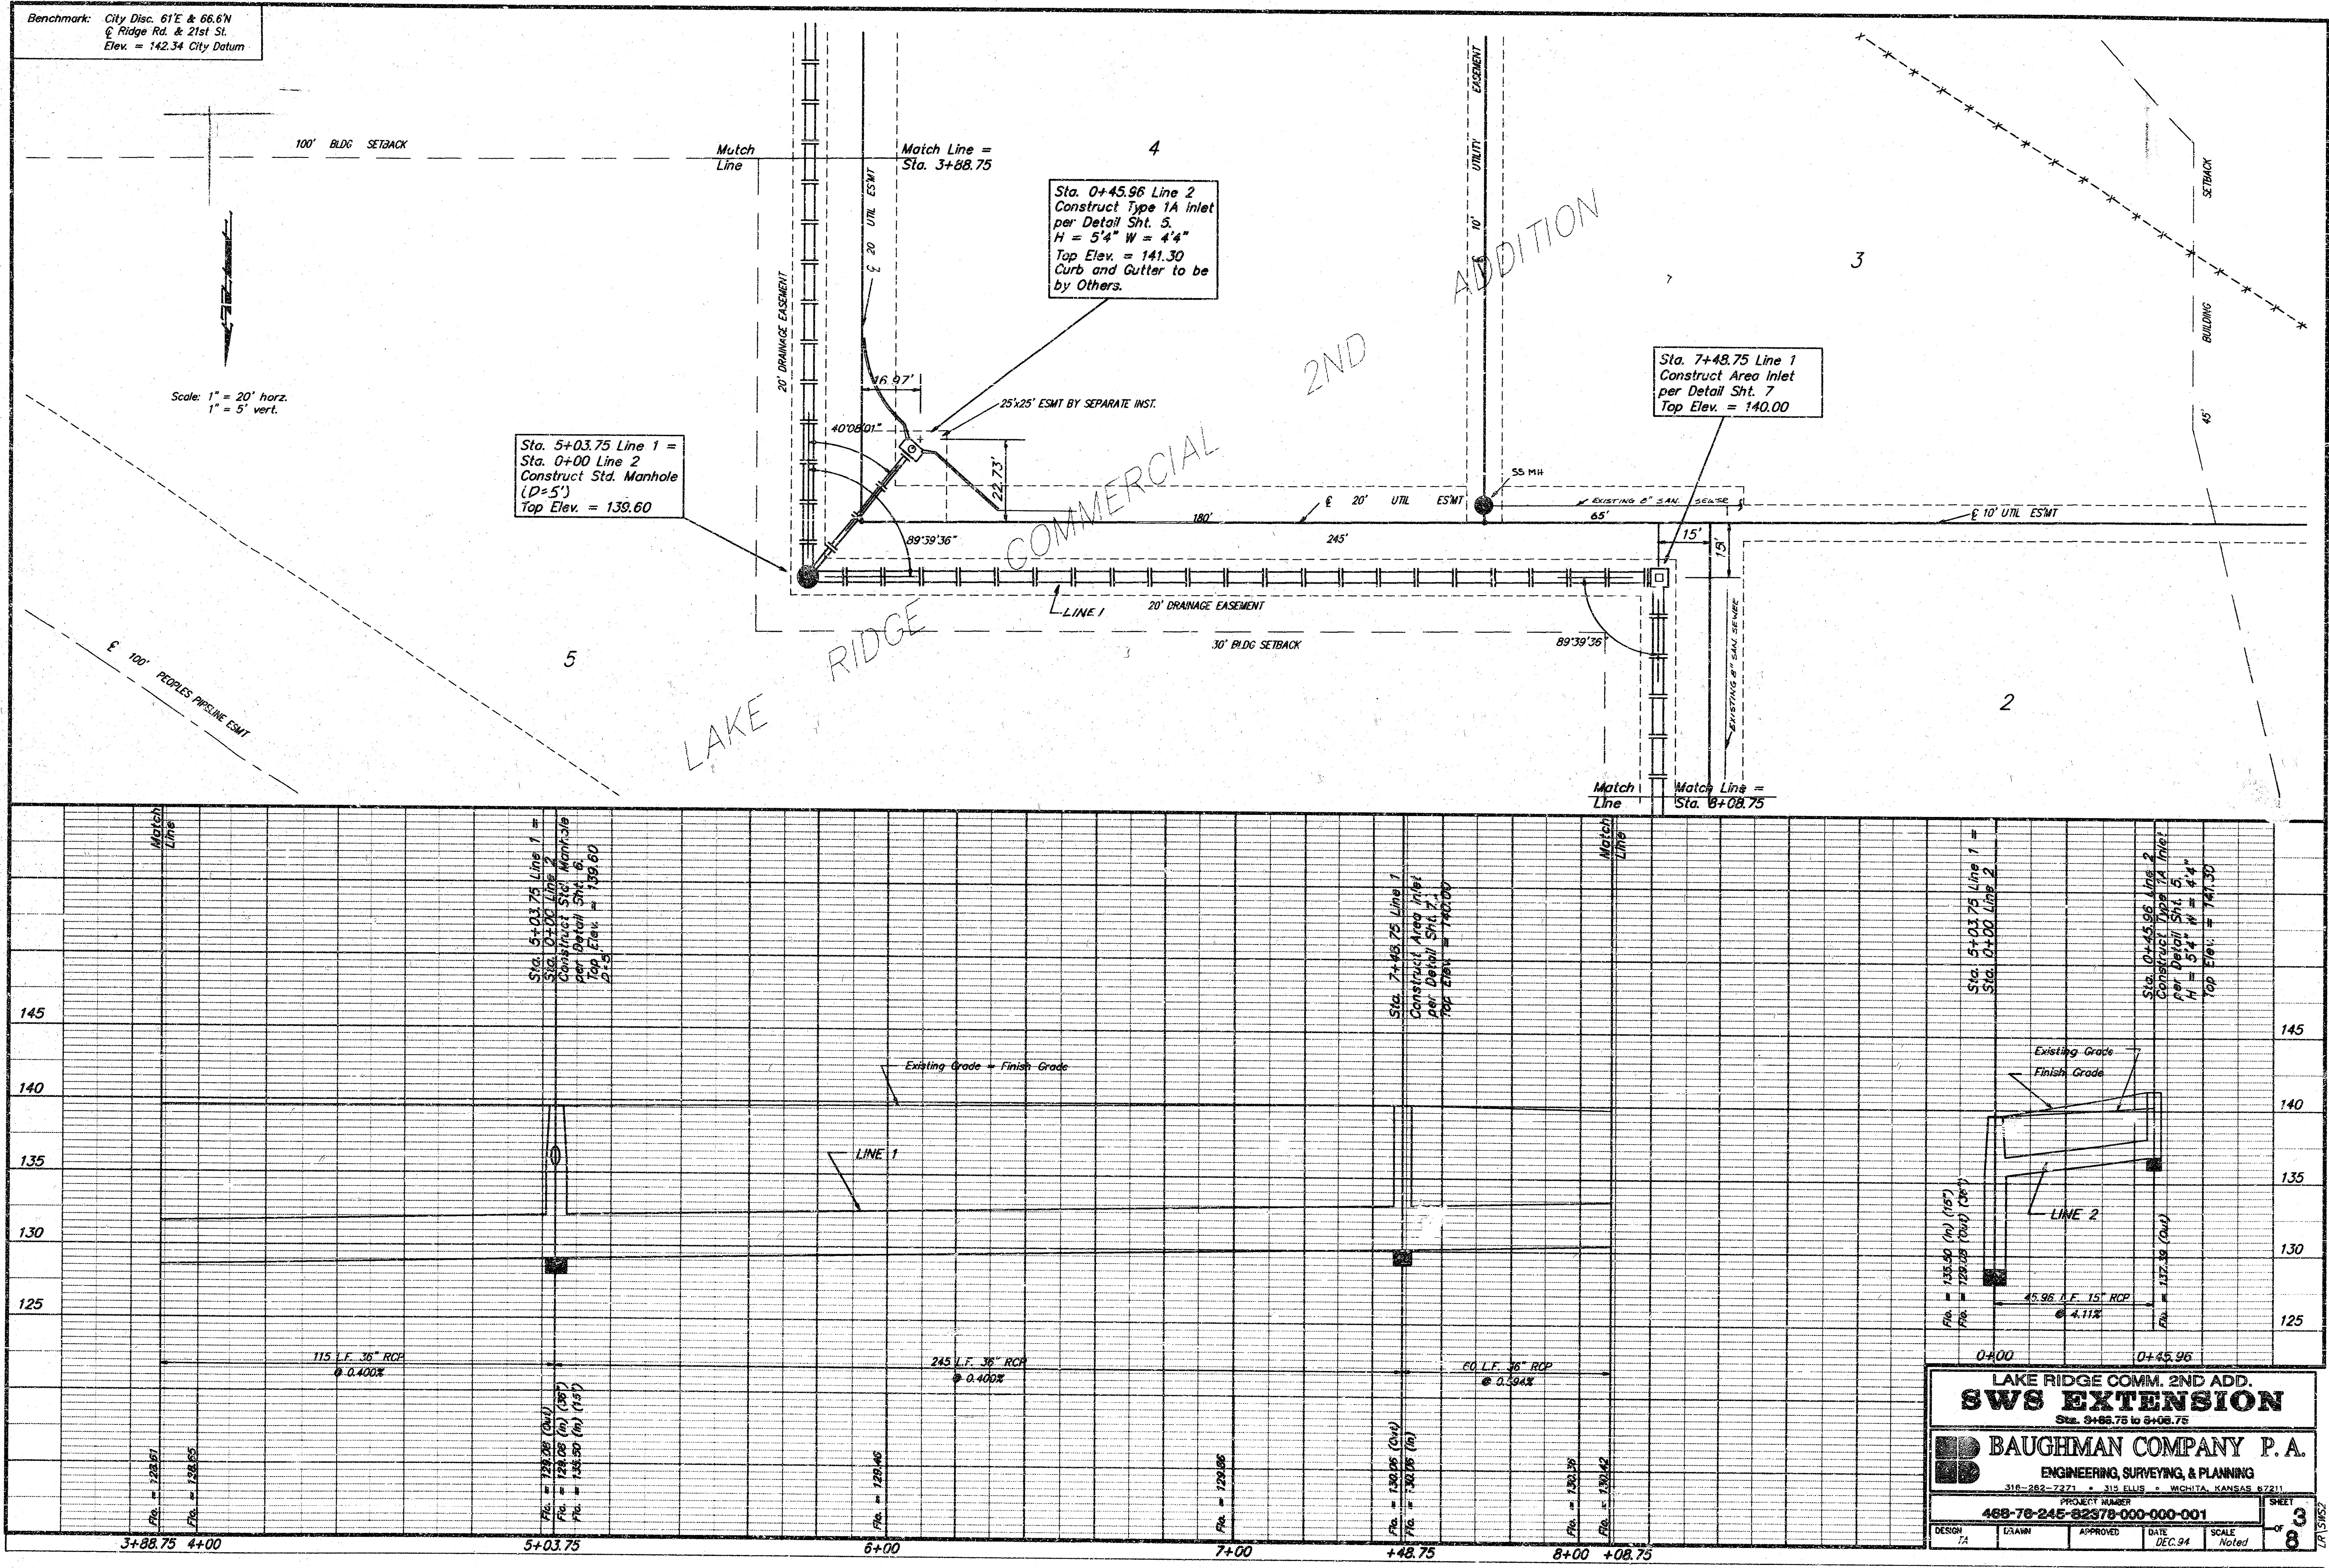

LAKE RIDGE COMM. 2ND ADD.
SWS EXTENSION
Sta. 3+88.75 to 8+08.75

BAUGHMAN COMPANY P.A.
ENGINEERING, SURVEYING, & PLANNING
318-282-7271 • 315 ELLIS • WICHITA, KANSAS 67211



PROJECT NUMBER
488-76-245-82378-000-001

DESIGN 1/1
DATE DEC. 94
SCALE Noted

SHEET
3
OF
8

Benchmark: City Disc. 61'E & 66.6"N
 @ Ridge Rd. & 21st St.
 Elev. = 142.34 City Datum

Scale: 1" = 20' Horz.
 1" = 5' Vert.
 • = Iron

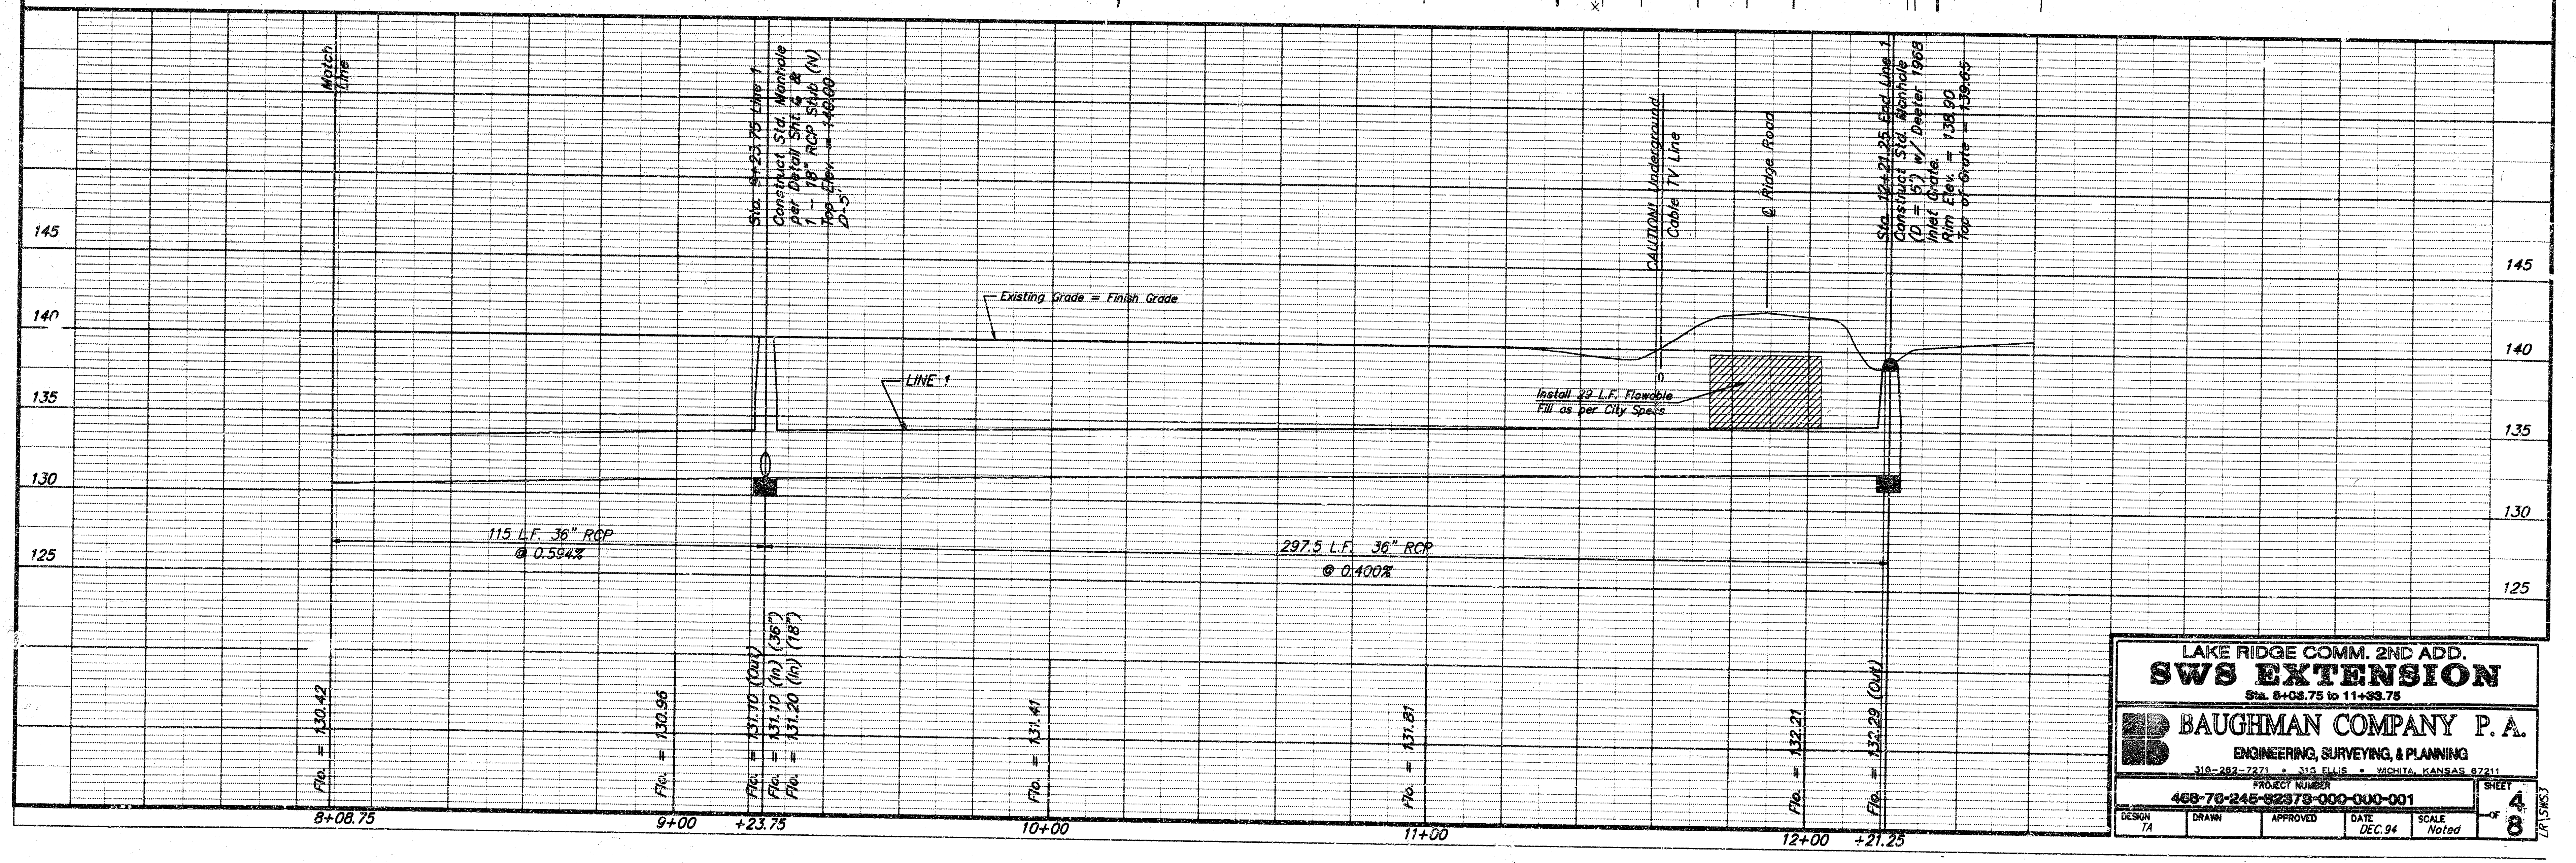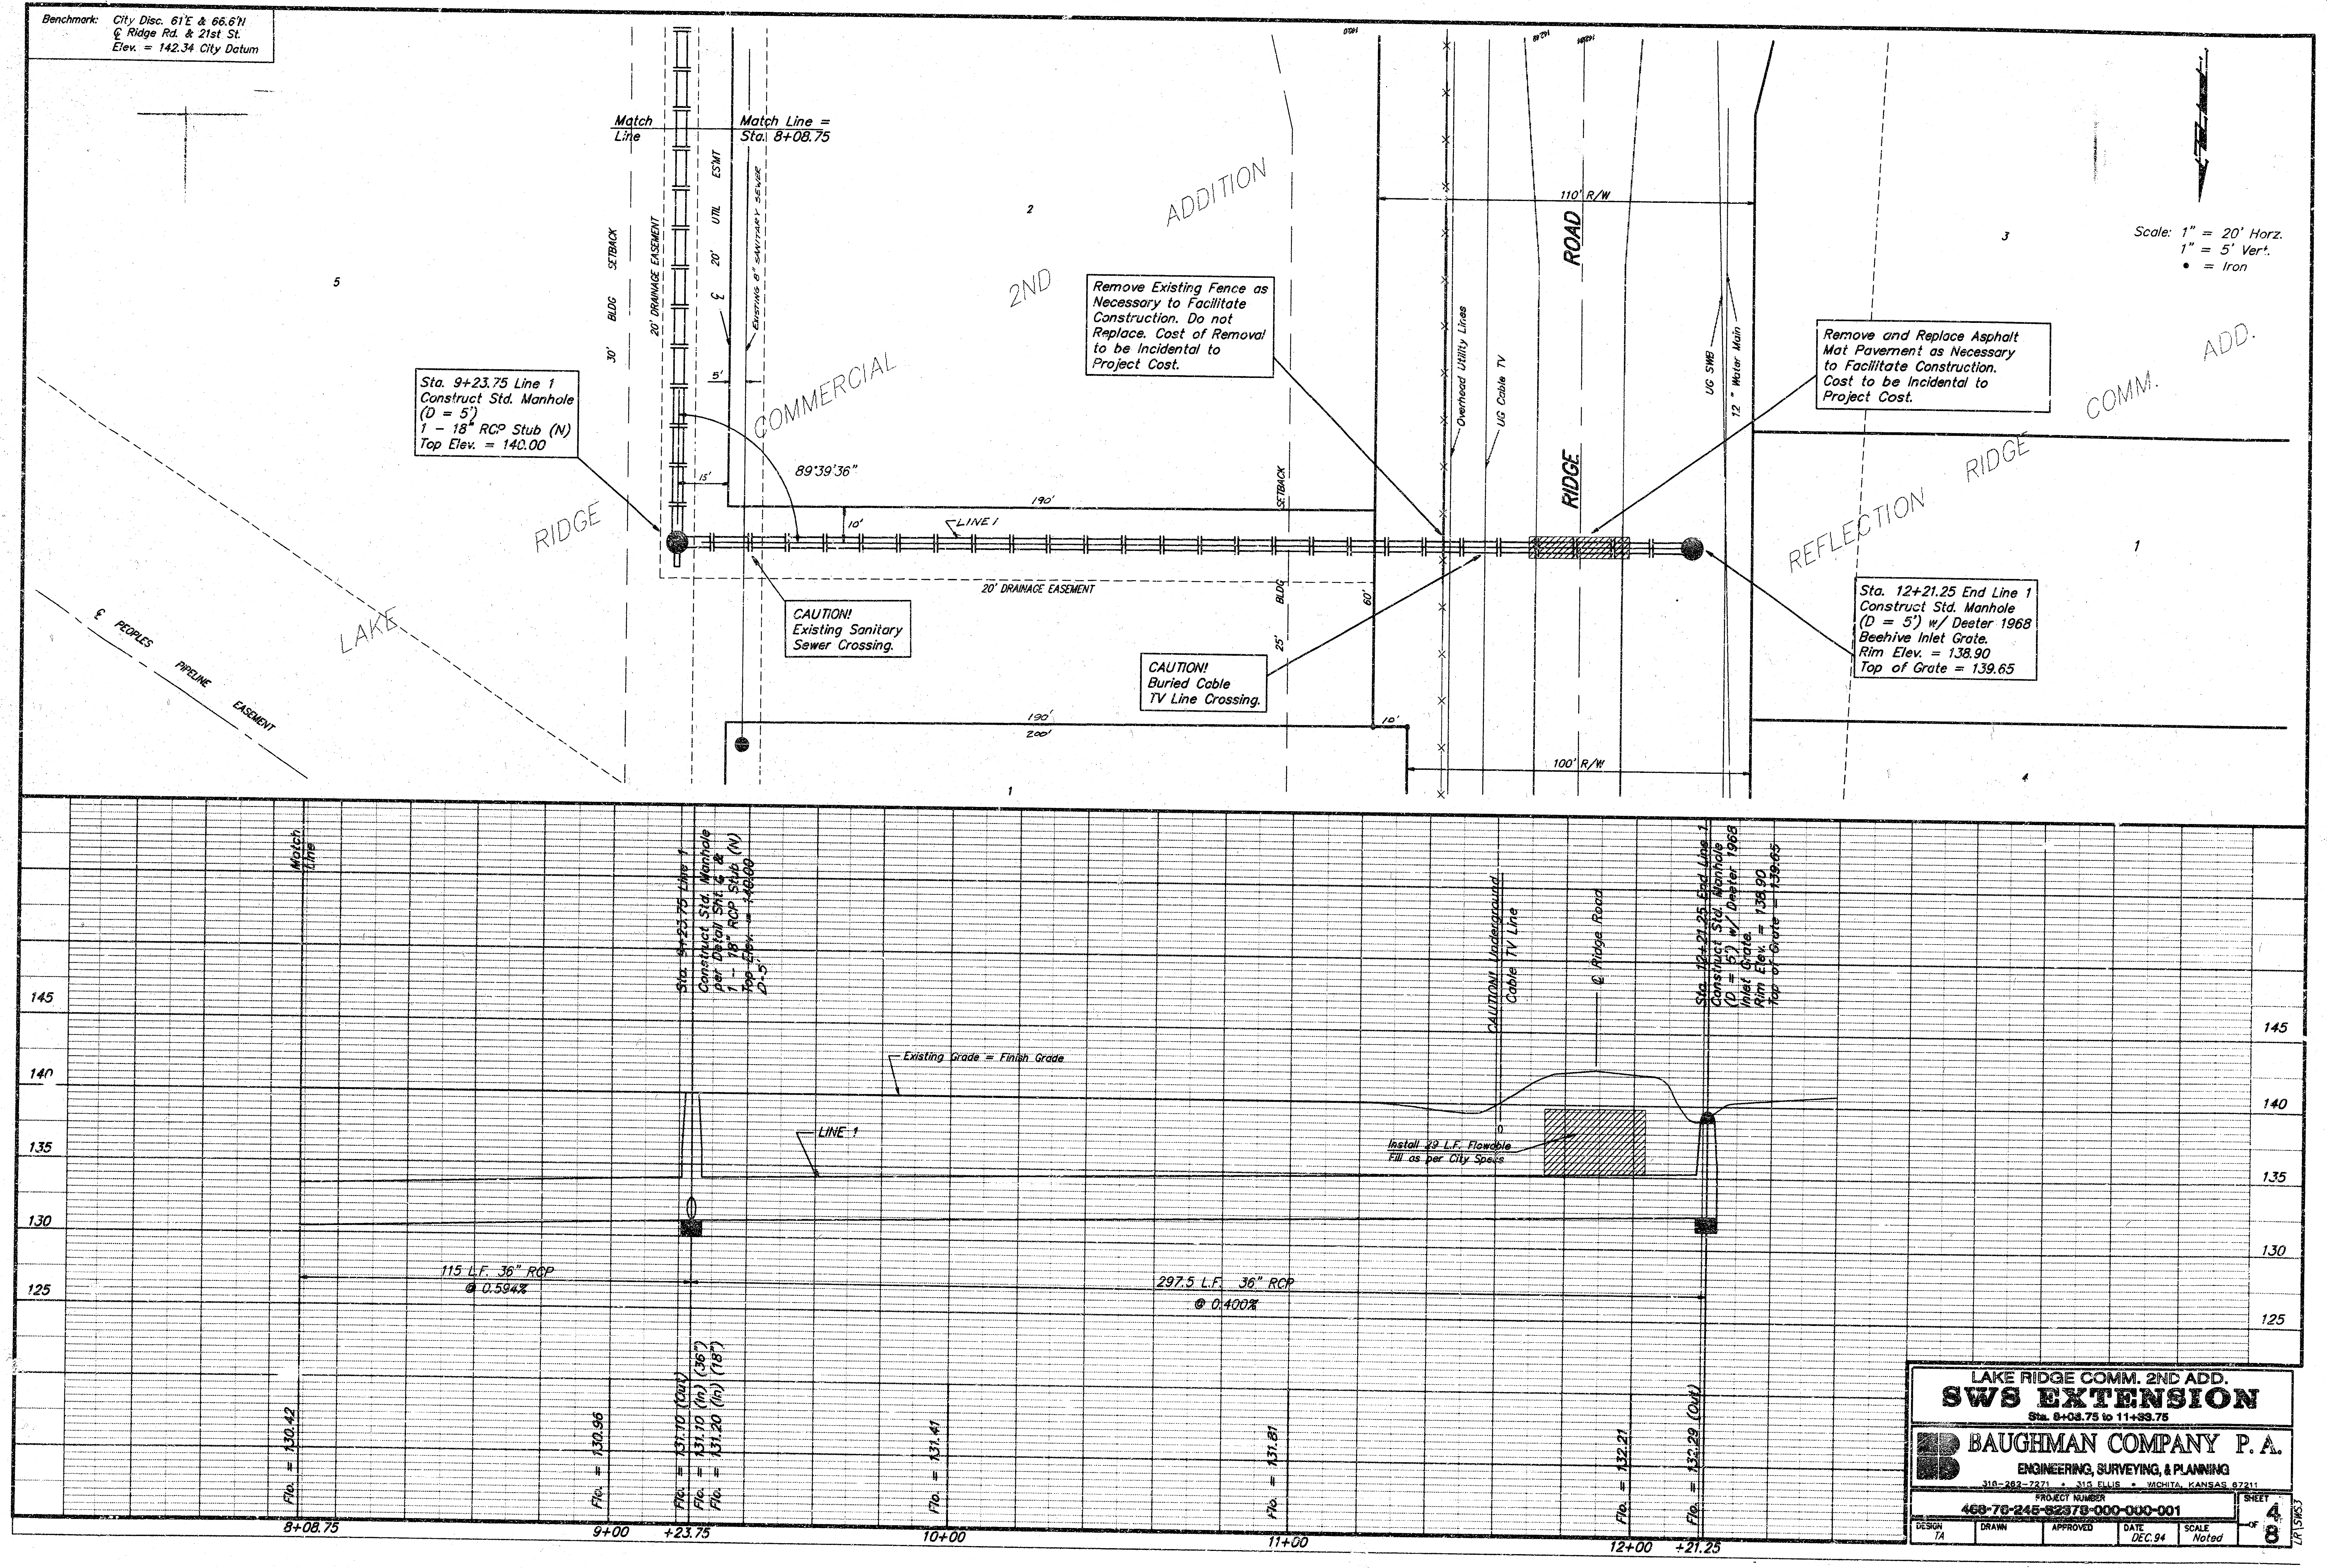


LAKE RIDGE COMM. 2ND ADD.
SWS EXTENSION
 Sta. 8+08.75 to 12+21.25

BAUGHMAN COMPANY P. A.
 ENGINEERING, SURVEYING, & PLANNING
 310-262-7271 • 310 ELLIS • MOHITA, KANSAS 67211

PROJECT NUMBER: 469-70-245-82378-000-000-001


DESIGN	DRAWN	APPROVED	DATE	SCALE
1A			DEC. 94	Noted

SHEET 4 OF 8

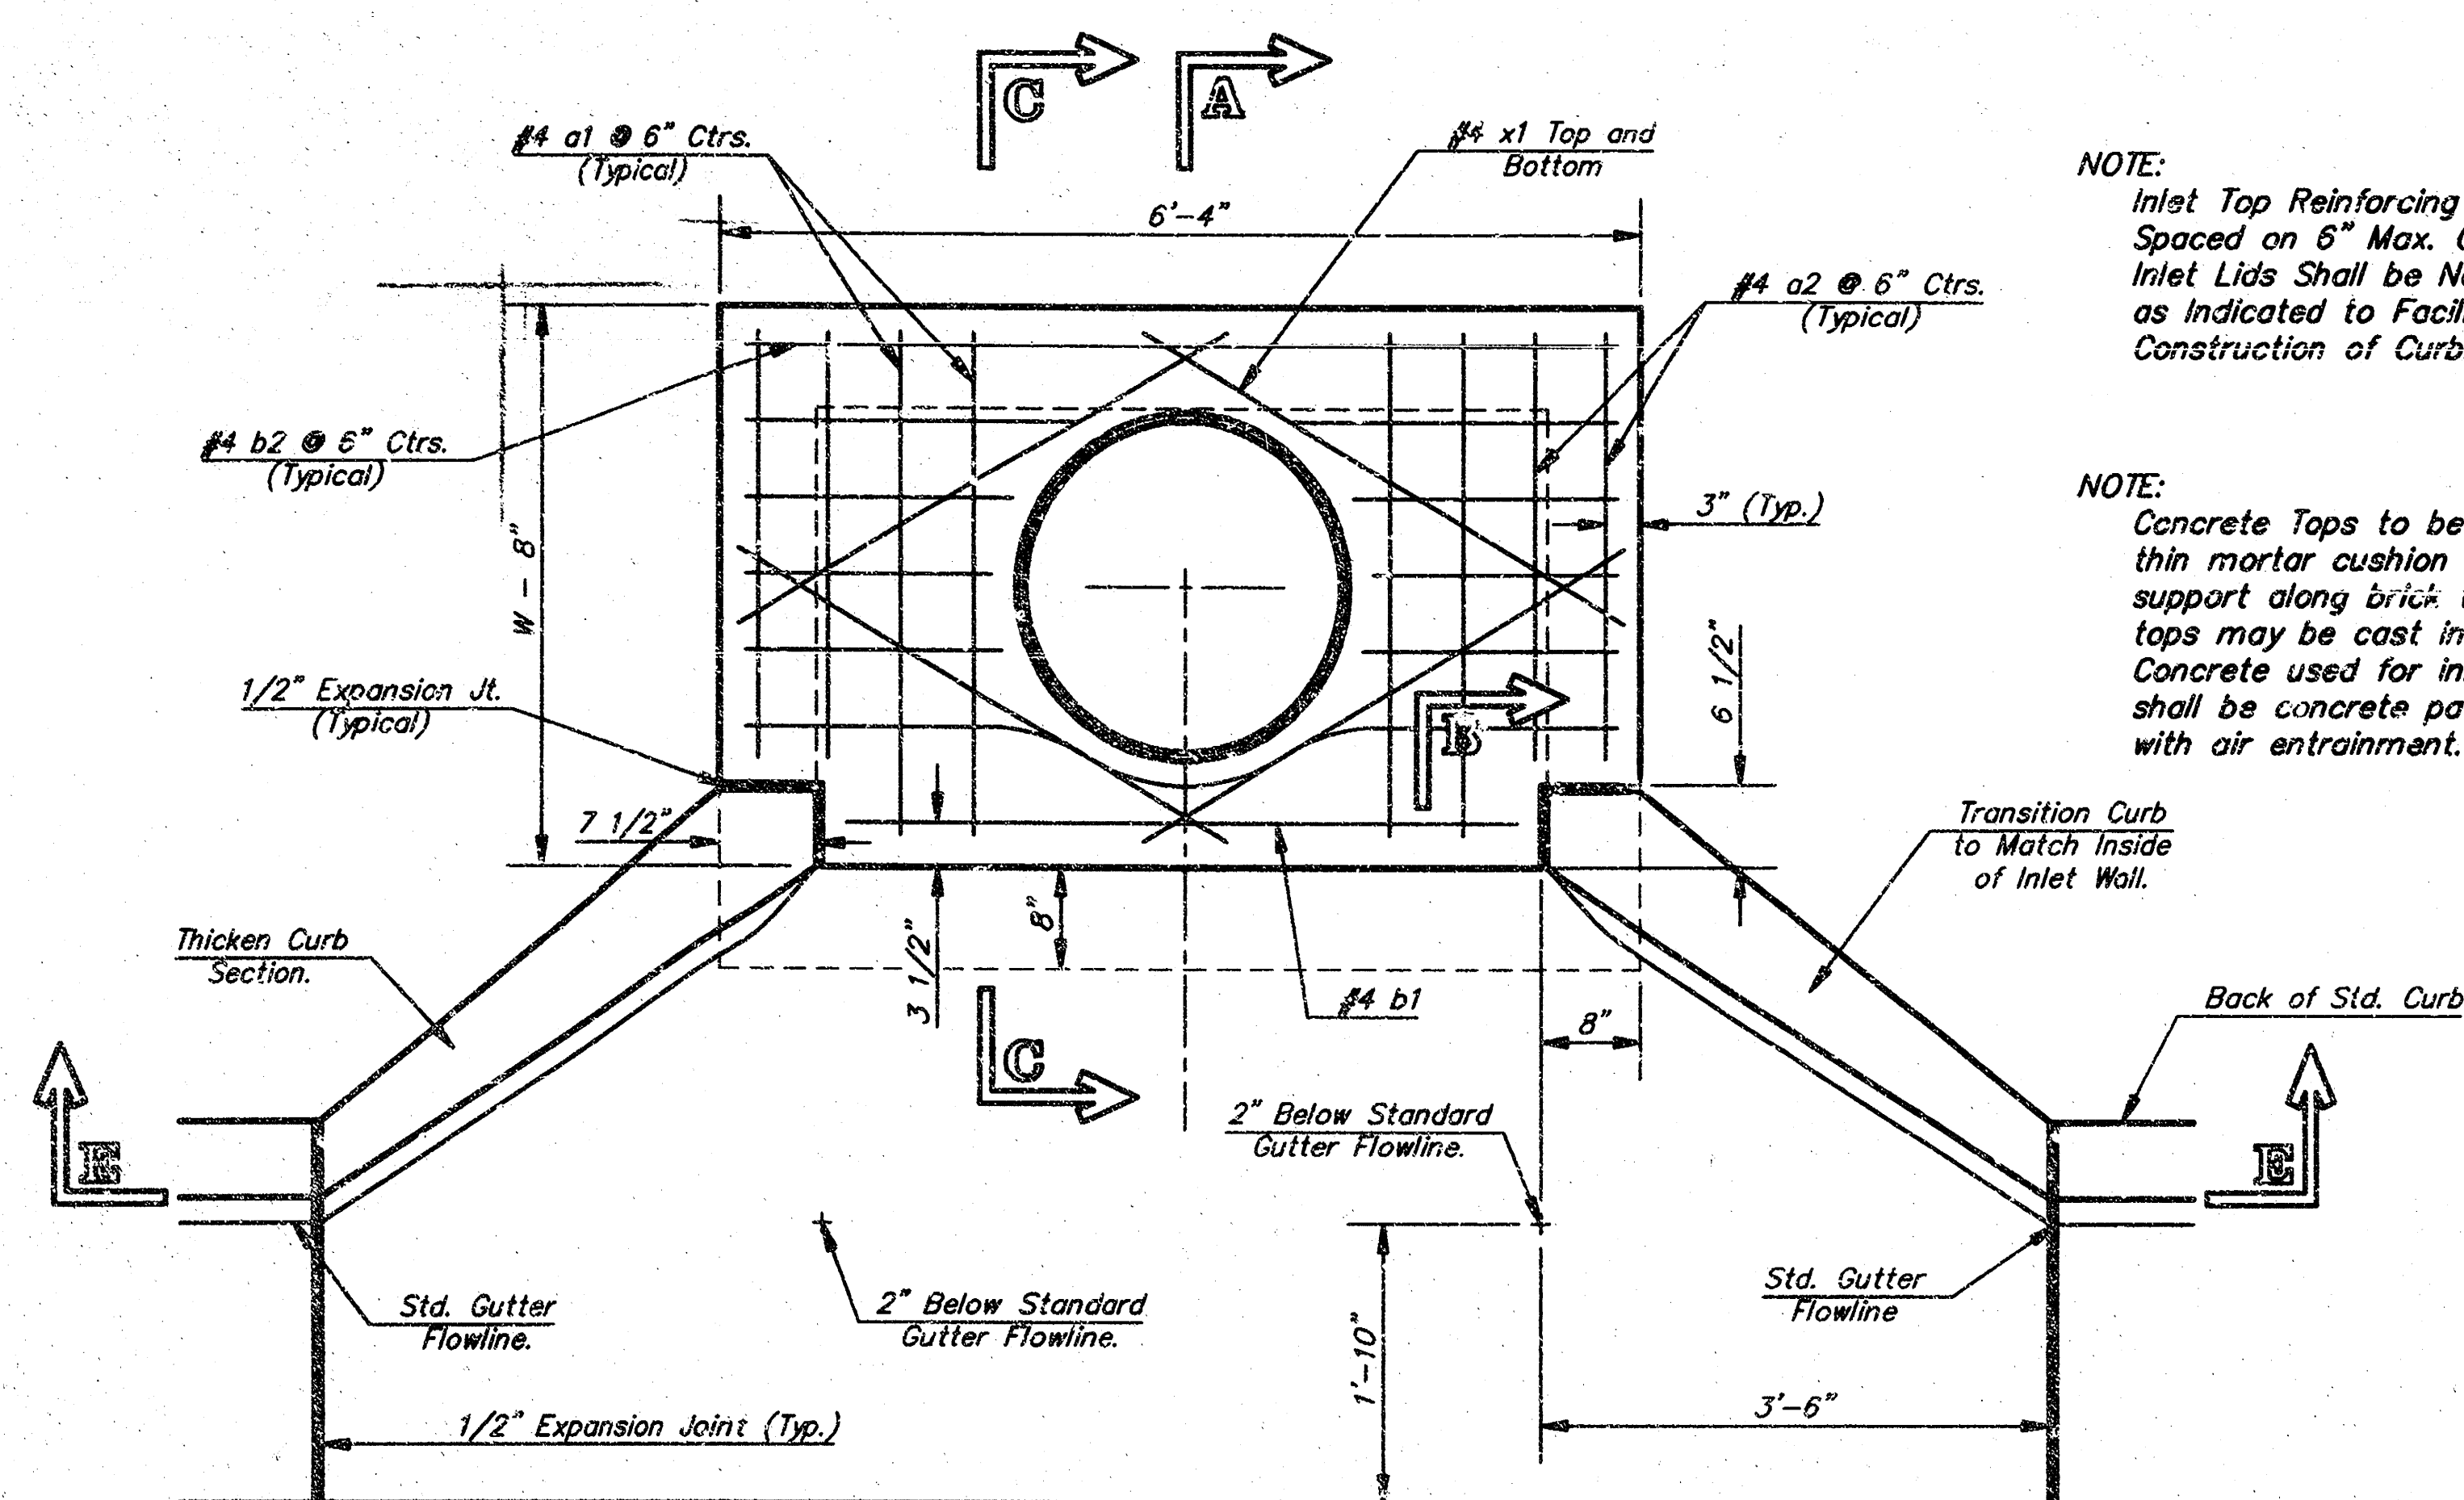


NOTE: Expansion Joint Only in Curb Area With Concrete Pavement.

PLAN

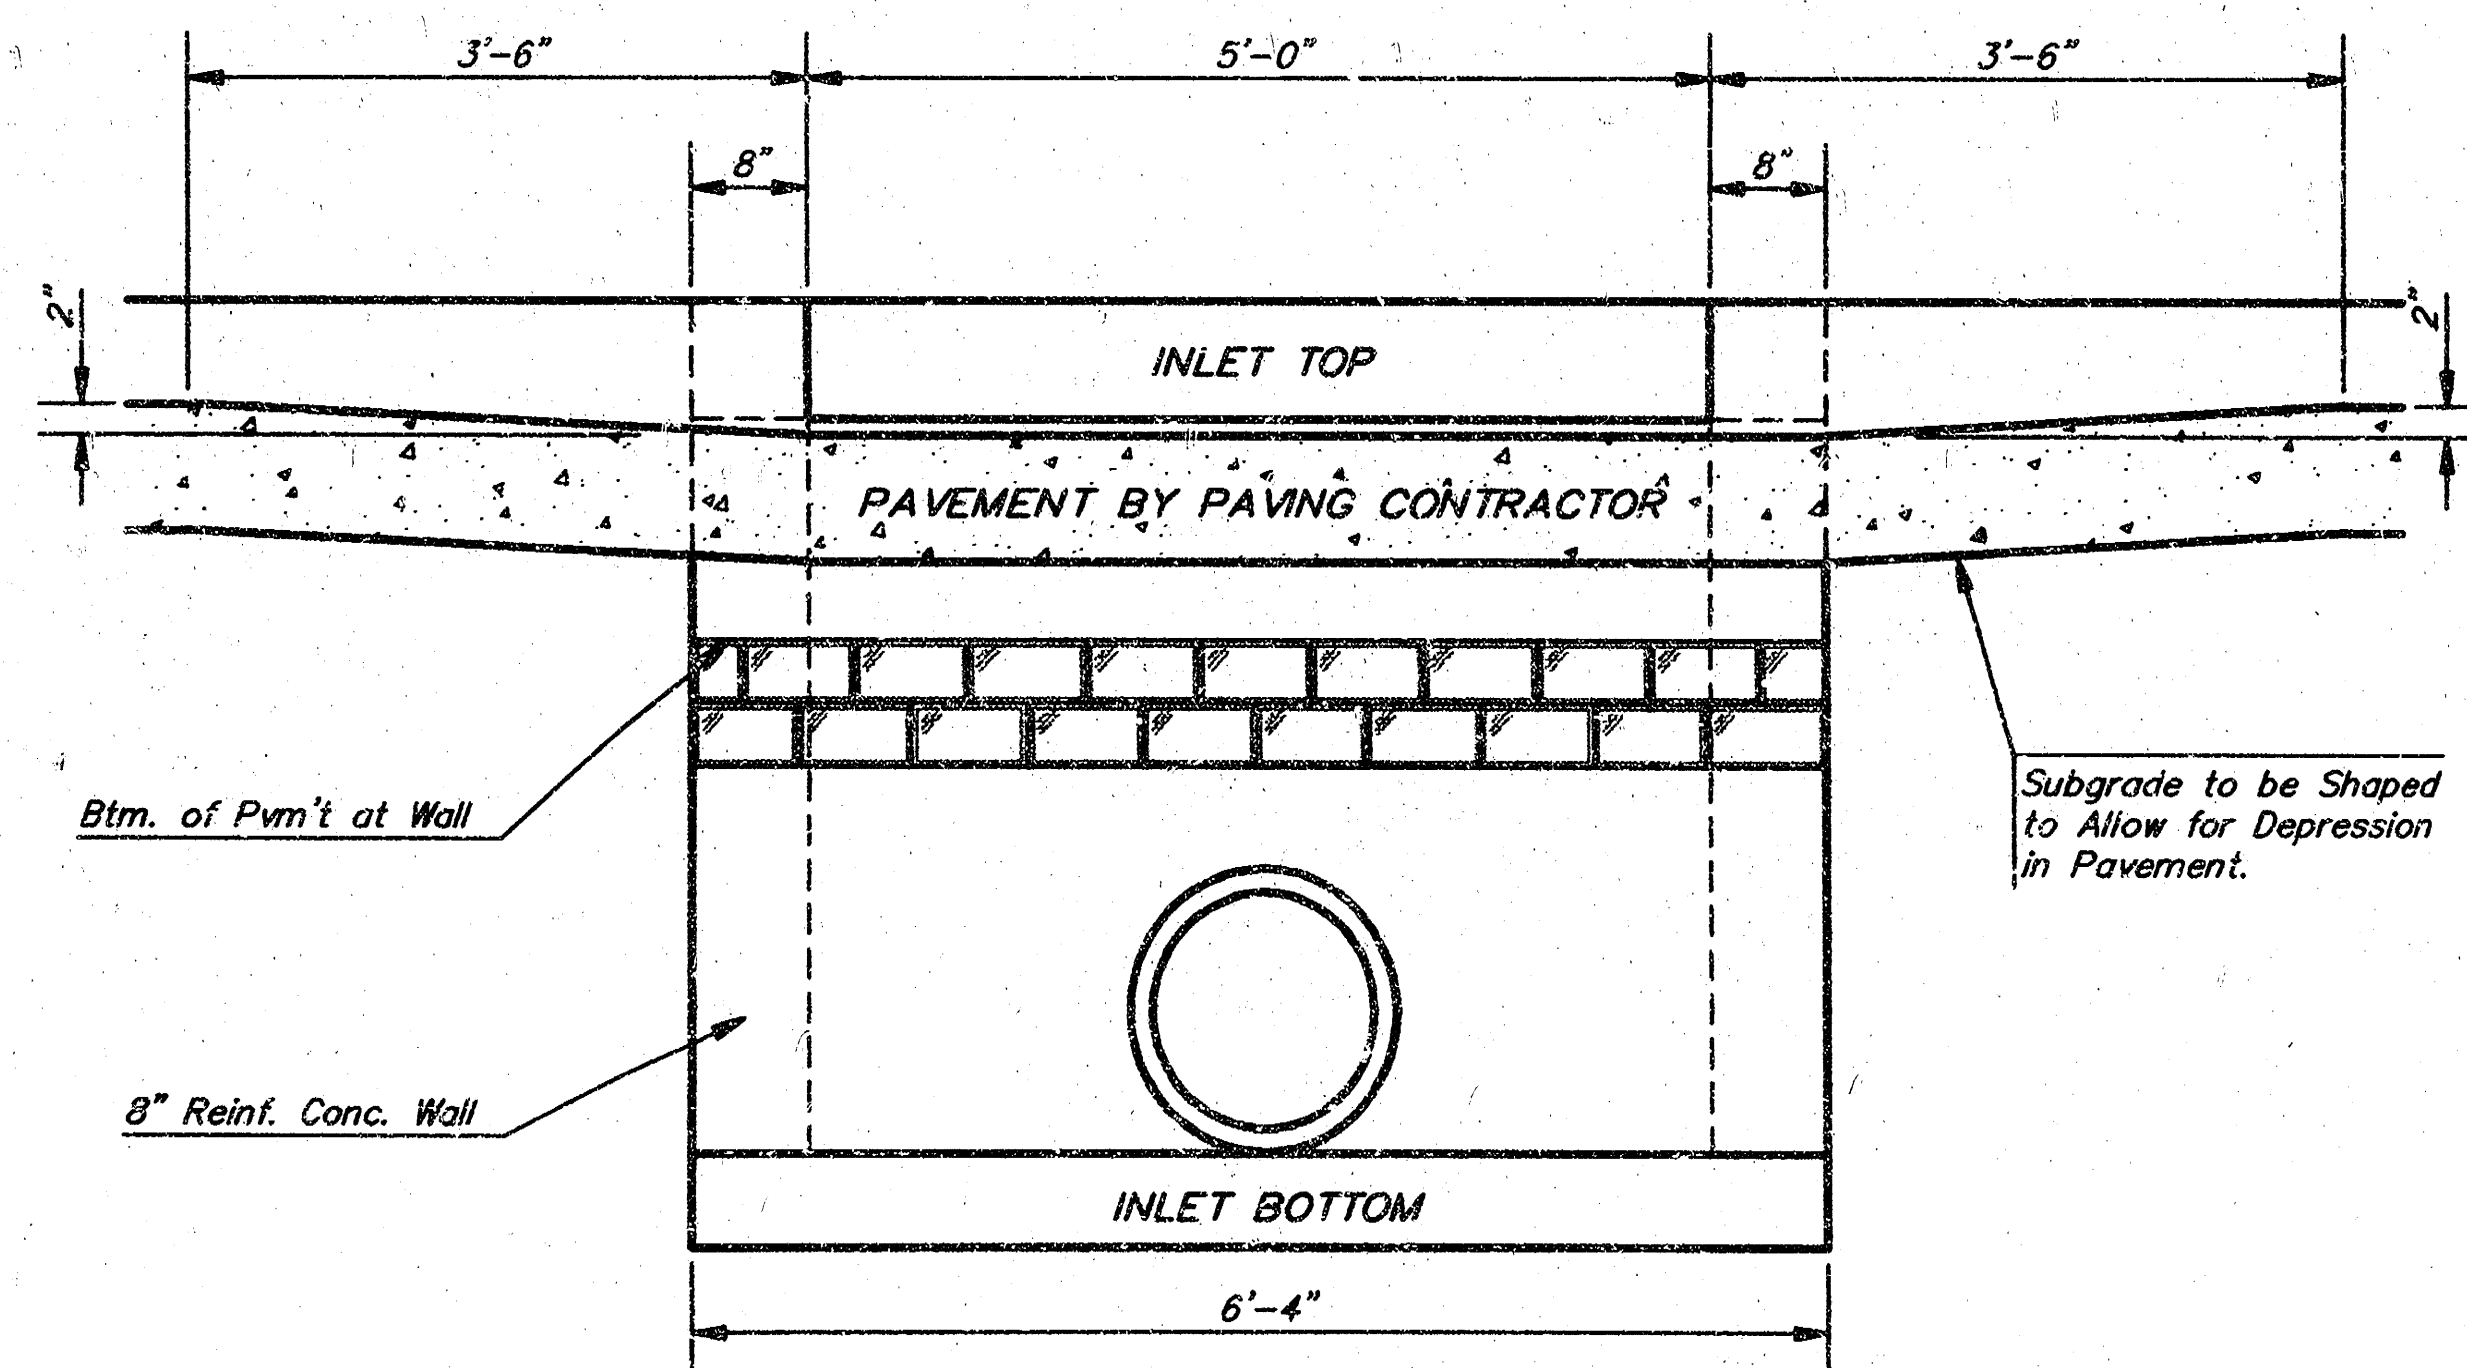

SECTION E-E

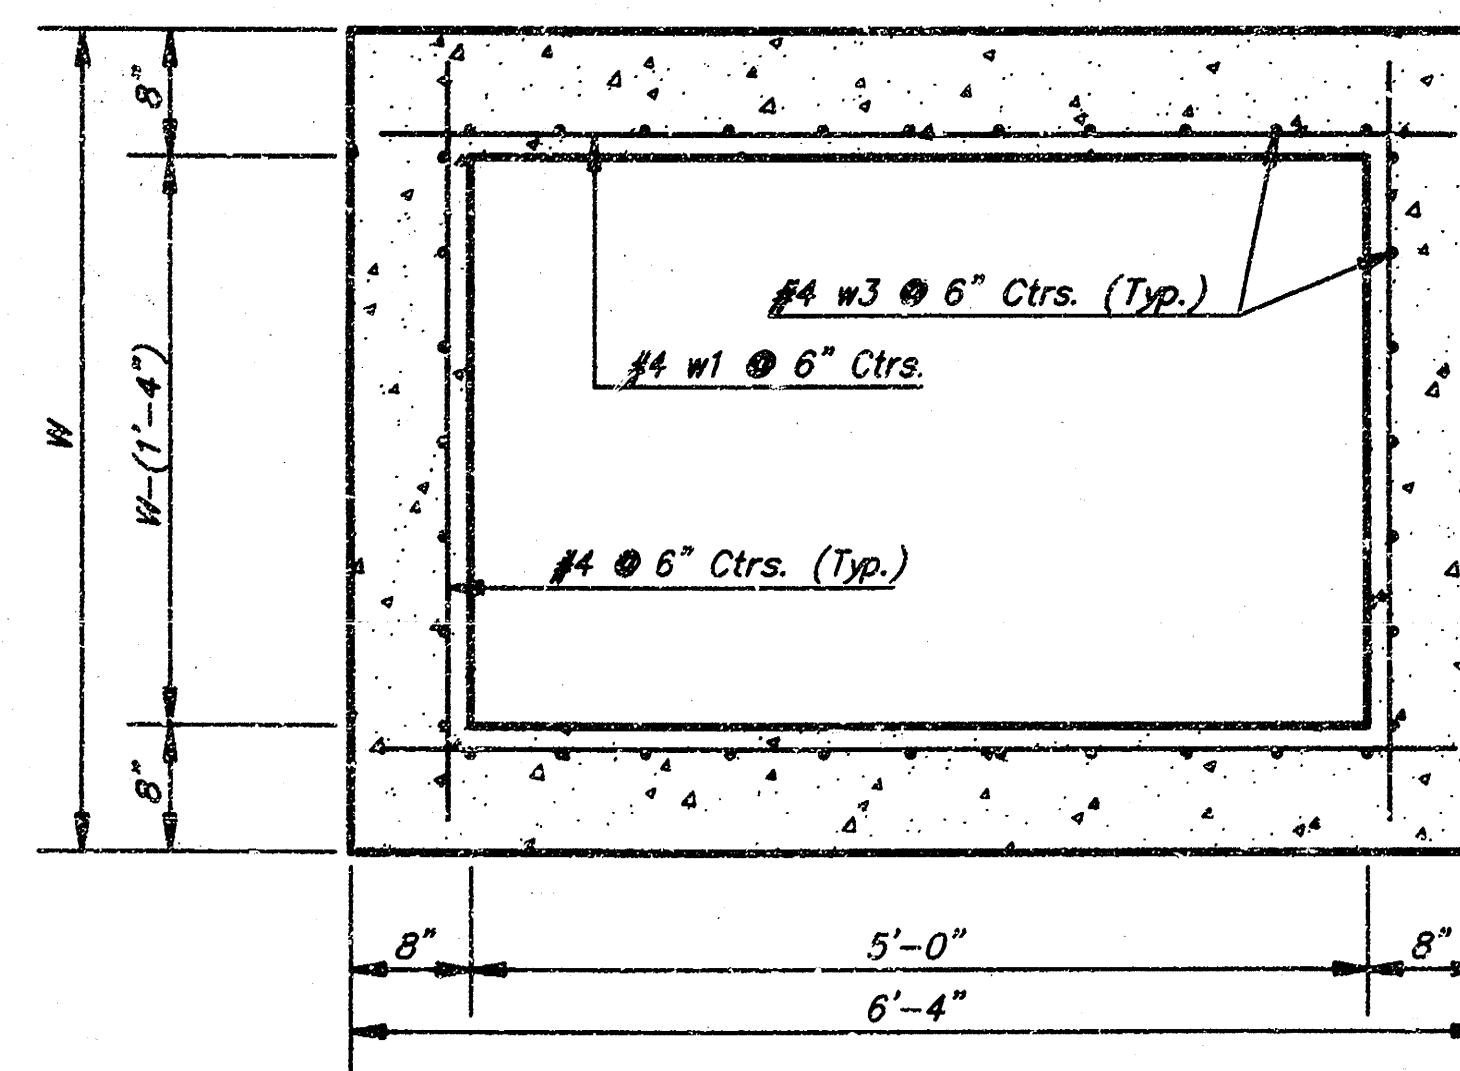

SECTION D-D

NOTE: Contractor shall have the option of constructing 8" brick masonry walls between the concrete inlet base and top on this inlet when W=6'-4" and H=7'-0" or less.


Additional curb and gutter construction necessary to connect set-back inlet to pavement will be paid for at the unit price bid for each inlet hookup.

Inlet invert shall be shaped with 8" sand mix concrete to create flow channels and to increase hydraulic efficiency such that the inlet will be self-cleaning between all inlet and/or outlet pipes.

The ends of all pipes installed in inlets shall be cut off flush with the inside face of the inlet wall


NOTE: Inlet Top Reinforcing shall be Spaced at 6" Max. Centers. Inlet Lids Shall be Notched Out as Indicated to Facilitate Construction of Curb.

NOTE: Concrete Tops to be installed on thin mortar cushion to insure full support along brick walls. Concrete tops may be cast in place or precast. Concrete used for inlet construction shall be concrete pavement mix with air entrainment.

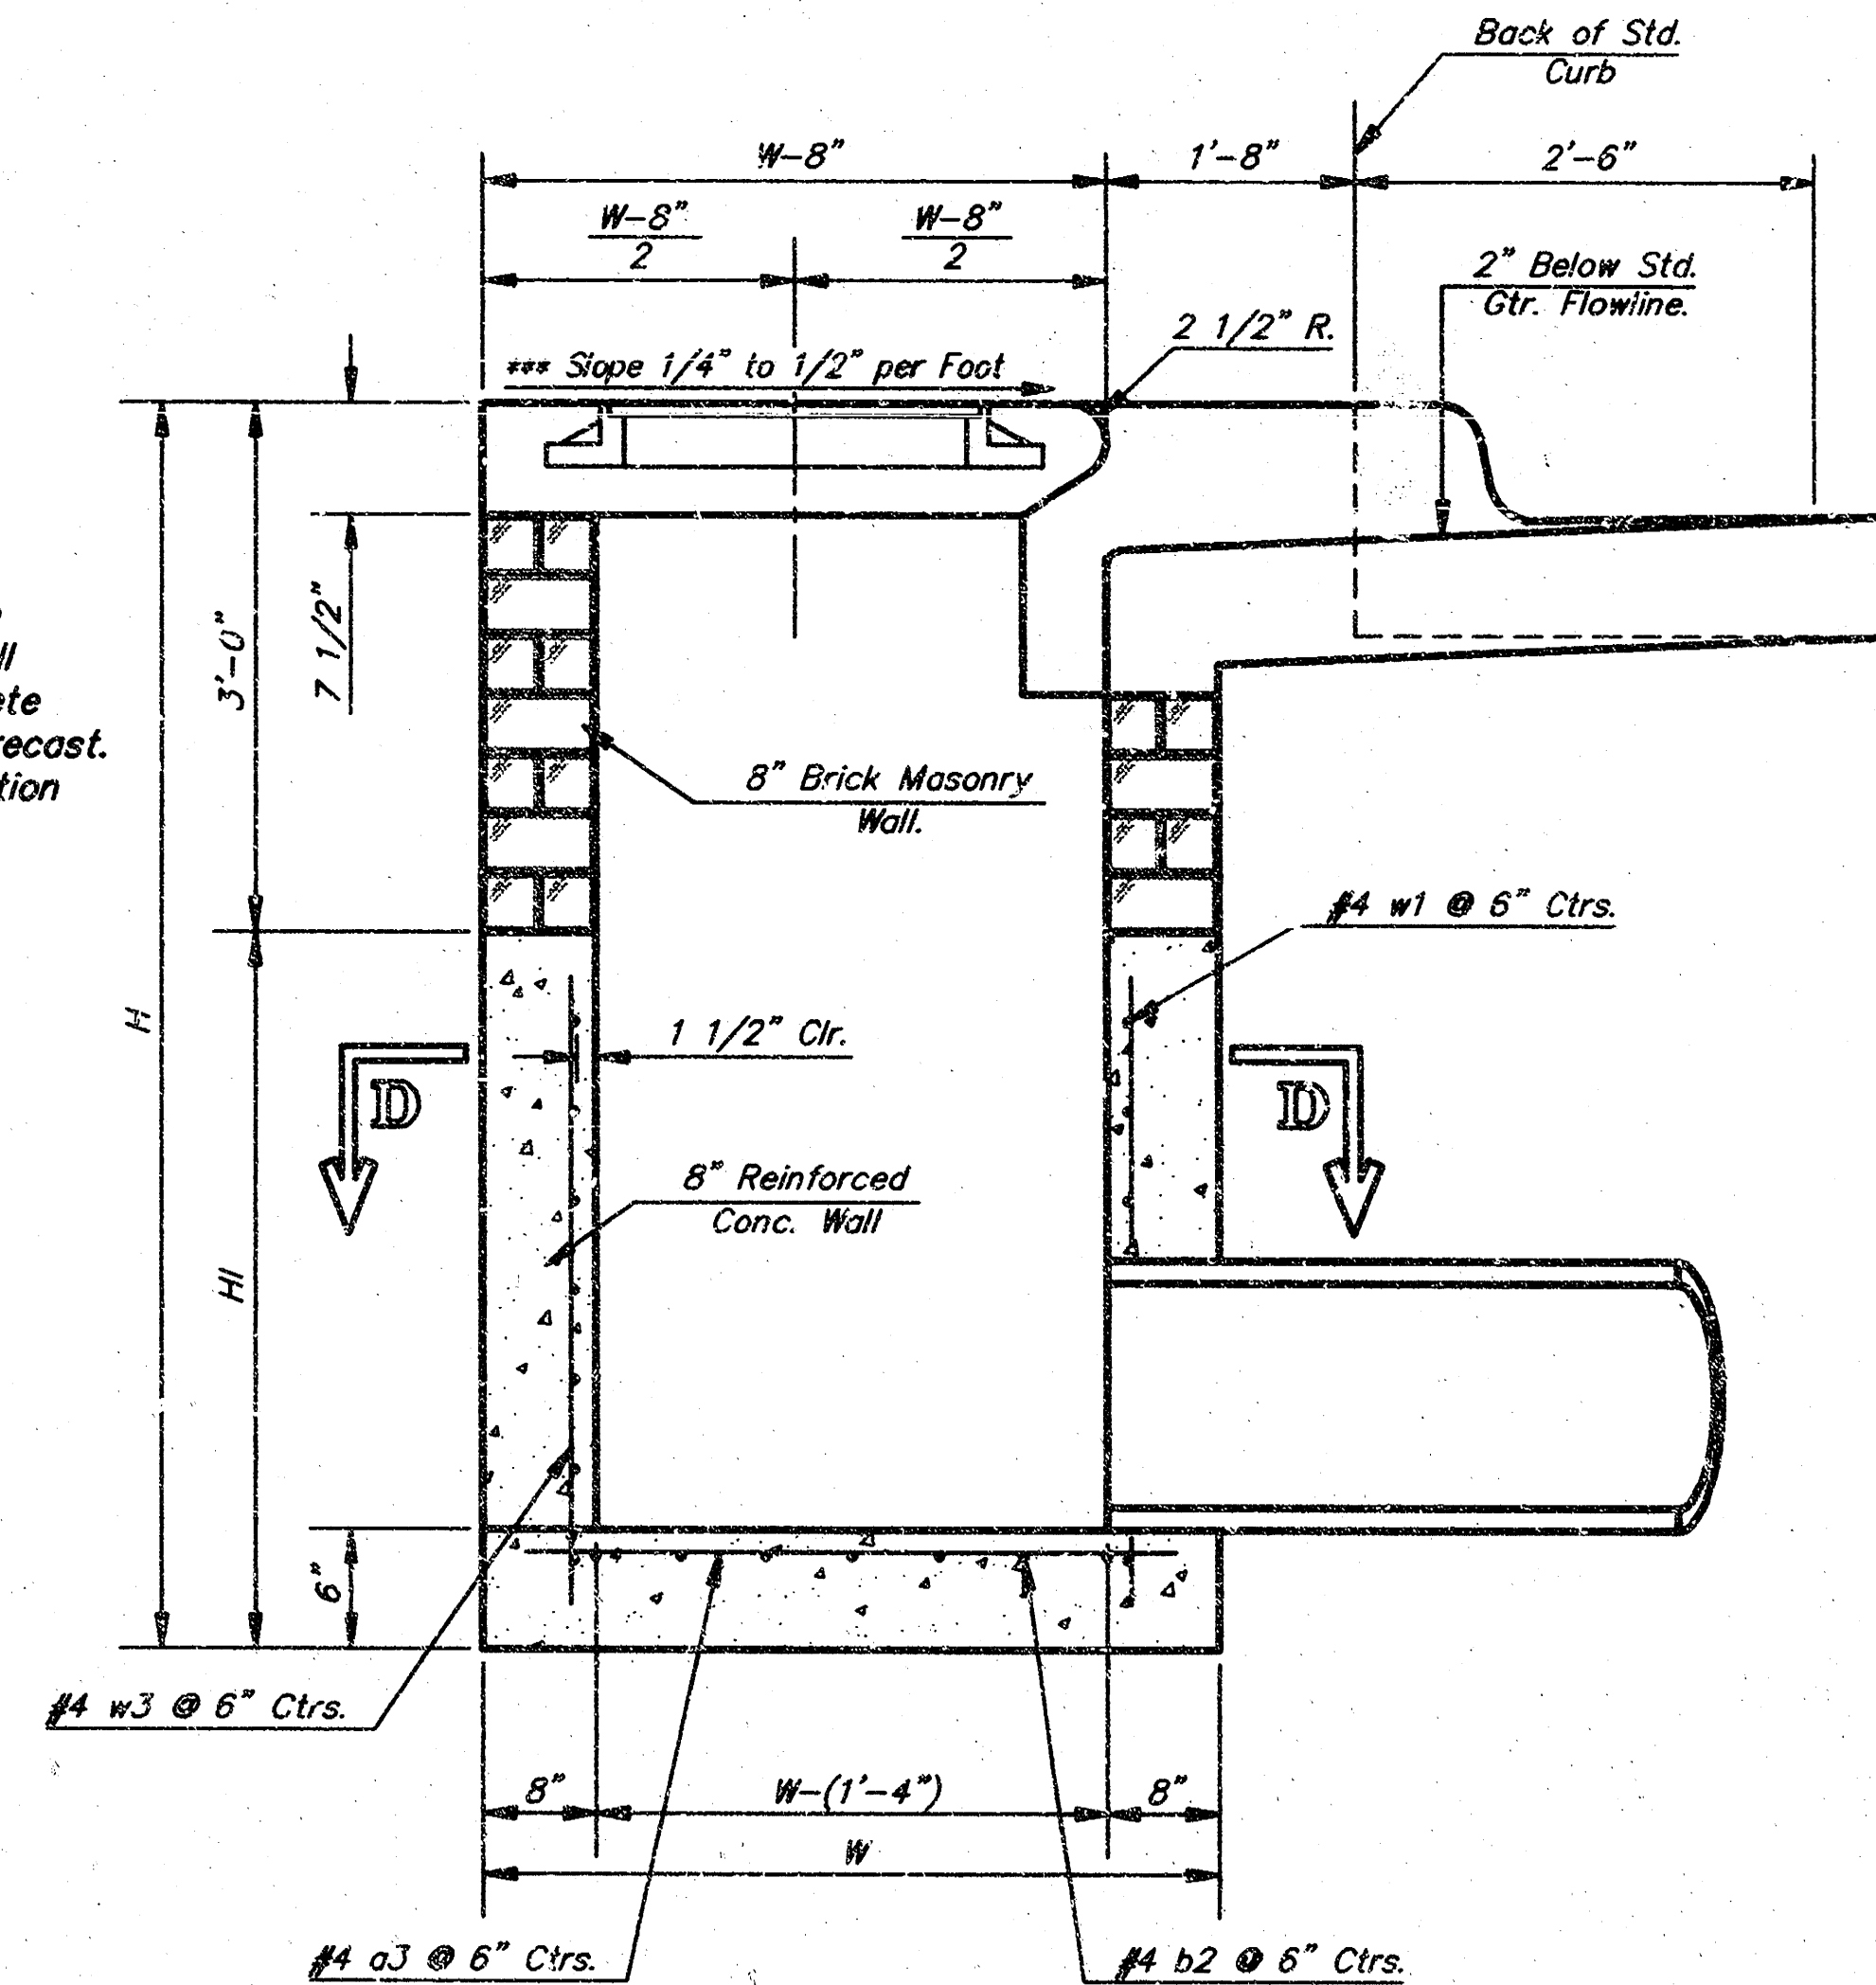

SECTION A-A

NOTE: Slope of Inlet tops to Match Sidewalk or Parking Slopes within Limits Indicated.

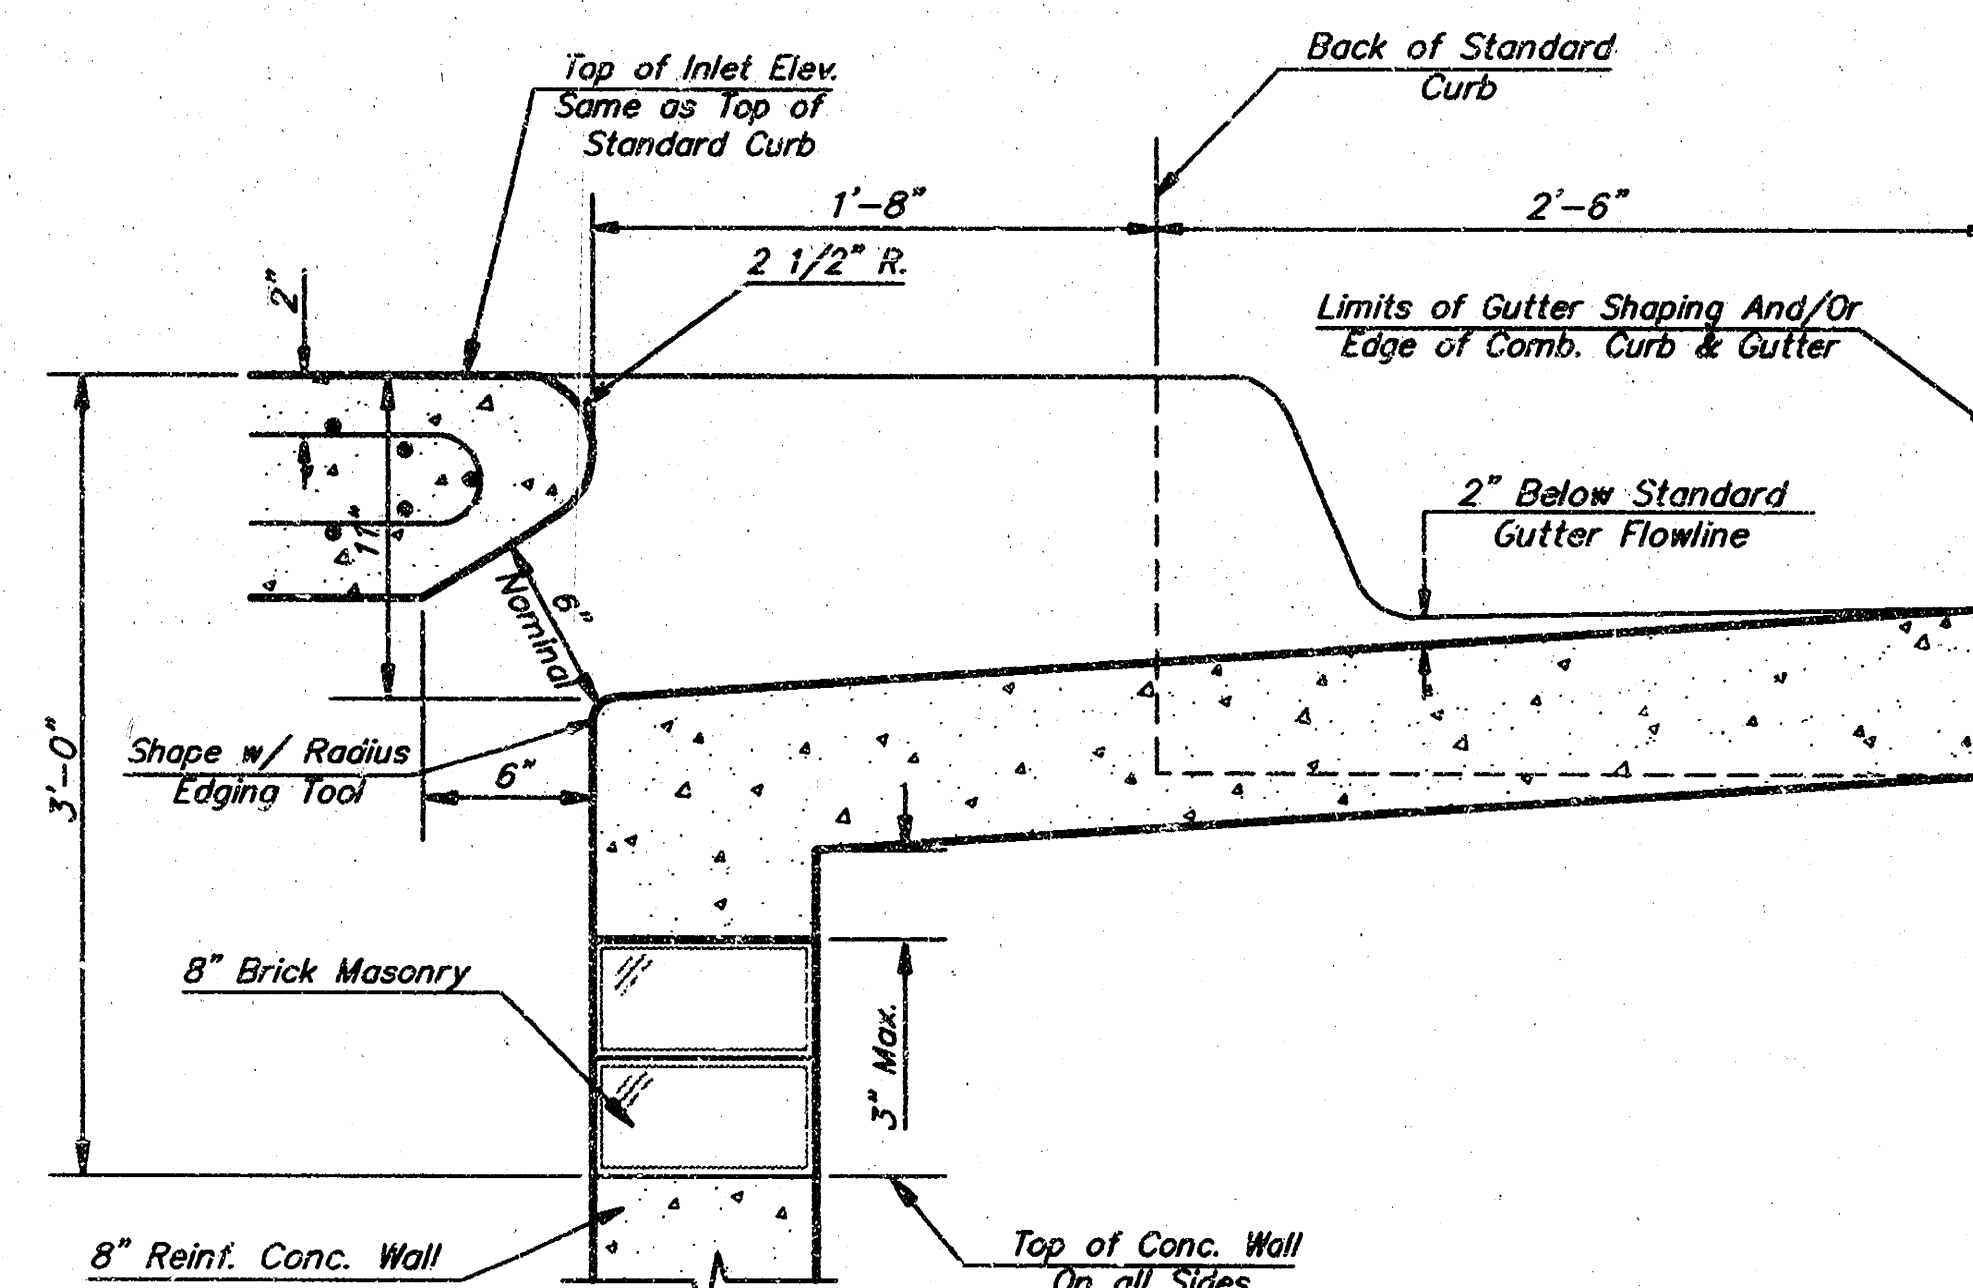


SECTION B-B


PRECAST SLAB AND FLOOR REINFORCING											
		W = 4'-4"		W = 5'-4"		W = 6'-4"		W = 7'-4"		W = 8'-4"	
MARK	SIZE	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH
* o1	#4	6	6'-7"	6	8'-7"	6	10'-7"	6	12'-7"	6	14'-7"
a2	#4	4	6'-0"	4	8'-0"	4	10'-0"	4	12'-0"	4	14'-0"
a3	#4	13	4'-1"	13	5'-1"	13	6'-1"	13	7'-1"	13	8'-1"
b1	#4	1	4'-9"	1	4'-9"	1	4'-9"	1	4'-9"	1	4'-9"
* b2	#4	23	6'-1"	29	6'-1"	35	6'-1"	41	6'-1"	47	6'-1"
x1	#4	8	3'-10"	8	4'-2"	8	4'-6"	8	4'-10"	9	5'-2"

WALL REINFORCING											
		W = 4'-4"		W = 5'-4"		W = 6'-4"		W = 7'-4"		W = 8'-4"	
MARK	SIZE	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH
w1	#4	①	6'-1"	①	6'-1"	①	6'-1"	①	6'-1"	①	6'-1"
w2	#4	①	4'-1"	①	5'-1"	①	6'-1"	①	7'-1"	①	8'-1"
w3	#4	32	②	36	②	40	②	44	②	49	②

* Field Bend or Cut Reinforcing as Required for Clearance.
 ① 4 (H - 12") (H - 21") Rounded down to nearest 0.5"
 ② H - 3"

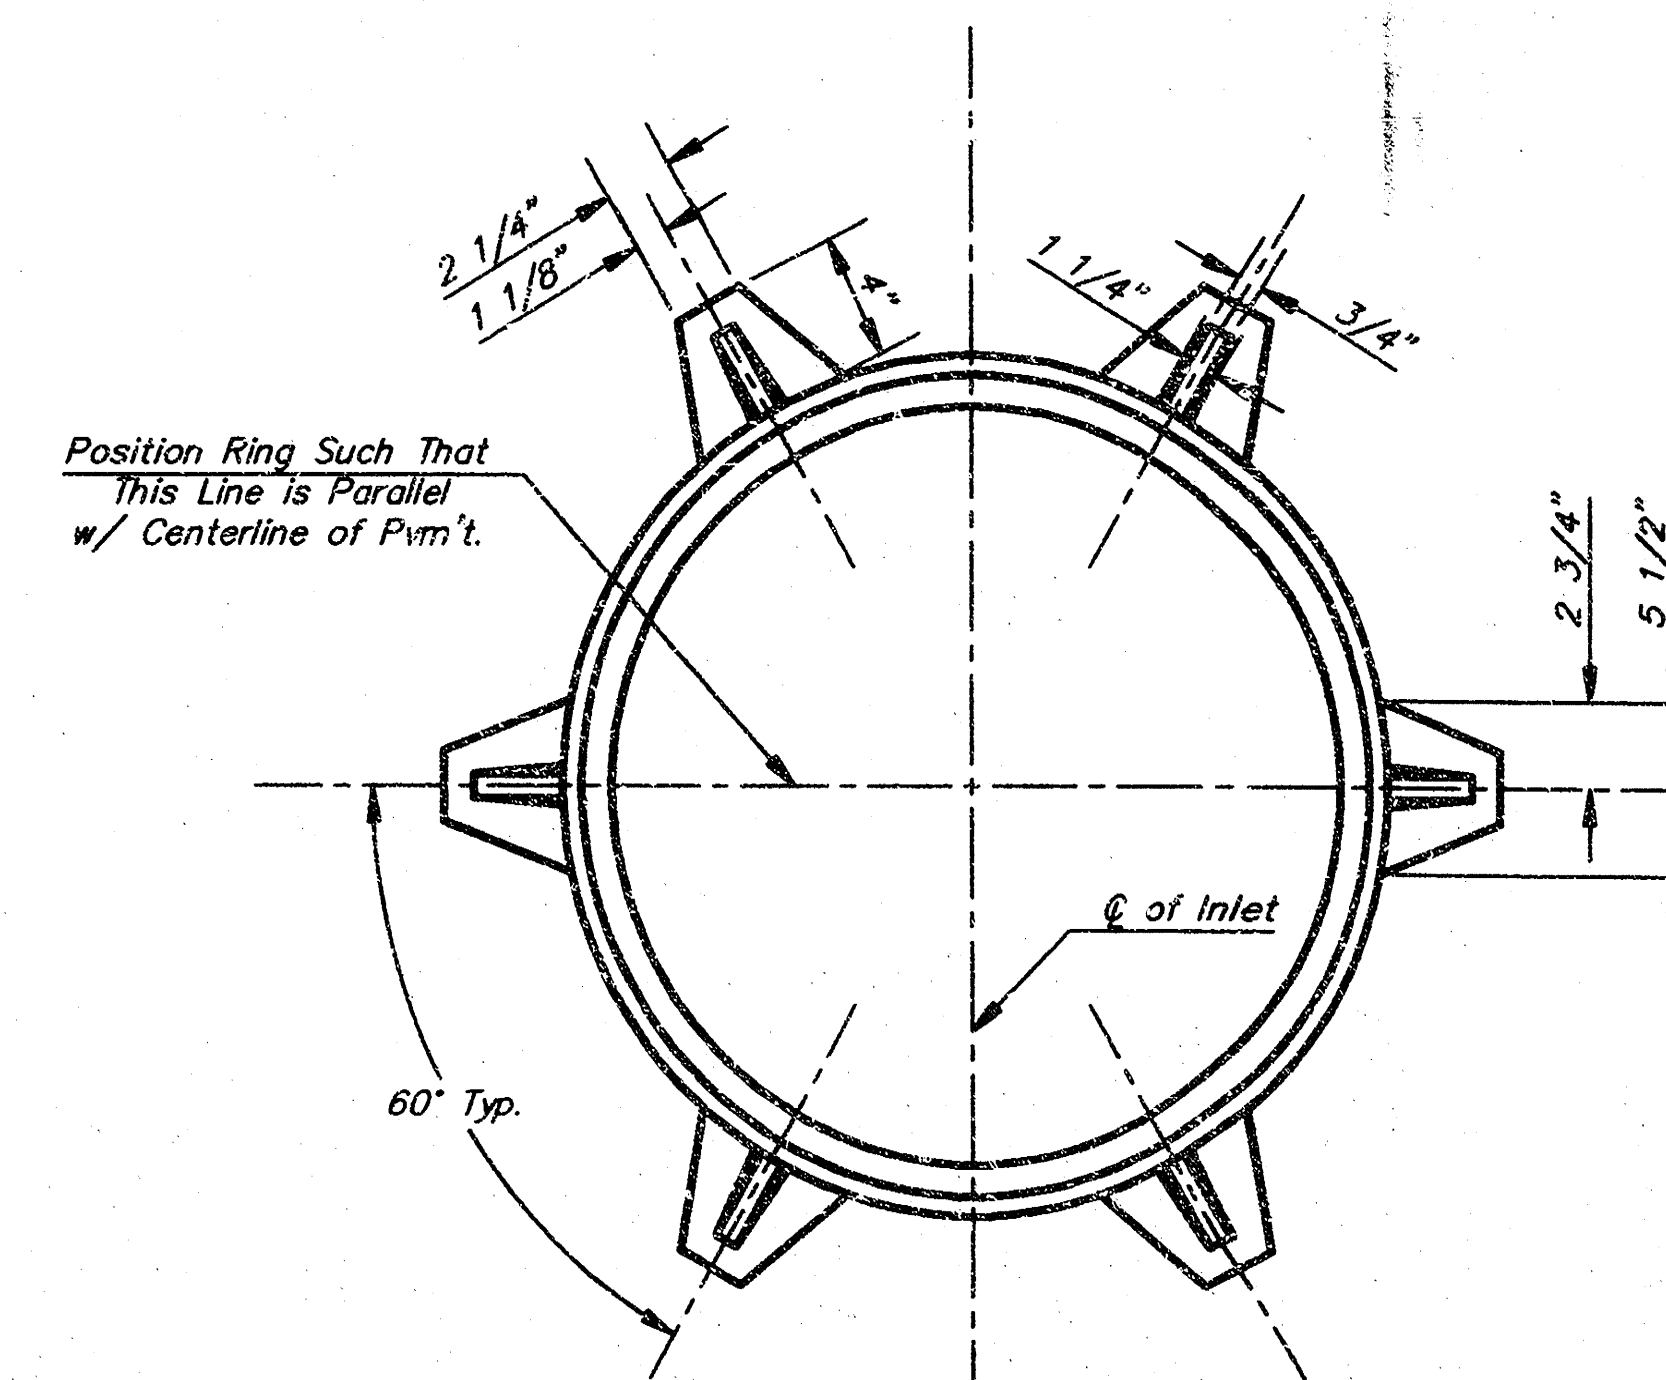


Position Ring Such That This Line is Parallel w/ Centerline of Pvm't.

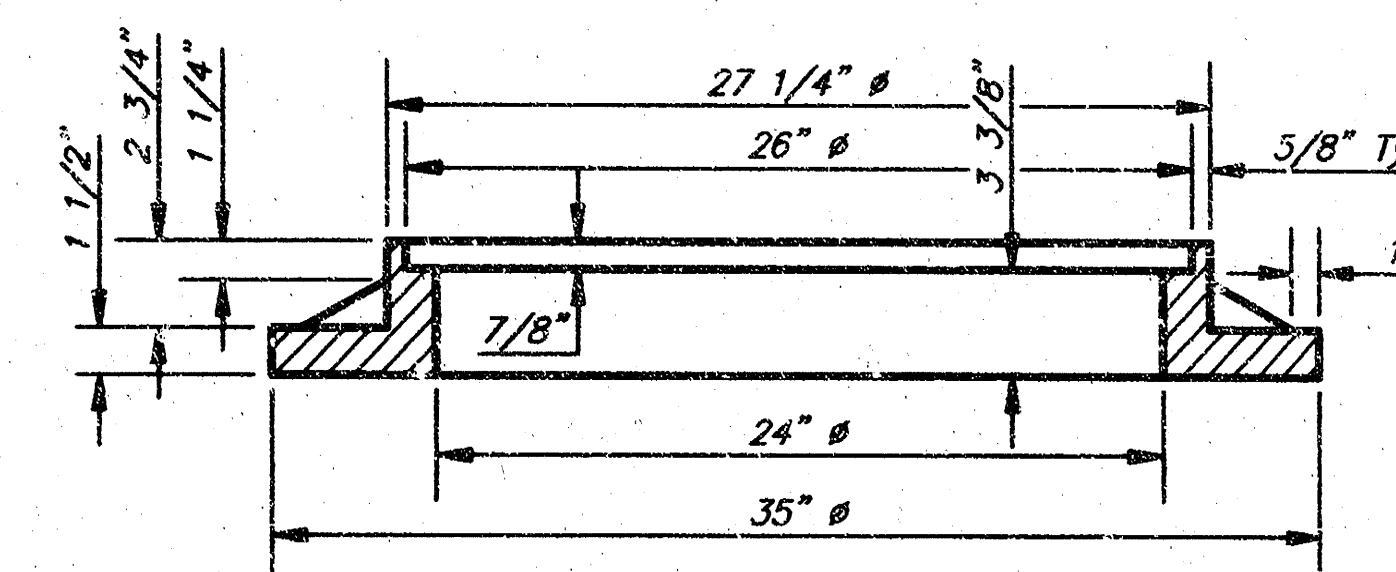


MANHOLE RING AND COVER

Weight = 180 Lbs.

*See City of Wichita Standard Manhole Ring and Cover Detail Sheet for Cover Details to Be Used With Inlet Frame.

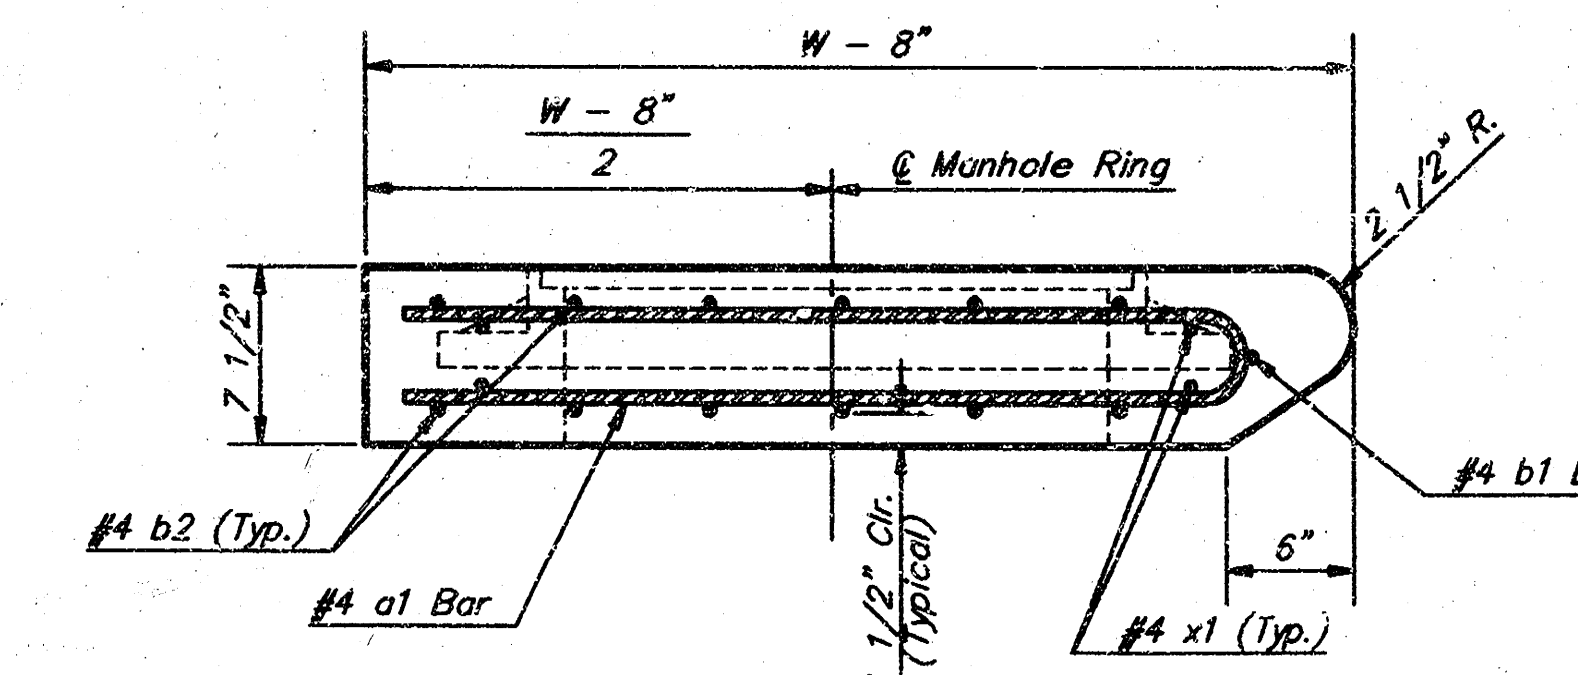

SECTION A-A

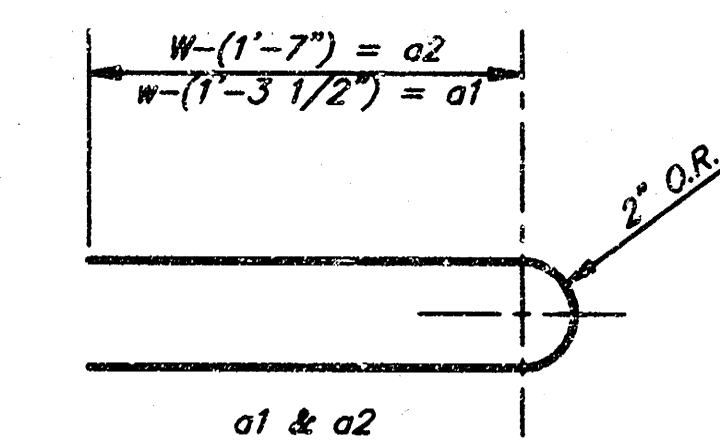

BENDING DIAGRAM

STANDARD CURB INLET PRECAST TOPS			
W	PRE-CAST TOP SIZE	PIPE SIZE	CU. YD. CONC.
4'-4"	3'-8" x 6'-4" x 7 1/2"	21" & SMALLER	0.39±
5'-4"	4'-8" x 6'-4" x 7 1/2"	24" & 30"	0.51±
6'-4"	5'-8" x 6'-4" x 7 1/2"	36" & 42"	0.64±
7'-4"	6'-8" x 6'-4" x 7 1/2"	48" & 54"	0.77±
8'-4"	7'-8" x 6'-4" x 7 1/2"	60" & 66"	0.90±

CITY OF WICHITA STANDARD TYPE 1A
 CURB INLET DETAILS
 INLET OPENING = 6" x 5'-0"

PROJECT NUMBER





SHEET 5 OF 8



BAUGHMAN COMPANY P. A.
 ENGINEERING & SURVEYING
 316/282-7271 • 315 ELLIS • WICHITA, KANSAS 67211

Revised - Feb. 16, 1989

SEWER APPURTENANCES DETAILS

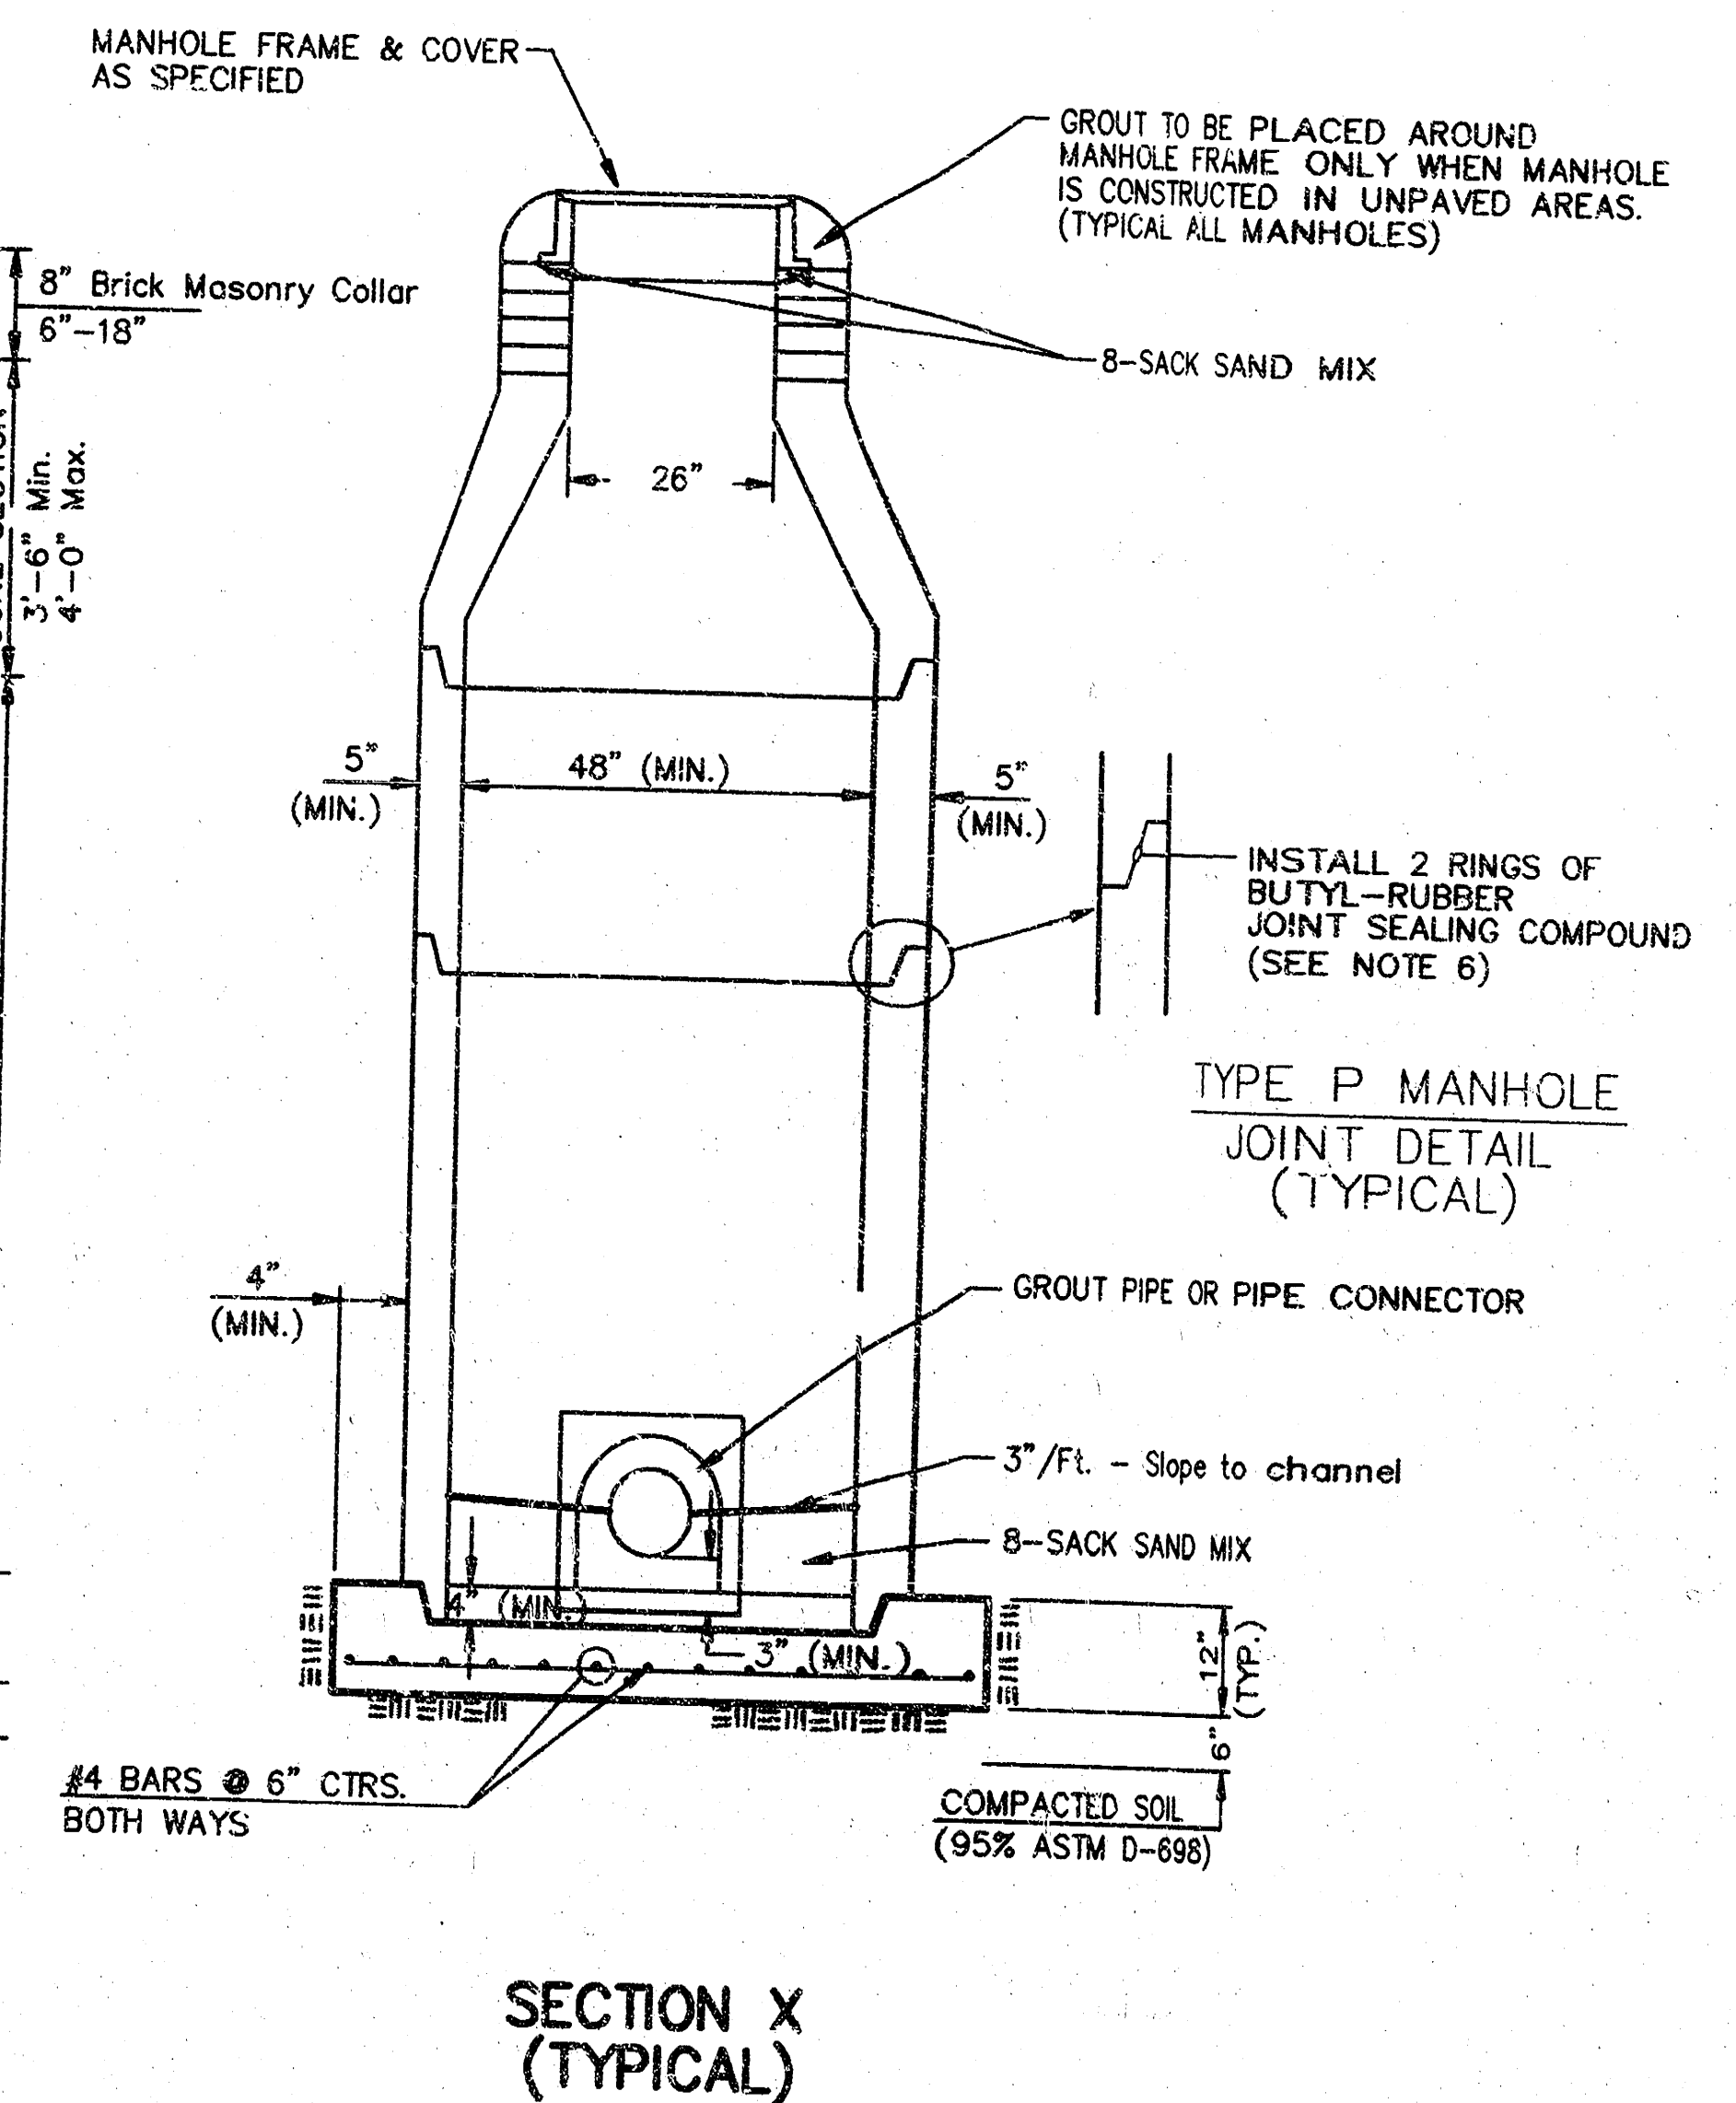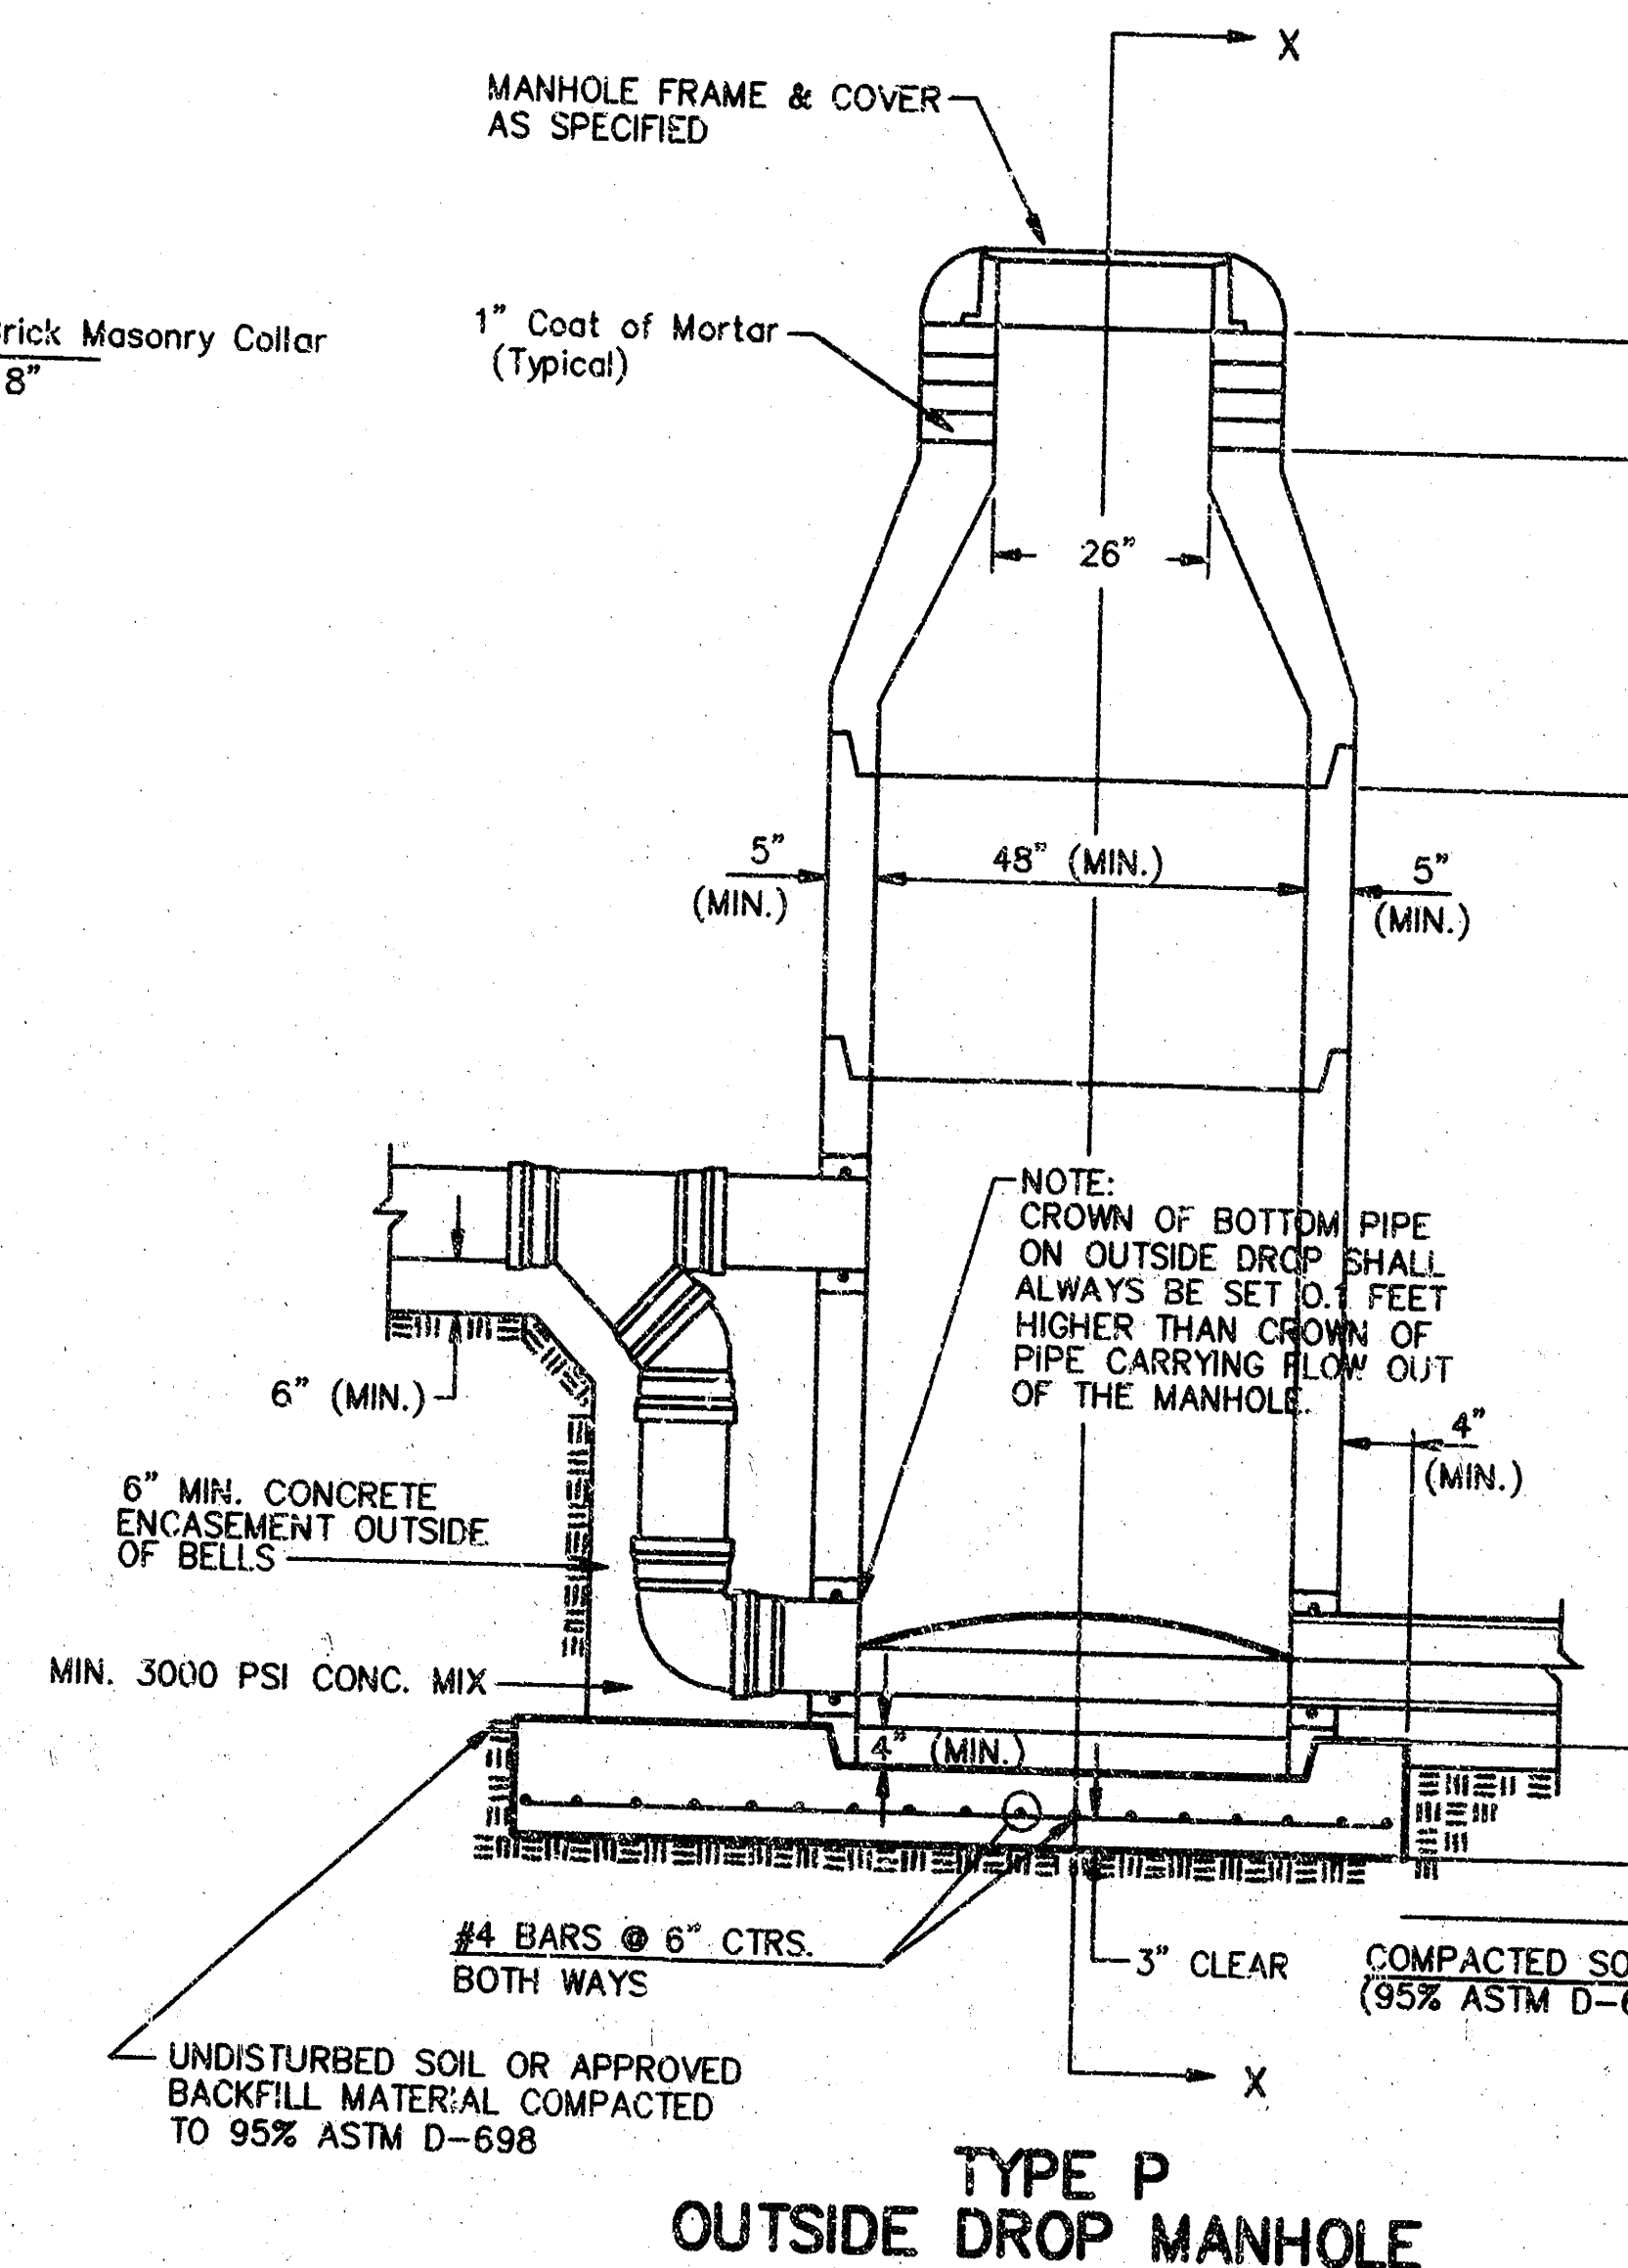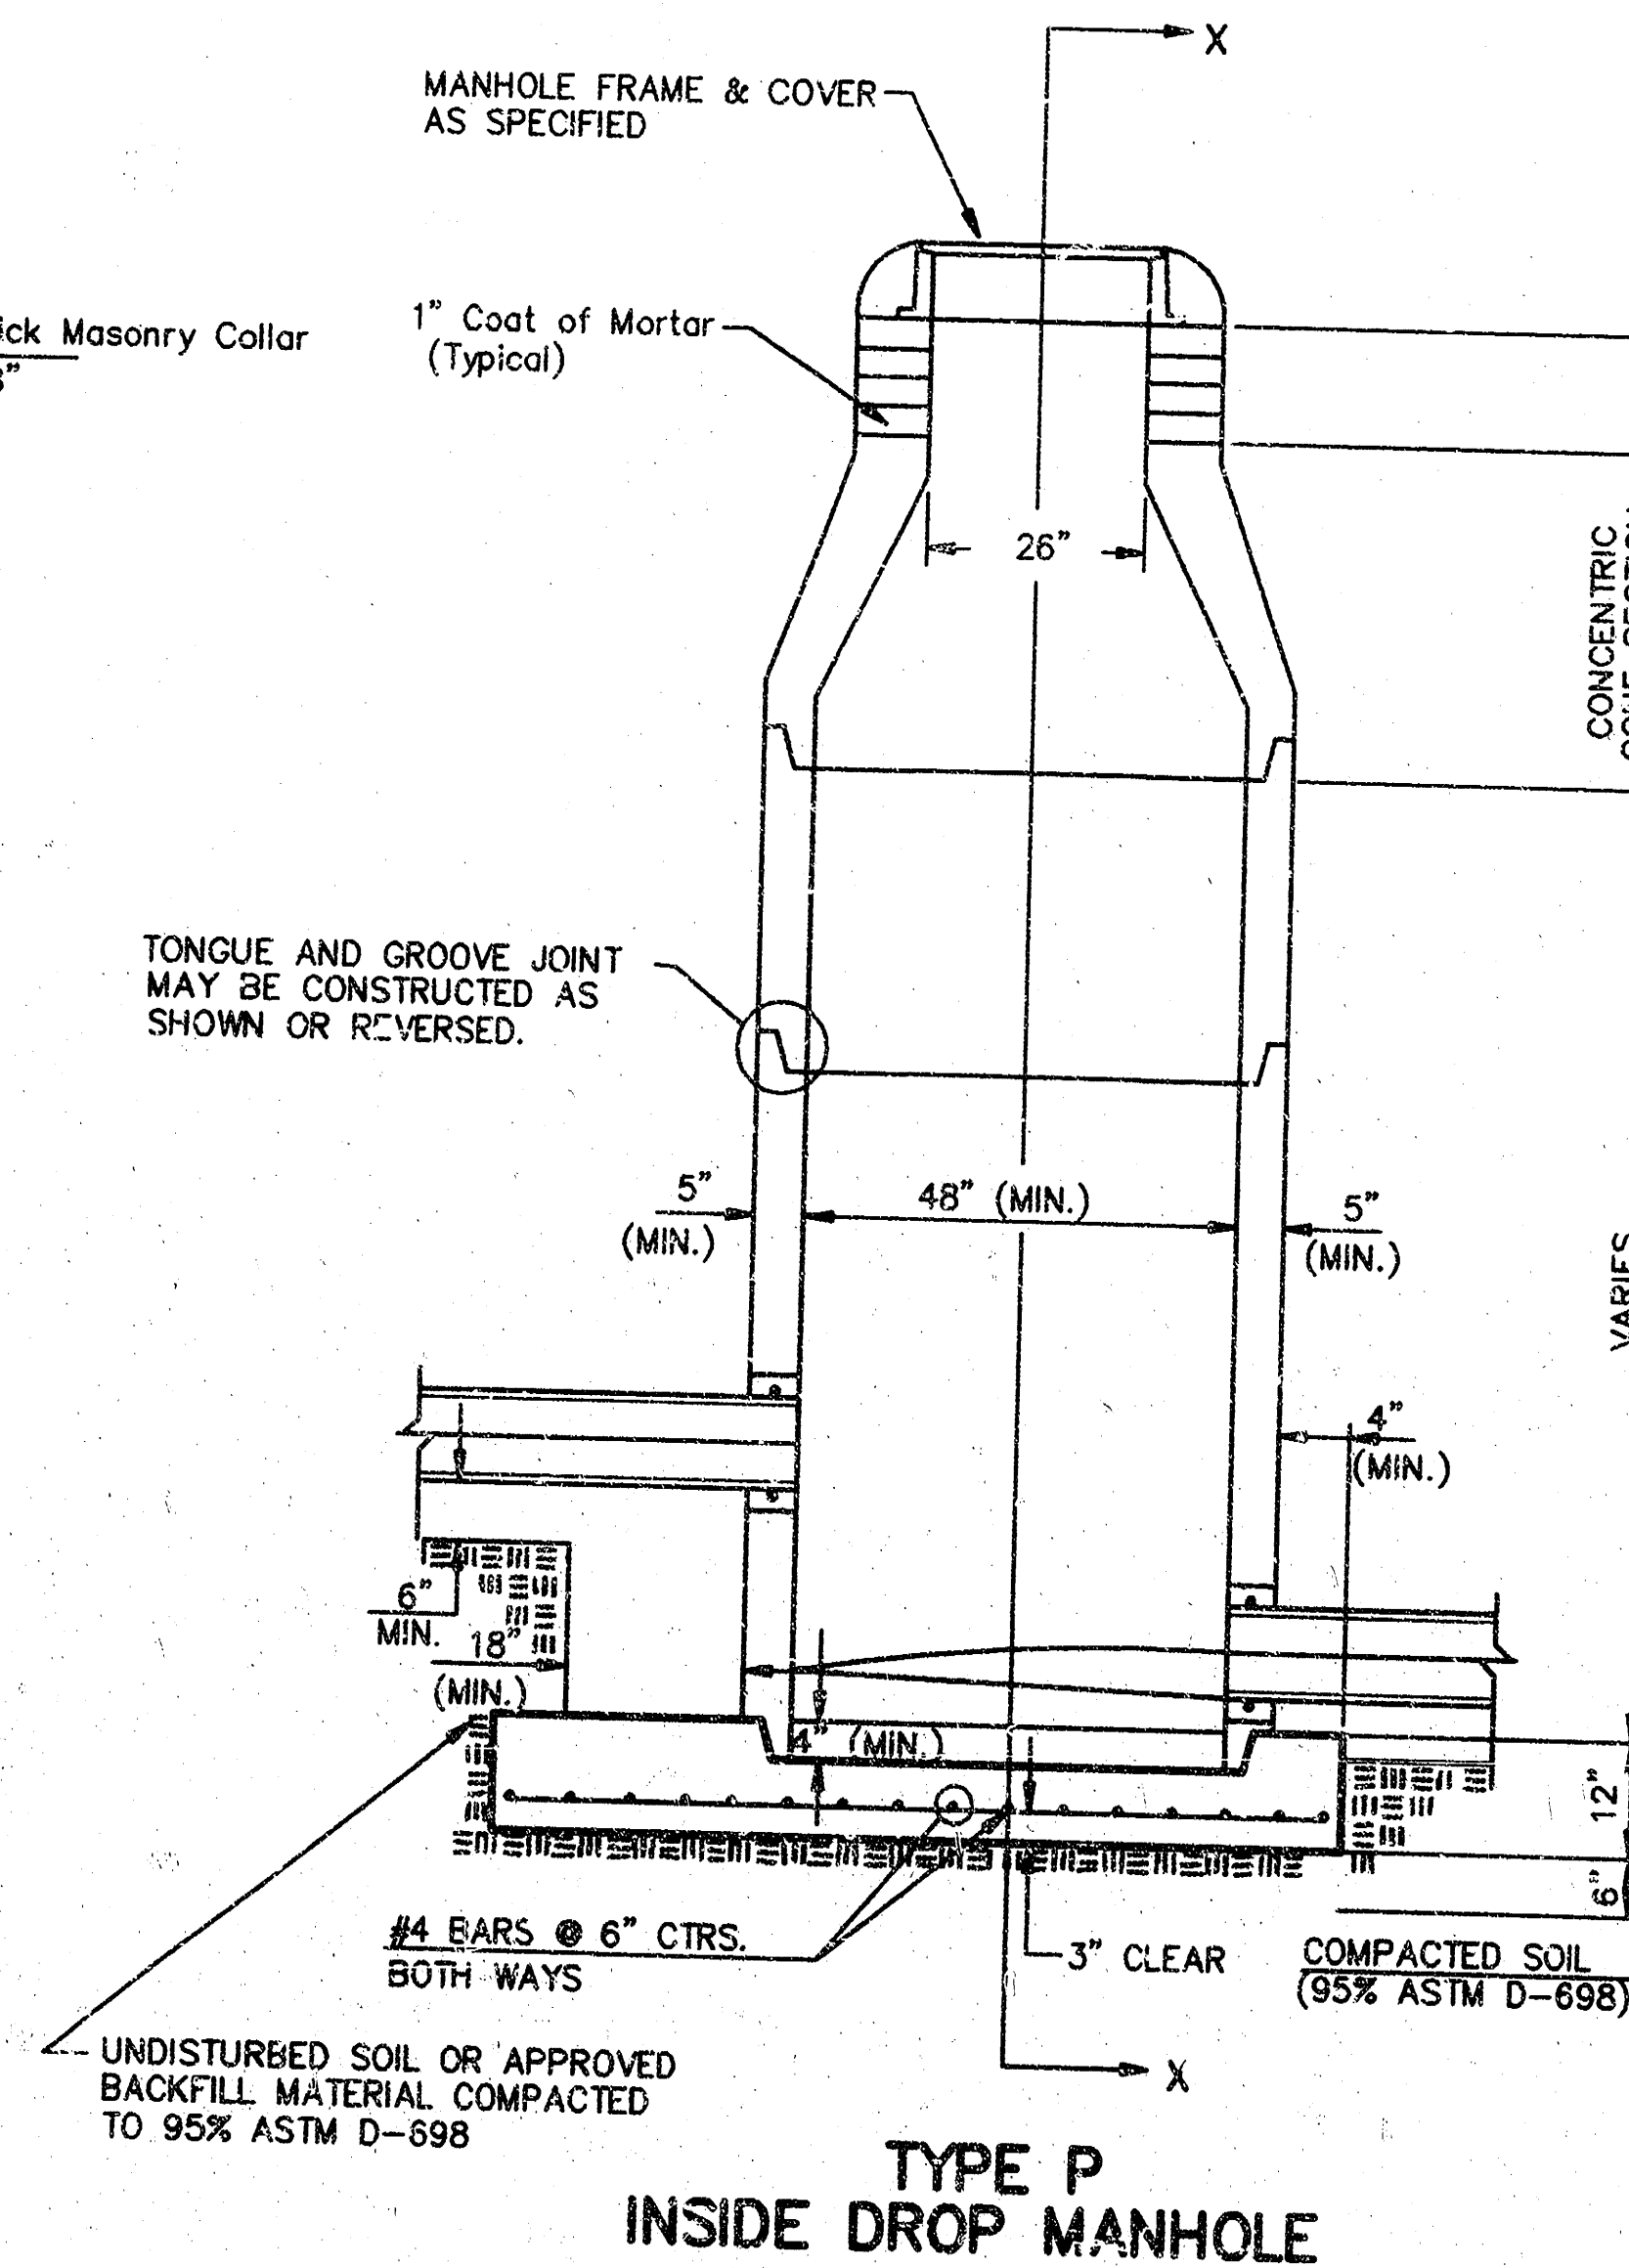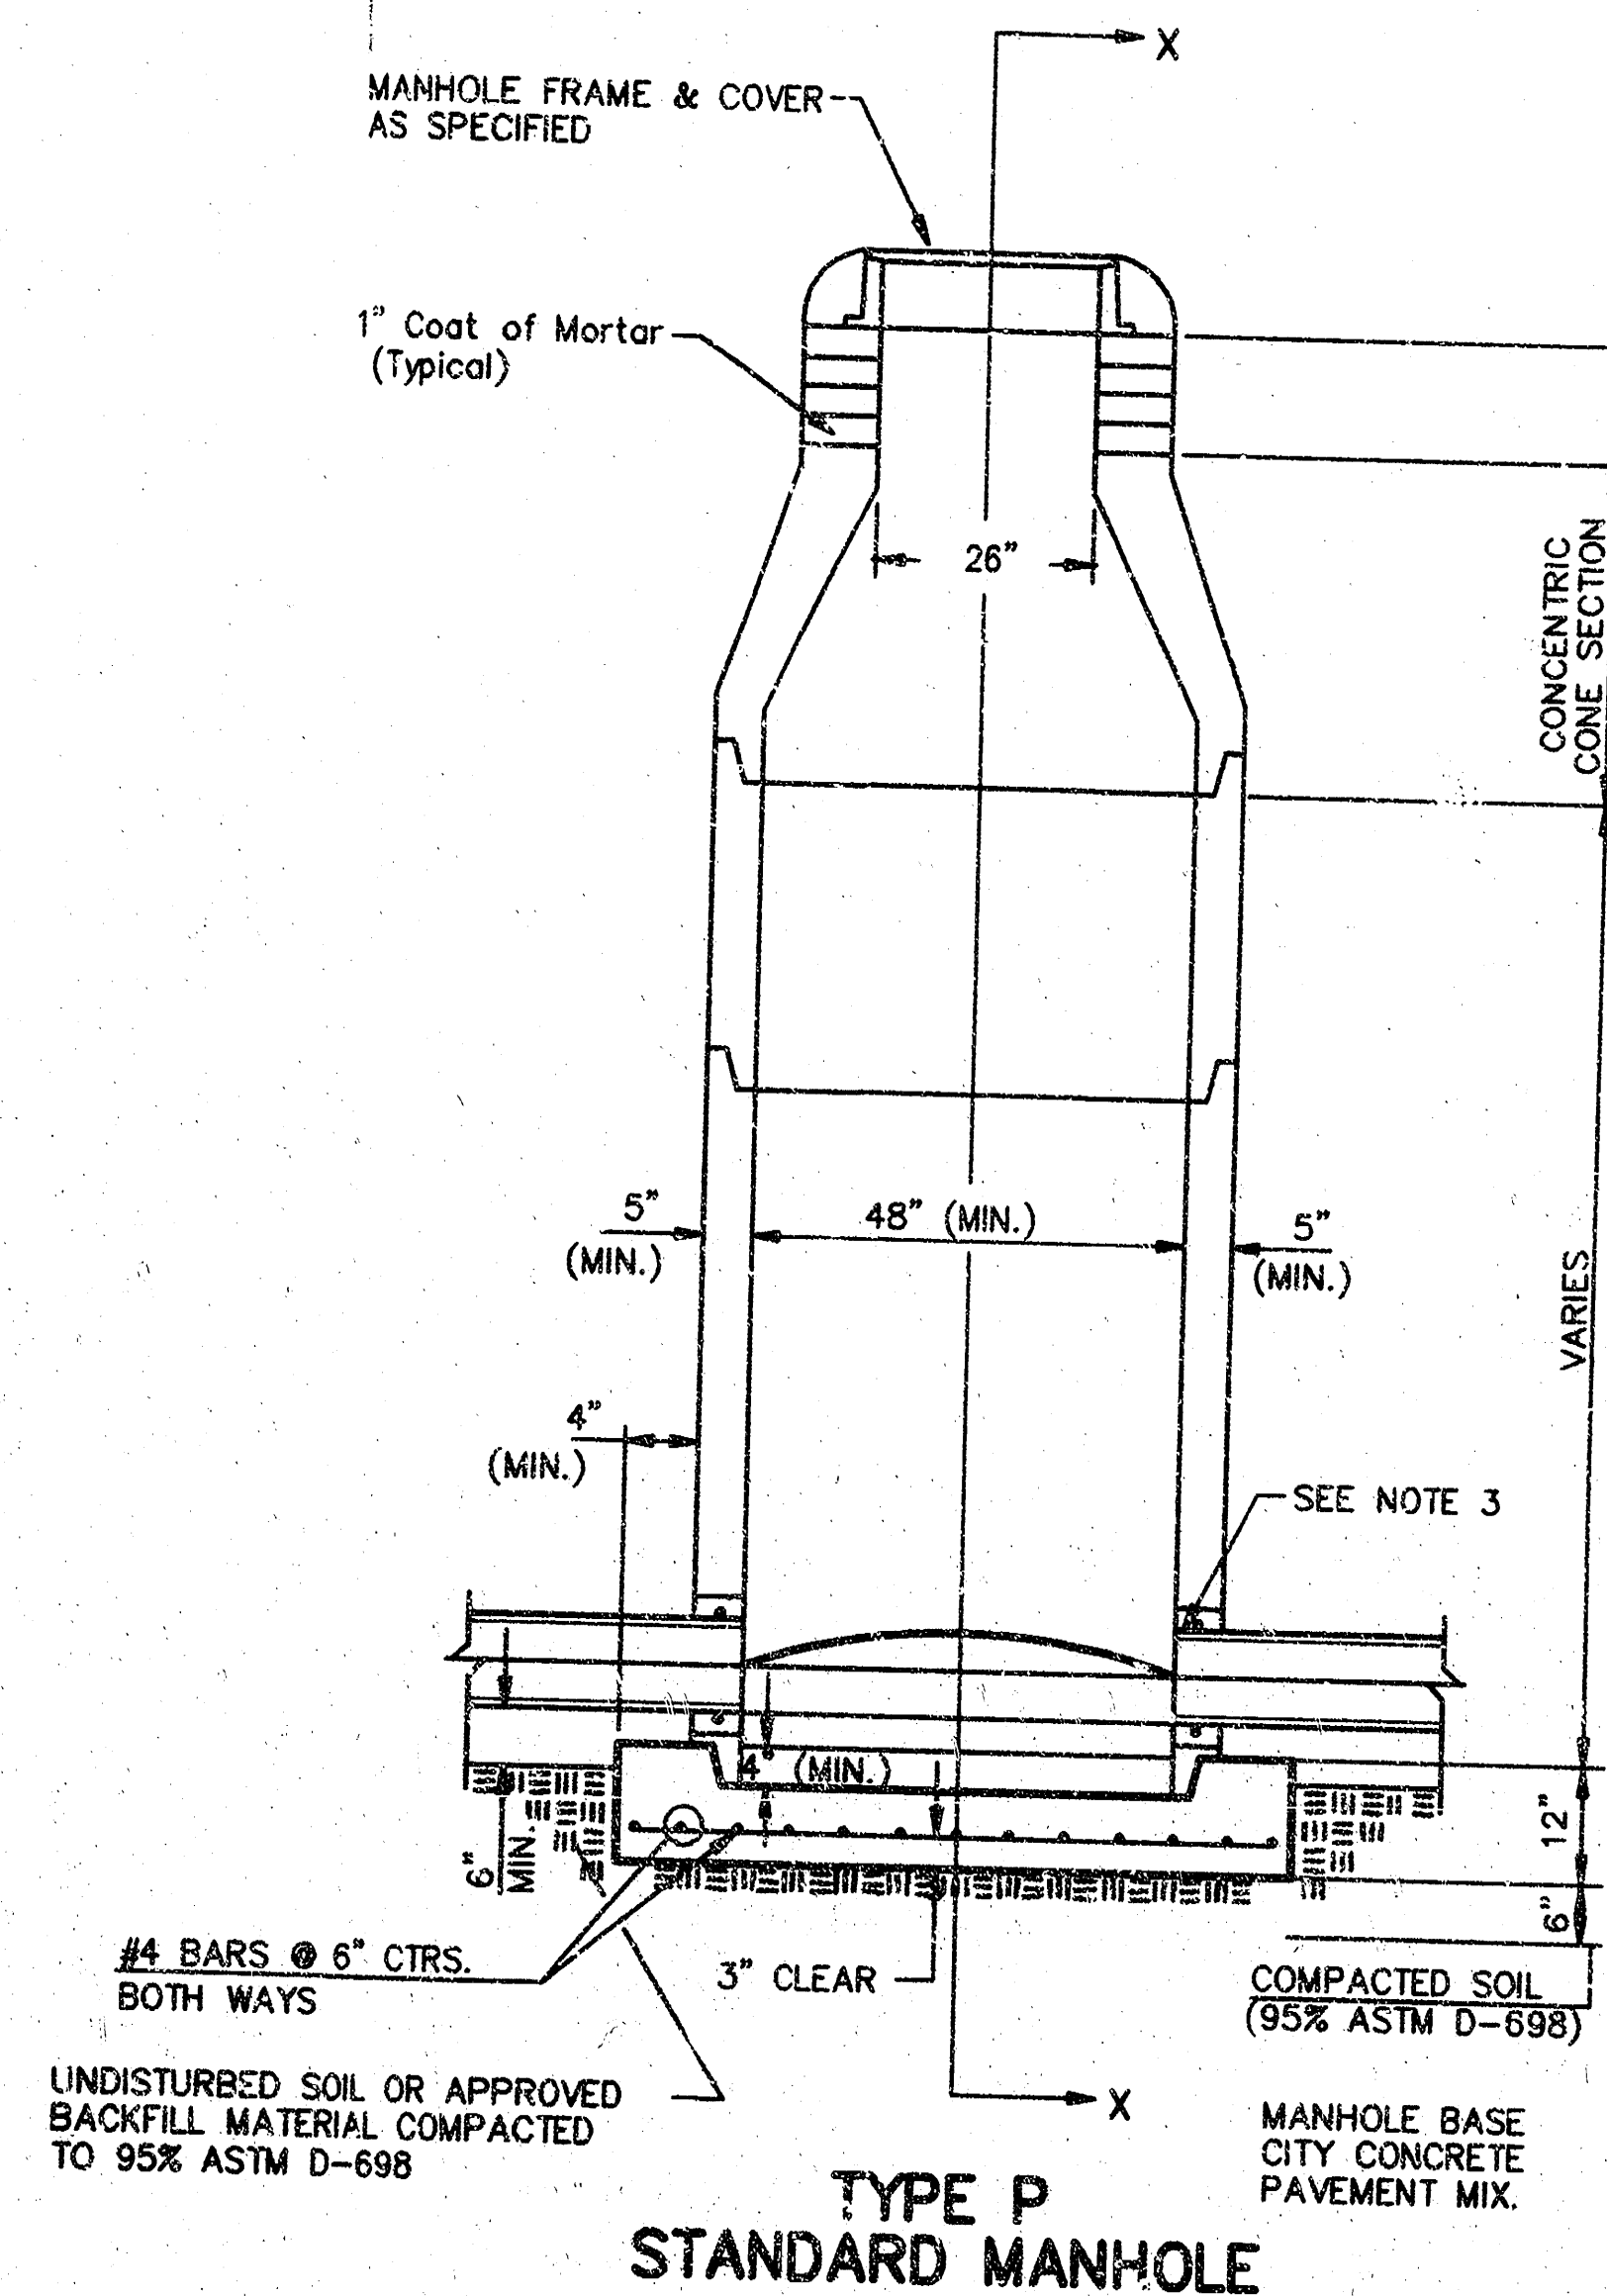


GENERAL NOTES

1. ALL PRECAST CONCRETE MANHOLE SECTIONS SHALL CONFORM TO THE LATEST REVISIONS OF A.S.T.M. C478 AS MODIFIED BY THE SPECIFICATIONS.
2. NON-SHRINK GROUT SHALL BE NON-METALLIC TYPE.
3. APPROVED FLEXIBLE WATERSTOP GASKETS SHALL BE INSTALLED TO JOIN THE SEWER TO THE MANHOLE WALL WHEN A.B.S. COMPOSITE PIPE OR P.V.C. PIPE IS USED. FOR OTHER TYPES OF PIPE THE SEWER PIPE SHALL BE GROUDED IN PLACE WITH NON-SHRINK GROUT. THE SEWER PIPE SHALL BE SUPPORTED WITH CONCRETE ENCASEMENT A MINIMUM OF 3 FEET FROM THE MANHOLE WALL AND TO THE FIRST JOINT FOR V.C.P. SUCH THAT THE JOINT REMAINS FLEXIBLE.
4. ALL INSIDE SURFACES OF THE CONCRETE MANHOLE WHICH WOULD BE EXPOSED TO SEWER GAS SHALL BE COATED WITH 2 COATS TNEDEC SERIES 86 HI-BUILD EPOXYKURE, DRY THICKNESS OF 8 MILS (MIN.)
5. EXTERIOR MANHOLE WALLS SHALL BE COATED WITH 1 COAT MOBILARMA 633 BITUMINOUS COATING.
6. JOINT SEALING COMPOUND SHALL BE KENT SEAL NO. 2 OR APPROVED EQUAL.
7. PRECAST MANHOLES SHALL BE SET AT LEAST 4 INCHES INTO THE MANHOLE BASE.
8. TOP OF MANHOLE FLOOR SLAB SHALL BE AT LEAST 3 INCHES BELOW THE FLOW LINE OF THE OUTLET PIPE TO INSURE SUFFICIENT MINIMUM THICKNESS OF SHAPED INVERT.
9. LIFTING HOLES SHALL BE FILLED WITH NON-SHRINK GROUT AND THE INTERIOR SURFACE COATED AS SPECIFIED.
10. MORTAR USED IN MASONRY CONSTRUCTION SHALL CONTAIN 8 SACKS OF CEMENT PER CUBIC YARD. CONCRETE USED IN MANHOLE BASES SHALL CONFORM TO THE REQUIREMENTS OF CONCRETE FOR CONCRETE PAVEMENT CONSTRUCTION AS SPECIFIED IN THE CITY STANDARD PAVING SPECIFICATIONS USING CITY CONCRETE PAVEMENT MIX WITHOUT AIR ENTRAINING ADMIXTURE. MORTAR SHALL BE PLACED AROUND THE MANHOLE RING AS SHOWN ON THE DRAWINGS WHEN MANHOLES ARE CONSTRUCTED IN UNPAVED AREAS. MANHOLES CONSTRUCTED WHERE PIPE SIZES ARE SMALLER THAN 24" SHALL HAVE AN INSIDE DIAMETER OF 4'. MANHOLES CONSTRUCTED WHERE PIPE SIZES ARE 24" OR LARGER SHALL HAVE AN INSIDE DIAMETER OF 5'. COMPLETED MANHOLE SHALL BE WITHOUT LEAKS AND WATER TIGHT.


11. REINFORCING STEEL SHALL BE INSTALLED IN THE MANHOLE BASES AND SHALL CONSIST OF NO. 4 BARS PLACED ON 6" CENTERS IN BOTH DIRECTIONS. THE MANHOLE BASE REINFORCEMENT SHALL BE PLACED AT LEAST 3" ABOVE THE BOTTOM OF THE MANHOLE BASE. ALL COSTS FOR FURNISHING AND INSTALLING REINFORCING STEEL SHALL BE INCLUDED IN THE UNIT PRICE BID FOR THE MANHOLE.
12. OPENINGS SHALL BE CUT INTO THE MANHOLE WALL WHEN OUTSIDE DROPS ARE CONSTRUCTED ON EXISTING MANHOLES. SUCH OPENINGS CUT INTO EXISTING MANHOLES SHALL BE AS SMALL AS PRACTICAL TO FACILITATE INSTALLING AND GROUDED THE NEW PIPE IN PLACE. WATERSTOP GASKETS SHALL BE USED WITH P.V.C. AND A.B.S. COMPOSITE PIPE. THE NEW PIPE SHALL BE GROUDED INTO THE OPENING USING AN APPROVED NONSHRINK GROUT FOR THE FULL MANHOLE WALL THICKNESS. THE EXTERIOR OF THE COMPLETED CONNECTION SHALL BE SEALED WITH AN APPROVED BITUMINOUS COATING SUCH THAT THE CONNECTION WILL BE WATER TIGHT. FLOOR OF MANHOLE SHALL BE MODIFIED TO FORM NEW FLOW CHANNEL FOR THE NEW CONNECTION AS INDICATED BY THE DRAWING. THIS WORK, INCLUDING MODIFICATION OF MANHOLE FLOOR, SHALL BE PAID FOR AT THE UNIT PRICE BID FOR OUTSIDE DROP STACK CONSTRUCTED ON EXISTING MANHOLE.
13. THE FLOORS OF ALL MANHOLES SHALL BE SHAPED WITH FLOW CHANNELS SUCH THAT THE MANHOLES WILL BE SELF CLEANING AND FREE OF AREAS WHERE SOLIDS COULD BE DEPOSITED AS SEWAGE FLOWS THROUGH THE MANHOLE FROM ALL RILEY PIPES TO THE OUTLET PIPE. FLOW CHANNELS SHALL BE FORMED TO MATCH THE BOTTOM HALVES OF THE INFLOWING PIPES AND THE OUTFLOWING PIPE AS SHOWN IN THE DRAWINGS EXCEPT FOR INSIDE DROP MANHOLES. FLOW CHANNELS FOR INSIDE DROP MANHOLES SHALL BE CONSTRUCTED AS INDICATED BY THE DRAWING. MANHOLE FLOORS SHALL HAVE SLOPES OF 3 INCHES PER FOOT IN THE AREAS OUTSIDE OF THE FLOW CHANNELS SLOPED TOWARD THE FLOW CHANNELS. PIPES LAID THROUGH MANHOLES SHALL HAVE THE TOP HALF REMOVED TO HEAT LINES FOR THE FULL INSIDE DIAMETER OF THE MANHOLE. MANHOLE FLOORS SHALL THEN BE SHAPED AROUND THE BOTTOM HALF OF THE PIPE WHICH FORMS THE FLOW CHANNEL.
14. PIPES INSTALLED WITHIN THE EXCAVATION MADE FOR THE MANHOLE SHALL BE CRADLED WITH CONCRETE TO THE LIMITS OF THE MANHOLE EXCAVATION. WHEN CLAY PIPE IS USED, THE CRADLE SHALL EXTEND TO THE FIRST JOINT OUTSIDE THE MANHOLE. THE CRADLE SHALL BE TERMINATED AT THE CLAY PIPE JOINT IN A MANNER WHICH WILL MAINTAIN THE FLEXIBILITY OF THE JOINT. COST OF CRADLE WITHIN MANHOLE EXCAVATION OR TO CLAY PIPE JOINTS ADJACENT TO MANHOLE SHALL BE INCLUDED IN THE UNIT PRICE BID FOR THE MANHOLE.

15. MANHOLE COVER CASTINGS AND MANHOLE FRAME CASTINGS SHALL CONFORM TO THE REQUIREMENTS AS INDICATED IN THE STANDARD SPECIFICATIONS AND AS SHOWN IN THE STANDARD DETAIL DRAWING.
16. THE VERTICAL DROP IN INSIDE DROP MANHOLES SHALL NOT EXCEED 2' FOR INFLOWING PIPES SIZED 12" OR SMALLER AND 2' FOR INFLOWING PIPES LARGER THAN 12". THE CROWNS OF INFLOWING PIPES SHALL NEVER BE SET LOWER THAN THE CROWN OF THE OUTFLOWING PIPE.
17. STANDARD MANHOLES AND STANDARD INSIDE DROP MANHOLES SHALL BE BID AS STANDARD MANHOLES FOR THE TYPE AND DIAMETER INDICATED. OUTSIDE DROP MANHOLES SHALL BE BID AS STANDARD OUTSIDE DROP MANHOLES FOR THE TYPE AND DIAMETER INDICATED. ALL MANHOLE DIAMETERS WILL BE 4' UNLESS INDICATED OTHERWISE.
18. A BRICK MASONRY COLLAR SHALL BE INSTALLED BETWEEN THE CAST IRON FRAME AND THE CONCENTRIC CONE. THE COLLAR WILL HAVE 8" WALLS AND A VERTICAL HEIGHT OF 6" MINIMUM AND 18" MAXIMUM. A 1" COAT OF MORTAR WILL BE PLASTERED ON THE OUTSIDE OF THE COLLAR. THE USE OF PRE-CAST CONCRETE SPACERS FOR MANHOLE TOP ADJUSTMENT IS ALSO ALLOWED.

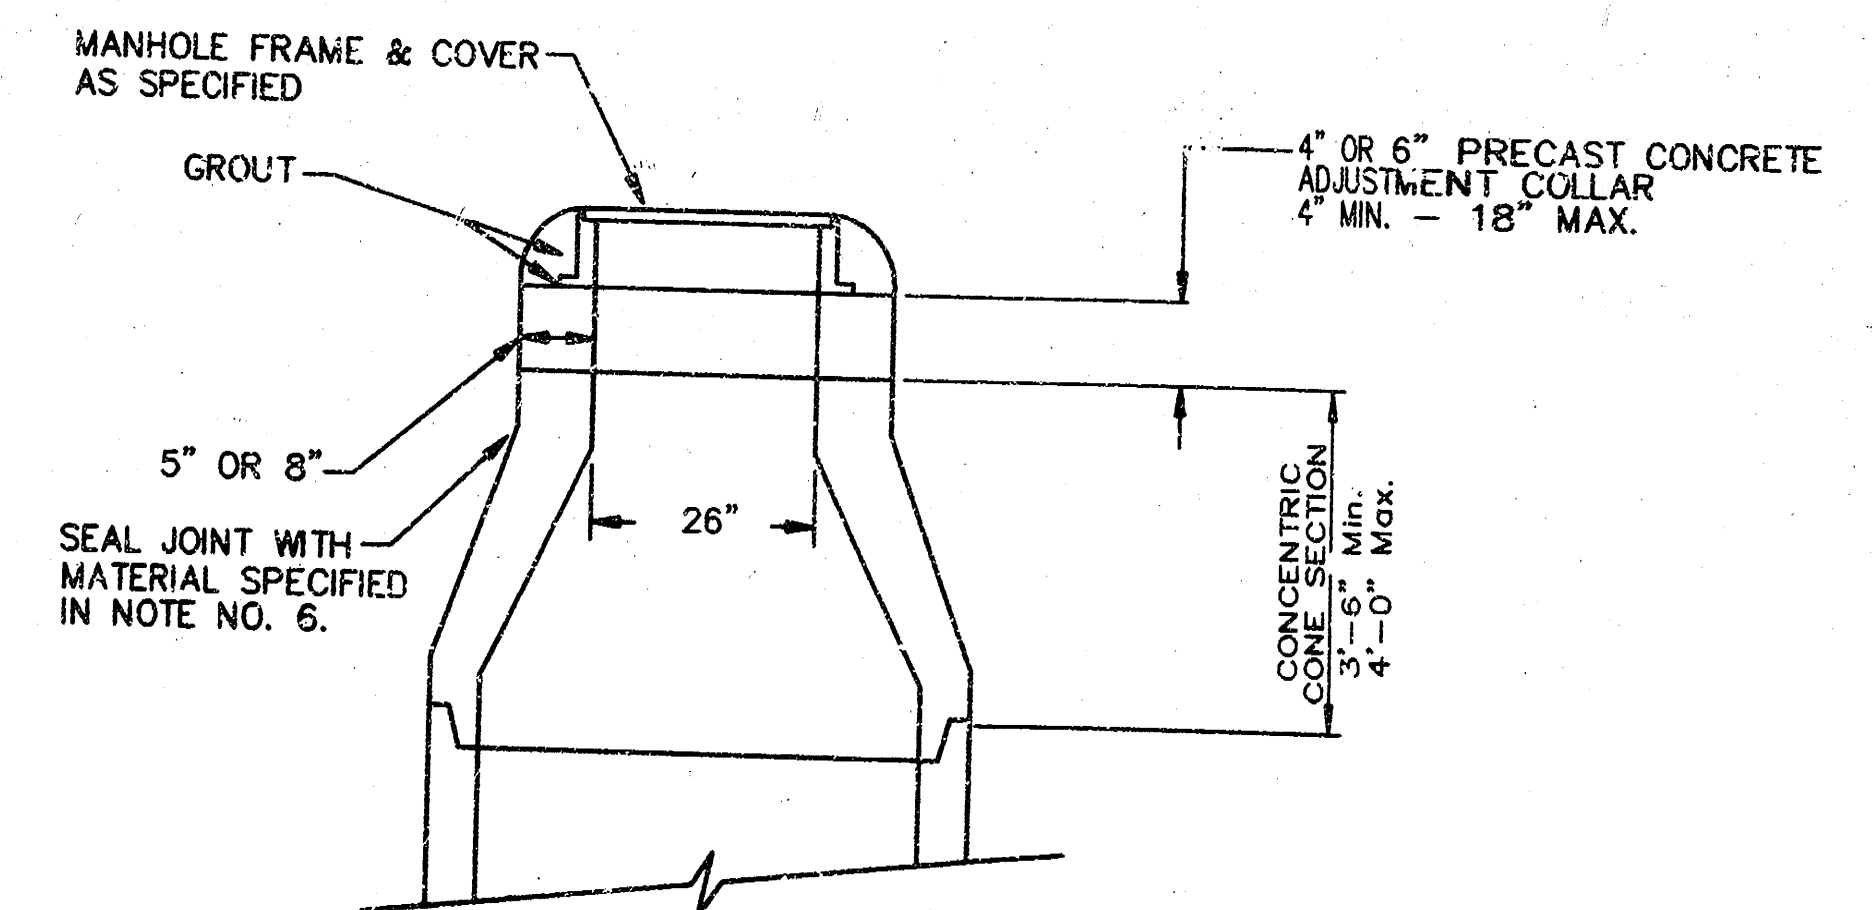

CITY OF WICHITA, KANSAS
STANDARD MANHOLE DETAILS
SEWER APPURTENANCES DETAILS

BAUGHMAN COMPANY P. A. ENGINEERING, SURVEYING & PLANNING 316/262-7271 • 315 E. 10th • WICHITA, KANSAS 67201		REV. NOV. 1993
PROJECT NUMBER 468-76-245-82378-000-000-001		SHEET 6
DESIGN	DRAWN	APPROVED
DATE	SCALE	OF 8

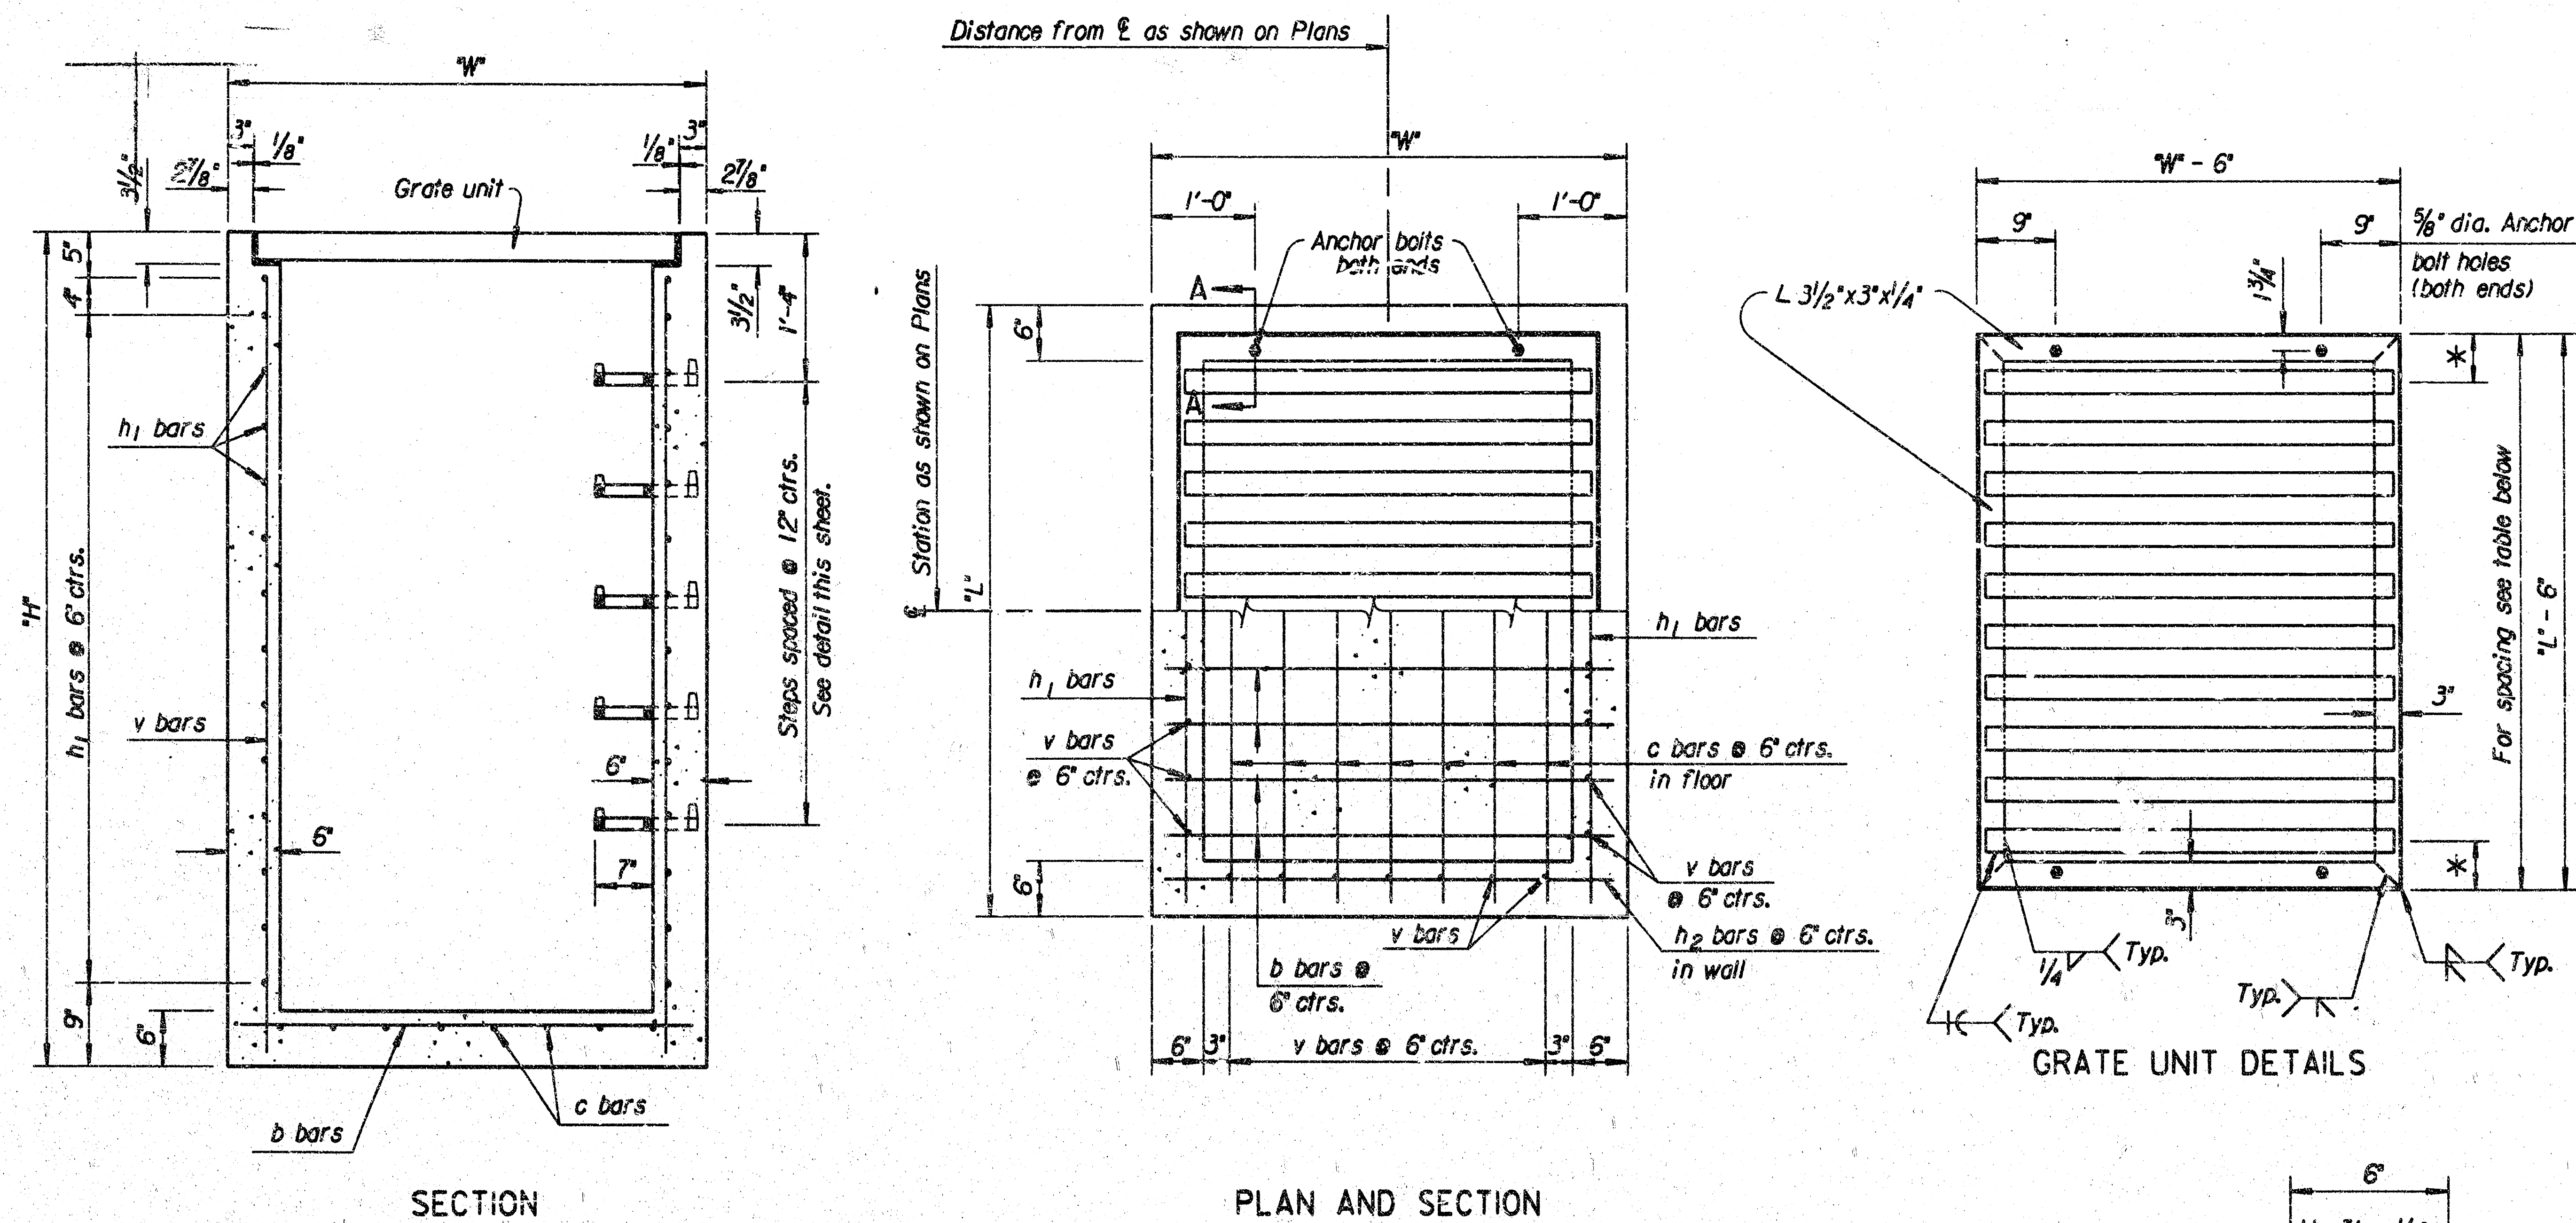

GENERAL NOTE

Use Class A Concrete throughout. All exposed edges shall be finished with an edging tool.

At the contractor's option, Class A Concrete (AE) or mix used in concrete pavement may be used throughout.

In general, pipes will enter and leave the manhole at various positions. Where possible bend bars around pipes.

Floor of inlet shall be shaped as shown in various "Examples" on Reinforced Concrete Manhole Standard No. 633. Concrete used for shaping shall be unreinforced Class "A" Concrete or concrete pavement mix. No addition in concrete quantities shall be made for shaping floor of inlets.

Manhole steps, where used, shall be placed to afford easy access to top of shaped invert.

No deductions in concrete quantities shall be made for pipe openings.


All bars are #4 @ 6" spacing and shall have a minimum clearance of 1 1/2" unless otherwise noted on the plans.

The top of the manhole shall be sloped slightly to approximately fit the ground line or other conditions as directed by the Engineer.

Steps shall be installed on all storm sewer inlets when specified in the plans or when "H" is equal to or greater than six feet. Steps shall comply with the KDOT Standard Specification.


The grate shall be fabricated from standard or commercial grade structural steel and black steel pipe. The unit shall be hot dipped, galvanized after fabrication, in accordance with ASTM A123 except the weight of coating shall average not less than 2.0 ounces per square foot of actual surface and no individual test shall show less than 1.8 ounces of coating per square foot of actual surface area.

All quantities shown are approximate and are presented for information only. Material and excavation costs for construction of the drop inlet are subsidiary to the bid item "Reinforced Concrete Drop Inlet."

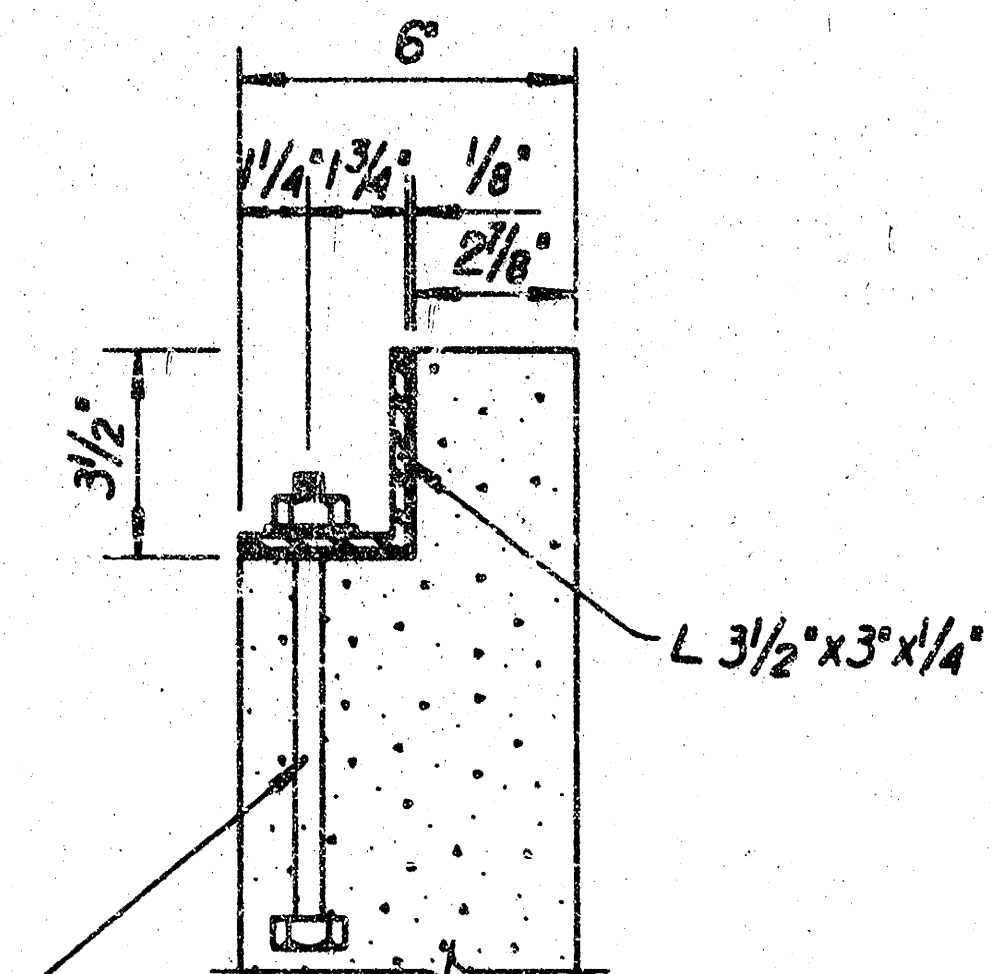

SECTION A-A

Note: Anchor bolts are subsidiary to the bid item "Inlet-Manhole, Special".

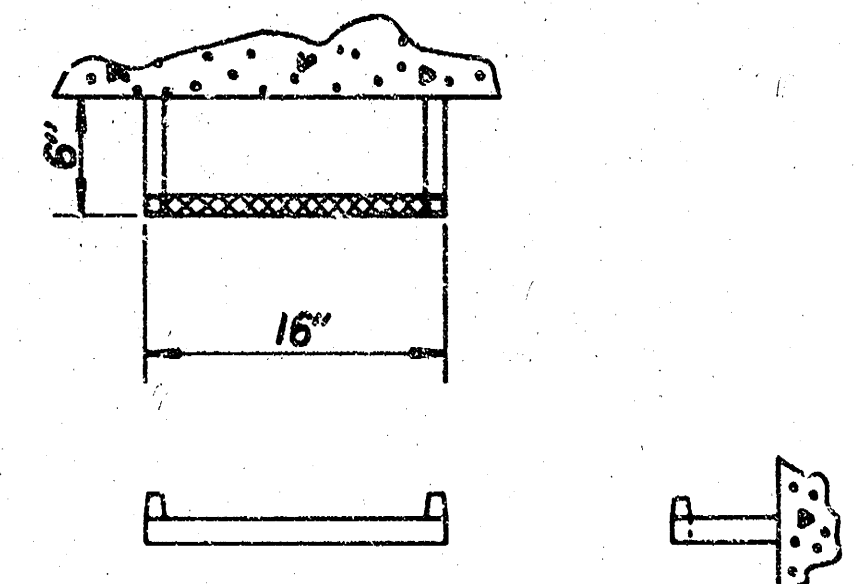

STEP DETAILS

BILL OF MATERIALS FOR INLET-MANHOLE (SPECIAL)																			
"L" x "W" x "H" 4'-6" x 4'-6" x 3'-6"				"L" x "W" x "H" 7'-6" x 4'-6" x 7'-6"				"L" x "W" x "H" 5'-0" x 5'-0" x 10'-9"											
Bar	No.	Size	Length	Bar	No.	Size	Length	Bar	No.	Size	Length	Bar	No.	Size	Length	Bar	No.	Size	Length
v	28	#4	3'-0"	v	40	#4	7'-0"	v	32	#6	10'-3"	v		#4		v		#4	
c	7	#4	4'-3"	c	7	#4	7'-3"	c	8	#4	4'-9"	c		#4		c		#4	
b	7	#4	4'-3"	b	13	#4	4'-3"	b	8	#4	4'-9"	b		#4		b		#4	
h ₁	12	#4	4'-3"	h ₁	28	#4	7'-3"	h ₁	40	#4	4'-9"	h ₁		#4		h ₁		#4	
h ₂	12	#4	4'-3"	h ₂	28	#4	4'-3"	h ₂	40	#4	4'-9"	h ₂		#4		h ₂		#4	
Class "A" Conc. 1.23 Cu.Yd.				Class "A" Conc. 3.42 Cu.Yd.				Class "A" Conc. 4.2 Cu.Yd.				Class "A" Conc. Cu.Yd.				Class "A" Conc. Cu.Yd.			
Reinf. steel 164 Lbs.				Reinf. steel 473 Lbs.				Reinf. steel 778 Lbs.				Reinf. steel Lbs.				Reinf. steel Lbs.			
Struct. steel 260 Lbs.				Struct. steel 430 Lbs.				Struct. steel 320 Lbs.				Struct. steel Lbs.				Struct. steel Lbs.			
Class III Excav. 5 Cu.Yd.				Class III Excav. 17 Cu.Yd.				Class III Excav. 19 Cu.Yd.				Class III Excav. Cu.Yd.				Class III Excav. Cu.Yd.			


BILL OF MATERIALS FOR INLET-MANHOLE (SPECIAL)																							
~~'L' x 'W' x 'H' 4'-6" x 4'-6" x 6'-0"~~				~~'L' x 'W' x 'H' 5'-6" x 4'-6" x 7'-6"~~				~~'L' x 'W' x 'H' 4'-0" x 4'-0" x 4'-6"~~				~~'L' x 'W' x 'H' 4'-6" x 4'-6" x 4'-0"~~				~~'L' x 'W' x 'H' 4'-6" x 4'-6" x 4'-6"~~				~~'L' x 'W' x 'H' 5'-6" x 4'-6" x 5'-0"~~			
Bar	No.	Size	Length	Bar	No.	Size	Length	Bar	No.	Size	Length	Bar	No.	Size	Length	Bar	No.	Size	Length	Bar	No.	Size	Length
v	28	#4	5'-6"	v	32	#4	7'-0"	v	24	#4	4'-0"	v	28	#4	3'-6"	v	29	#4	4'-0"	v	32	#4	4'-6"
c	7	#4	4'-3"	c	7	#4	5'-3"	c	6	#4	3'-9"	c	7	#4	4'-3"	c	7	#4	4'-3"	c	7	#4	5'-3"
b	7	#4	4'-3"	b	9	#4	4'-3"	b	6	#4	3'-9"	b	7	#4	4'-3"	b	7	#4	4'-3"	b	9	#4	4'-3"
h ₁	22	#4	4'-3"	h ₁	28	#4	5'-3"	h ₁	16	#4	3'-9"	h ₁	14	#4	4'-3"	h ₁	16	#4	4'-3"	h ₁	18	#4	5'-3"
h ₂	22	#4	4'-3"	h ₂	28	#4	4'-3"	h ₂	16	#4	3'-9"	h ₂	14	#4	4'-3"	h ₂	16	#4	4'-3"	h ₂	18	#4	4'-3"
Class 'A' Conc. 1.96 Cu.Yd.				Class 'A' Conc. 2.83 Cu.Yd.				Class 'A' Conc. 1.30 Cu.Yd.				Class 'A' Conc. 1.32 Cu.Yd.				Class 'A' Conc. 1.52 Cu.Yd.				Class 'A' Conc. 1.91 Cu.Yd.			
Reinf. steel	268	Lbs.		Reinf. steel	377	Lbs.		Reinf. steel	174	Lbs.		Reinf. steel	185	Lbs.		Reinf. steel	205	Lbs.		Reinf. steel	261	Lbs.	
Struct. steel	260	Lbs.		Struct. steel	315	Lbs.		Struct. steel	206	Lbs.		Struct. steel	260	Lbs.		Struct. steel	260	Lbs.		Struct. steel	375	Lbs.	
Class III Excav.	9	Cu.Yd.		Class III Excav.	14	Cu.Yd.		Class III Excav.	6	Cu.Yd.		Class III Excav.	6	Cu.Yd.		Class III Excav.	7	Cu.Yd.		Class III Excav.	9	Cu.Yd.	

PIPE DIMENSIONS AND SPACING				
L x W	No. of Bars	Dia. x Length x Spacing		*
7'-6" x 4'-6"	13	2 1/2" x 3'-10 1/4" pipes @ 6' ctrs.		6'
5'-8" x 4'-6"	10	2 1/2" x 3'-10 1/4" pipes @ 5 1/2" ctrs.		5 1/4'
4'-8" x 4'-6"	8	2 1/2" x 3'-10 1/4" pipes @ 5 1/2" ctrs.		4 1/4'
4'-0" x 4'-0"	7	2 1/2" x 3'-4 1/4" pipes @ 5 1/2" ctrs.		4'
5'-0" x 5'-0"	9	2 1/2" x 4'-4 1/4" pipes @ 6' ctrs.		6"

6	1-30-92	Rev. step det. env. issent. on CAUD	R.J.S.	J.O.B.
5	10-8-86	Rev. pipe clearance on No. 10 & 8	R.J.S.	J.O.B.
NO.	DATE	REVISIONS	BY	APP'D
KANSAS DEPARTMENT OF TRANSPORTATION INLET - MANHOLE, SPECIAL				
STD. NO. 648				
PICTA APPROVAL		2-27-92	APP'D James O. Brewer	
DESIGNED	DETAILS	QUANTITIES	TRACED	S.W.L.
CHECKED	DETAIL CK.	QUAN. CK.	TRACE CK.	R.J.S.

LAKE RIDGE COMMERCIAL 2ND ADDITION

WICHITA, SEDGWICK COUNTY, KANSAS

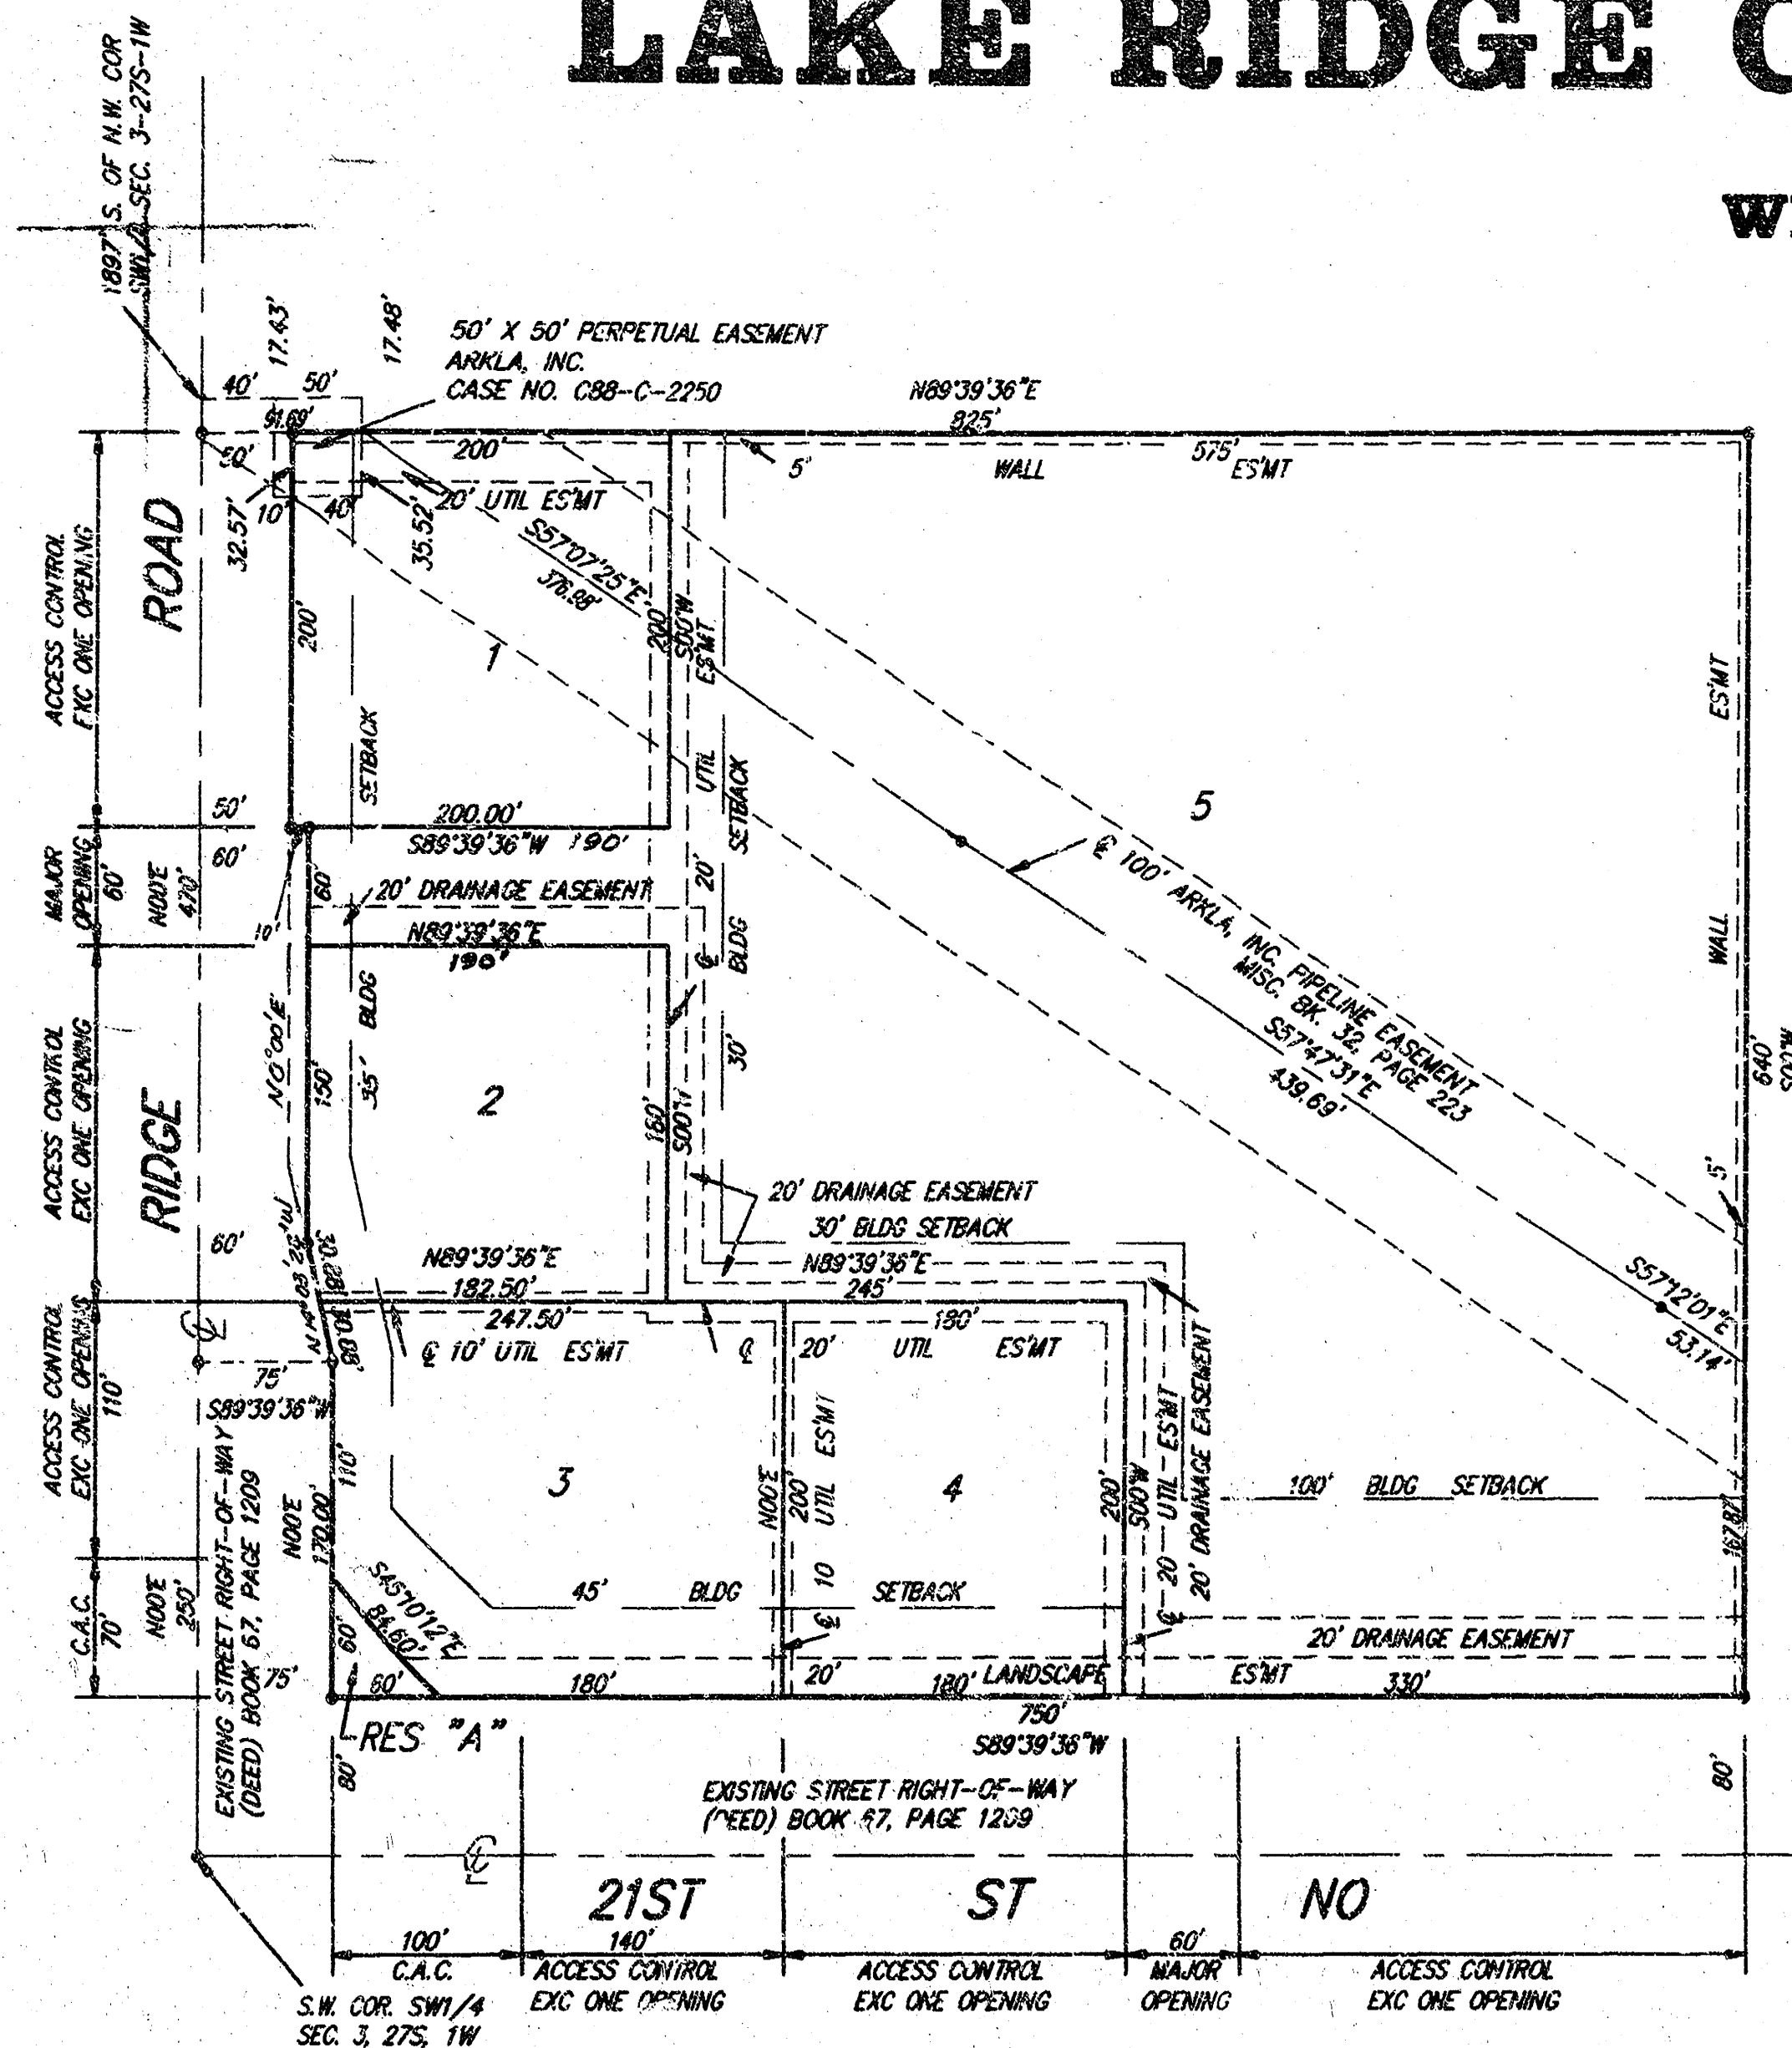

NOTE: THERE ARE ADDITIONAL SETBACK REQUIREMENTS FOR THE APPROVED ASSOCIATED C.U.P. (DP-205) ON FILE WITH MAPS.

State of Kansas) SS We, Baughman Company, P.A., Surveyors in Sedgwick County and State do hereby certify that we have surveyed and platted "LAKE RIDGE COMMERCIAL 2ND ADDITION", Wichita, Sedgwick County, Kansas and that the accompanying plat is a true and correct exhibit of the property surveyed, described as and being a replat of Lake Ridge Commercial Addition, Wichita, Sedgwick County, Kansas.

All being situated in the SW1/4 of Sec. 3, Twp. 27-S, R-1-W of the 6th P.M., Sedgwick County, Kansas.

Existing public easements and dedications being vacated by virtue of K.S.A. 12-512(b).

Baughman Company, P.A.

Gregory F. Severns Surveyor

Know all men by these presents that we, the undersigned, have caused the land in the surveyors certificate to be platted into Lots, Reserves and streets to be known as "LAKE RIDGE COMMERCIAL ADDITION", Wichita, Sedgwick County, Kansas. Reserve "A" is hereby reserved for earthberms, landscaping, lighting, irrigation, drainage, signage, entry monuments, sidewalks, bike paths and utilities confined to easements. The landscaping easements are hereby granted as indicated for the construction and maintenance of private landscaping, allowing for earthberms, landscaping, lighting, irrigation, drainage, signage, sidewalks, bike paths, utilities confined to easements and utilities and driveways are allowed to cross these easements. Reserve "A" shall be owned by the lot owners association for the addition and Reserve "A" and the landscaping easements shall be maintained by the lot owners association for the addition. The 5 foot wall easements are hereby granted as indicated for the construction and maintenance of a private wall and utilities are allowed to cross these easements. The utility easements are hereby granted as indicated for the construction and maintenance of all public utilities. The drainage easement is hereby granted for the use of drainage purposes. The street is hereby dedicated to and for the use of the public. Access controls are hereby granted to the appropriate governing body as indicated on the face of the plat and shall be determined by the engineer of the appropriate governing body.

Lake Ridge Investors, L.C.,

Managing Member

Jerry Hoggatt

Prairie Capital, Inc.

President

W. Newton Male

Quiktrip Corporation

Executive Vice-President

Alvin Howerton

State of Kansas) SS The foregoing instrument acknowledged before me, this day of 1994, by Jerry Hoggatt, President of Lake Ridge Investors, L.C., a Kansas Limited Liability Company, on behalf of the corporation.

Notary Public

My App't. Exp. _____

State of Kansas) SS The foregoing instrument was acknowledged before me this day of 1994, by W. Newton Male, President of Prairie Capital, Inc.

Notary Public

My App't. Exp. _____

State of Oklahoma) SS The foregoing instrument was acknowledged before me this day of 1994, by Alvin Howerton, Executive Vice-President of Quiktrip Corporation.

Notary Public

My App't. Exp. _____

This plat of "LAKE RIDGE COMMERCIAL 2ND ADDITION", Sedgwick County, Kansas has been submitted to and approved by the Wichita-Sedgwick County Metropolitan Area Planning Commission Wichita, Kansas. Dated this day of 1994. Wichita-Sedgwick County Metropolitan Area Planning Commission

Chairman

James D. Miner

Secretary

Marvin S. Krout

This plat approved and all dedications shown hereon accepted by the City Council of the City of Wichita, Kansas, this day of 1994.

Mayor

Elma Broadfoot

Deputy City Clerk

Pat Burnett

State of Kansas) SS This is to certify that this plat has been filed for record in the office of the Register of Deeds, this day of 1994, at o'clock M, and is duly recorded.

Register of Deeds

Pat Kettler

Deputy

Ed Resa

Entered on transfer record this day of 1994.

County Clerk

Susan E. Crockett-Spoon

We, the undersigned, holders of a mortgage on the above described property, do hereby consent to this plat of "LAKE RIDGE COMMERCIAL ADDITION", Wichita, Sedgwick County, Kansas.

Prairie State Bank of Maize

Vice-President

Chris A. Anderson

State of Kansas) SS The foregoing instrument acknowledged before me, this day of 1994, by Chris A. Anderson, Vice-President of Prairie State Bank of Maize, on behalf of the corporation.

Notary Public

My App't. Exp. _____

BAUGHMAN COMPANY P.A.
ENGINEERING, SURVEYING & PLANNING
316-282-7271 • 315 ELLIS • WICHITA, KANSAS 67211

8/8

10-2-1-3