



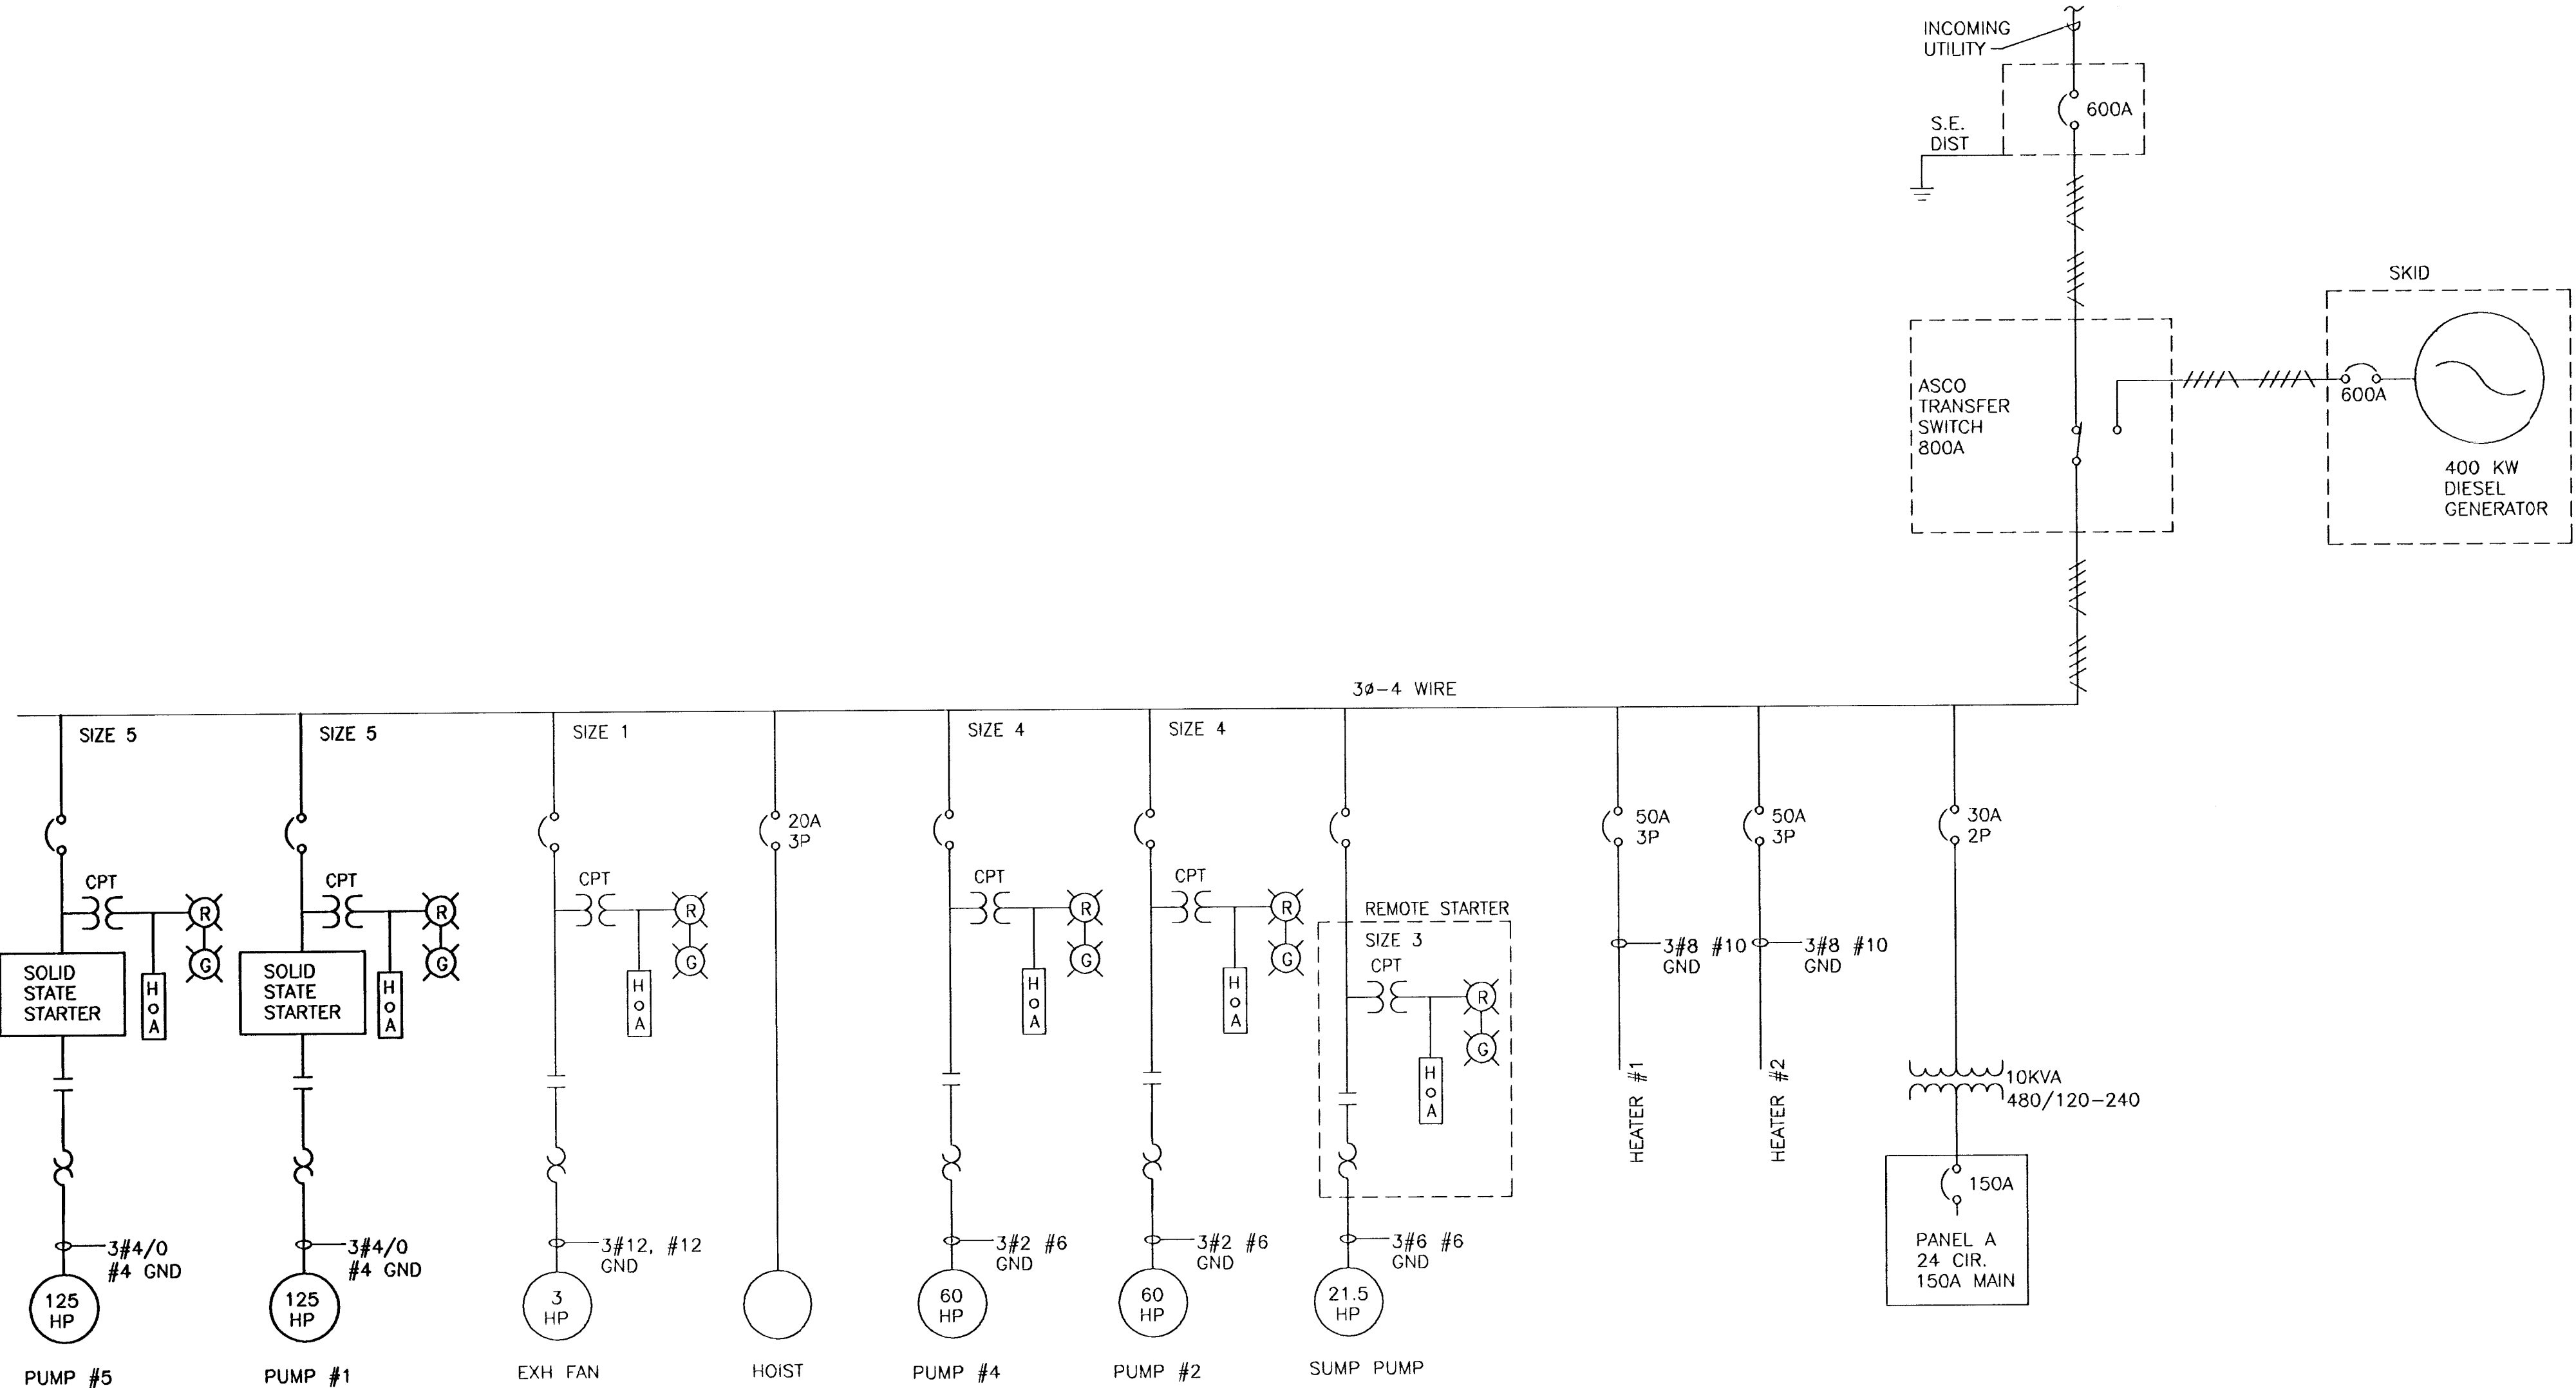


MOTOR CONTROL CENTER ONE-LINE DIAGRAM

SCALE: NONE

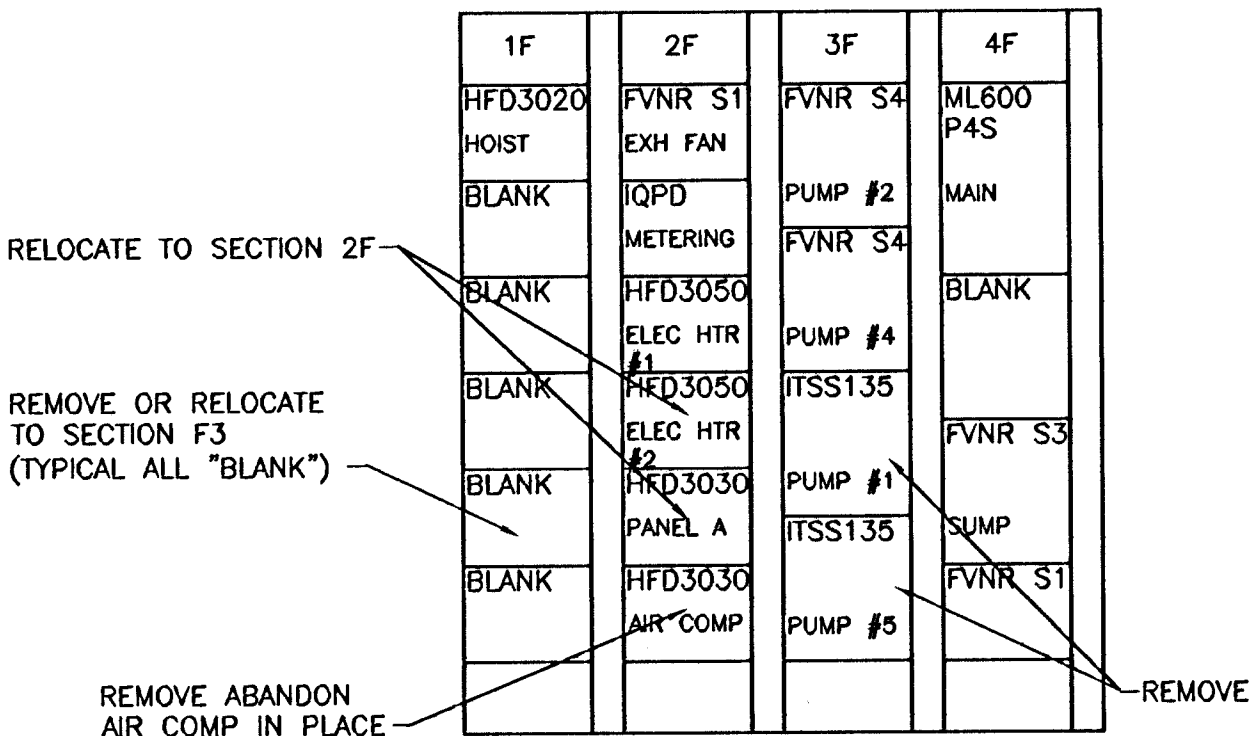

MCC FRONT ELEVATION (OLD LINE-UP)

SCALE: NONE

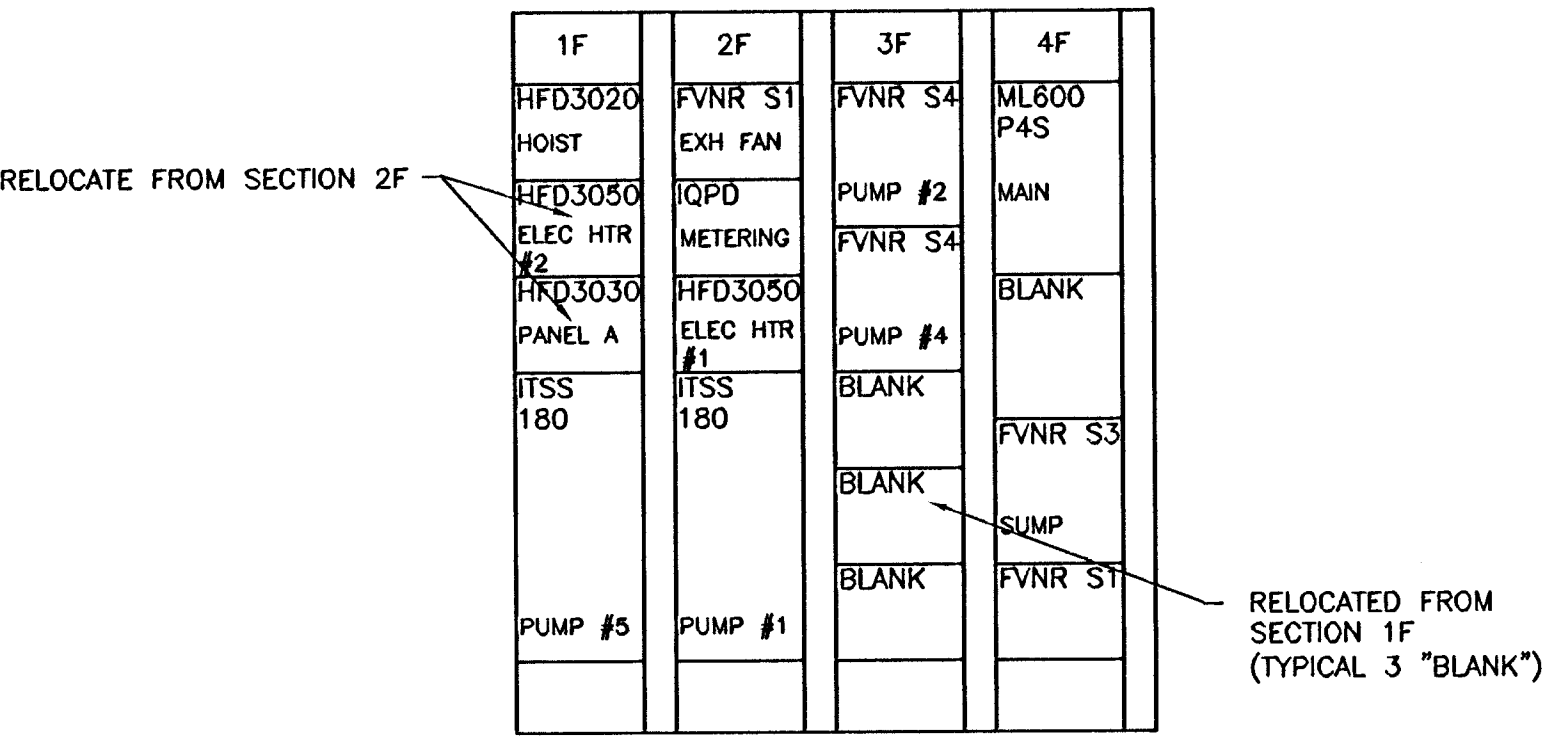

MCC FRONT ELEVATION (NEW LINE-UP)

SCALE: NONE

480VAC MOTOR CONTROL CENTER 3Ø-4 WIRE-GND																										
PH 3		WIRE 4	HZ 60		HORIZONTAL BUS = 800A COPPER-TIN PLATED				VERTICAL - 300A			TOTAL CONNECTED LOAD =										NORMAL OPERATION LOAD =				
BUS BRACING = 65 KA RMS SYMMETRICAL SHORT CIRCUIT													INTERRUPTING CAPACITY = 65KA													
MCC UNIT NO.	EQUIP. NO.	SERVICE	RATING	FULL LOAD AMPS	RPM	SERVICE FACTOR	STARTER TYPE	STARTER SIZE	SPACE REQ.	CIRCUIT BREAKER		AUTO RESTART	EXTRA INTERLOCKS										SCHEMATIC DIAGRAMS	NOTES		
										FRAME	TRIP PLUG		SWITCH				IND. LIGHTS									
													STOP	HAND-OFF-ENABLE	FAST-SLOW-STOP	GREEN (STOPPED)	RED (RUN FWD FAST)	AMBER (VERY SLOW)	WHITE (LOCKED OUT)							
																				PUSH-TO-TEST						
													NO		NC								CONT. PWR. XCHG. W/ 2PRI & 2 SEC FUSES			
	PUMP #1	STORM WATER PUMP #1	125 HP	156	900	1.15	SOFT ST.	5	6X	250		-	2	2	X		X	X			X	X			SOLID STATE SOFT START 180A MIN RATED	
	PUMP #5	STORM WATER PUMP #5	125 HP	156	900	1.15	SOFT ST.	5	6X	250		-	2	2	X		X	X			X	X			SOLID STATE SOFT START 180A MIN RATED	

NOTES:

- HMCP--MOTOR CIRCUIT PROTECTOR BREAKERS SHALL BE SUPPLIED AND SETTINGS OF TRIP PLUGS AND OVER LOAD RELAYS SHALL BE COORDINATED WITH THE EQUIPMENT AND THE ENGINEER FOR FINAL SETTINGS.
- MOTOR CONTROL CIRCUITRY SHALL BE PROVIDED SUCH THAT "HAND-OFF-AUTO" PROVIDES COMPLETE LOCAL CONTROL ON HAND AND REMOTE CONTROL BY "AUTO".
- CONTRACTOR SHALL REPLACE TWO EXISTING 100 HP "CUTLER-HAMMER" SOFT START MOTOR STARTERS WITH NEW 125 HP STARTERS & RELOCATE THEM WITHIN THE MCC STRUCTURE AS INDICATED.



CITY OF WICHITA, KANSAS
STORMWATER PUMP STATION NO. 1
REPLACE PUMP 1 & 5 MTRS & STARTERS

PROJECT NAME

ONE-LINE DIAGRAM

SHEET TITLE

SLA

DESIGN BY:

RES

DRAWN BY:

SLA

CHECKED BY:

SEPTEMBER, 2002

DATE

0214102

DRAWING NAME

E1 / 2

SHEET / OF