


SEWER PIPE JOINTS—Ends of pipe shall be dry when the joints are made. Jute shall be lumped into the angular space between the spigot and the bell in sufficient amount to seal the joint at the end of the spigot without unnecessarily filling the angular space. Joints shall be made with poured hot asphalt jointing material, using flaxite, B.K. or similar compounds.

B.M. Elev. 171.67 - 6" in Globe N. of Hillside & N. of Carmen

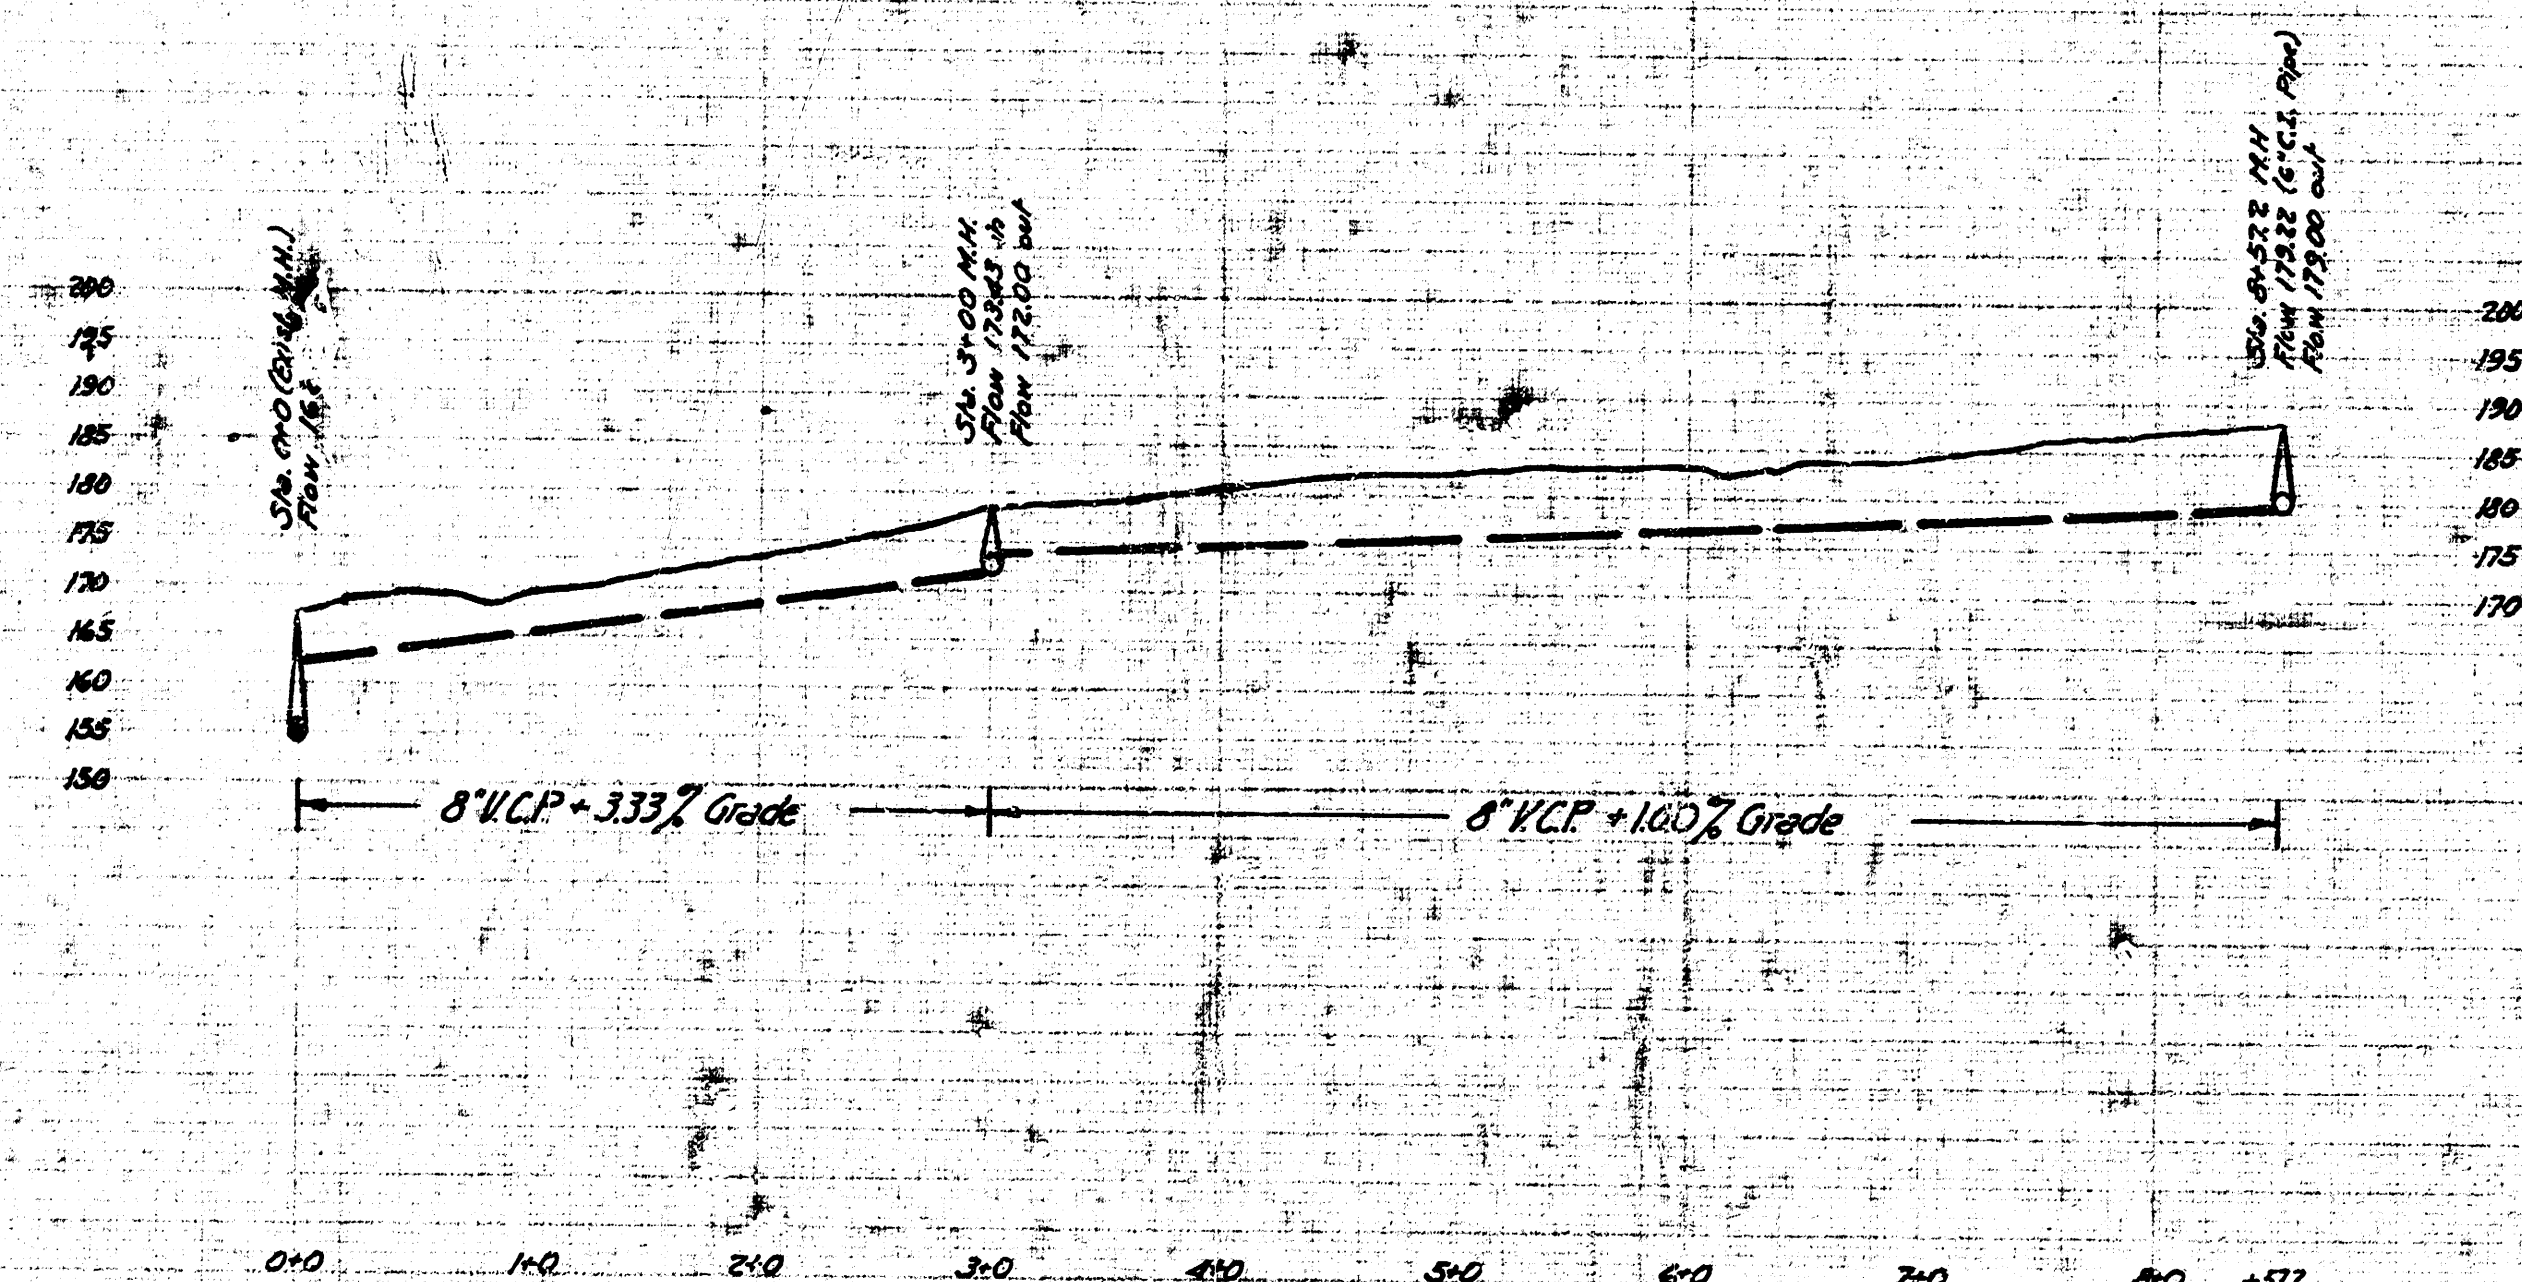

DEPARTMENT OF SERVICE - CITY OF WICHITA, KANSAS

ENGINEERING DIVISION

L.K. WHITE CITY ENGINEER

PLAN SCALE 1"=80' PROFILE SCALE - HORIZ. 1"=80' VERT. 1"=20'

JULY 1966 DESIGN BY B.E.S. 7/5/66

Booked & J.W.
3k E. Pg. 118.
-1-61-