


STATE	PROJECT NO.	YEAR	SHEET NO.	SHEETS
KANSAS	87 N-0190-01	2005	34	96

CRUSHED ROCK GRADATION REQUIREMENTS

Percent of Aggregate Retained	1 1/2"	0
	3/4"	15-60
	# 4	40-80
	#40	74-92
	P-200	4-12

Rock Quality Shall Be The Same As Specified For Coarse Aggregate For Asphalt Concrete Mixes.

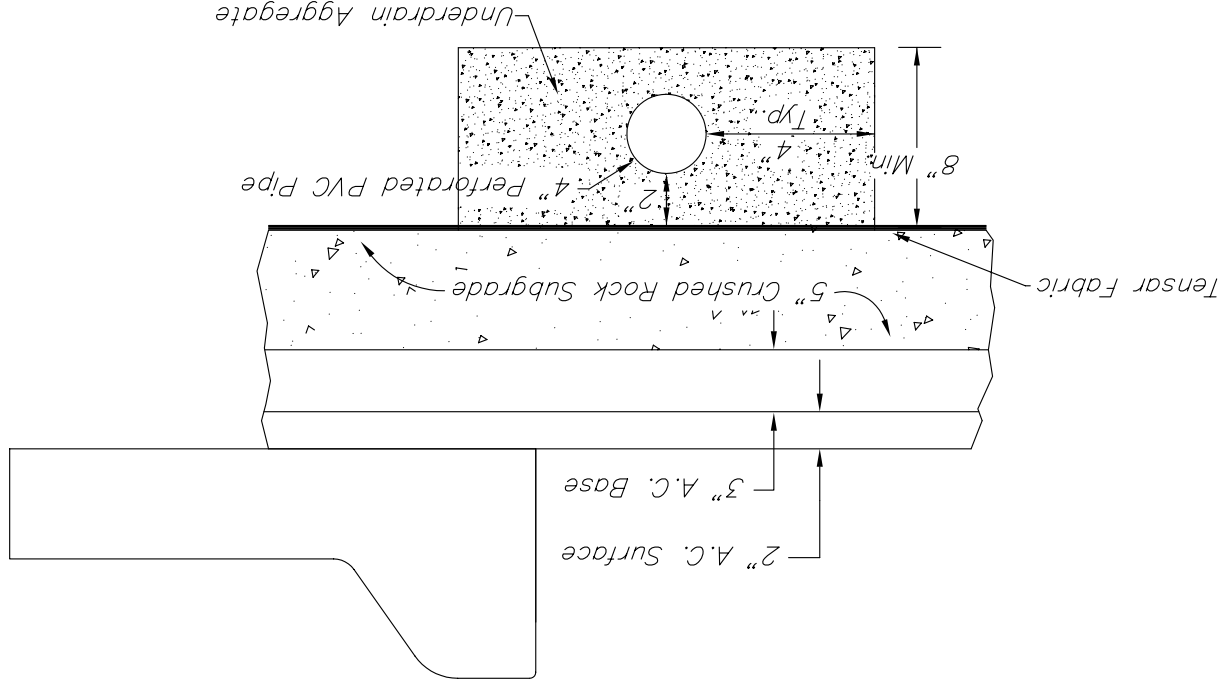

NOTE: Place 4" PVC Perforated Pipe at all drainage sump locations.
 Cost of Underdrain System to be incidental to the Reinforced Crushed Rock Subgrade.

THE CITY OF WICHITA


CITY ENGINEER'S OFFICE
 CITY HALL - SEVENTH FLOOR
 445 NORTH MAIN STREET
 WICHITA, KANSAS 67202
 (316) 268-4501
 (316) 268-4114 FAX

JIM ARMOUR, P.E. - CITY ENGINEER

PROJECT NUMBER XXX-XXXXX
 INDEX CODE XXXXX



DATE JULY 2005
 SHEET 34 OF 96

PAVEMENT UNDERDRAIN DETAIL

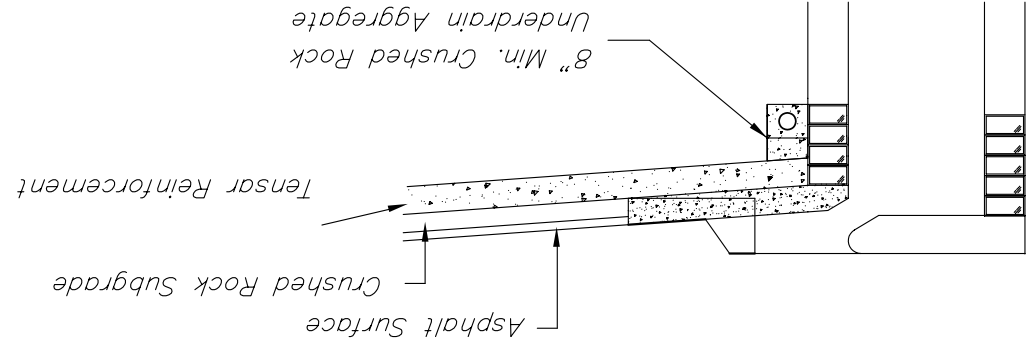

SECTION A-A

(Min. 16 Perforations Per Lin. Ft. @ 1/4" Dia.)
 Perforations To Be on Bottom Half

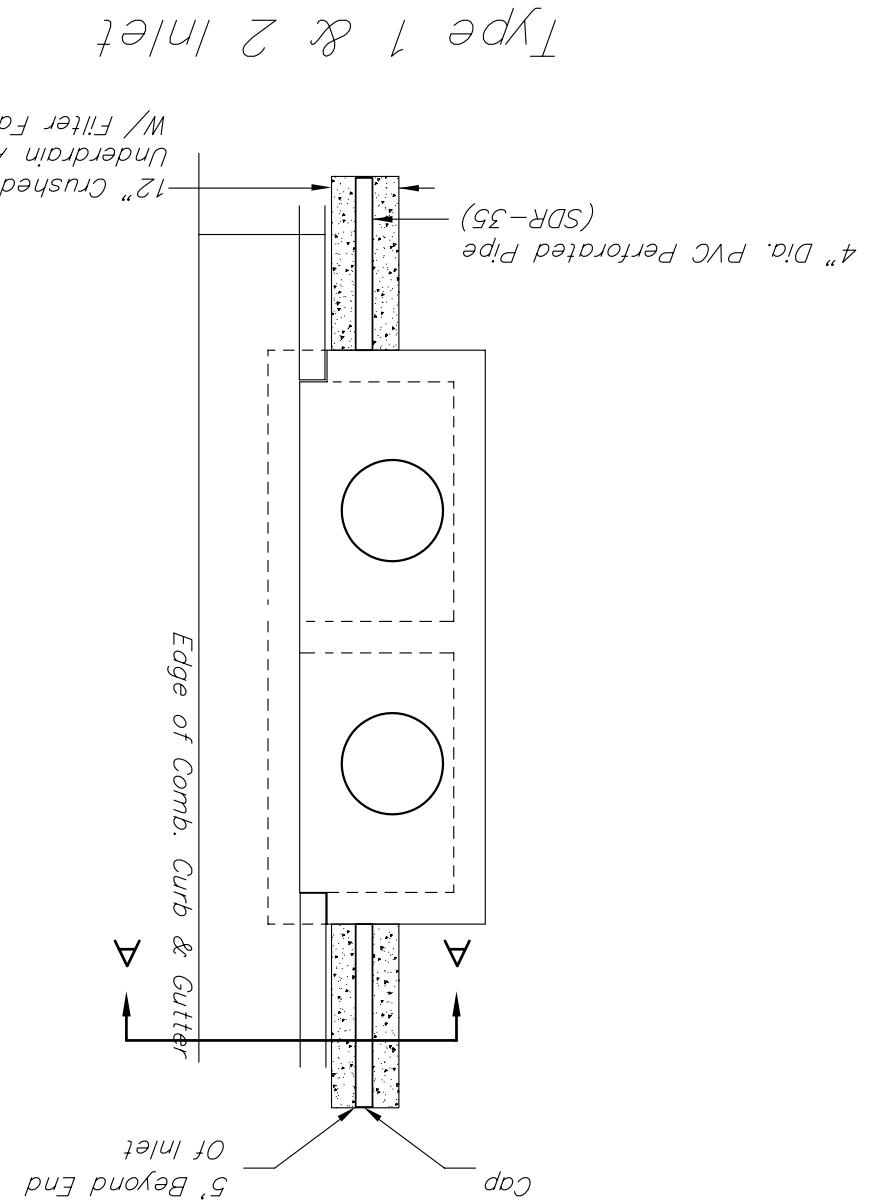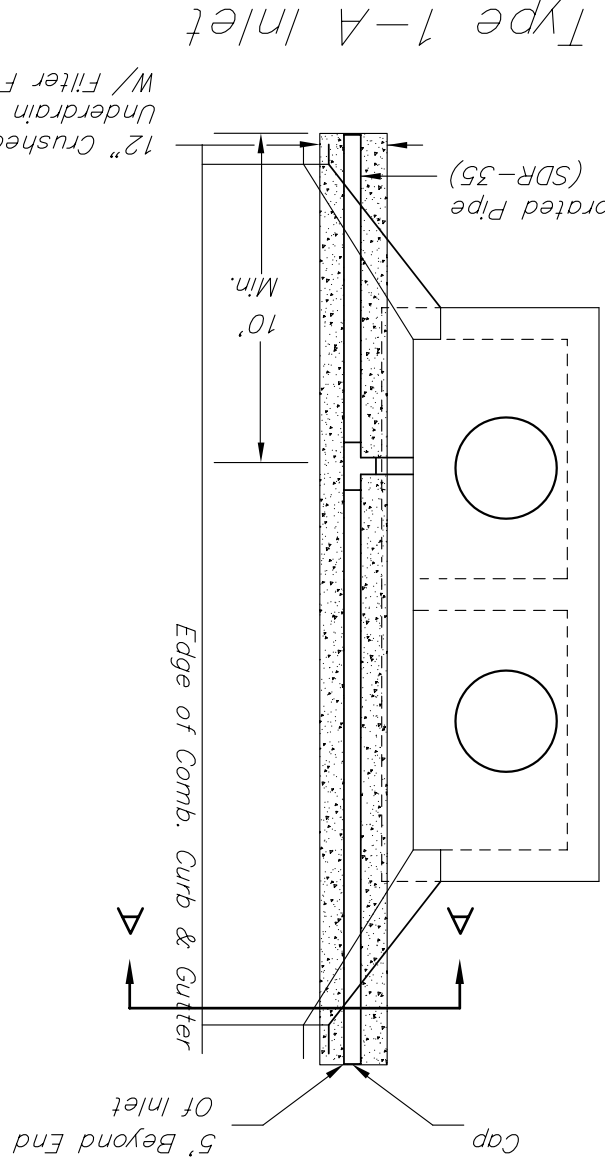

PAVEMENT UNDERDRAIN DETAIL