



NOTE TO CONTRACTOR
 This project will be constructed under the supervision of the CITY ENGINEER and conforming to the SPECIFICATIONS of the CITY OF WICHITA. The CONTRACTOR will reimburse the City of Wichita for all cost of Engineering Plans, and Inspection.

8-17-77
APPROVED AS NOTED
 By CITY ENGINEER OF WICHITA
 Sanitary Sewers _____
 Storm Sewers _____
 Driveway Approaches _____

K.O. Taylor, PE
 Rev. 7-21-77
 Rev. 8-12-77
 Rev. 8-16-77

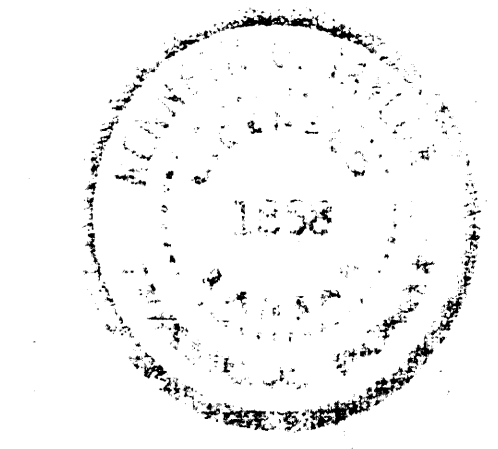

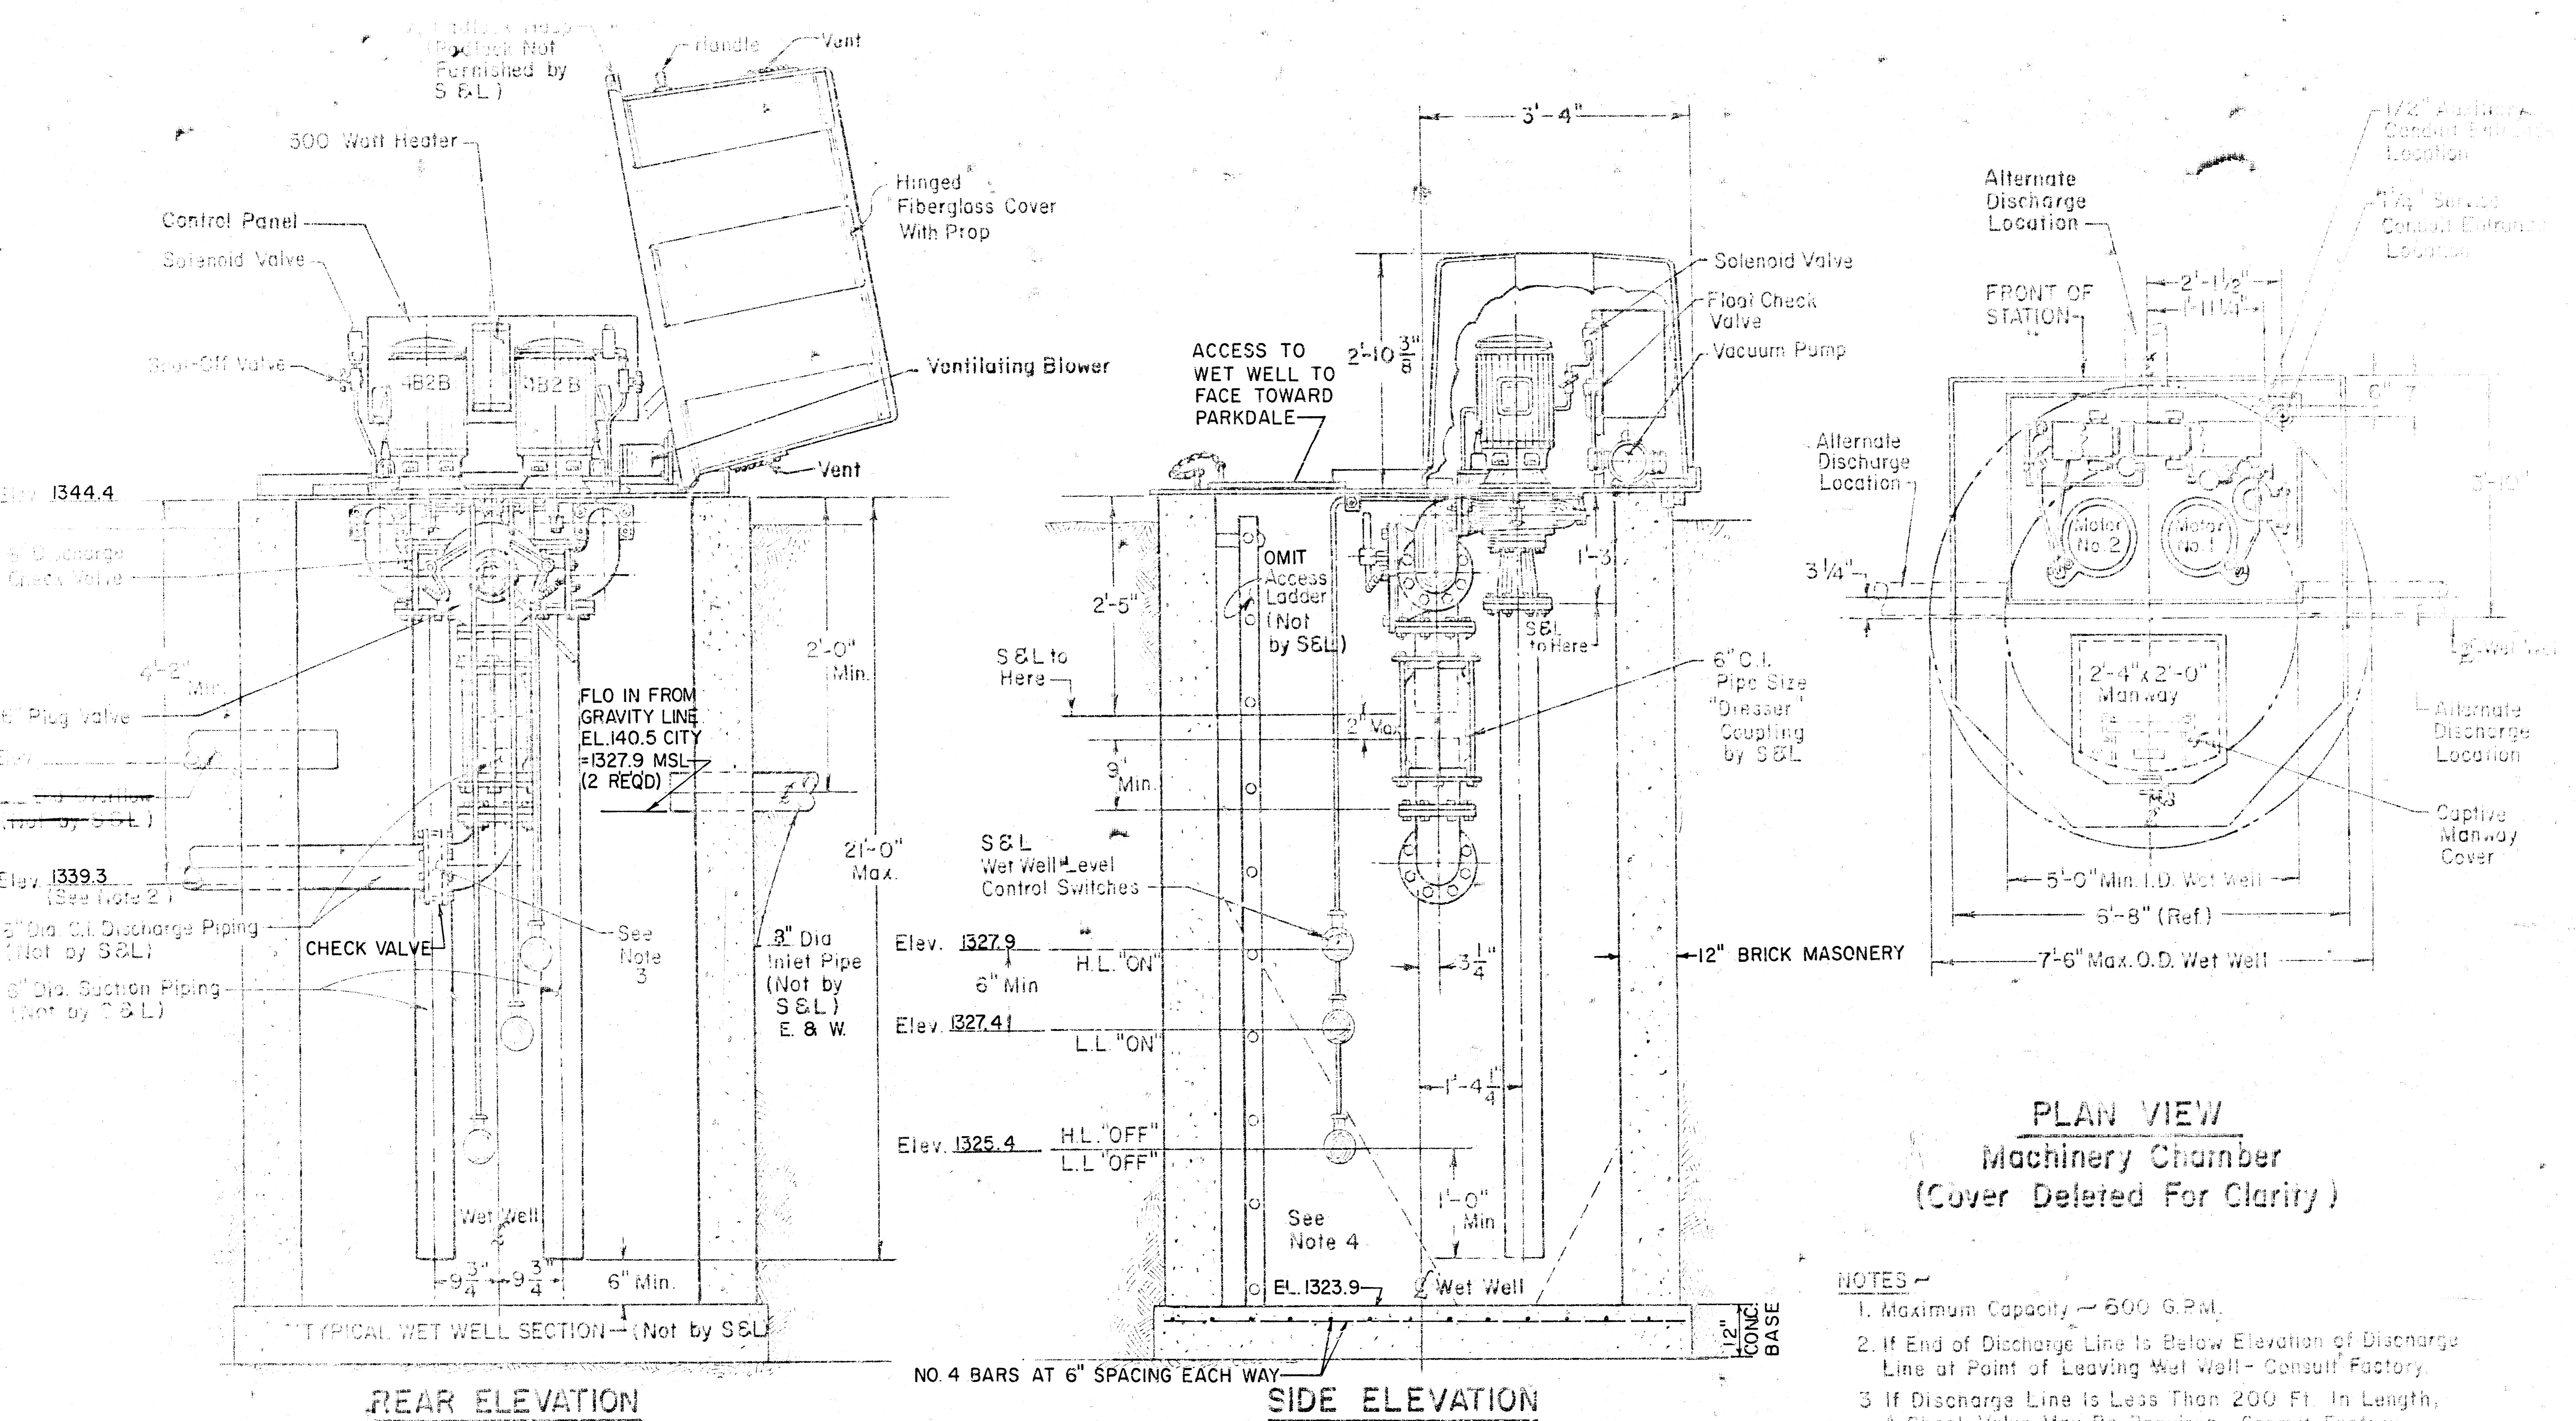

PLAN VIEW
Machinery Chamber
 (Cover Deleted For Clarity)

- NOTES**
1. Maximum Capacity - 600 G.P.M.
 2. If End of Discharge Line is Below Elevation of Discharge Line at Point of Leaving Wet Well - Consult Factory.
 3. If Discharge Line is Less Than 200 Ft. In Length, A Check Valve May Be Required - Consult Factory.
 4. Provide 60° Slope in Wet Well - As Required.

K.O. TAYLOR, P.E.
 AUG. 16, 1977

SHEET 3 OF 3 SHEETS

DRAWING NO. 86B102
 ("D" SIZE DWG. 86D107)

B.M. El. 1347.31 - Top of Iron @ SE. Cor. SE 1/4 Sec. 7-27-1W



PATENTED IN THE U.S.A. & FOREIGN COUNTRIES		971 19	
E 10-12 9/16 O 10-21 1/2 C 10-23 1/2 B 10-24 1/2 A 10-25 1/2		BASLAM 3-77 TUCKER 3-77 MARTIN 3-77 1000	
WET-Well-MOUNTED SEWAGE PUMP LIFT STATION 6" PIPING - 5/8" DIA. WET WELL			
86D107			