


NOTE:

All 6" V.C.P. leads to be enclosed with 8" reinforced concrete encasement.
See 125' grade on all 6" leads.
Joints on 6" pipe shall be PVC.

NOTE To Field Engineer:

See stationing of both sides of all 6" leads and set five diagonal and perpendicular distances from the 6" leads.

Surveyed by J. E. Smith
Checked by J. E. Smith
Date: Nov. 1963

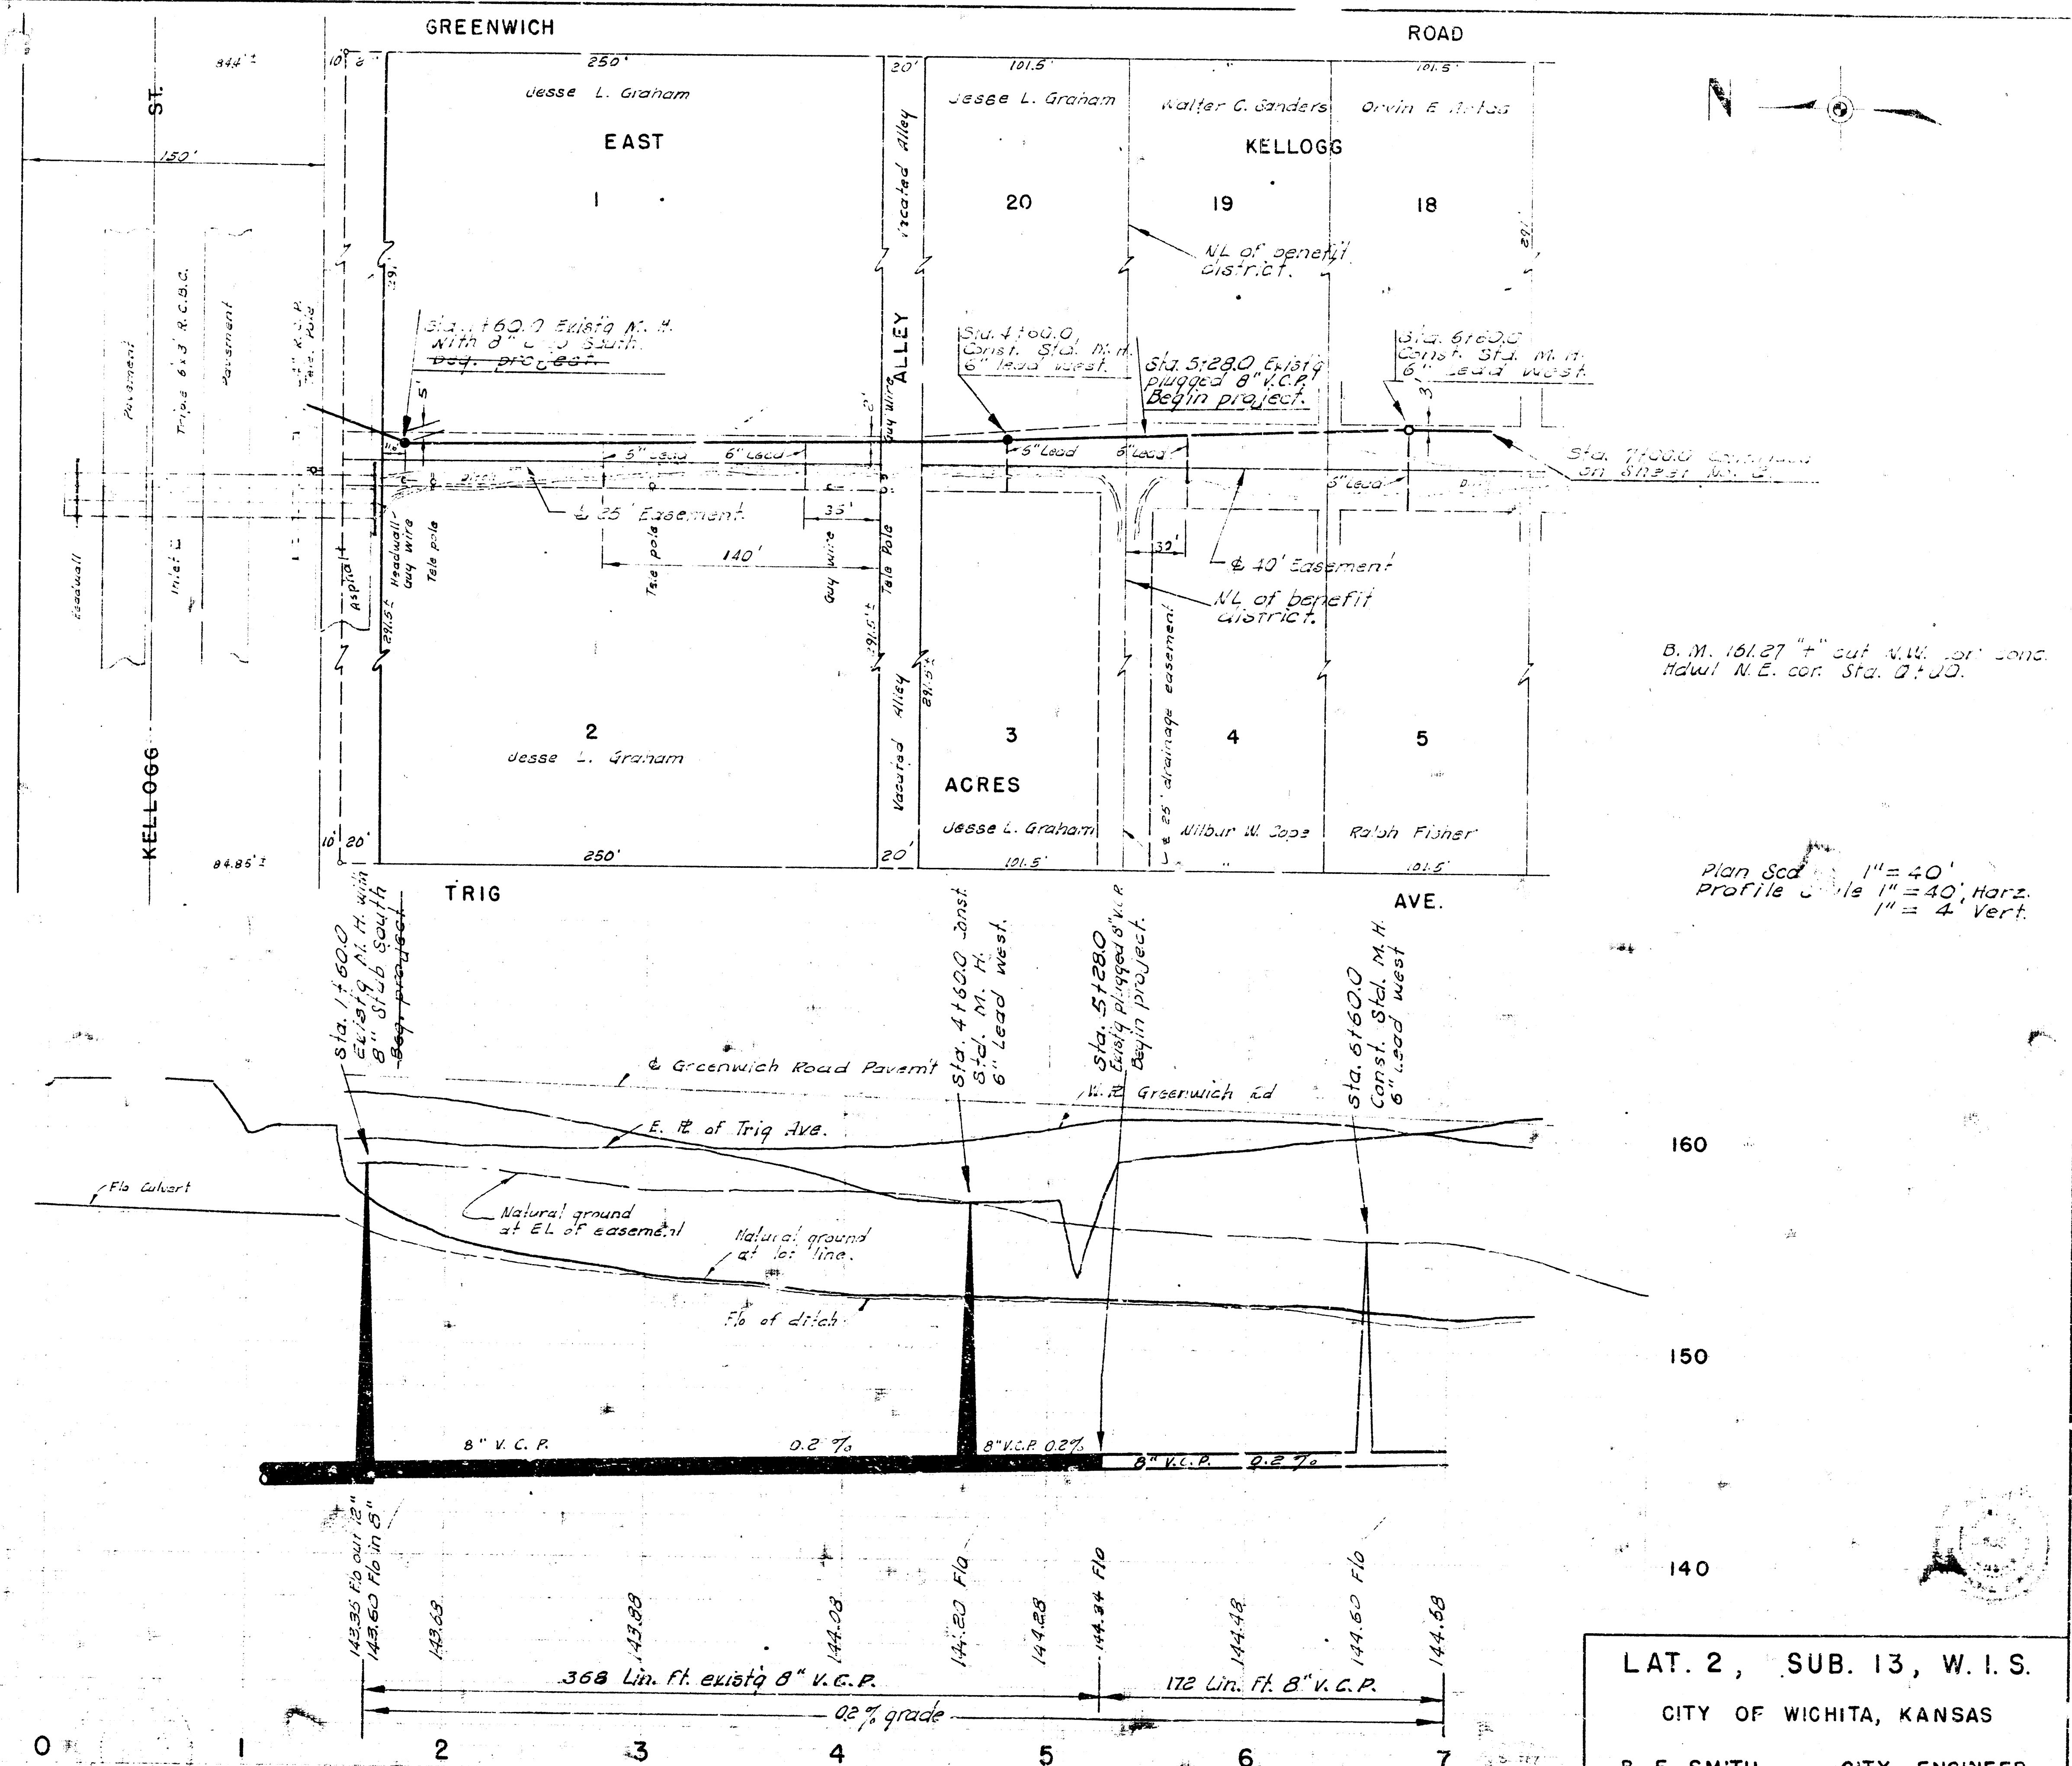

LAT. 2, SUB. 13, W. I. S.

CITY OF WICHITA, KANSAS

B. E. SMITH CITY ENGINEER

NOV. 1963 PROJECT NO. C23-4

SHEET NO. 1 OF 2

