



DATE	NO.	PROFILE
NOVEMBER 1964	1	PROFILES
DECEMBER 1964	2	GRADES 1-10
JANUARY 1965	3	S. W. 1/4
FEBRUARY 1965	4	SECTION 1
MARCH 1965	5	SECTION 2
APRIL 1965	6	SECTION 3
MAY 1965	7	SECTION 4
JUNE 1965	8	SECTION 5
JULY 1965	9	SECTION 6
AUGUST 1965	10	SECTION 7
SEPTEMBER 1965	11	SECTION 8
OCTOBER 1965	12	SECTION 9
NOVEMBER 1965	13	SECTION 10
DECEMBER 1965	14	SECTION 11
JANUARY 1966	15	SECTION 12
FEBRUARY 1966	16	SECTION 13
MARCH 1966	17	SECTION 14
APRIL 1966	18	SECTION 15
MAY 1966	19	SECTION 16
JUNE 1966	20	SECTION 17
JULY 1966	21	SECTION 18
AUGUST 1966	22	SECTION 19
SEPTEMBER 1966	23	SECTION 20
OCTOBER 1966	24	SECTION 21
NOVEMBER 1966	25	SECTION 22
DECEMBER 1966	26	SECTION 23
JANUARY 1967	27	SECTION 24
FEBRUARY 1967	28	SECTION 25
MARCH 1967	29	SECTION 26
APRIL 1967	30	SECTION 27
MAY 1967	31	SECTION 28
JUNE 1967	32	SECTION 29
JULY 1967	33	SECTION 30
AUGUST 1967	34	SECTION 31
SEPTEMBER 1967	35	SECTION 32
OCTOBER 1967	36	SECTION 33
NOVEMBER 1967	37	SECTION 34
DECEMBER 1967	38	SECTION 35
JANUARY 1968	39	SECTION 36
FEBRUARY 1968	40	SECTION 37
MARCH 1968	41	SECTION 38
APRIL 1968	42	SECTION 39
MAY 1968	43	SECTION 40
JUNE 1968	44	SECTION 41
JULY 1968	45	SECTION 42
AUGUST 1968	46	SECTION 43
SEPTEMBER 1968	47	SECTION 44
OCTOBER 1968	48	SECTION 45
NOVEMBER 1968	49	SECTION 46
DECEMBER 1968	50	SECTION 47
JANUARY 1969	51	SECTION 48
FEBRUARY 1969	52	SECTION 49
MARCH 1969	53	SECTION 50
APRIL 1969	54	SECTION 51
MAY 1969	55	SECTION 52
JUNE 1969	56	SECTION 53
JULY 1969	57	SECTION 54
AUGUST 1969	58	SECTION 55
SEPTEMBER 1969	59	SECTION 56
OCTOBER 1969	60	SECTION 57
NOVEMBER 1969	61	SECTION 58
DECEMBER 1969	62	SECTION 59
JANUARY 1970	63	SECTION 60
FEBRUARY 1970	64	SECTION 61
MARCH 1970	65	SECTION 62
APRIL 1970	66	SECTION 63
MAY 1970	67	SECTION 64
JUNE 1970	68	SECTION 65
JULY 1970	69	SECTION 66
AUGUST 1970	70	SECTION 67
SEPTEMBER 1970	71	SECTION 68
OCTOBER 1970	72	SECTION 69
NOVEMBER 1970	73	SECTION 70
DECEMBER 1970	74	SECTION 71
JANUARY 1971	75	SECTION 72
FEBRUARY 1971	76	SECTION 73
MARCH 1971	77	SECTION 74
APRIL 1971	78	SECTION 75
MAY 1971	79	SECTION 76
JUNE 1971	80	SECTION 77
JULY 1971	81	SECTION 78
AUGUST 1971	82	SECTION 79
SEPTEMBER 1971	83	SECTION 80
OCTOBER 1971	84	SECTION 81
NOVEMBER 1971	85	SECTION 82
DECEMBER 1971	86	SECTION 83
JANUARY 1972	87	SECTION 84
FEBRUARY 1972	88	SECTION 85
MARCH 1972	89	SECTION 86
APRIL 1972	90	SECTION 87
MAY 1972	91	SECTION 88
JUNE 1972	92	SECTION 89
JULY 1972	93	SECTION 90
AUGUST 1972	94	SECTION 91
SEPTEMBER 1972	95	SECTION 92
OCTOBER 1972	96	SECTION 93
NOVEMBER 1972	97	SECTION 94
DECEMBER 1972	98	SECTION 95
JANUARY 1973	99	SECTION 96
FEBRUARY 1973	100	SECTION 97
MARCH 1973	101	SECTION 98
APRIL 1973	102	SECTION 99
MAY 1973	103	SECTION 100
JUNE 1973	104	SECTION 101
JULY 1973	105	SECTION 102
AUGUST 1973	106	SECTION 103</

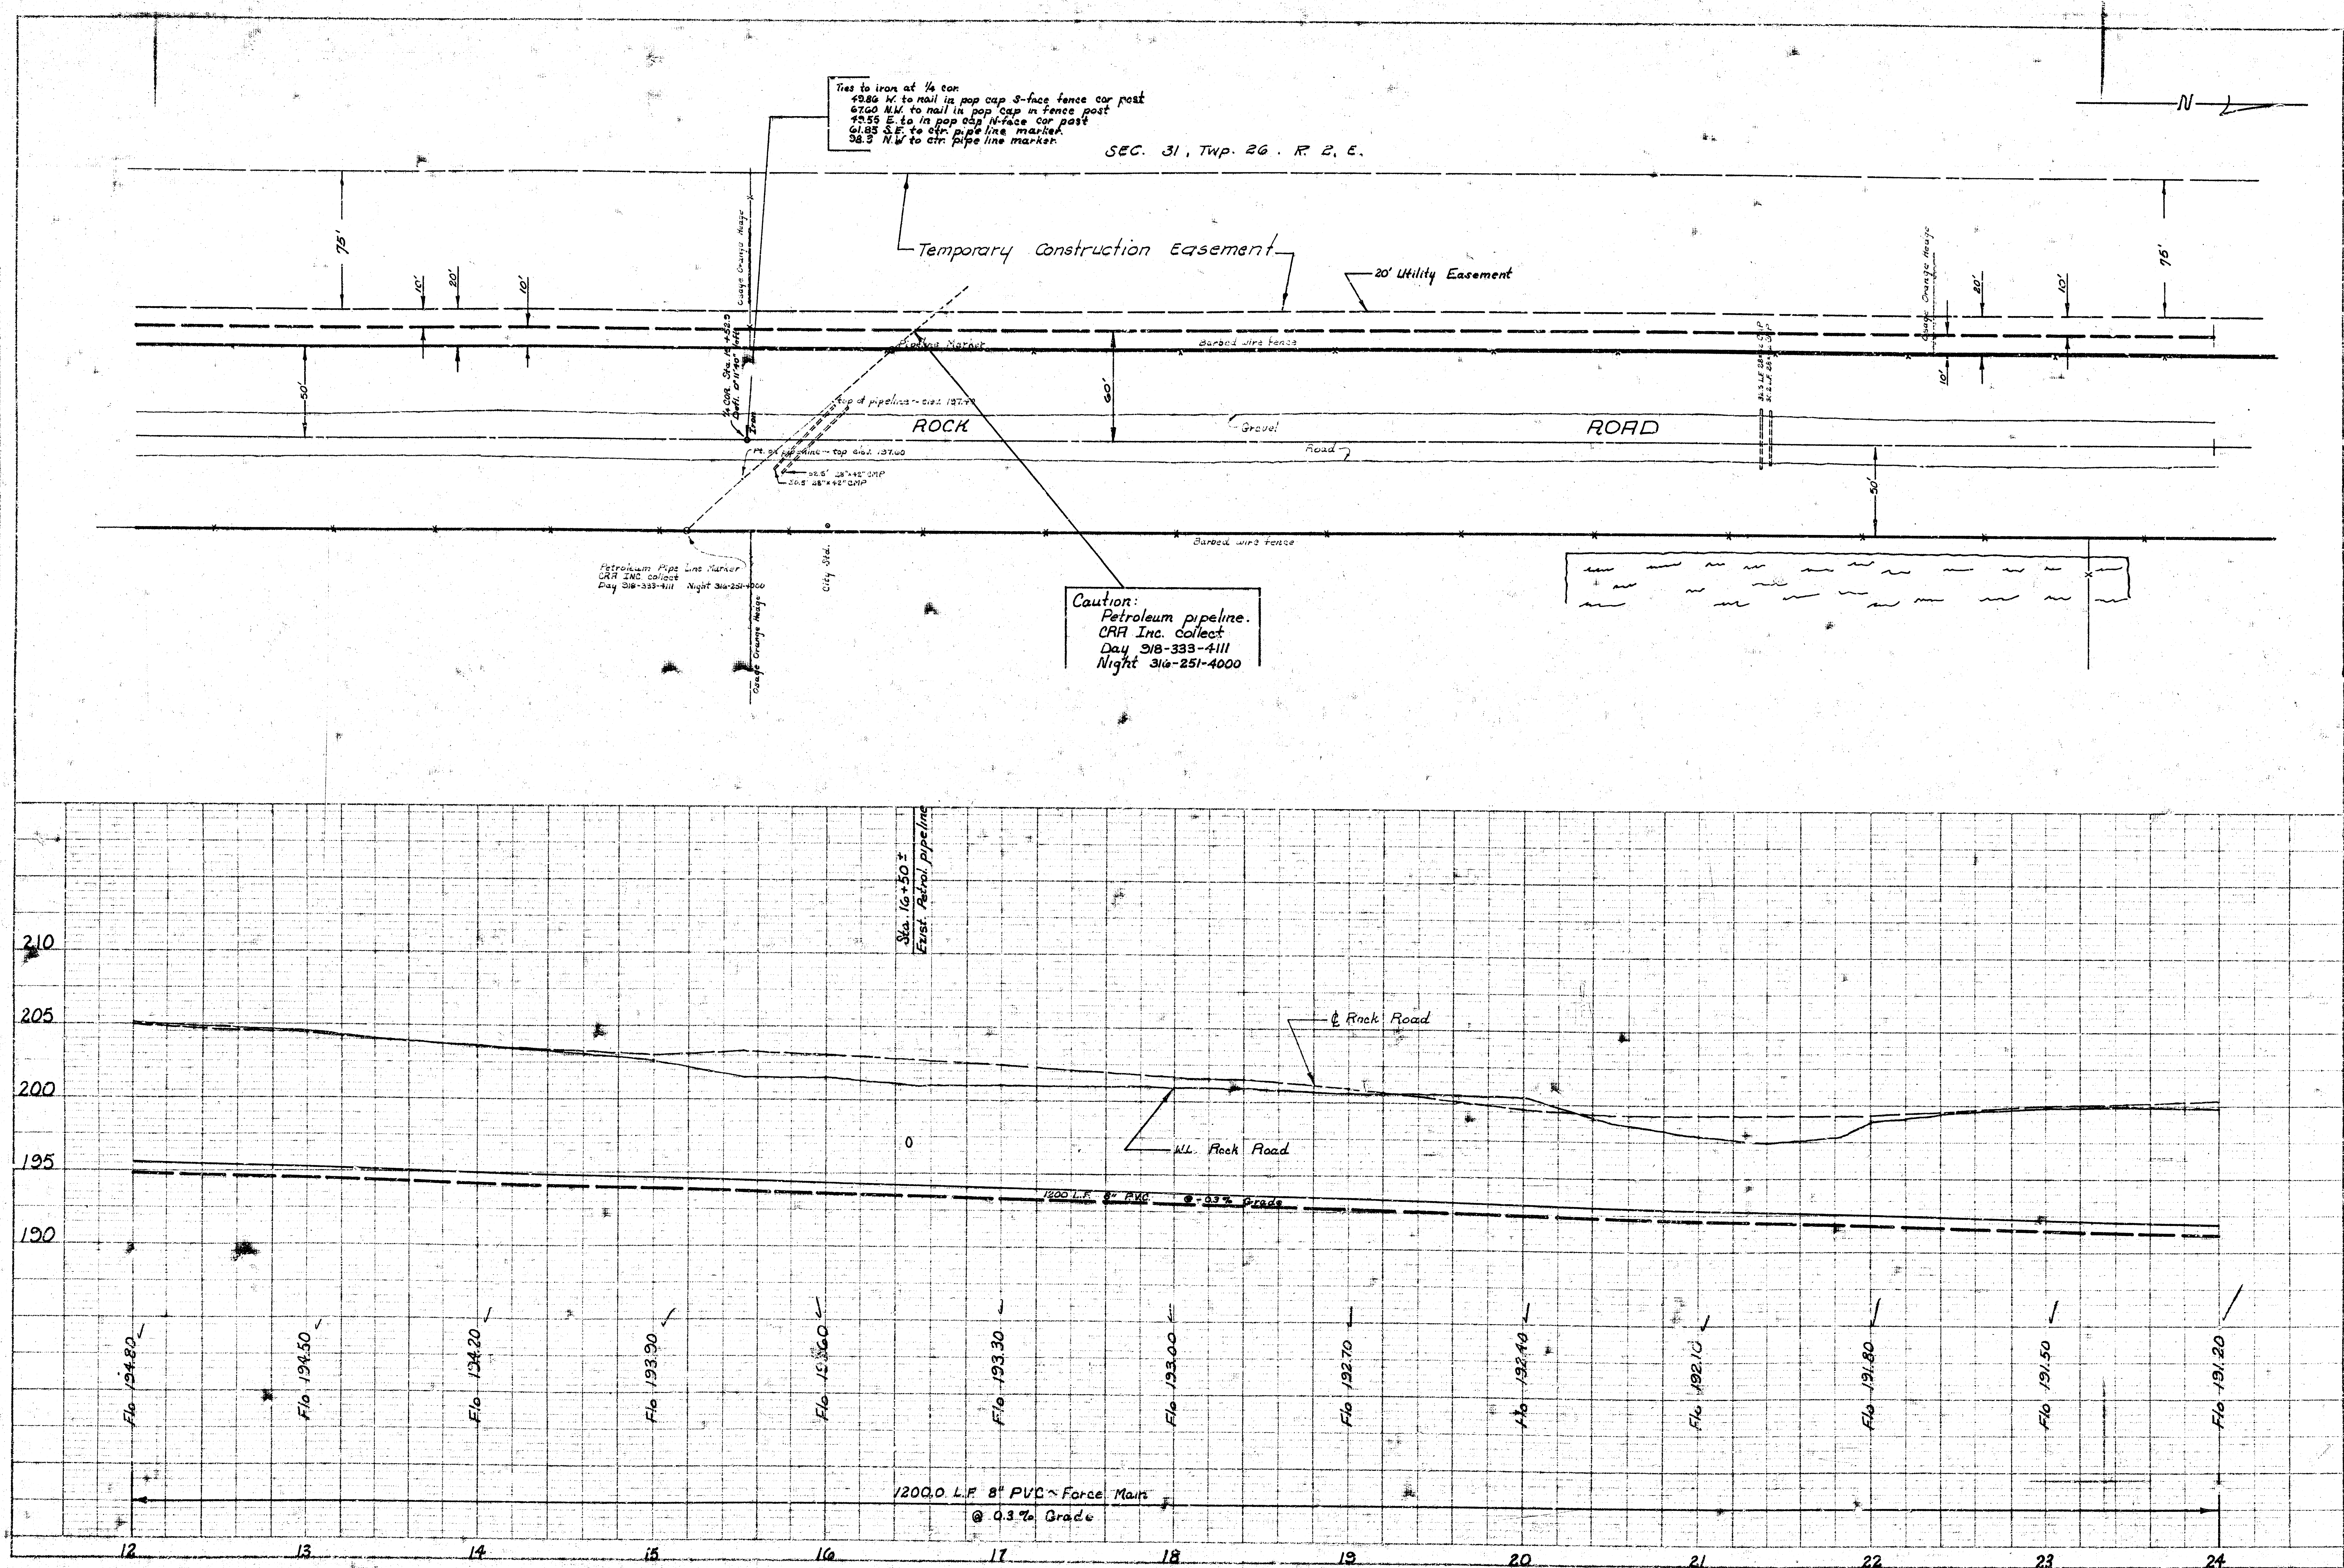

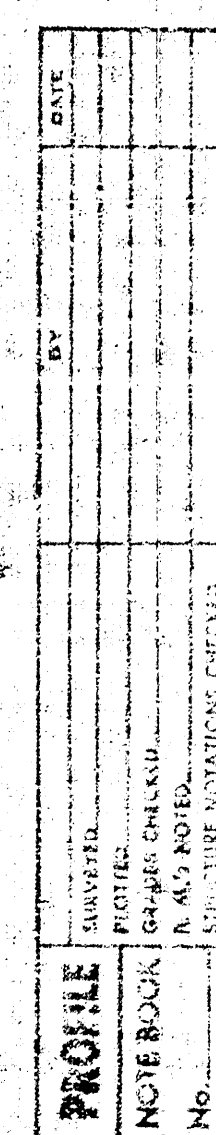


Note:
Contractor to provide service pole & guy wire & determine location in field for installation. Contact Mr. Steele with K.G.E. (Commercial elec.) to determine when electric power will be available.
Contractor to provide weatherproof disconnect switch as recommended by lift station supplier.


Note: Contractor to provide 1/2" service conduit from disconnect switch on service pole to station entrance. Conduit shall be rigid galv. metallic above grade & rigid, non-metallic above below grade. Provide equipment ground in P.V.C. conduit.

Note: Contractor to provide 6" discharge pipe

Note: Contractor to provide 6"-8" increaser outside wet well.

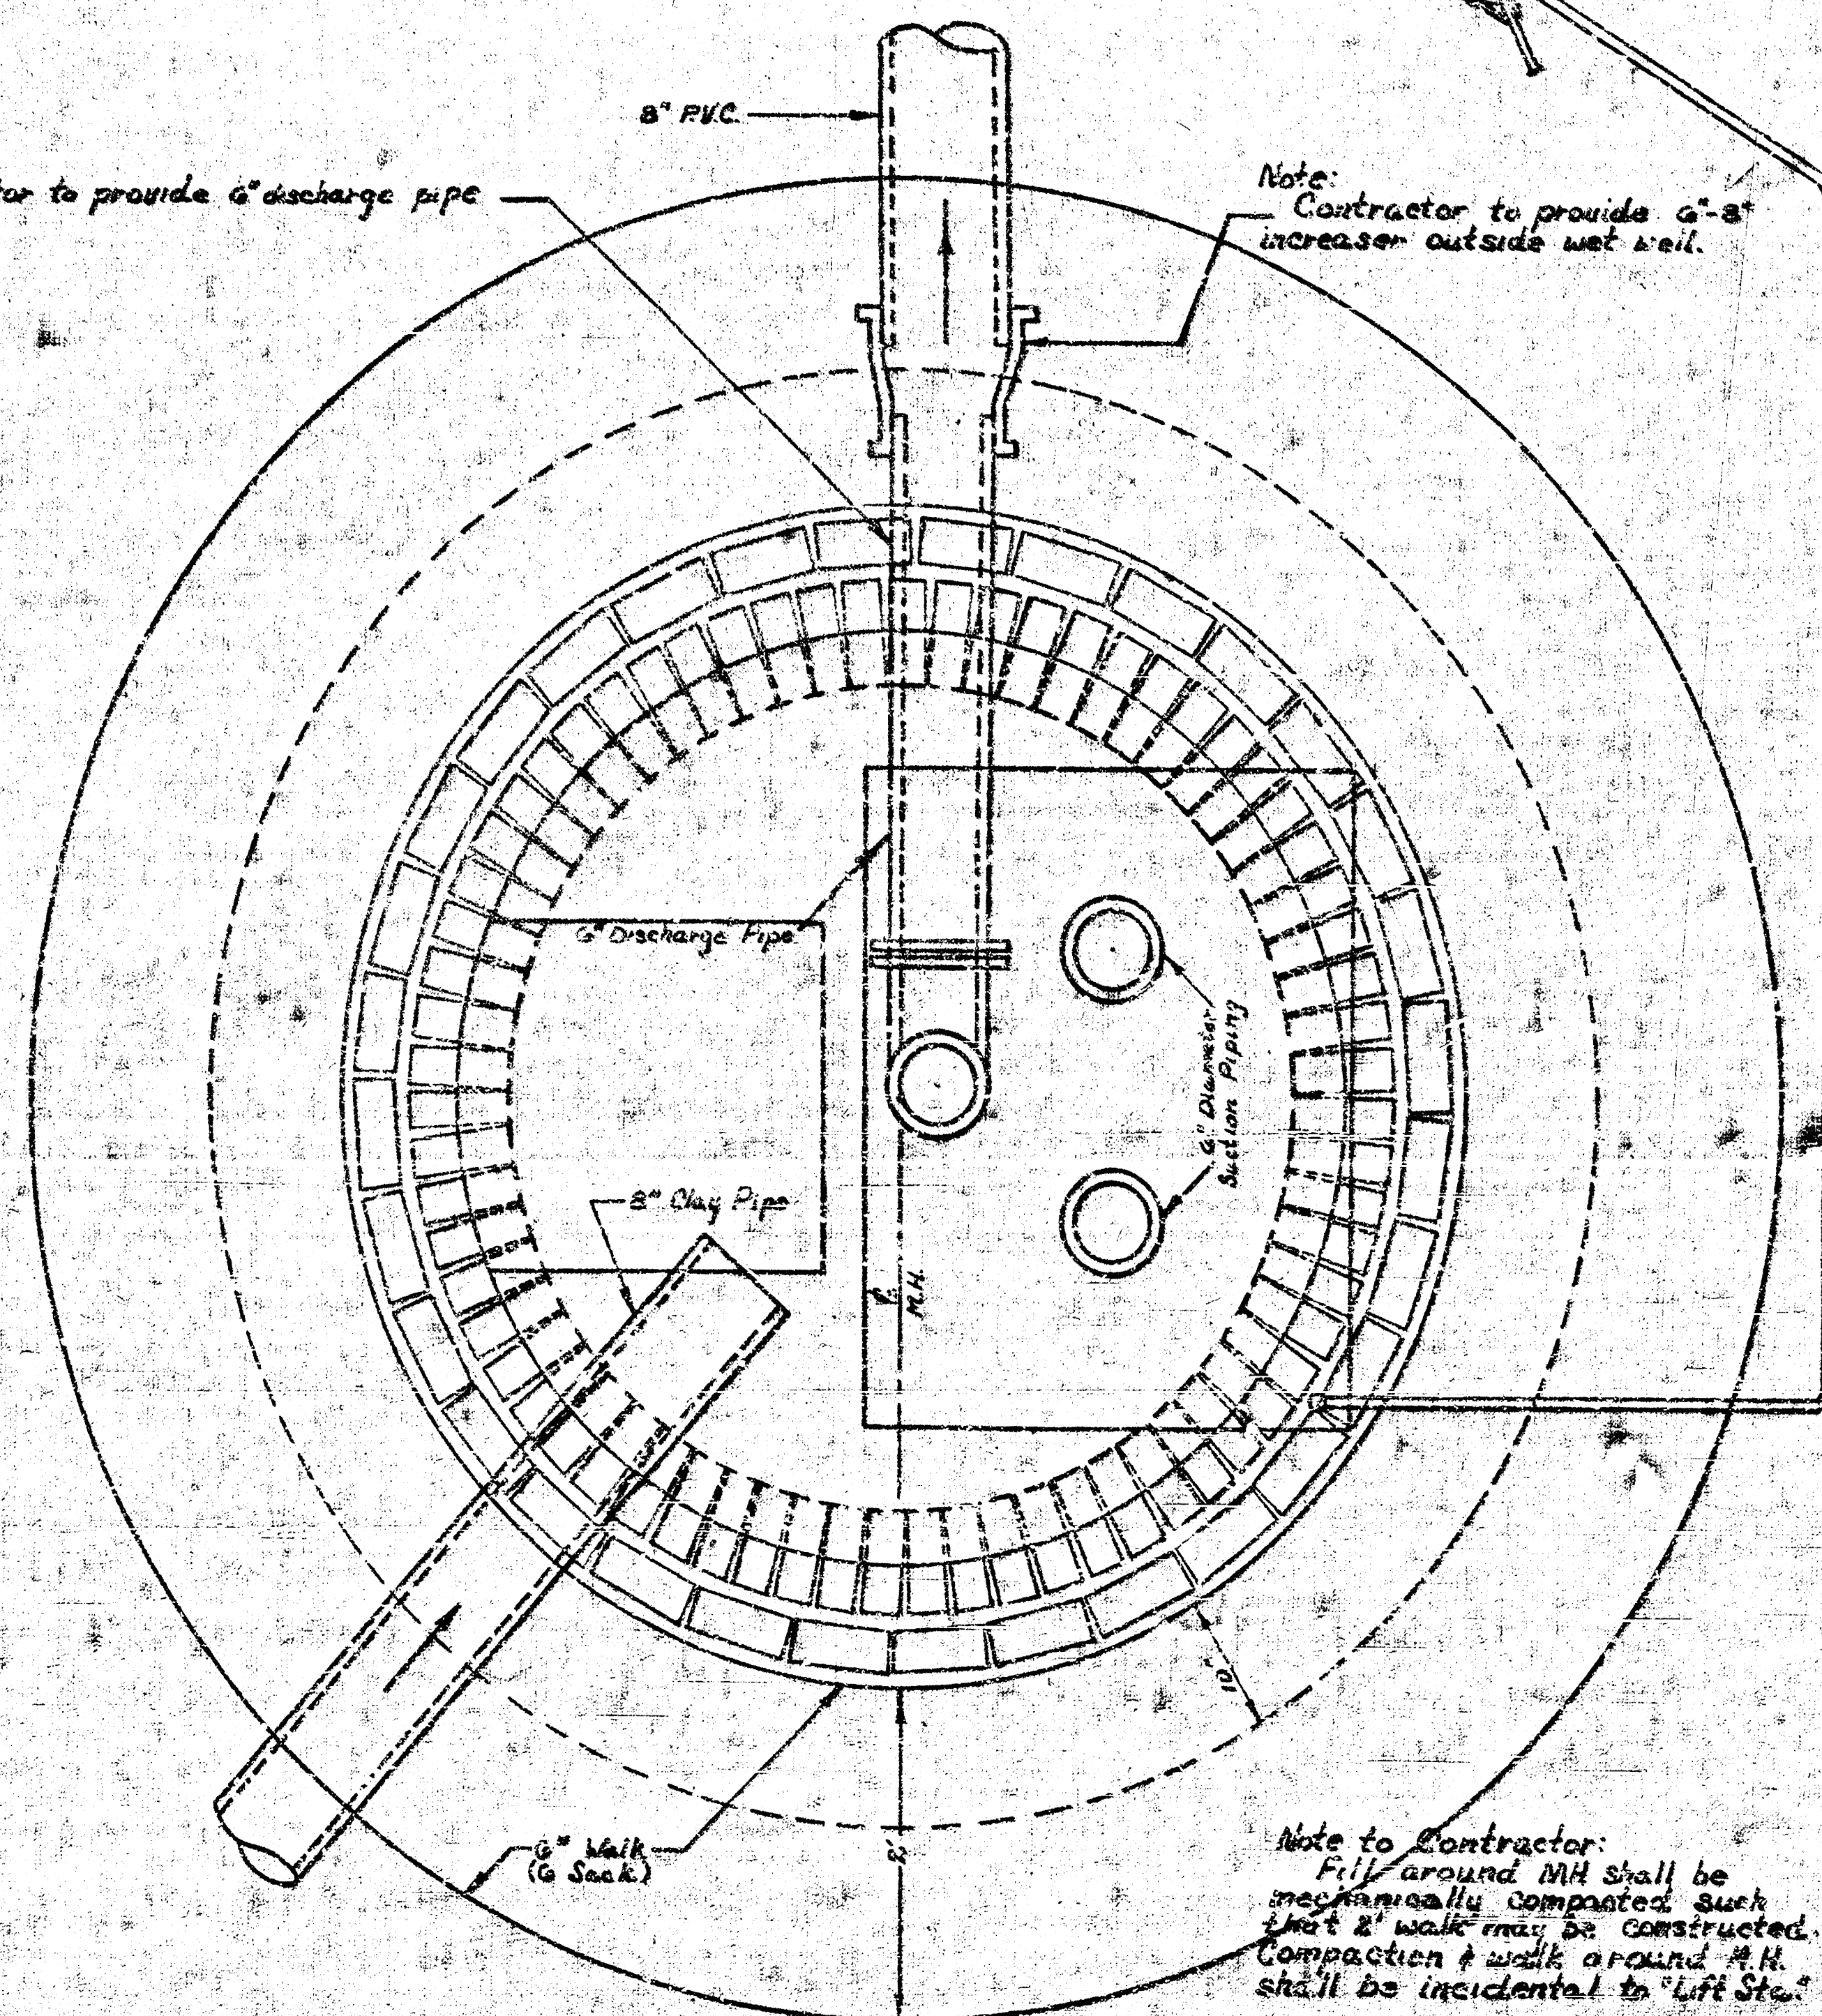


Note to Contractor:
Fill around MH shall be mechanically compacted such that 2" wide may be constructed. Compaction & work around M.H. shall be incidental to Lift Sta.

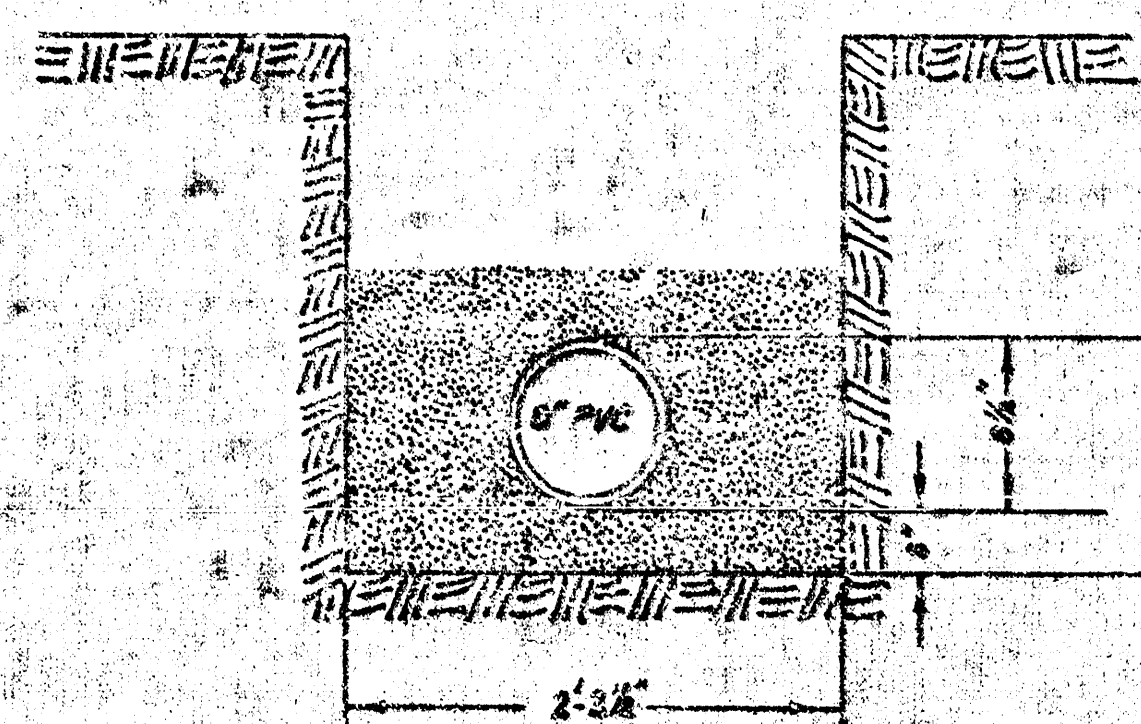


Typical Trench Section

Note: Contractor shall sand backfill force main trench. Cast of furnishing sand, placing, vibrating & flushing same shall be included in Lump Sum bid of Lift Sta.

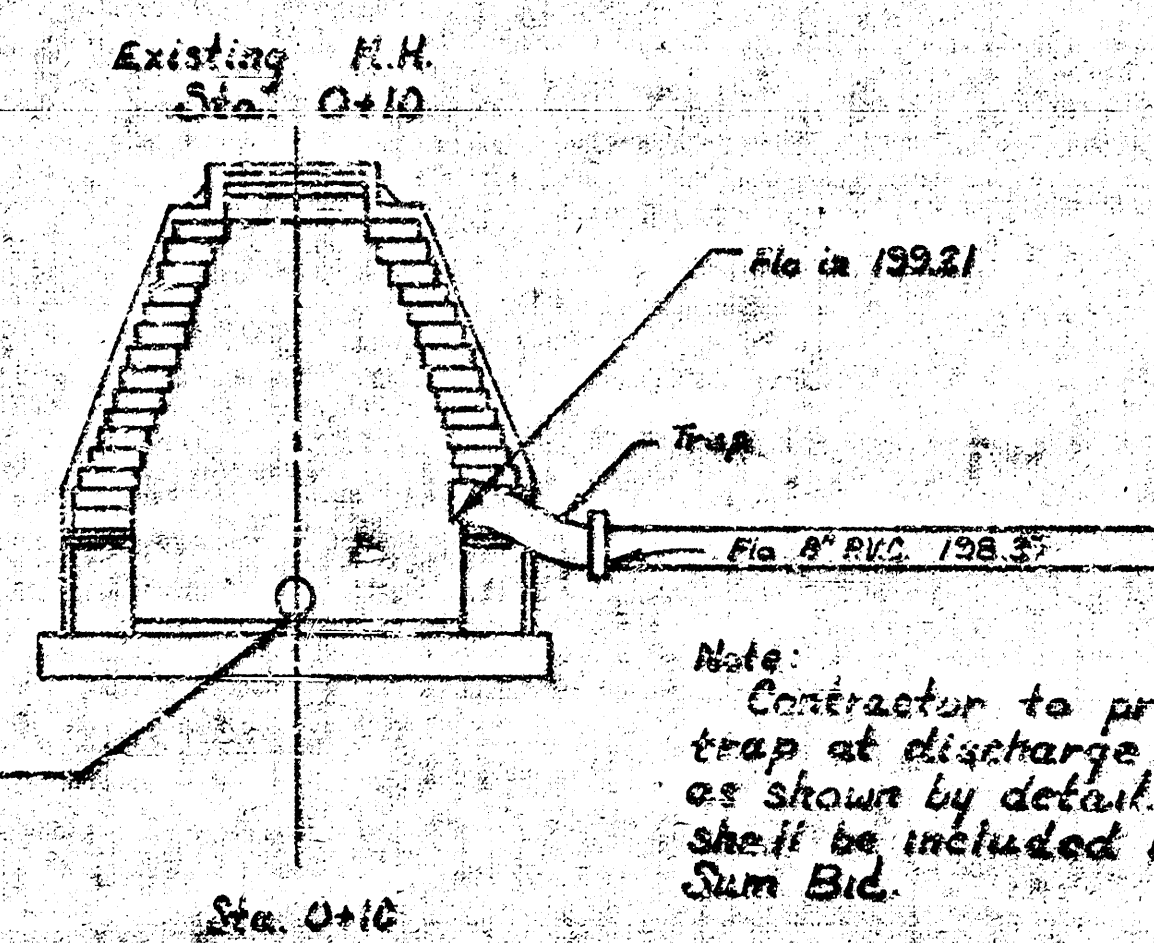


Note: Contractor to provide 8" trap at discharge manhole as shown by detail. Trap shall be included in Lump Sum Bid.

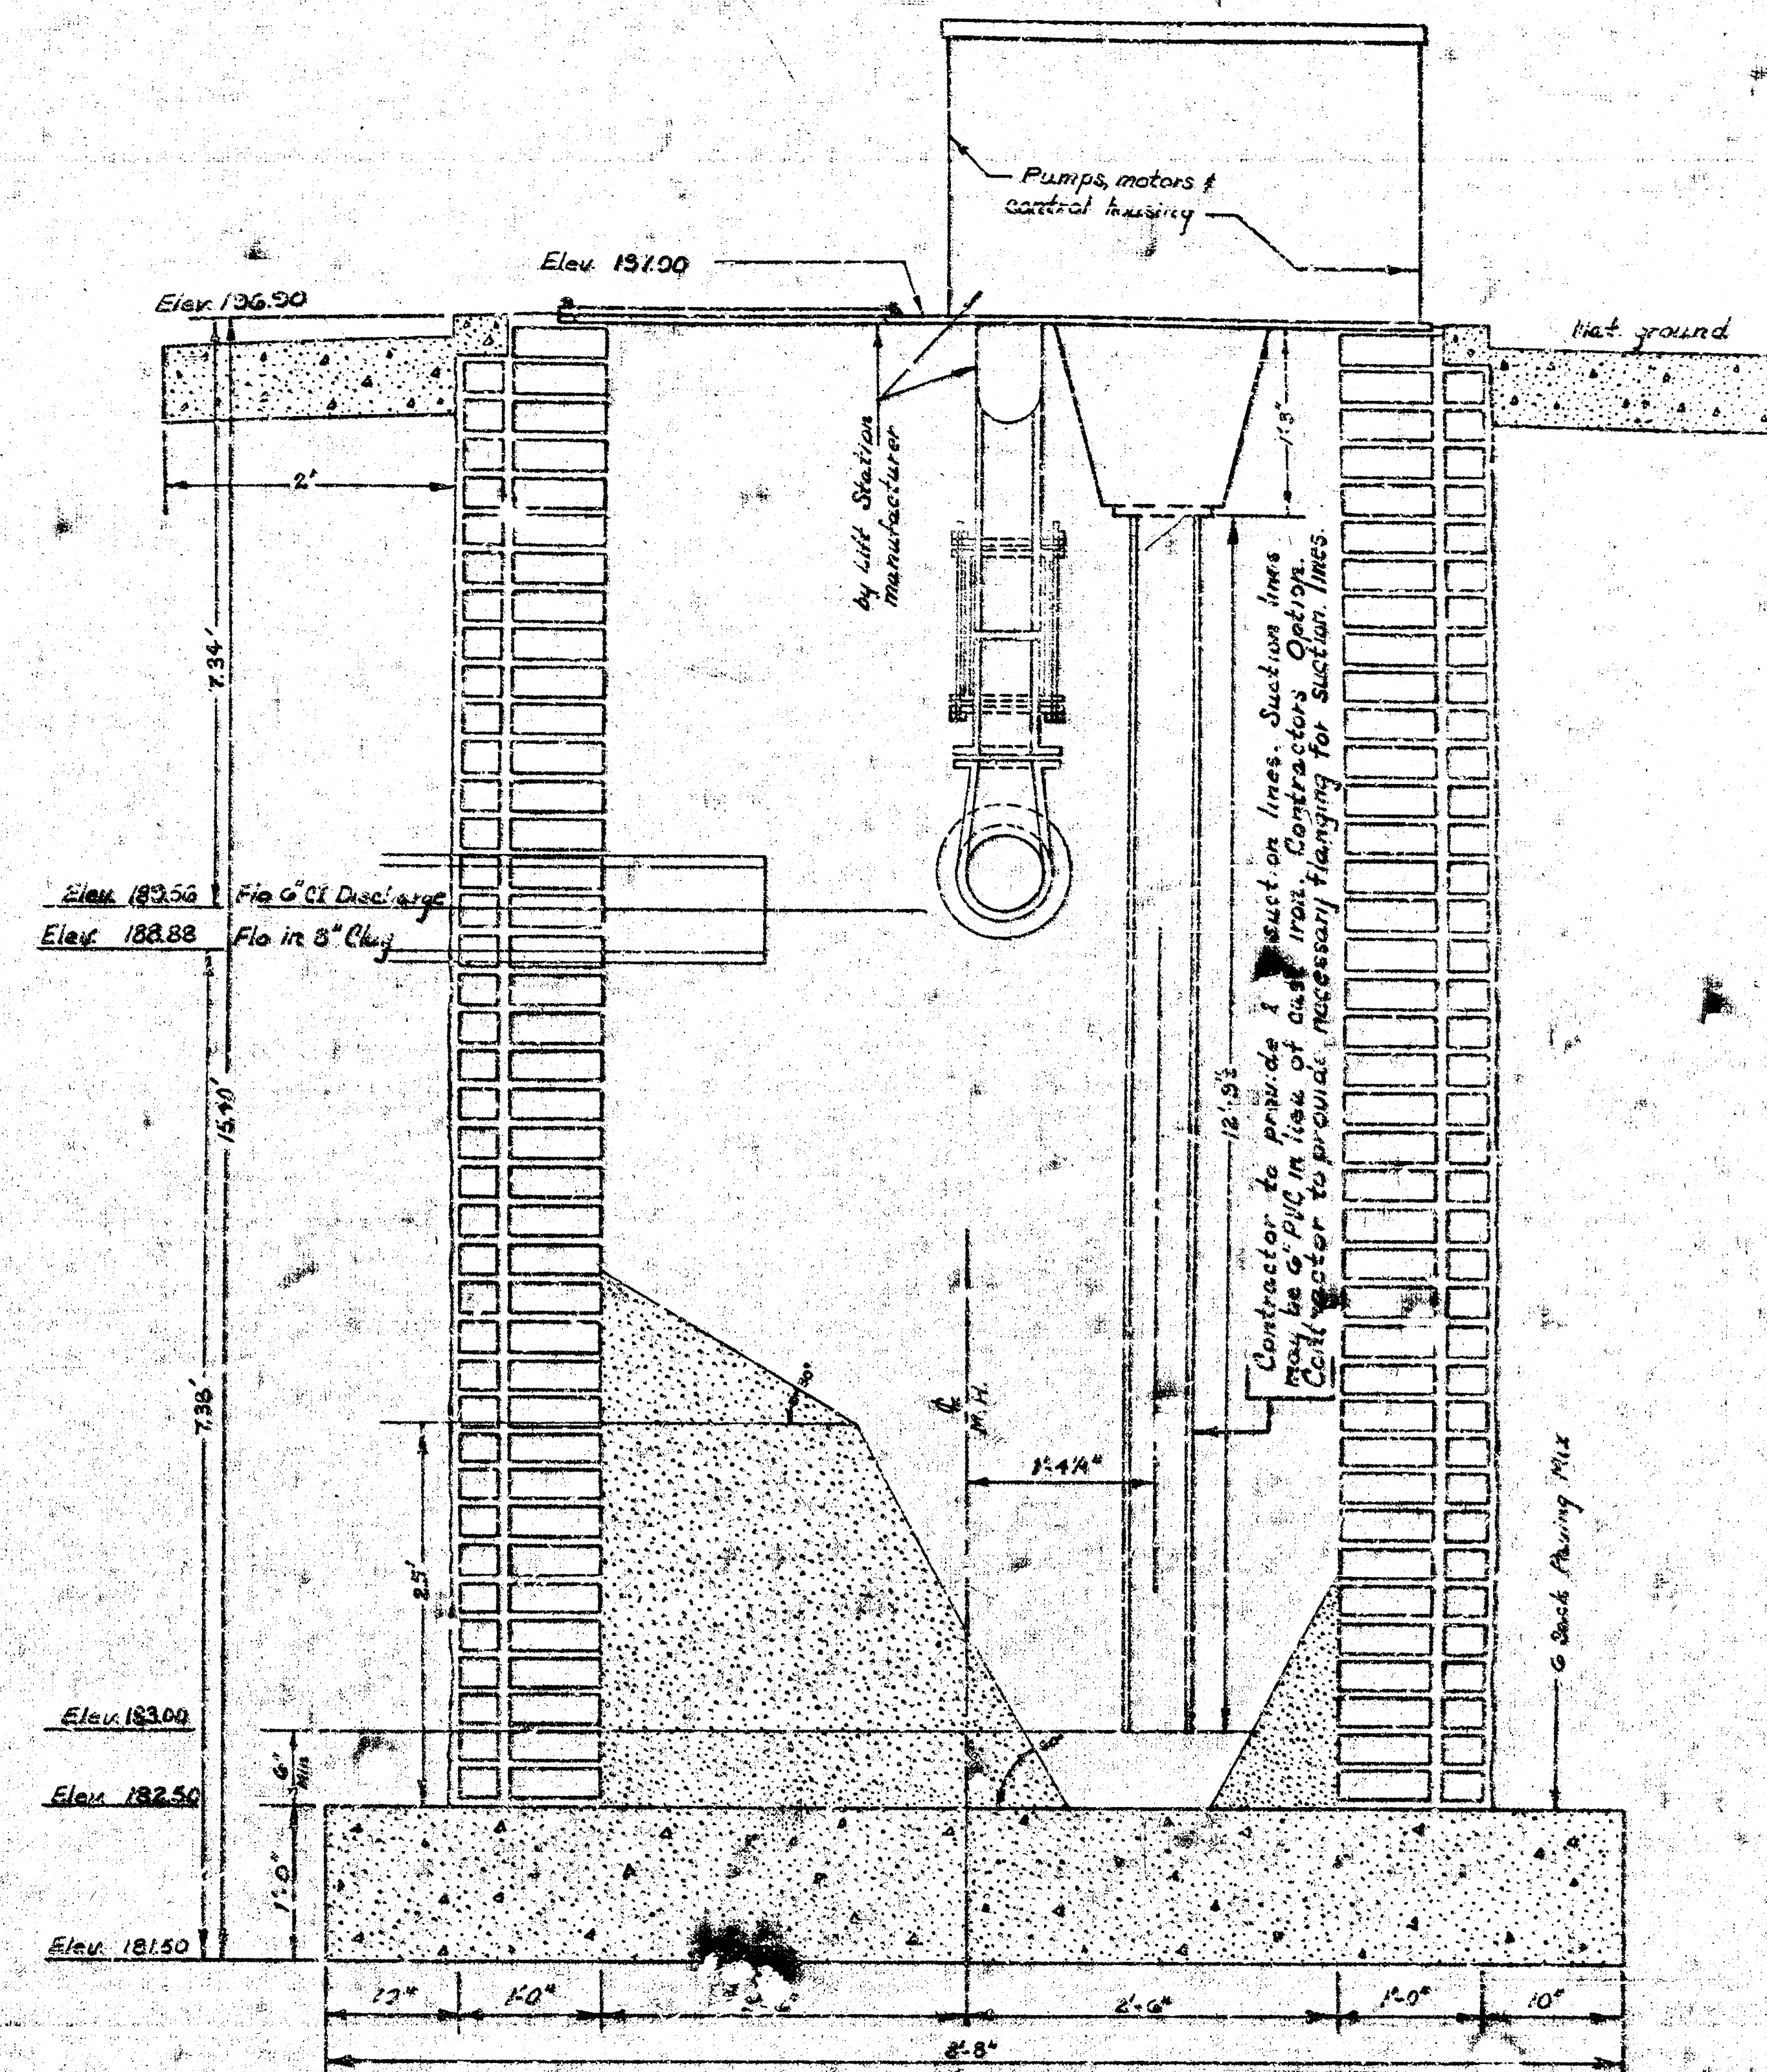


Type "B" 5' Diameter Wet Well

LIFT STA. #1, MAIN #7, S.S. #23


PROJ. NO. DBKP 573060

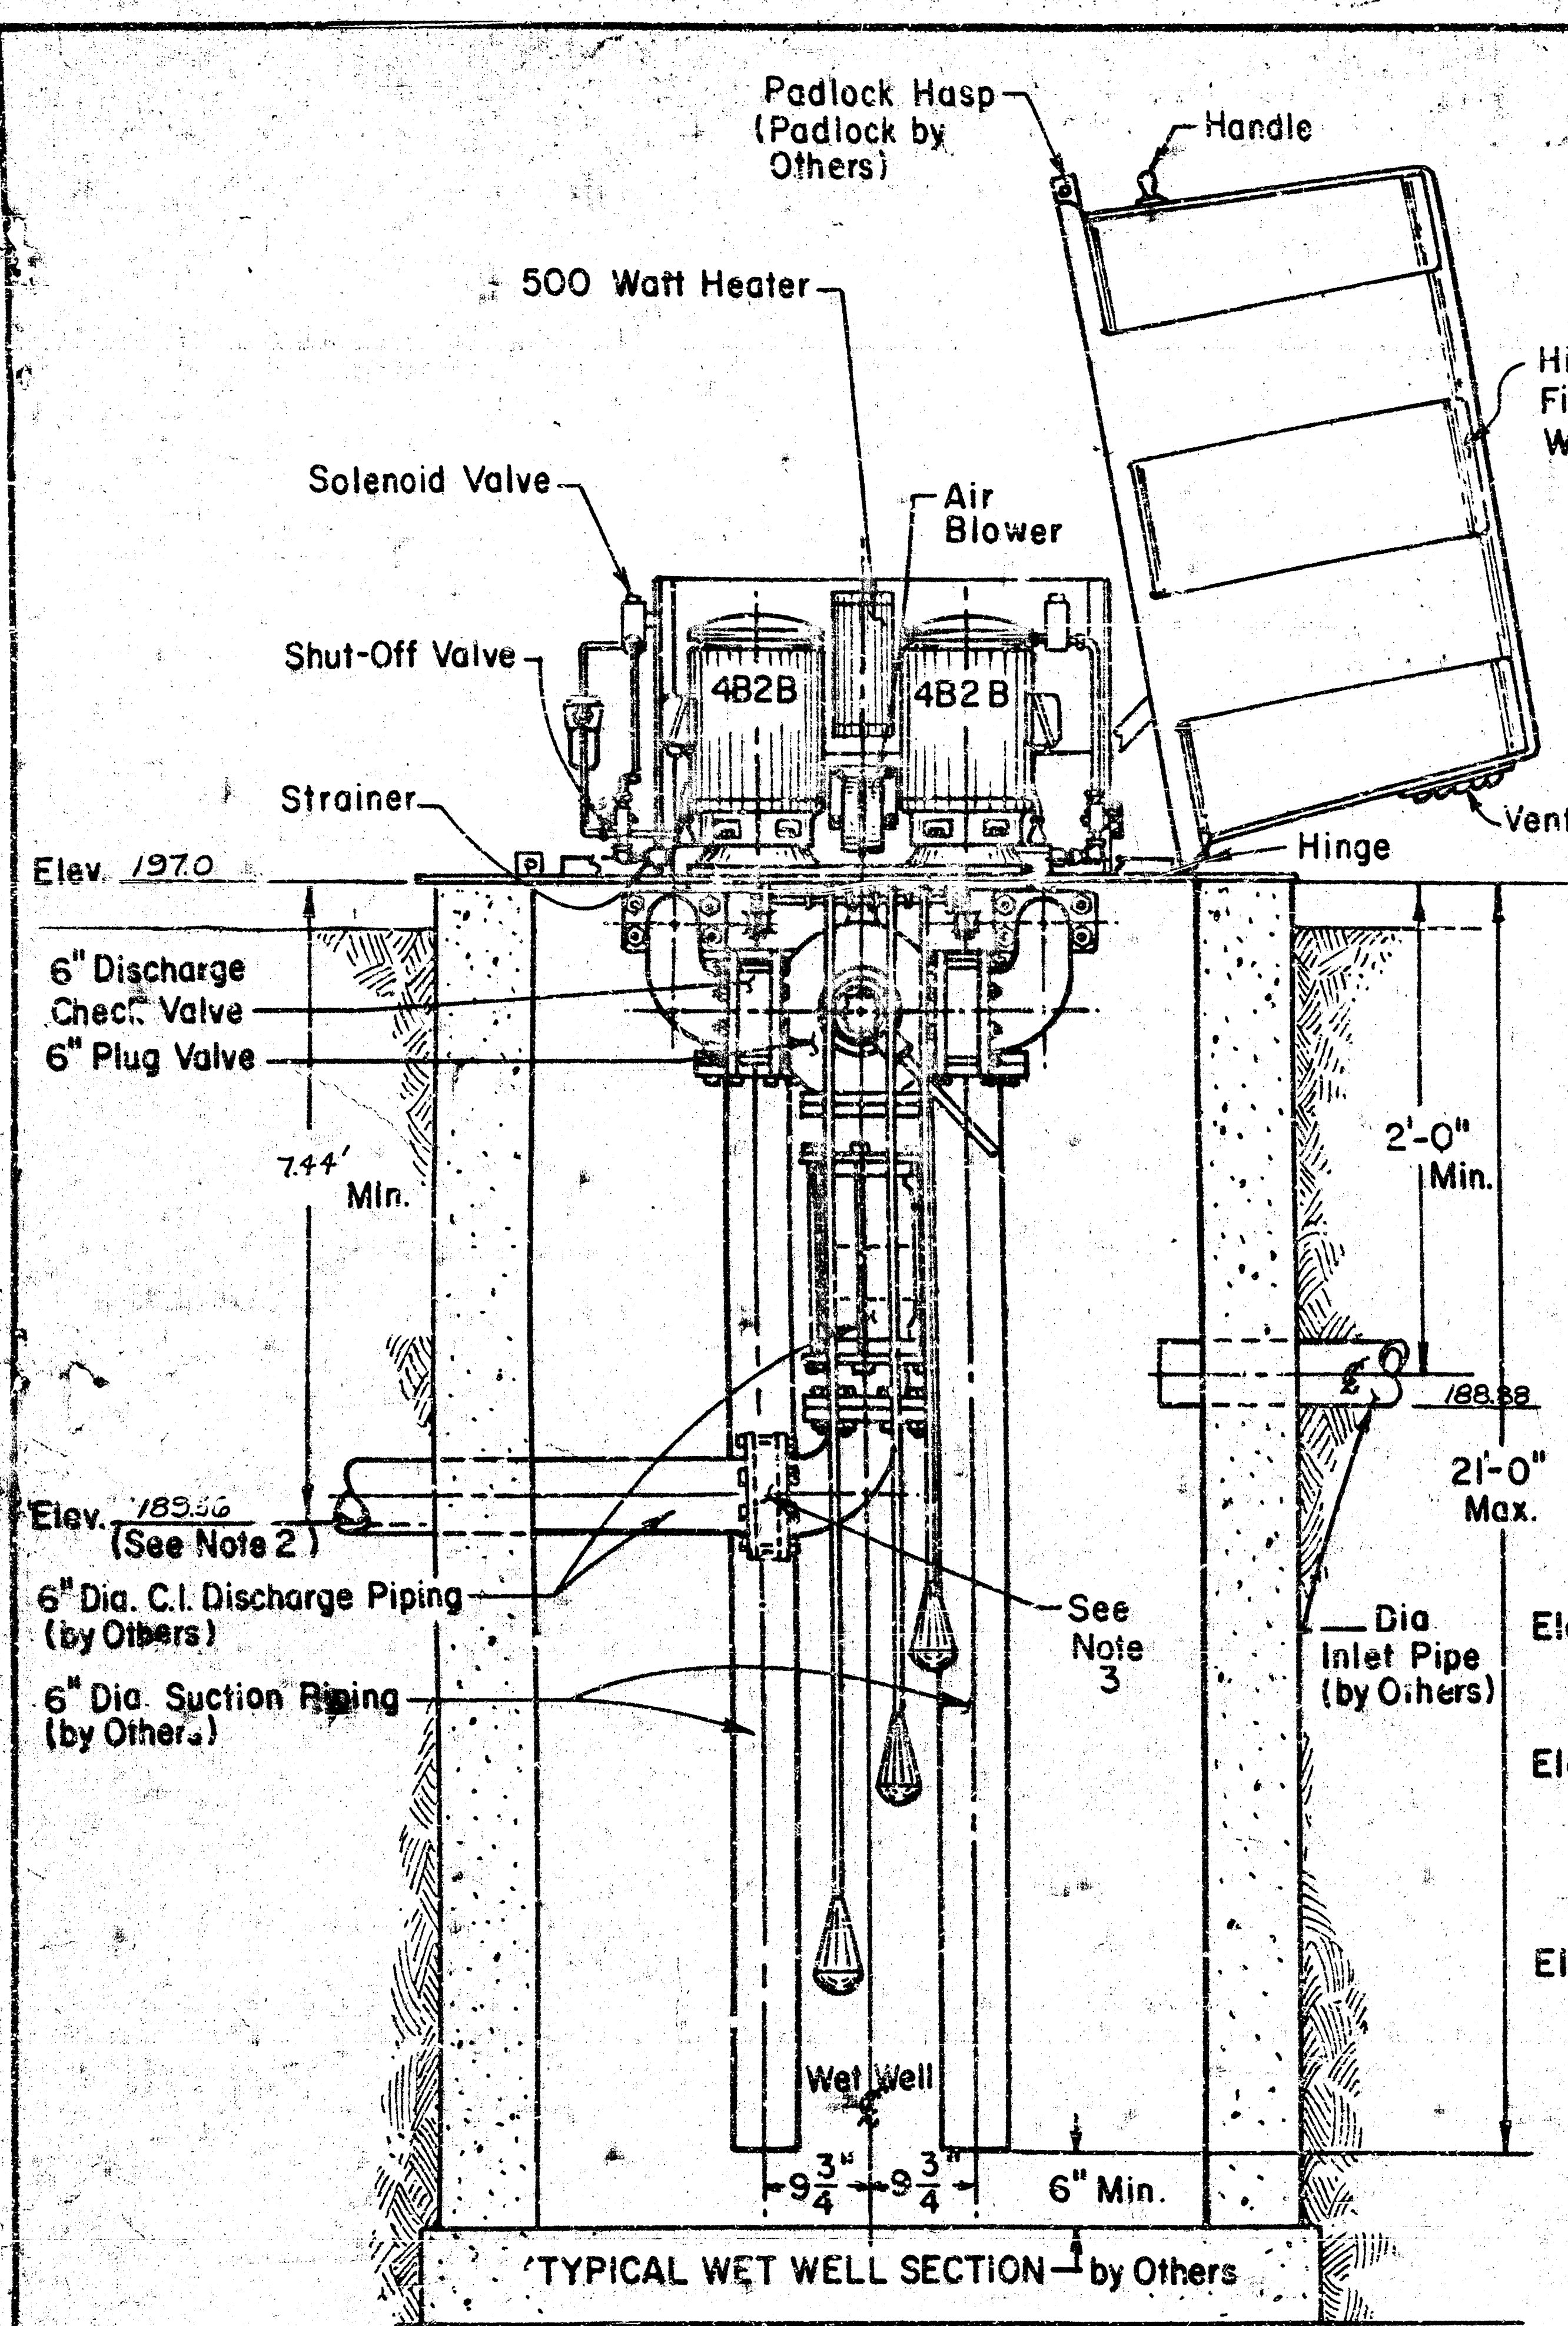

REAR ELEVATION

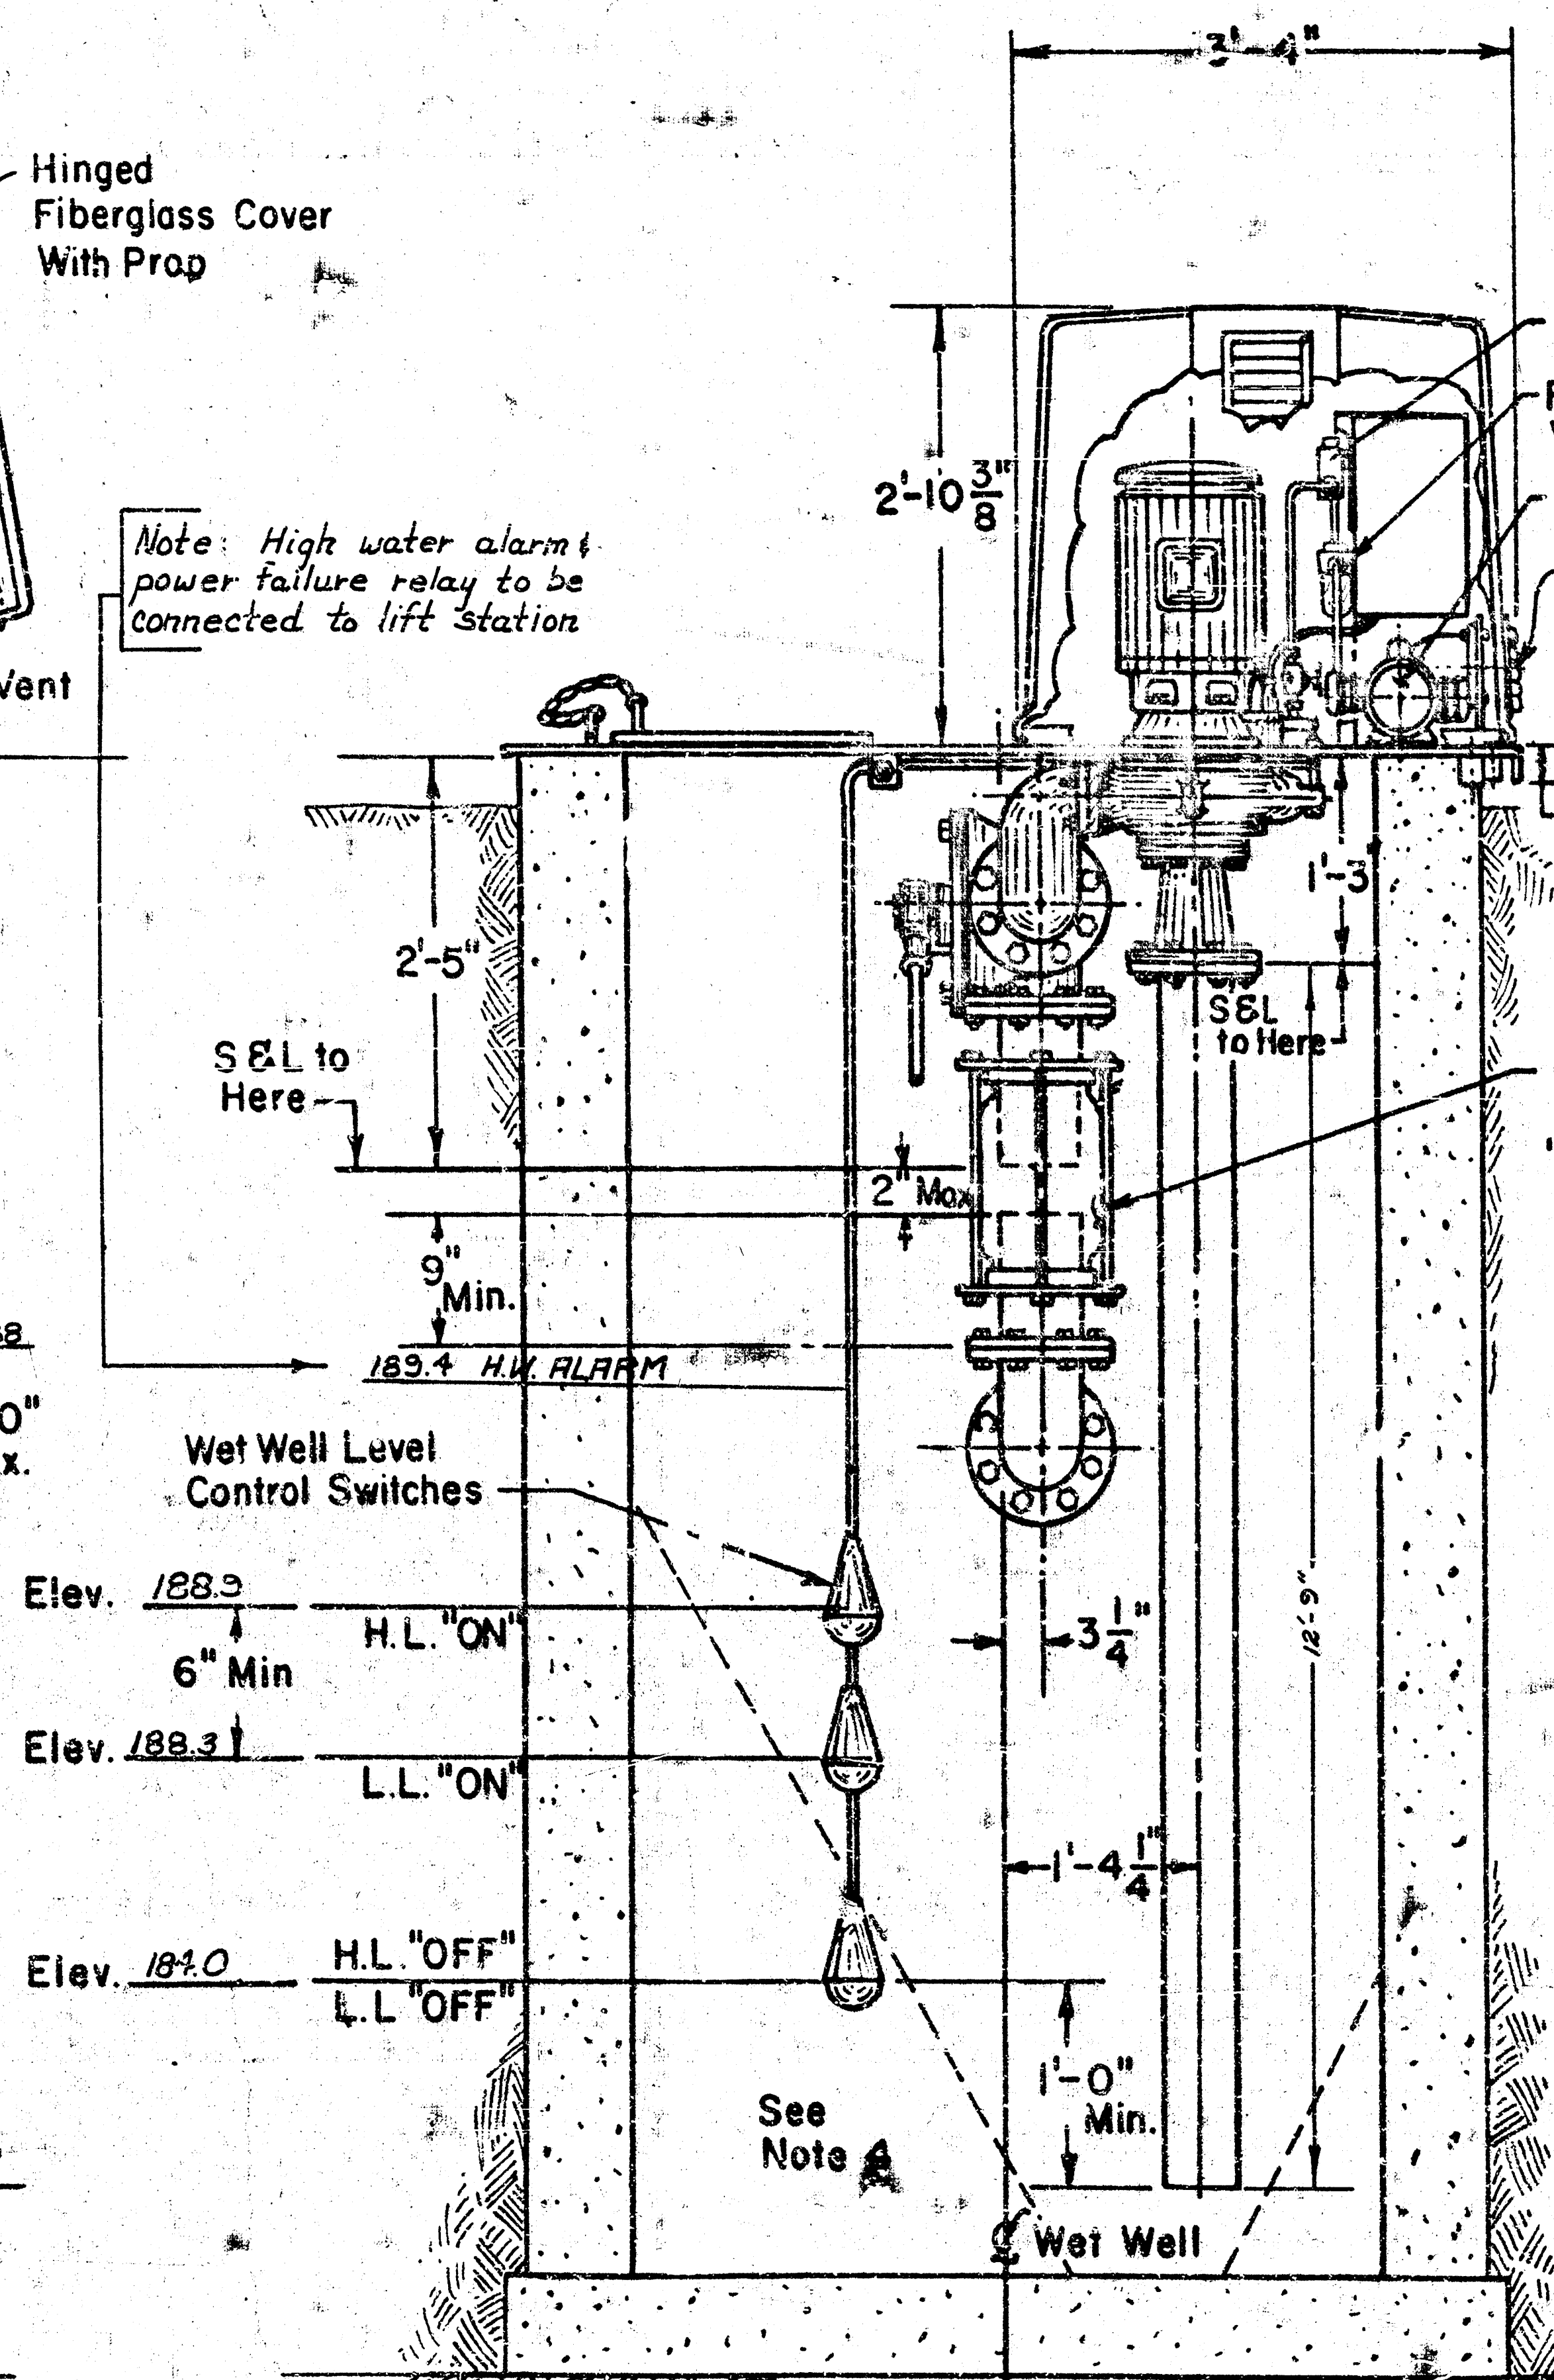

SIDE ELEVATION

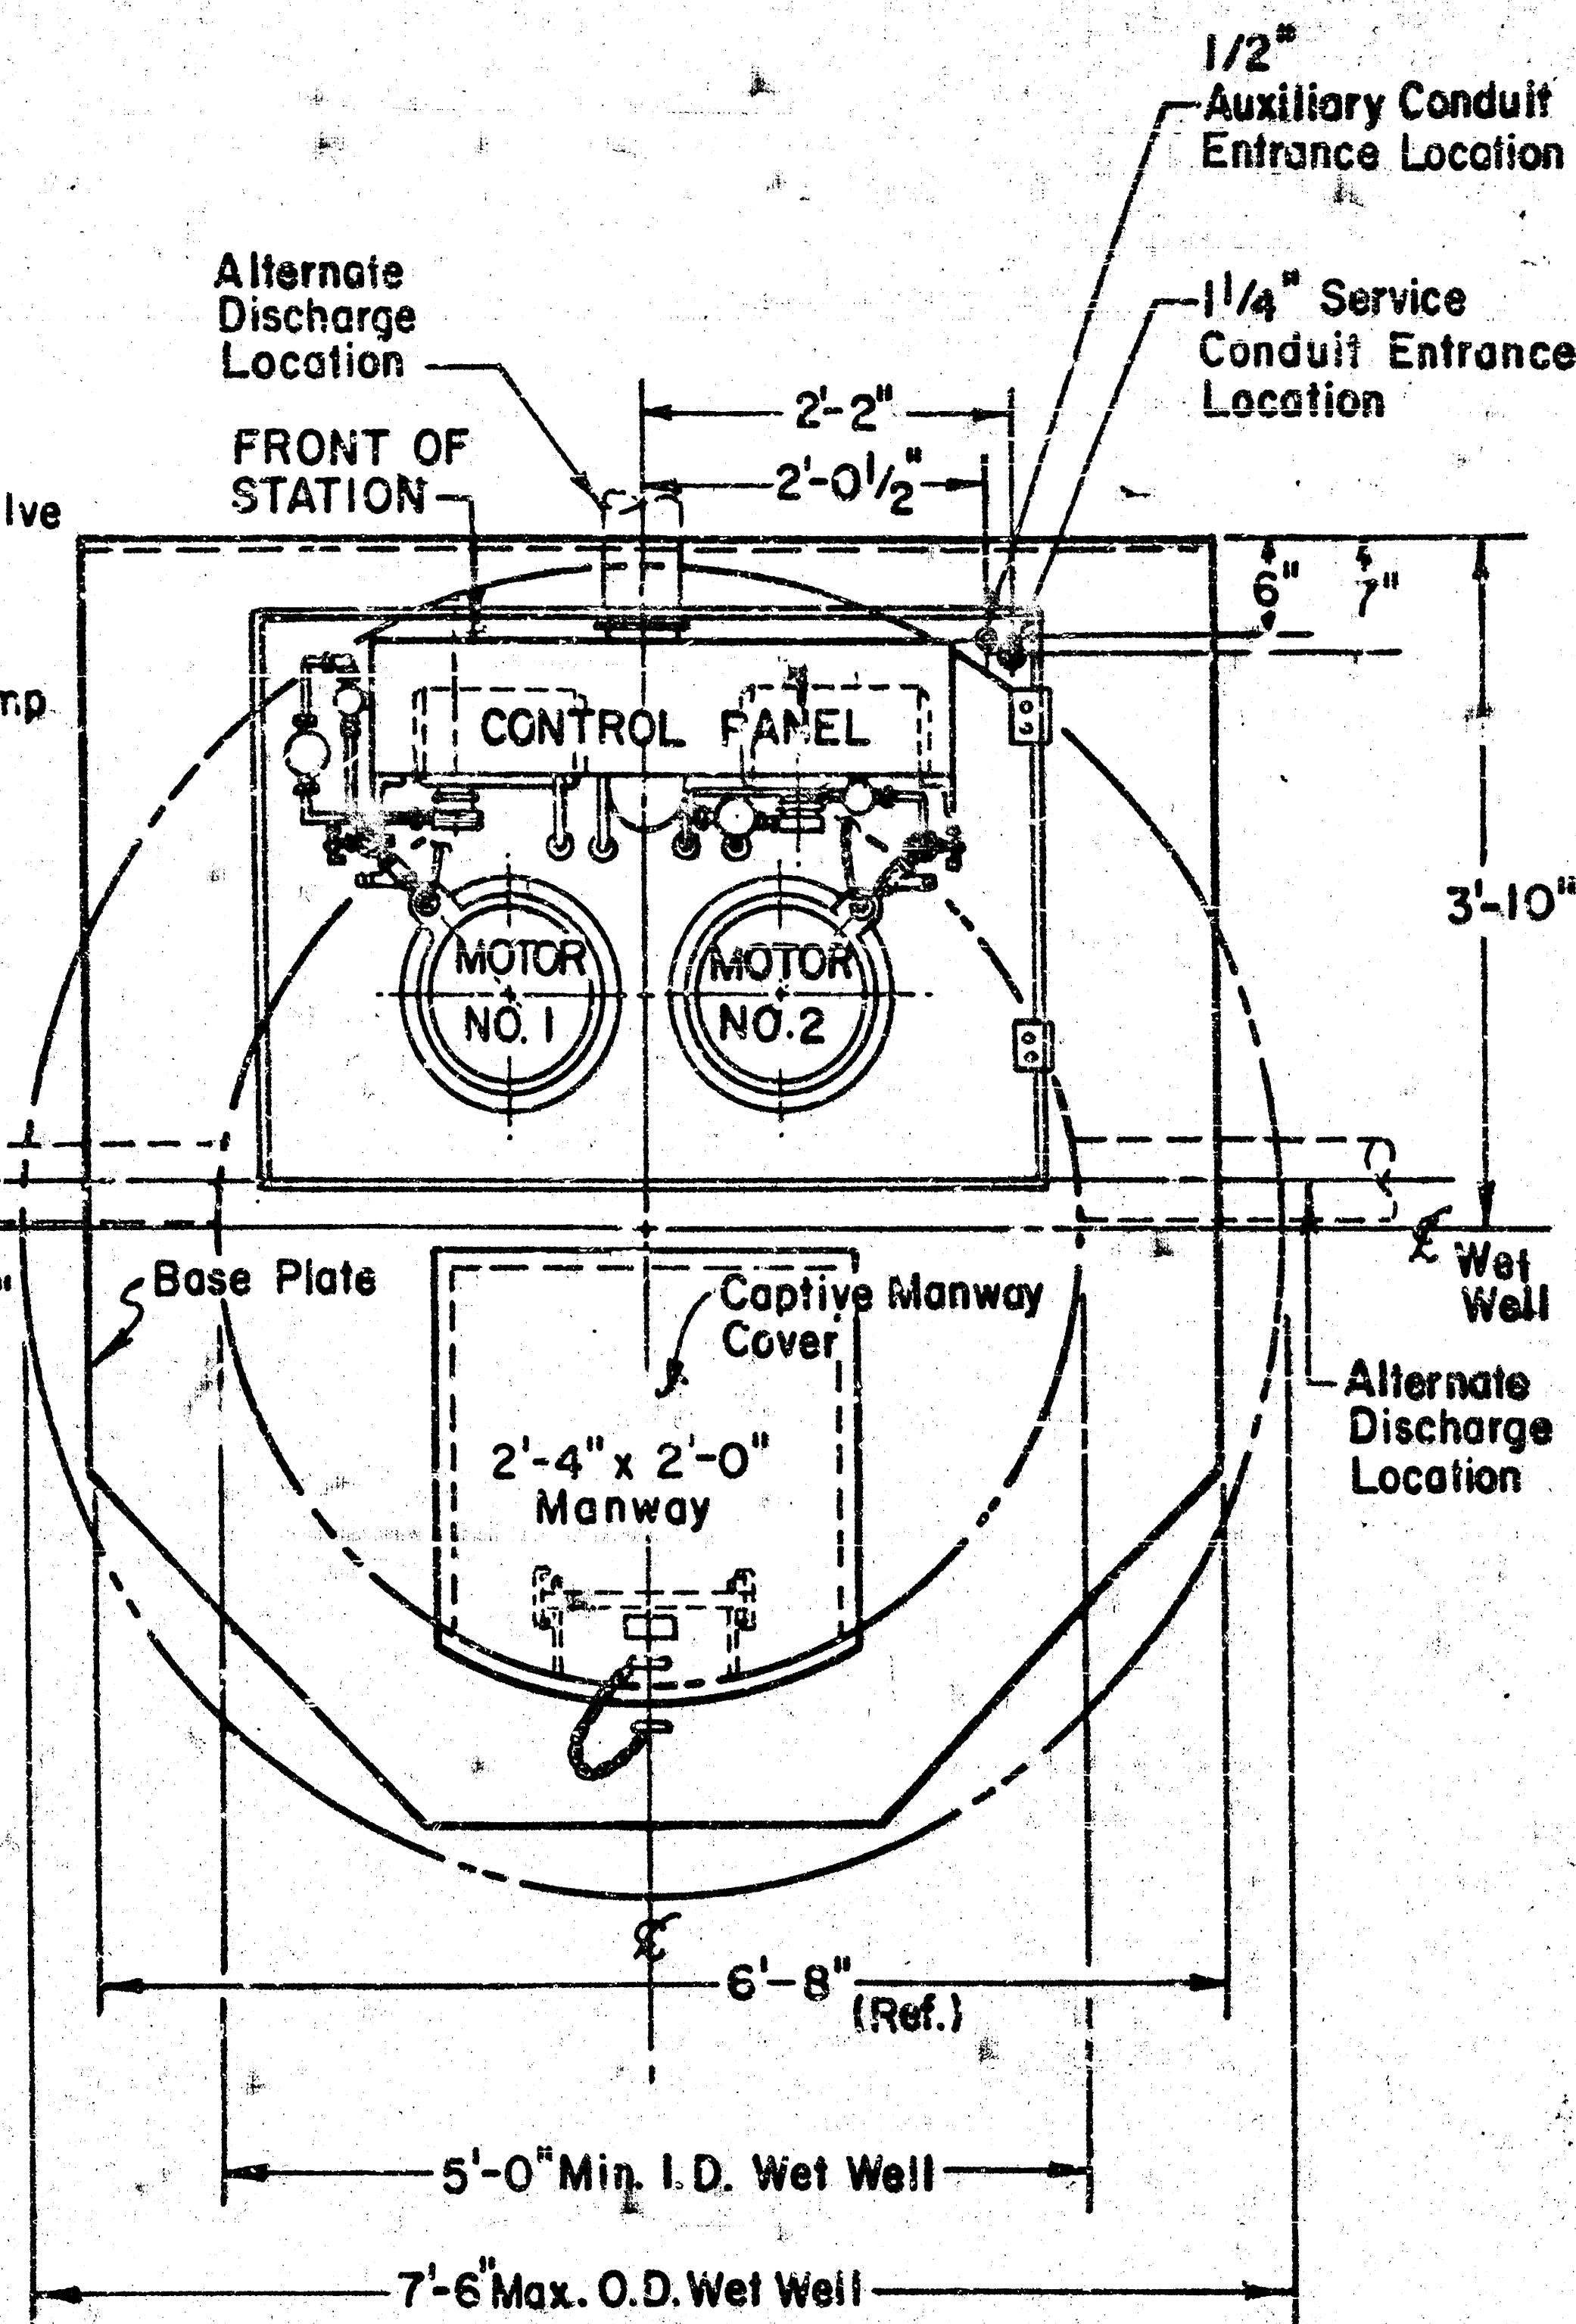

PLAN VIEW
Machinery Chamber
(Cover Deleted for Clarity)

NOTES

1. Maximum Capacity — 600 G.P.M.
2. If End of Discharge Line Is Below Elevation of Discharge Line at Point of Leaving Wet Well — Consult Factory.
3. If Discharge Line Is Less Than 200 Ft. in Length, A Check Valve May Be Required — Consult Factory.

PATENTED IN THE U.S.A. & FOREIGN COUNTRIES

NTI-18

THE DESIGN AND DETAIL OF THIS DRAWING IS THE PROPERTY OF EDDYNE CORPORATION, SMITH & LOVELESS DIVISION AND IS NOT TO BE USED EXCEPT IN CONNECTION WITH OUR WORK. DESIGN AND INVENTION RIGHTS ARE RESERVED.

EDDYNE CORPORATION SMITH & LOVELESS DIVISION An Affiliate of Trane, Inc. Sign & Seal Santa Fe Trail Lawrence, Kansas 66044		FOR WET-Well-MOUNTED SEWAGE PUMPING STATION— 5 FT. - 6 FT. I.D. WET WELLS	
DESIGNED BY MASLAM	DATE 3-17	CHECKED BY TIEHEN	DATE 5-71
APPROVED BY MARTIN	DATE 5-71	SCALE none	
SERIAL NO. 860107	DRAWING NO. 860107		

LIFT STR.#1, MAIN#7, SS#23
PROT. NO. DBKP 573060