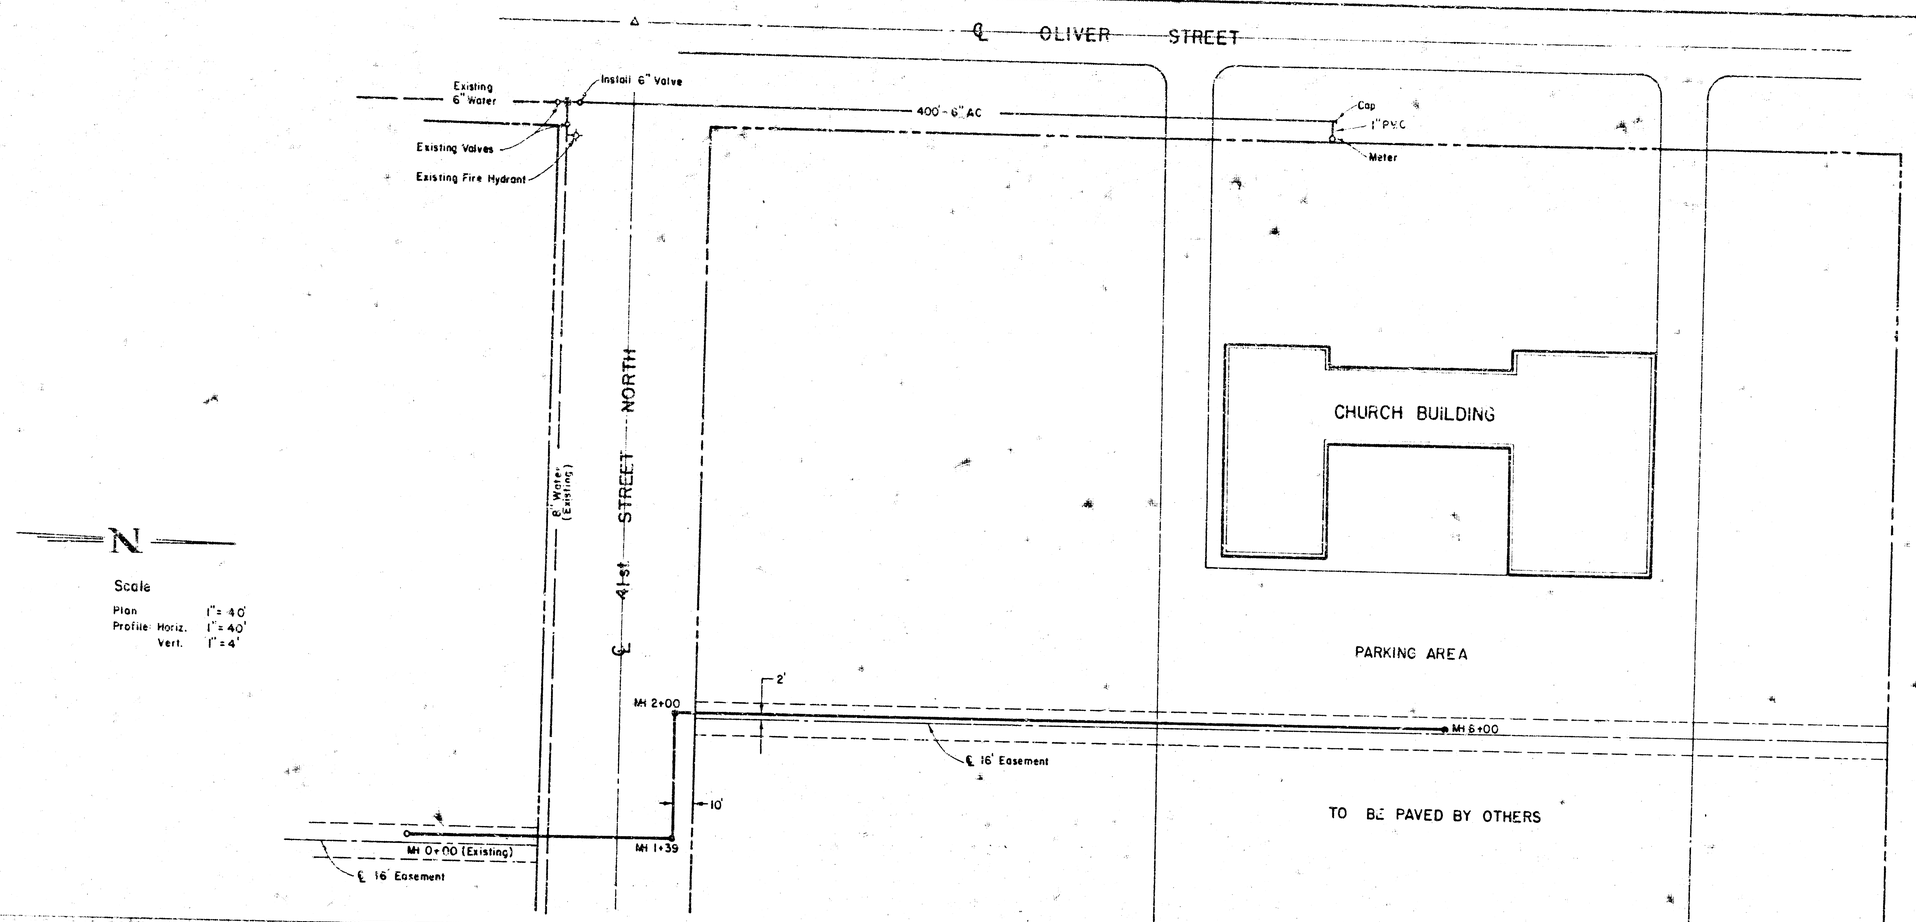
℄ OLIVER STREET
Existing 6" Water
Install 6" Valve
400'-6" AC
Existing Valves
Existing Fire Hydrant
Cap
1" PVC
Meter
CHURCH BUILDING
PARKING AREA
℄ 41st STREET NORTH
8" Water (Existing)
N
Scale
Plan 1" = 40'
Profile Horiz. 1" = 40'
Vert. 1" = 4'
MH 2+00
2'
MH 6+00
℄ 16' Easement
10'
TO BE PAVED BY OTHERS
MH 0+00 (Existing)
MH 1+39
℄ 16' Easement

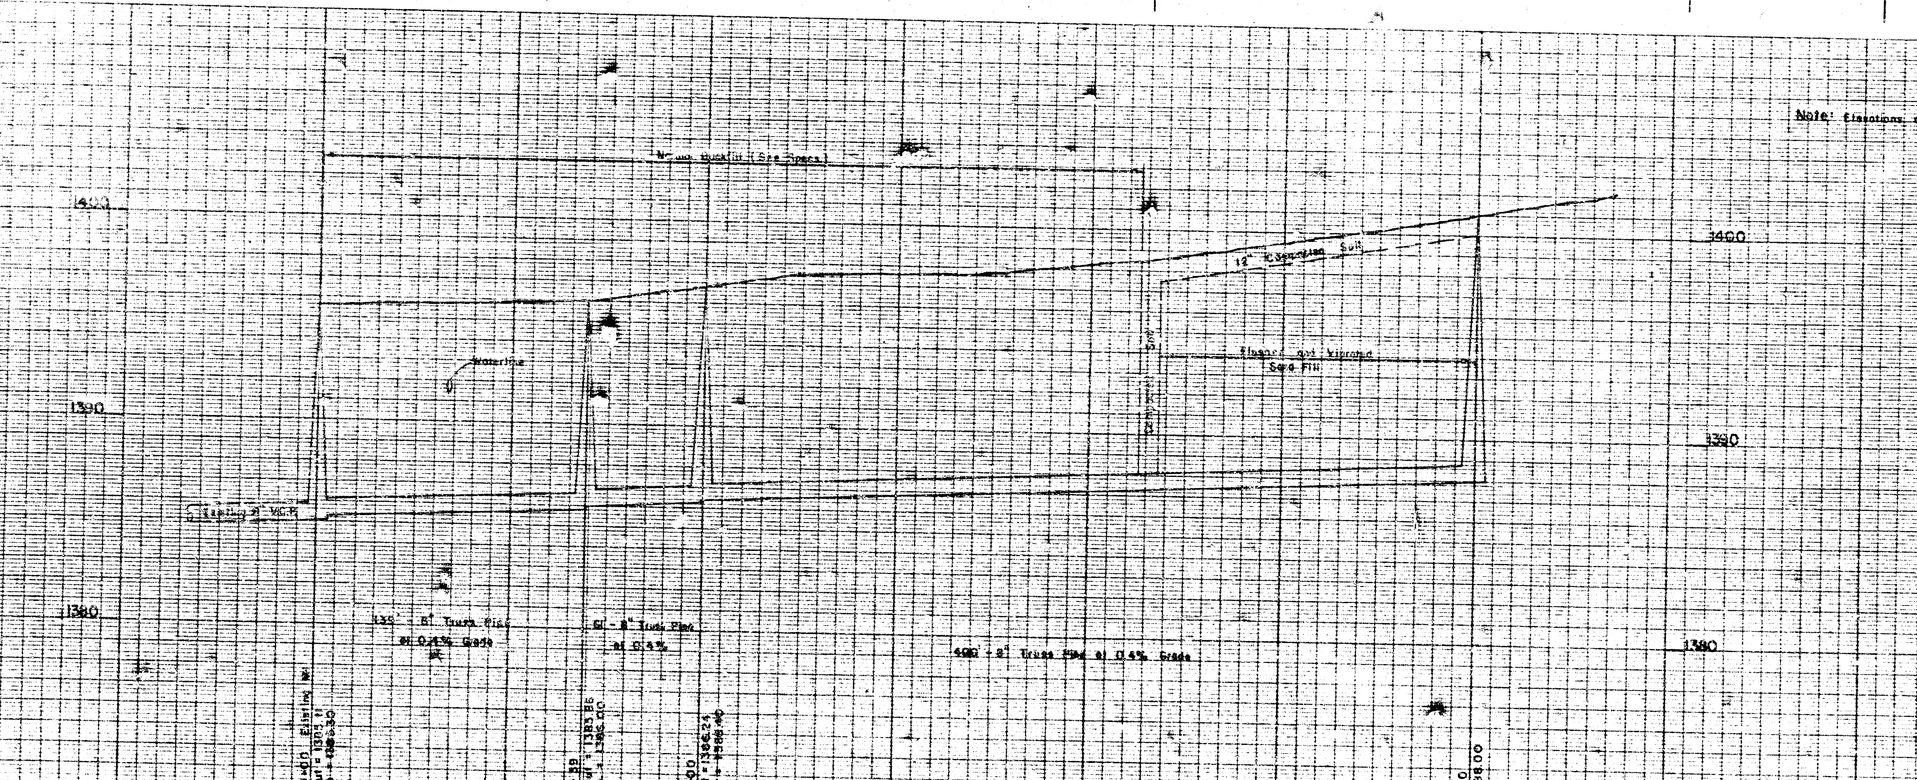
Note: Elevations are on USGS Datum
Mound Quantity (See Specs)
1400
1390
1380
12" Compacted Soil
Waterline
Flowable Fill Vibrated Sand Fill
Existing 2" Vac.
135' - 8" Truss Pipe at 0.4% Grade
61' - 8" Truss Pipe at 0.4%
400' - 8" Truss Pipe at 0.4% Grade
MH 0+00 Existing Inv. Out = 1391.21 Inv. In = 1388.30
MH 1+39 Inv. Out = 1385.86 Inv. In = 1385.50
MH 2+00 Inv. Out = 1386.24 Inv. In = 1386.00
MH 6+00 Inv. = 1388.00