


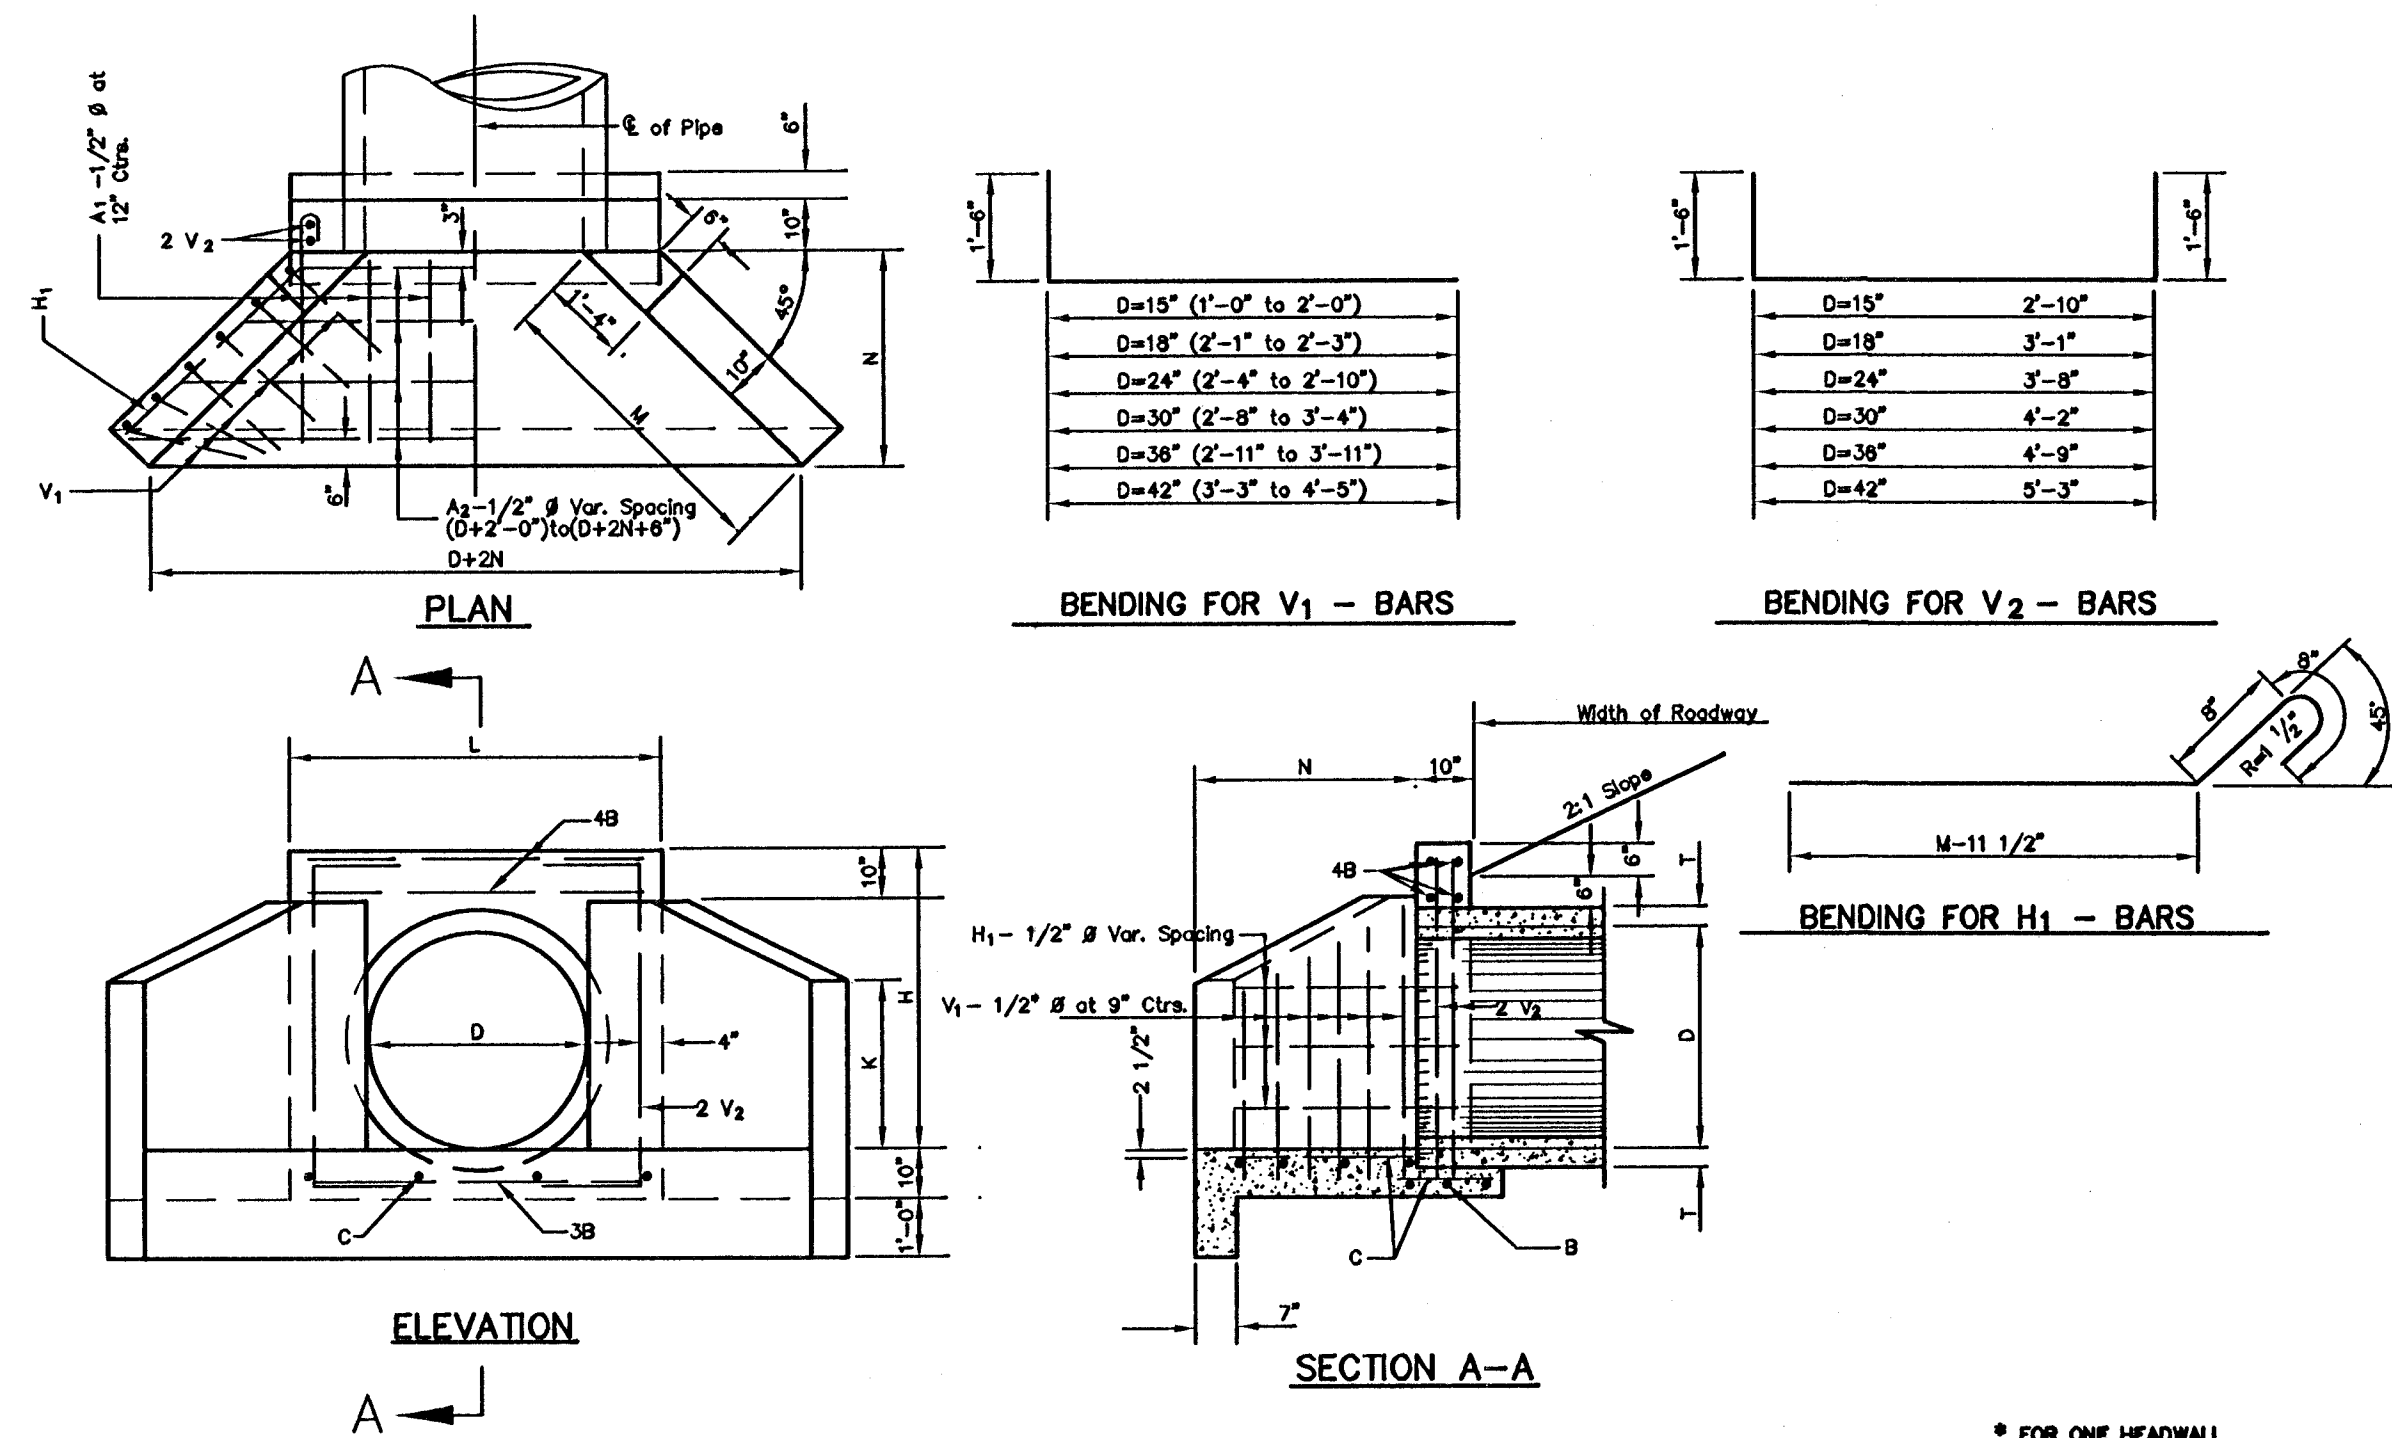
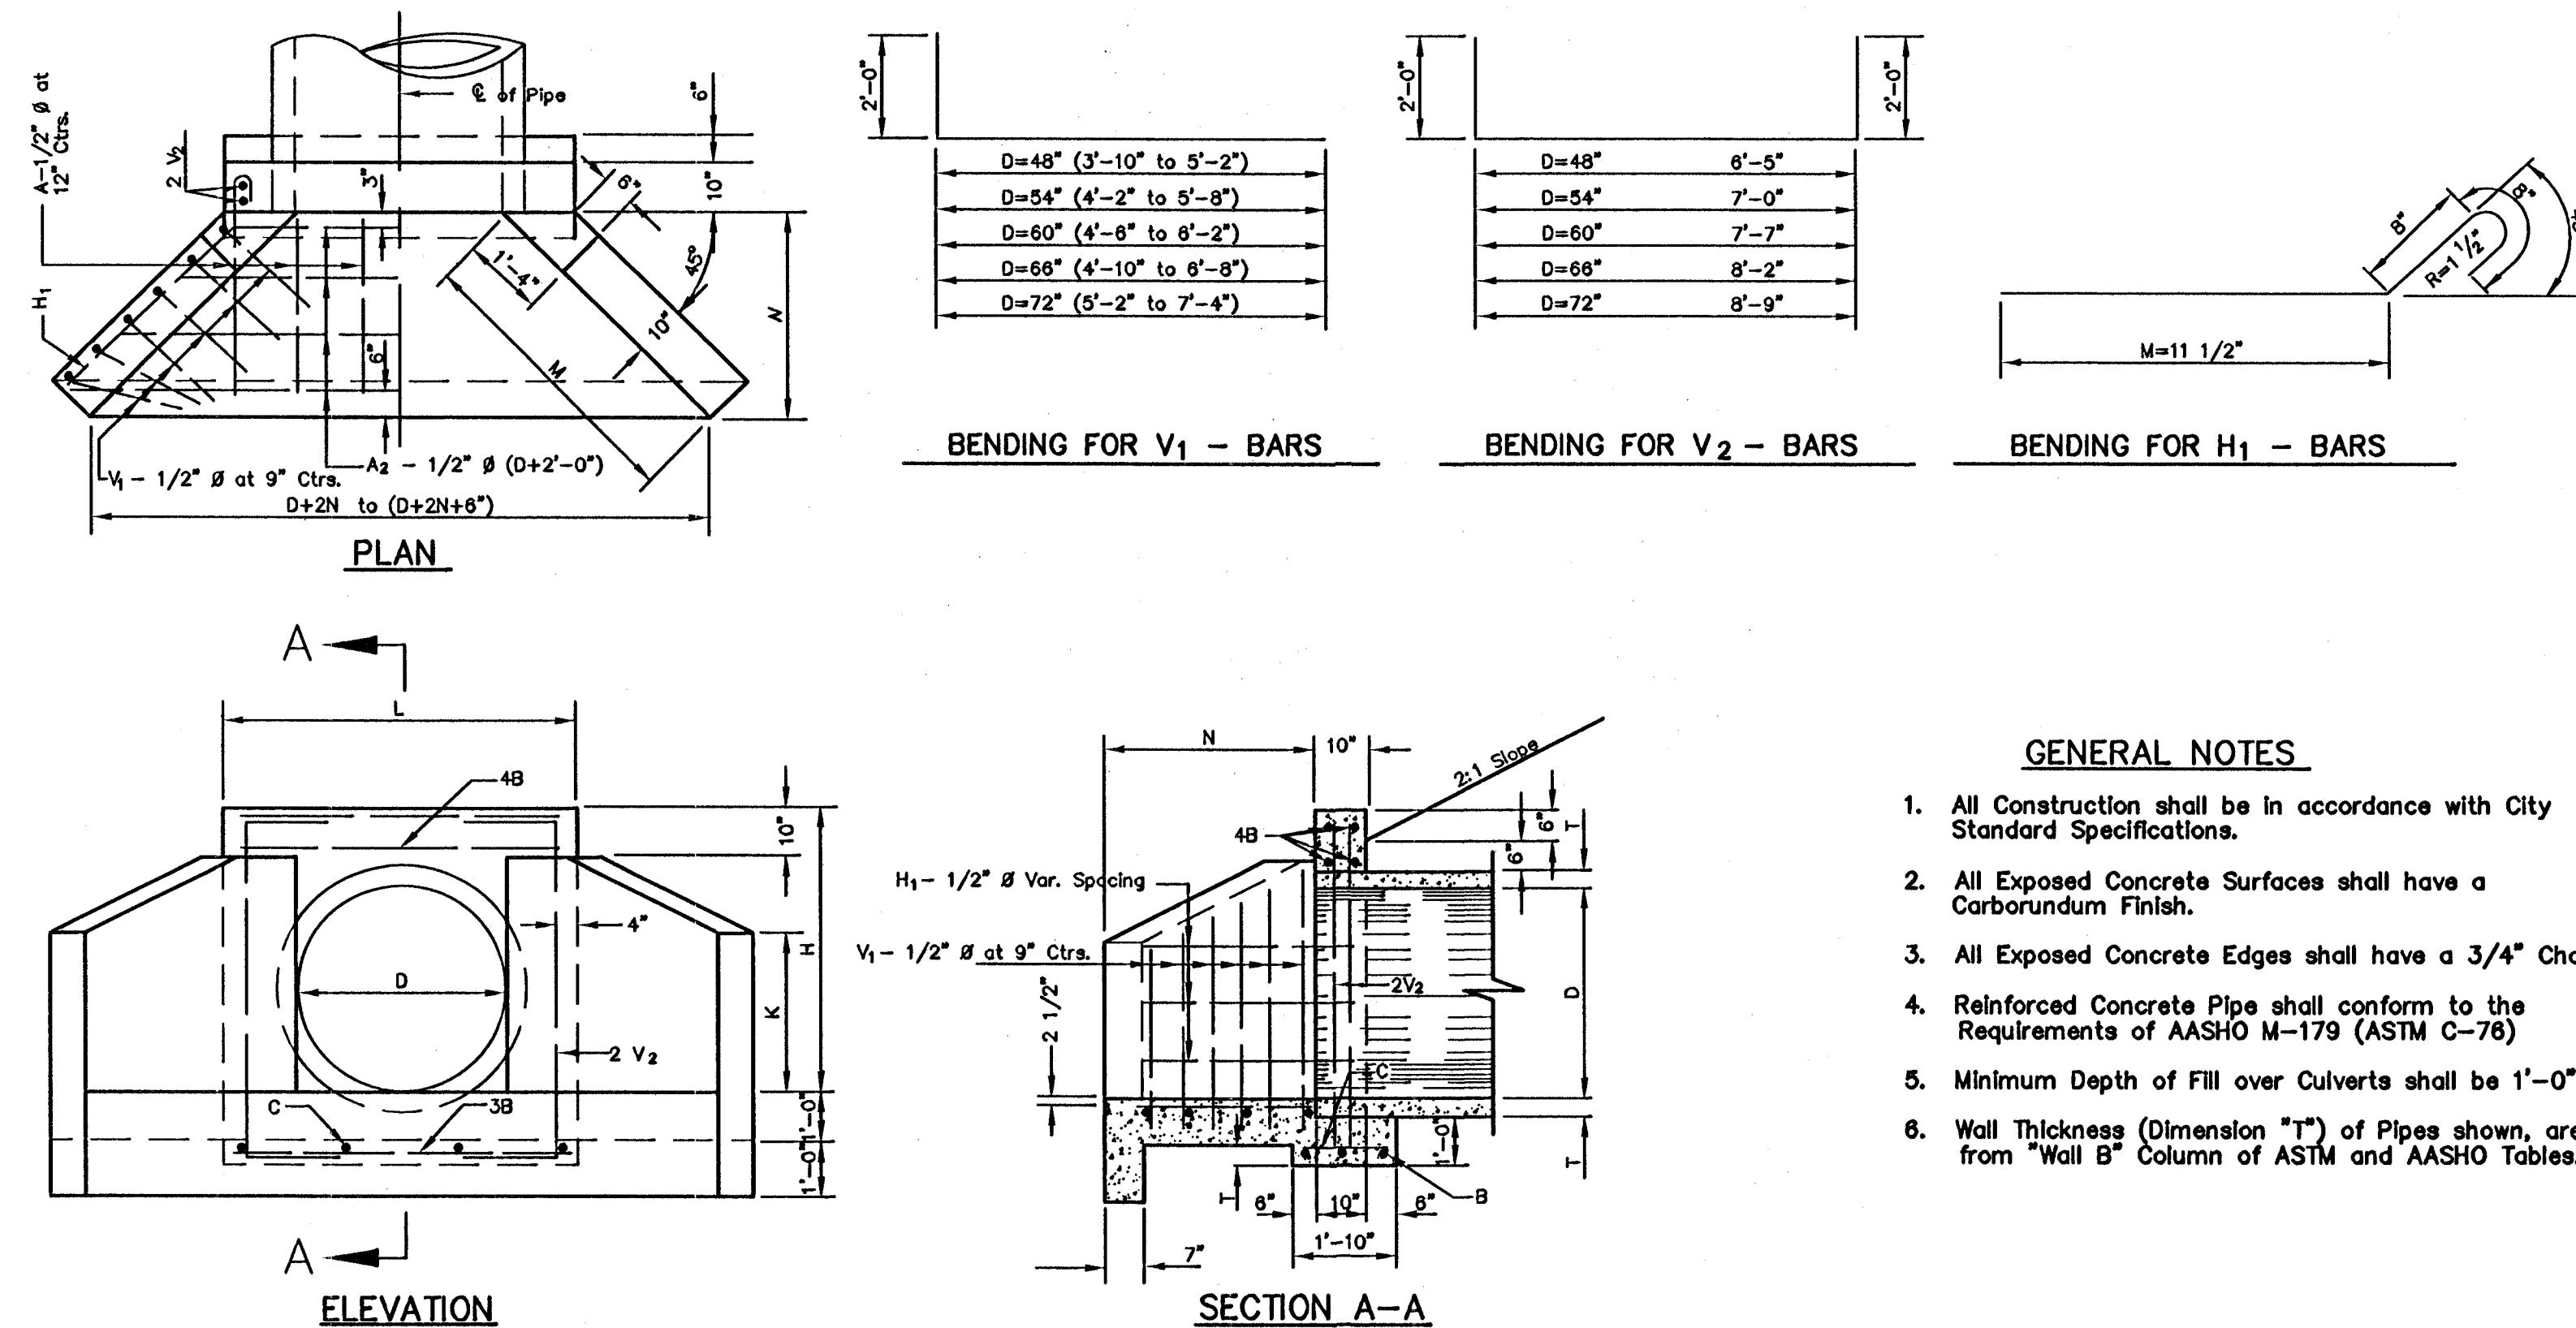


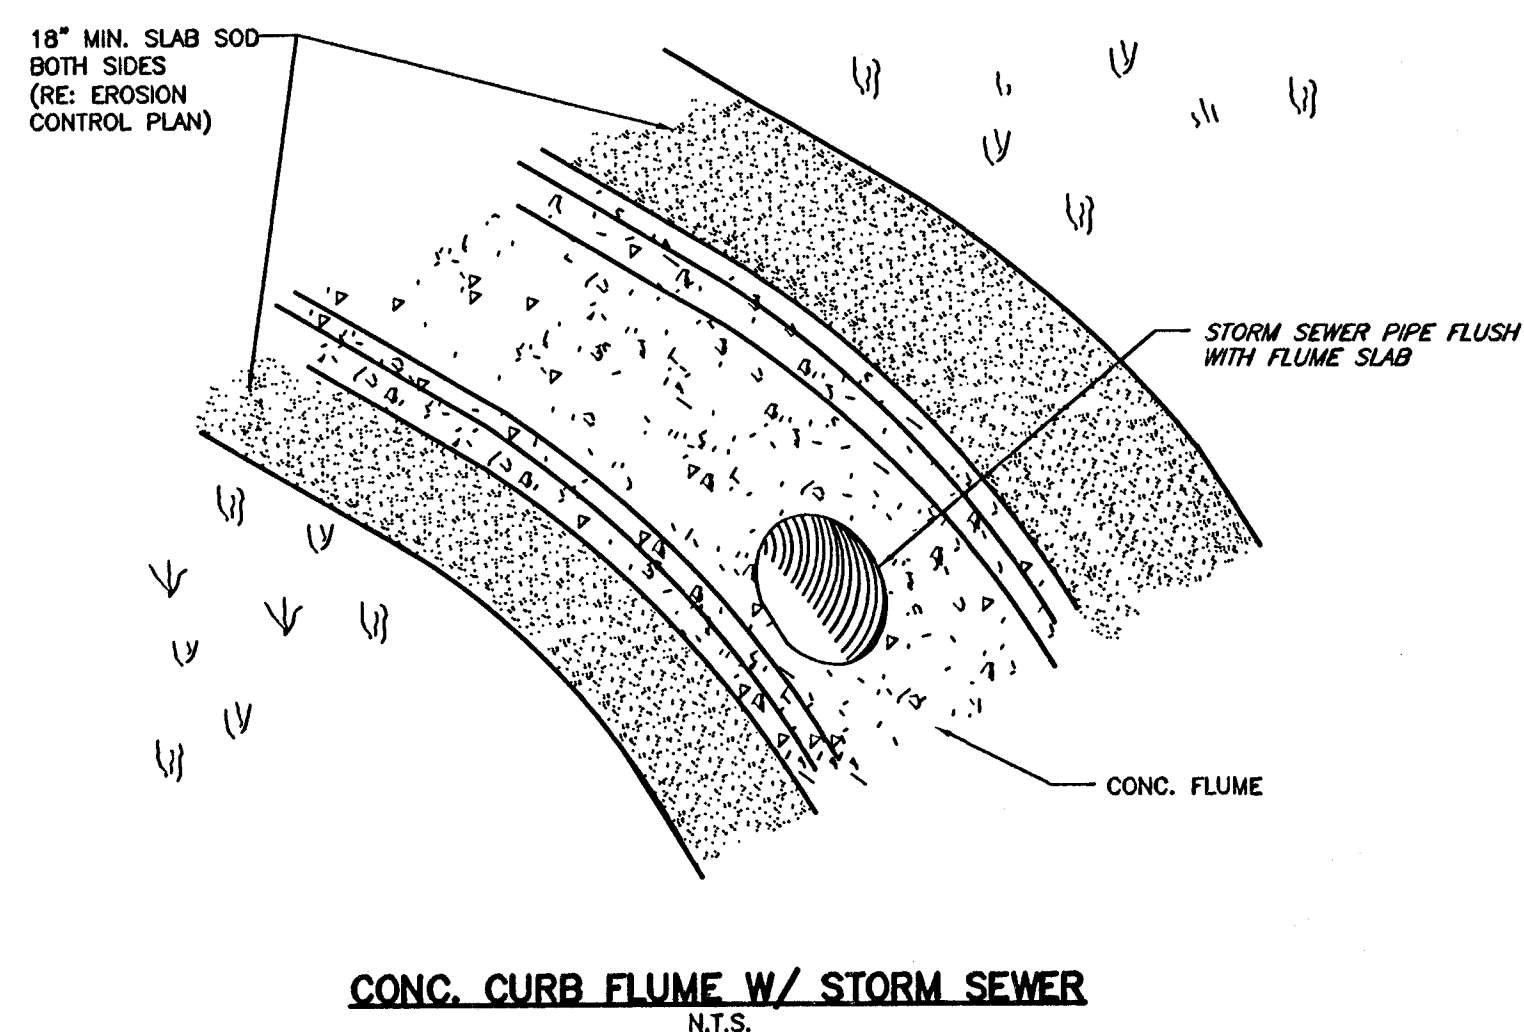

DIMENSIONS & QUANTITIES FOR HEADWALLS WITH 45° WINGS																														
DIMENSIONS							REINFORCING STEEL												QUANTITIES*											
D	AREA SQ.FT.	T	H	K	L	M	N	A ₁ - 1/2" Ø	A - 1/2" Ø	B - 1/2" Ø	C - 1/2" Ø	H ₁ - 1/2" Ø	V ₁ - 1/2" Ø	V - 1/2" Ø	CLASS "A" CONC. C.Y.	REINF. STEEL LBS.														
								NO. LENGTH	NO. LENGTH	NO. LENGTH	NO. LENGTH	NO. LENGTH	NO. LENGTH	NO. LENGTH																
10"	1.23	2 1/4"	2'-0 1/4"	1'-0"	3'-0"	1'-0"	1'-0"	4	1'-0"	2	3'-0"	Av	3	3'-0"	4	1'-0"	2	3'-0"	Av	4	3'-0"	Av	4	3'-0"	Av	4	3'-0"	Av	.74	57
18"	1.77	2 1/2"	2'-0 1/2"	1'-0"	3'-0"	1'-0"	2	4	1'-0"	4	1'-0"	4	3'-0"	Av	7	3'-0"	3	1'-0"	4	2'-0"	4	3'-0"	Av	4	6"-1"	Av	4	6"-1"	.91	81
24"	3.14	3"	3'-0"	1'-0"	3'-10 1/2"	2'-0"	2	5	1'-0"	3	5'-0"	Av	7	4'-0"	3	1'-0"	8	3'-0"	8	4'-0"	1"	Av	4	6"-8"	Av	4	6"-8"	1.37	85	
30"	4.91	3 1/2"	3'-0 1/2"	2'-0"	4'-0"	3'-6 1/2"	2'-0"	6	5	2'-0"	3	6'-0"	Av	7	4'-0"	4	1'-0"	8	3'-11"	8	4'-0"	Av	4	7'-2"	Av	4	7'-2"	1.77	104	
36"	7.07	4"	4'-0"	2'-0"	5'-0"	4'-0"	3'-0"	6	6	2'-0"	4	7'-0"	Av	7	5'-0"	4	1'-0"	8	4'-7"	10	4'-11"	Av	4	7'-6"	Av	4	7'-6"	2.29	130	
42"	9.82	4 1/2"	4'-0 1/2"	2'-0"	6'-0"	5'-0"	4'-11 1/2"	3'-0"	6	3'-0"	4	7'-0"	Av	7	6'-0"	4	1'-0"	8	5'-0"	12	5'-0"	Av	4	8'-3"	Av	4	8'-3"	2.89	151	

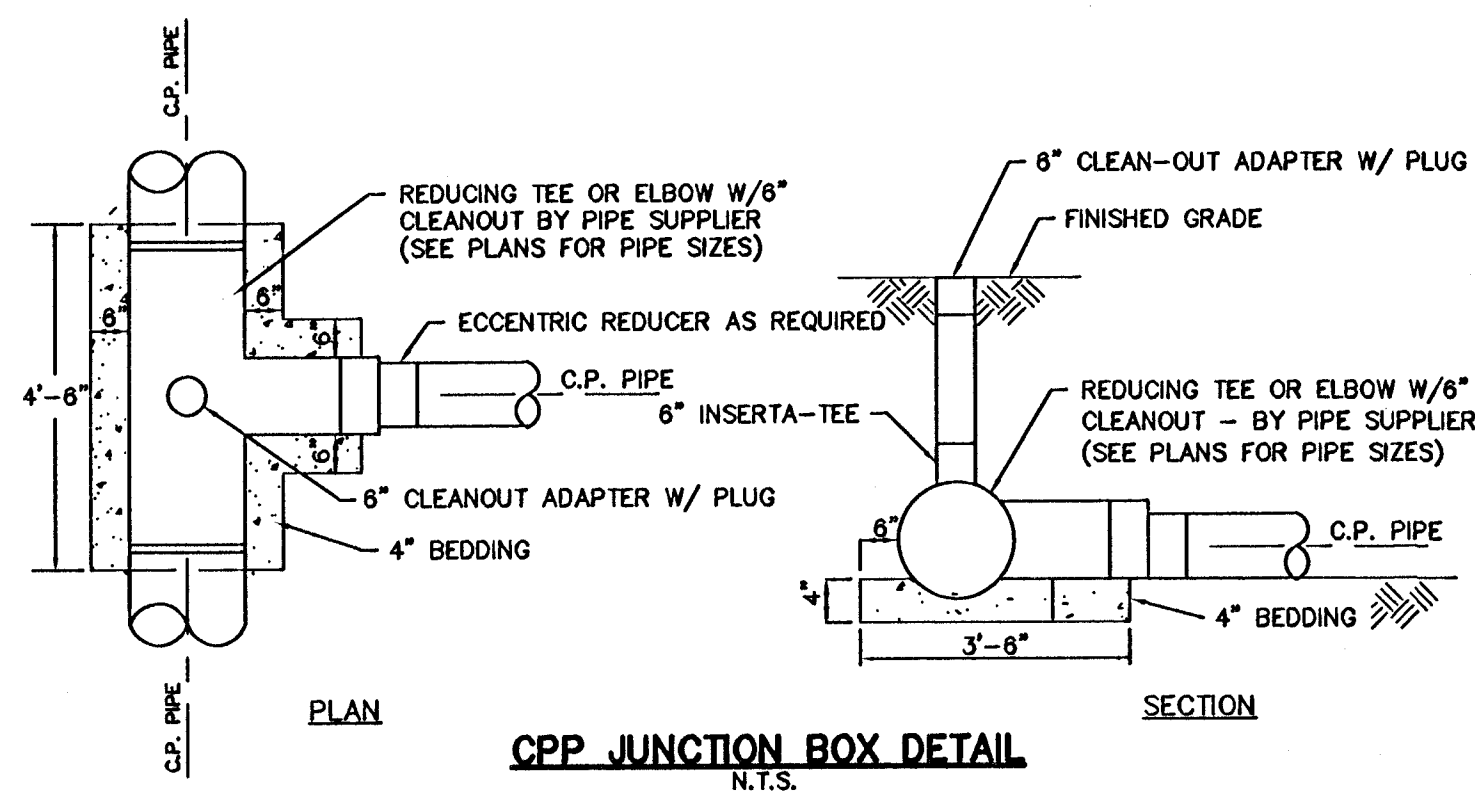

DIMENSIONS & QUANTITIES FOR HEADWALLS WITH 45° WINGS																					
DIMENSIONS								REINFORCING STEEL												QUANTITIES*	
D	AREA SQ.FT.	T	H	K	L	M	N	A ₁ - 1/2" Ø	A ₂ - 1/2" Ø	B - 1/2" Ø	C - 1/2" Ø	H ₁ - 1/2" Ø	V ₁ - 1/2" Ø	V ₂ - 1/2" Ø	CLASS "A" CONC. C.Y.	REINF. STEEL LBS.					
								NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH						
48"	12.57	5"	5'-0"	3'-2"	8'-4"	5'-3 1/2"	3'-9"	7	3'-5"	4	9'-0" Av.	7	6'-0"	8	5'-8"	12	6'-8" Av.	4	10'-5"	3.81	184
54"	15.90	5 1/2"	5'-11 1/2"	3'-5"	8'-10"	5'-10 1/2"	4'-2"	7	3'-10"	5	9'-11" Av.	7	6'-5"	8	6'-3"	14	6'-11" Av.	4	11'-0"	4.54	214
60"	19.63	6"	6'-8"	3'-10"	7'-4"	6'-5 1/2"	4'-7"	8	4'-3"	5	10'-11" Av.	7	7'-0"	6	6'-10"	18	7'-4" Av.	4	11'-7"	5.33	253
66"	23.76	6 1/2"	7'-0 1/2"	4'-2"	7'-10"	7'-1"	5'-0"	8	4'-8"	5	11'-9" Av.	7	7'-8"	6	6'-8"	18	7'-9" Av.	4	12'-2"	6.20	281
72"	28.27	7"	7'-1"	4'-8"	8'-4"	7'-9 1/2"	5'-8"	9	5'-2"	6	12'-9" Av.	7	8'-0"	6	6'-8"	20	8'-3" Av.	4	12'-9"	7.22	325

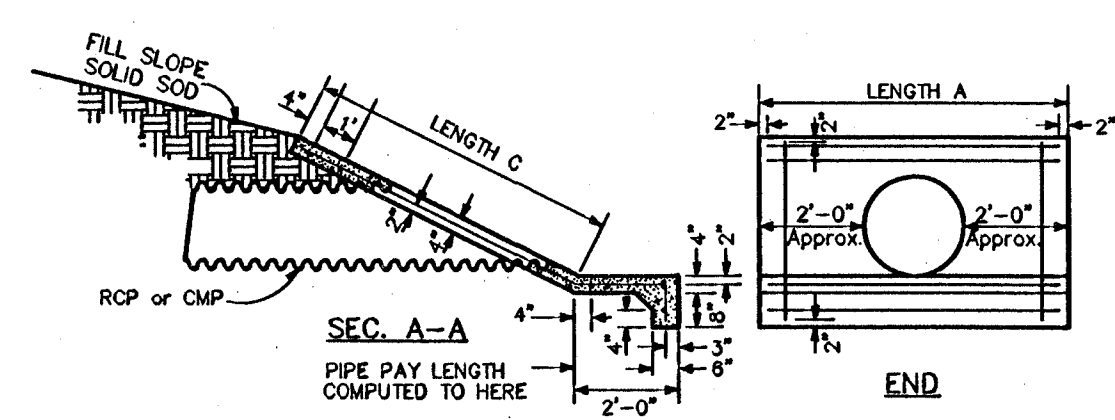

NOTE:
 1. SLOPE OF PIPE SHALL BE SHOP CUT. TWO COATS OF COLD GALVANIZED WILL BE APPLIED TO CUT EDGES OF STEEL PIPE. COSTS OF CUTTING AND GALVANIZING SHALL BE INCLUDED IN PRICE BID FOR PIPE.
 2. REINFORCED STEEL SHALL BE NO. 4 DEFORMED BARS. COST OF STEEL SHALL BE INCLUDED IN PRICE BID FOR CLASS "A" CONCRETE.
 3. QUANTITIES SHOWN IN TABLES ARE FOR END ONLY.
 4. ALL PIPES ARE TO BE CUT ON A 2:1 SLOPE THRU 30' ROUND OR IT EQUIVALENT ARCH.
 5. ALL CONSTRUCTION AND MATERIALS SHALL BE IN ACCORDANCE WITH THE CURRENT STANDARDS OR SUPPLEMENTAL SPECIFICATIONS.

PIPE SIZE	LENGTH A	LENGTH B	LENGTH C	CONC. C.Y.	STEEL LENGTH
12"	5'-0"	8'-0"	0.57	4'-8"	8'-9"
18"	5'-0"	8'-0"	0.71	5'-2"	10'-9"
24"	6'-0"	10'-0"	0.86	5'-8"	12'-9"
30"	6'-0"	12'-0"	1.02	6'-2"	14'-9"
36"	7'-0"	9'-0"	0.87	6'-8"	11'-3"
42"	7'-0"	10'-0"	0.97	7'-2"	12'-3"
48"	8'-0"	11'-0"	1.08	7'-8"	13'-3"
54"	8'-0"	12'-0"	1.19	8'-2"	14'-3"

CLASS "A" CONCRETE
 SLOPE WALL DETAIL
 N.T.S.

- GENERAL NOTES**
- All Construction shall be in accordance with City Standard Specifications.
 - All Exposed Concrete Surfaces shall have a Carborundum Finish.
 - All Exposed Concrete Edges shall have a 3/4" Chamfer.
 - Reinforced Concrete Pipe shall conform to the Requirements of AASHTO M-179 (ASTM C-76)
 - Minimum Depth of Fill over Culverts shall be 1'-0".
 - Wall Thickness (Dimension "T") of Pipes shown, are taken from "Wall B" Column of ASTM and AASHTO Tables.


MISCELLANEOUS STORM SEWER DETAILS

WAL-MART SUPERCENTER #4321-00

NW 53rd ST. NORTH & N. MERIDIAN
 WICHITA, KANSAS

SMC Consulting Engineers, P.C.
 815 West Main - Oklahoma City, OK 73108
 PH: 405-232-7715 Fax: 405-232-7859
 KANSAS CERTIFICATE OF AUTHORIZATION NO. E-335 EXP. DEC. 2008

No.	Revision	By	Date
1	Per City comments	MOS	02/23/07
DATE: 12/12/08			
DRAWN BY: TN			
PROJECT NO: 4344.00			
ENGINEER: TERENCE L. HAYNES, P.E. #14583			

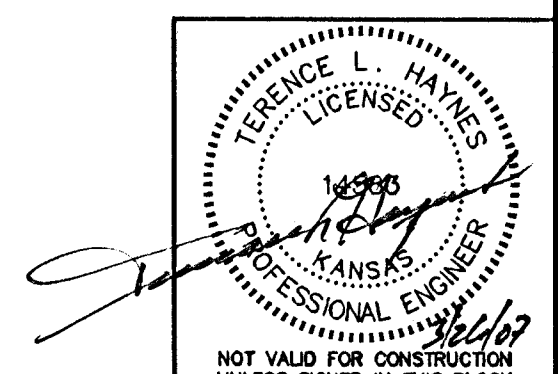

SHEET NO.

C-8.15