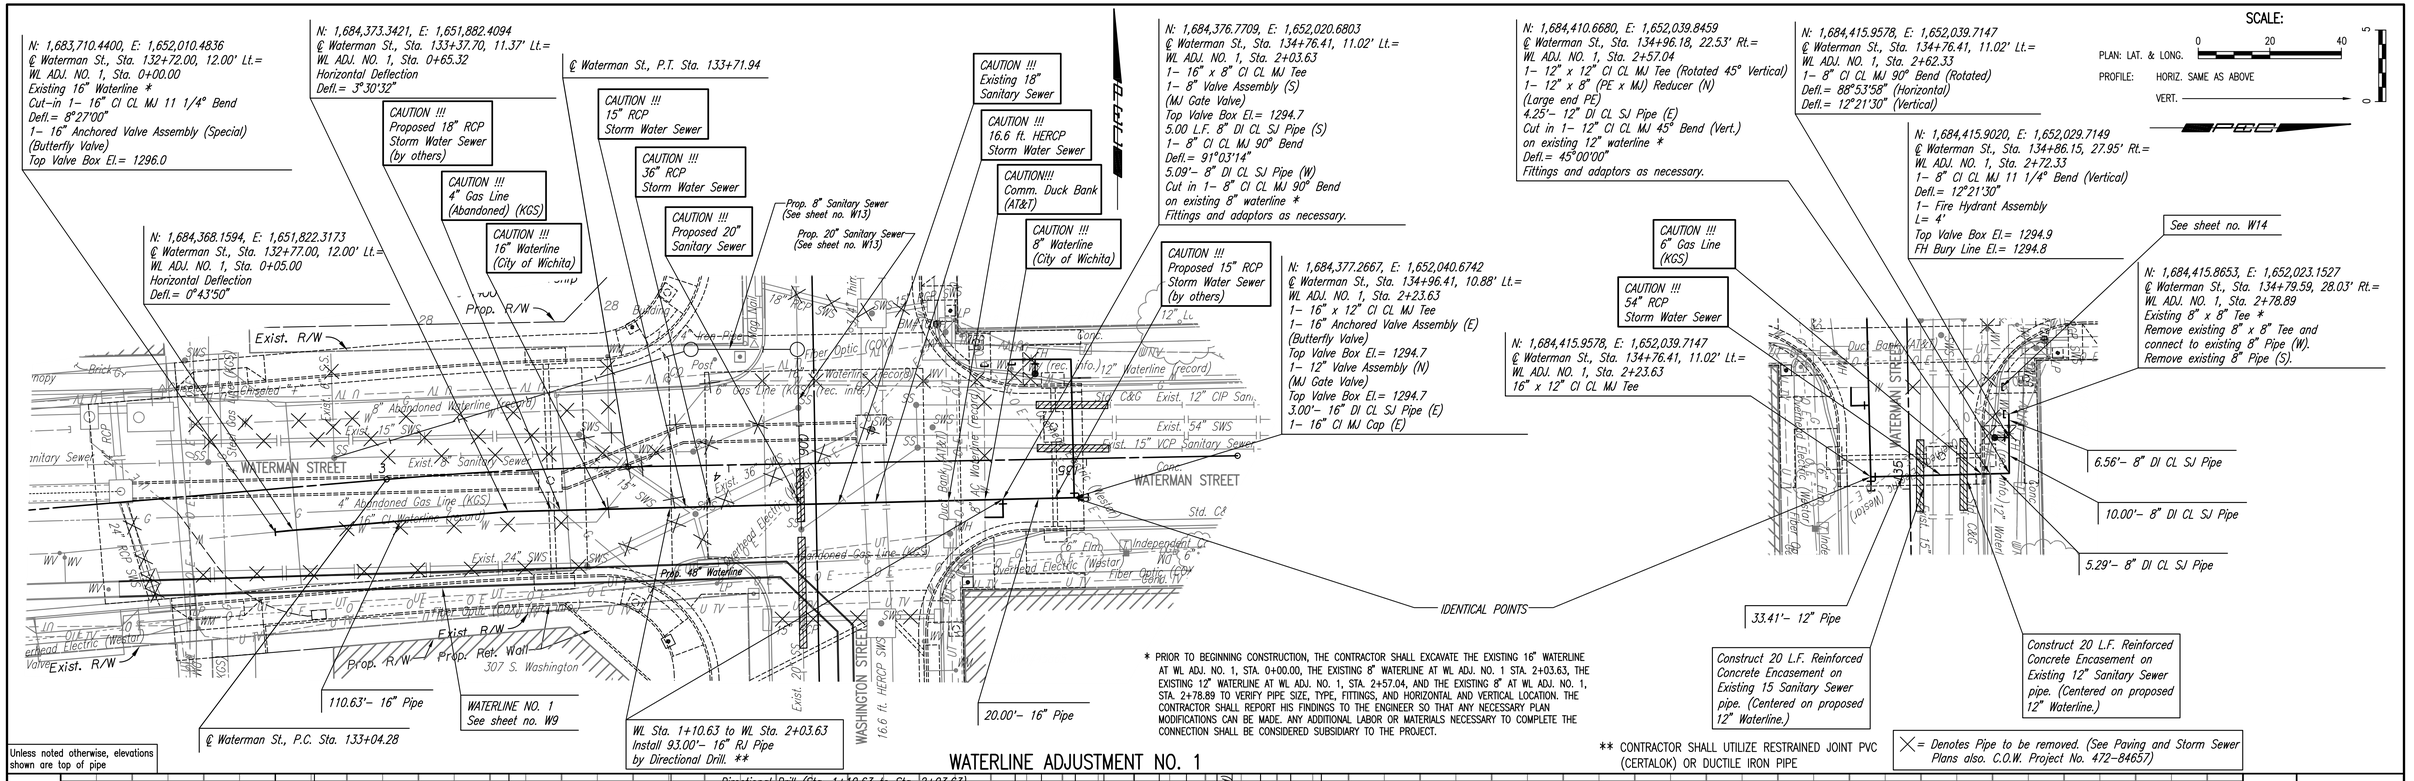

* PRIOR TO BEGINNING CONSTRUCTION, THE CONTRACTOR SHALL EXCAVATE THE EXISTING 16" WATERLINE AT WL ADJ. NO. 1, STA. 0+00.00, THE EXISTING 8" WATERLINE AT WL ADJ. NO. 1 STA. 2+03.63, THE EXISTING 12" WATERLINE AT WL ADJ. NO. 1, STA. 2+57.04, AND THE EXISTING 8" AT WL ADJ. NO. 1, STA. 2+78.89 TO VERIFY PIPE SIZE, TYPE, FITTINGS, AND HORIZONTAL AND VERTICAL LOCATION. THE CONTRACTOR SHALL REPORT HIS FINDINGS TO THE ENGINEER SO THAT ANY NECESSARY PLAN MODIFICATIONS CAN BE MADE. ANY ADDITIONAL LABOR OR MATERIALS NECESSARY TO COMPLETE THE CONNECTION SHALL BE CONSIDERED SUBSIDIARY TO THE PROJECT.

** CONTRACTOR SHALL UTILIZE RESTRAINED JOINT PVC (CERTALOK) OR DUCTILE IRON PIPE

X = Denotes Pipe to be removed. (See Paving and Storm Sewer Plans also. C.O.W. Project No. 472-84657)

WATERLINE ADJUSTMENT NO. 1

PLAN	CHECKED	BY	DATE
	CHECKED		

PROFILE	CHECKED	BY	DATE
	CHECKED		

SOUTHEAST 48" WATERLINE - PHASE 1C
WASHINGTON/WATERMAN TO LEWIS/IDA

WATERLINE ADJUSTMENT NO. 1

JAMES L. ARMOUR, P.E. - CITY ENGINEER
CITY OF WICHITA PROJECT NO. 448-90417

Professional Engineering Consultants, P.A.
303 S. TOPEKA • WICHITA, KANSAS 67202
316-262-2691 • FAX 316-262-3003

Designed By: MDK, EJB
Drawn By: RFT, CSL
Job No. 35-05787-001-042
Date: March 2006

Sheet W13 of 23

Saved 01-02-2009 9:45:02 AM by CSL
Plot Scale 20:1 Plot Date 01/02/2009 10:12:19 AM by MJC
Q:\2005\05787\001\Phase1C\05787-001-Phase1C-C-WLP005