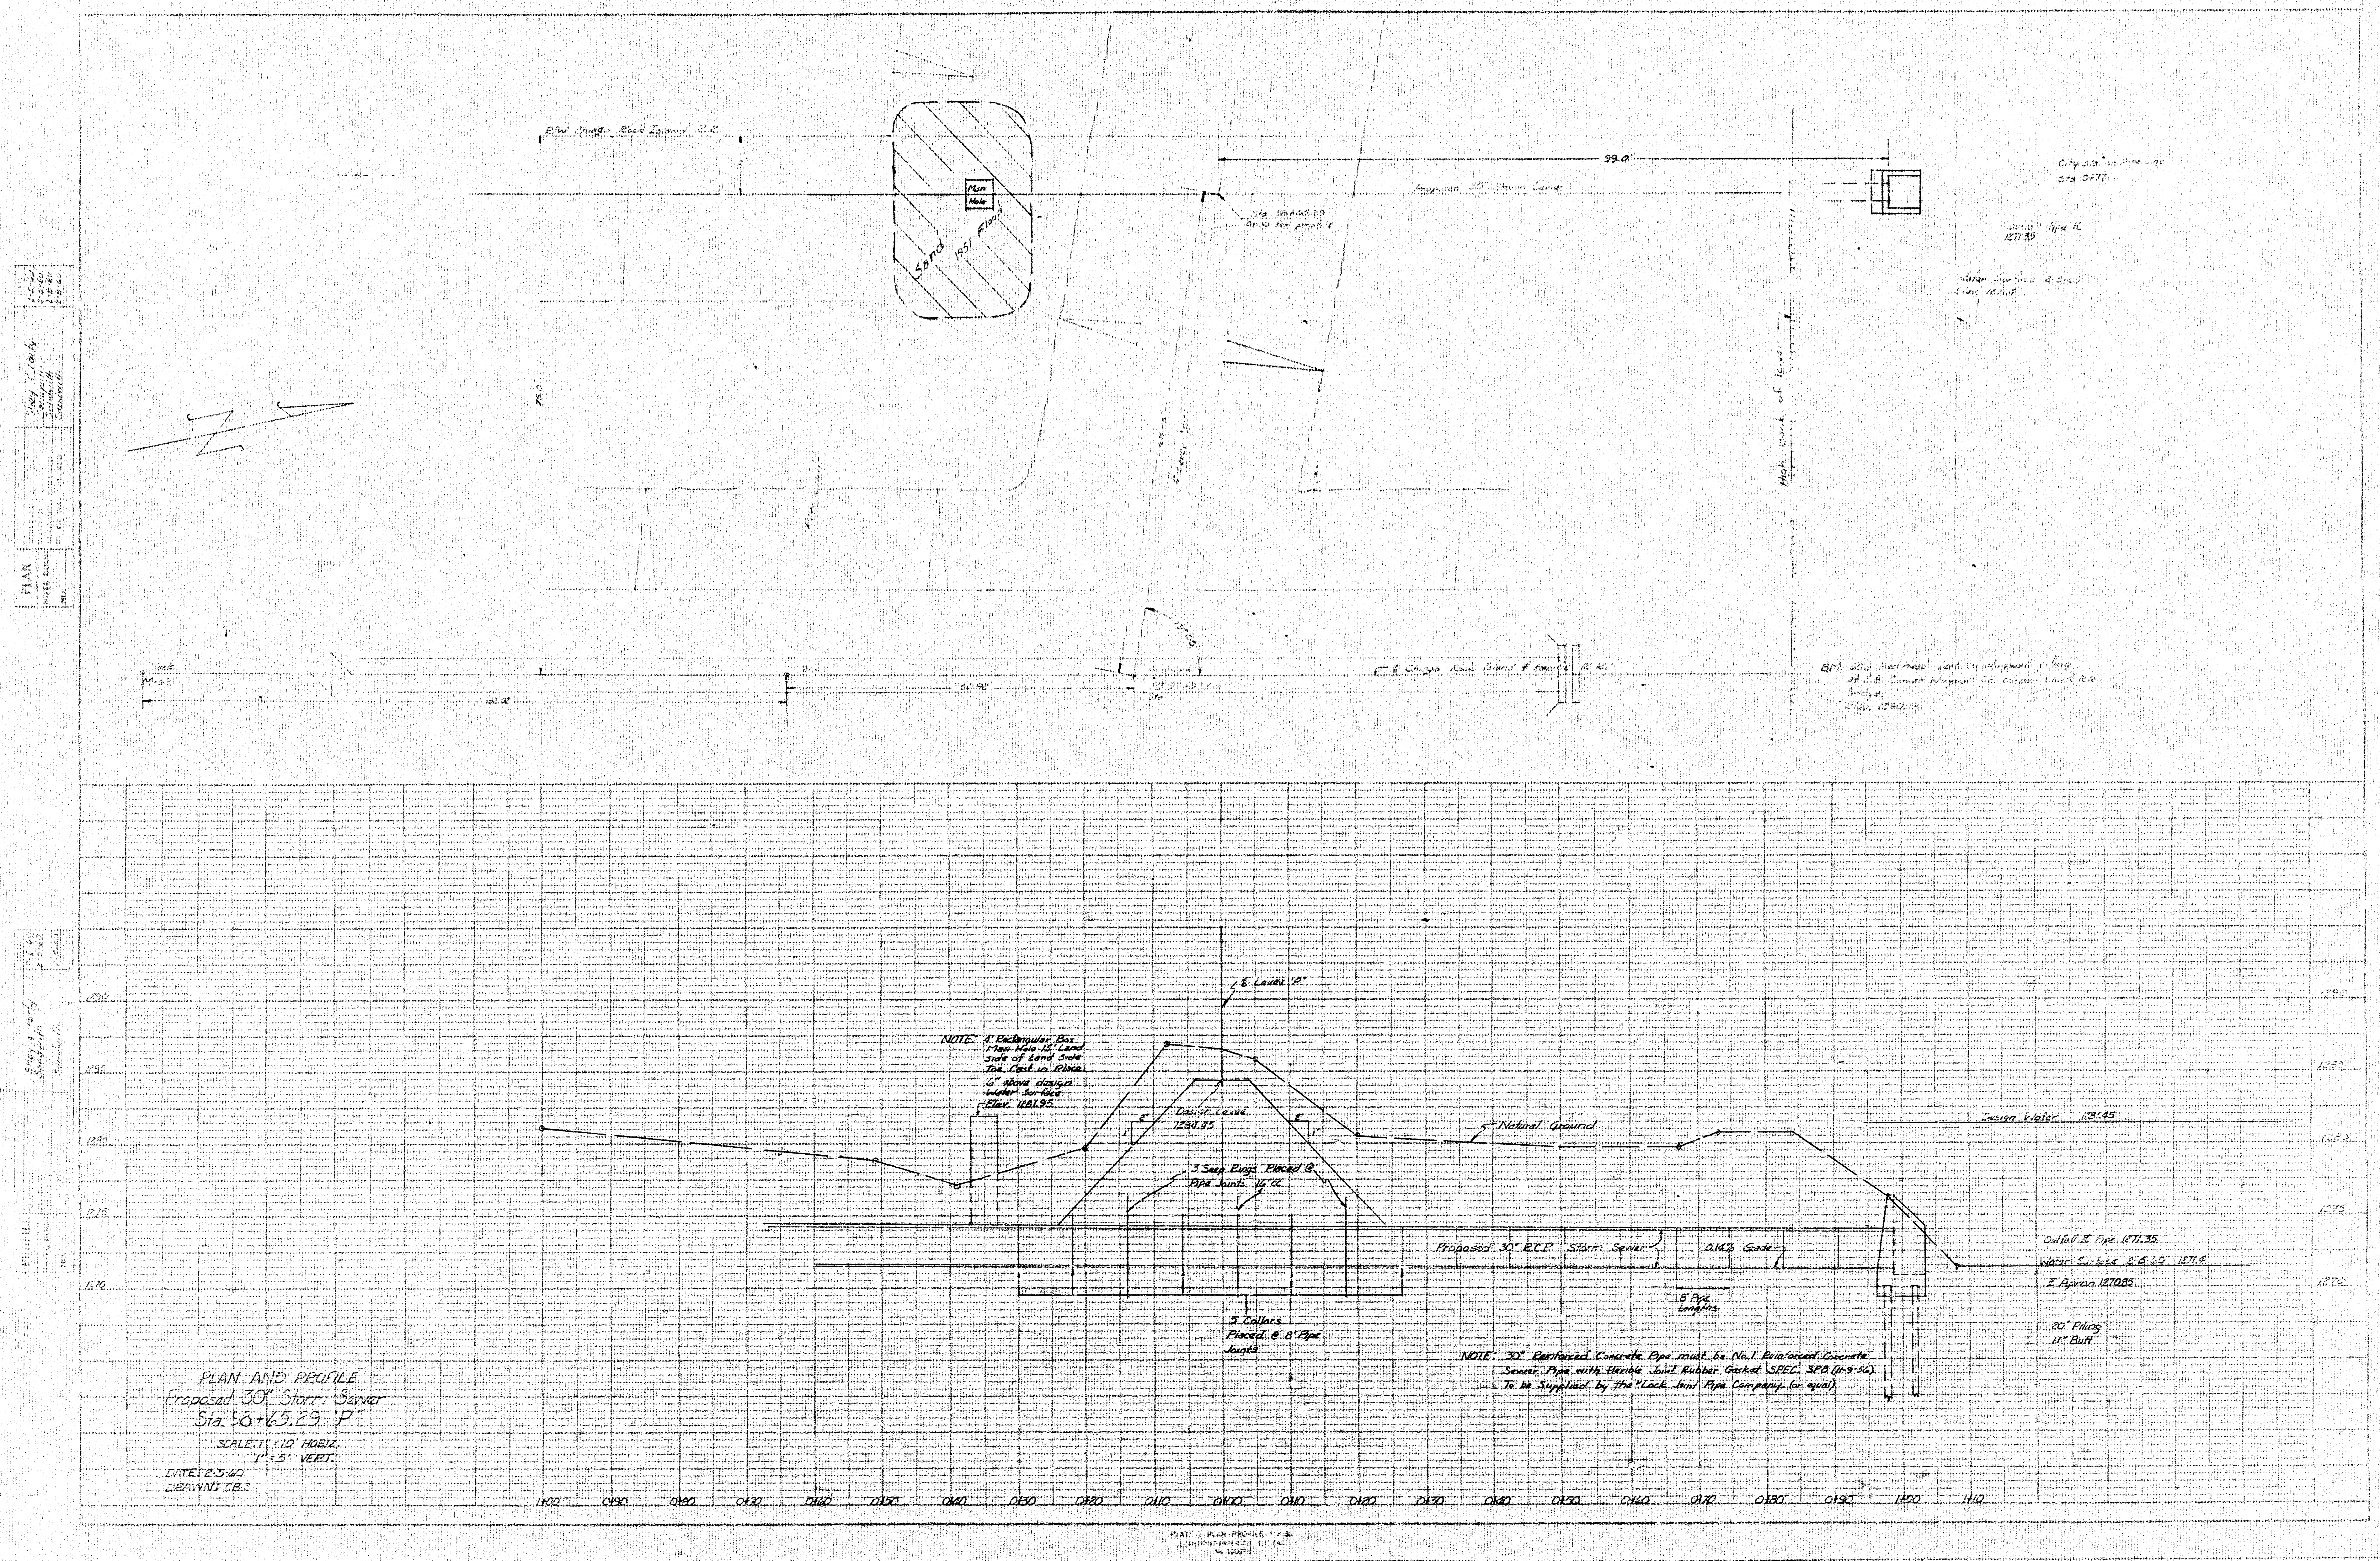

NOTE: 4' Rectangular Box Man Hole 15' Land Side of Land Side Toe Cast in Place 6" above design Water Surface. Elev. 1281.95

NOTE: 30" Reinforced Concrete Pipe must be No. 1 Reinforced Concrete Sewer Pipe with flexible Joint Rubber Gasket SPEC. SPB (11-9-56). To be Supplied by the "Lock Joint Pipe Company (or equal)

PLAN AND PROFILE
Proposed 30" Storm Sewer
Sta. 98+65.29 "P"

SCALE: 1" = 10' HORIZ.
1" = 5' VERT.

DATE: 2-5-60
DRAWN: C.B.S.