


**DRY-STACK STONE RETAINING WALL-PROFILE**

**GENERAL NOTES**

- DRY STACK QUARRY BLOCK STONE**  
QUARRY - PRAY STONE COMPANY  
1000 INDUSTRIAL ROAD  
WINFIELD, KS 67156  
PHONE: (620)221-7422  
FAX: (620)221-4487  
  
12-14" WINFIELD QUARRY BLOCK LIMESTONE  
AVG. LENGTH - 4' TO 6'  
MIN. COMPRESSIVE STRENGTH - 10,000 PSI
- PLACEMENT**  
-MINIMUM STONE OVERLAP IN WALL COURSE SHALL BE 12"  
-WALL GAP BETWEEN VERTICAL JOINTS SHALL BE NO MORE THAN 1" MAX., WHERE NECESSARY FILL MATERIAL (SMALL ROCK) SHALL BE USED TO FILL GAP. THESE AREAS SHALL BE KEPT TO A MINIMUM, FIELD VERIFY w/ OWNER'S REPRESENTATIVE PRIOR TO FINAL ACCEPTANCE.
- SURFACE FINISH**  
EXPOSED WALL SURFACE SHALL HAVE A DRESSED STONE FINISH. A MOCKUP WALL SECTION WILL BE REQUIRED PRIOR TO COMMENCEMENT OF WORK.


**NOTE**  
PRIOR TO ANY CONSTRUCTION SEE SHEET 78 FOR NOTES REGARDING TREE PROTECTION, LIMITS OF DISTURBANCE, AND PLAN VIEW/ELEVATIONS

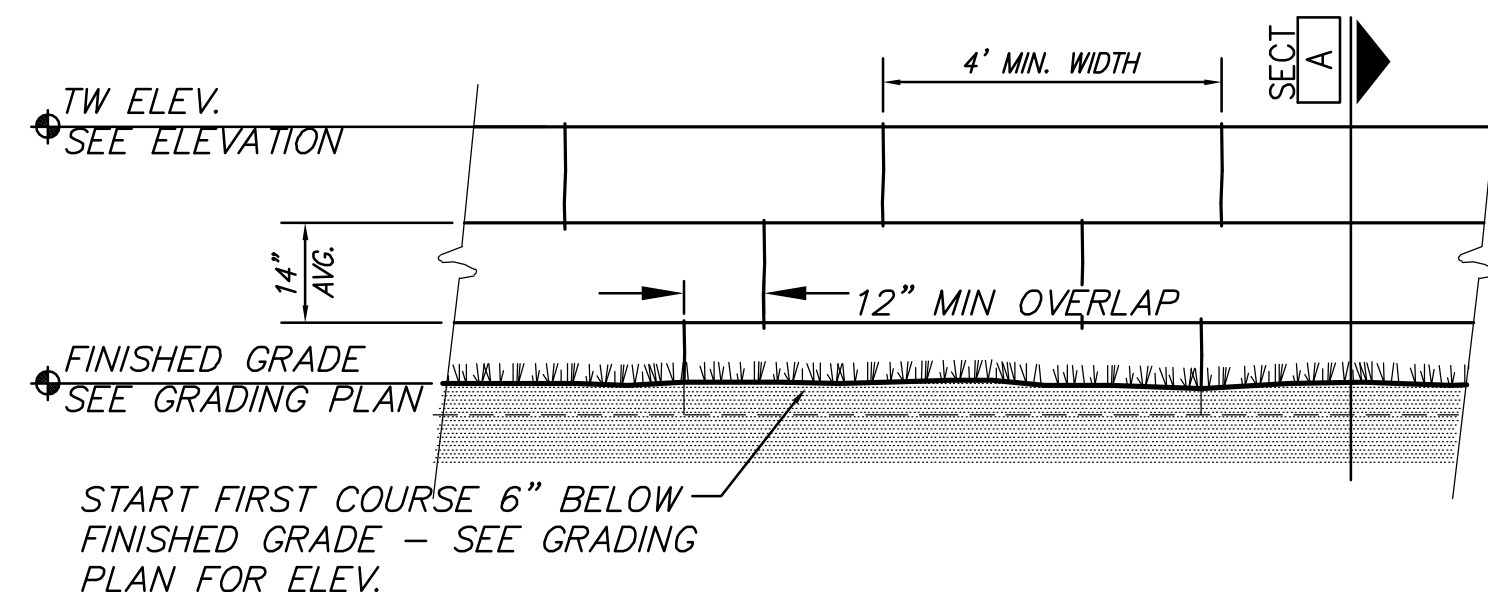

**ELEVATION**

NOTE: THE STONE WALL WIDTH @ THE TOP COURSE OF ALL WALLS SHALL BE 18" MIN., BATTERING DOWN TO A BASE COURSE MIN. WIDTH OF 2' OR ONE HALF THE HEIGHT OF THE WALL, WHICHEVER IS GREATER.

**DRY-STACK RETAINING WALL**  
NOT TO SCALE

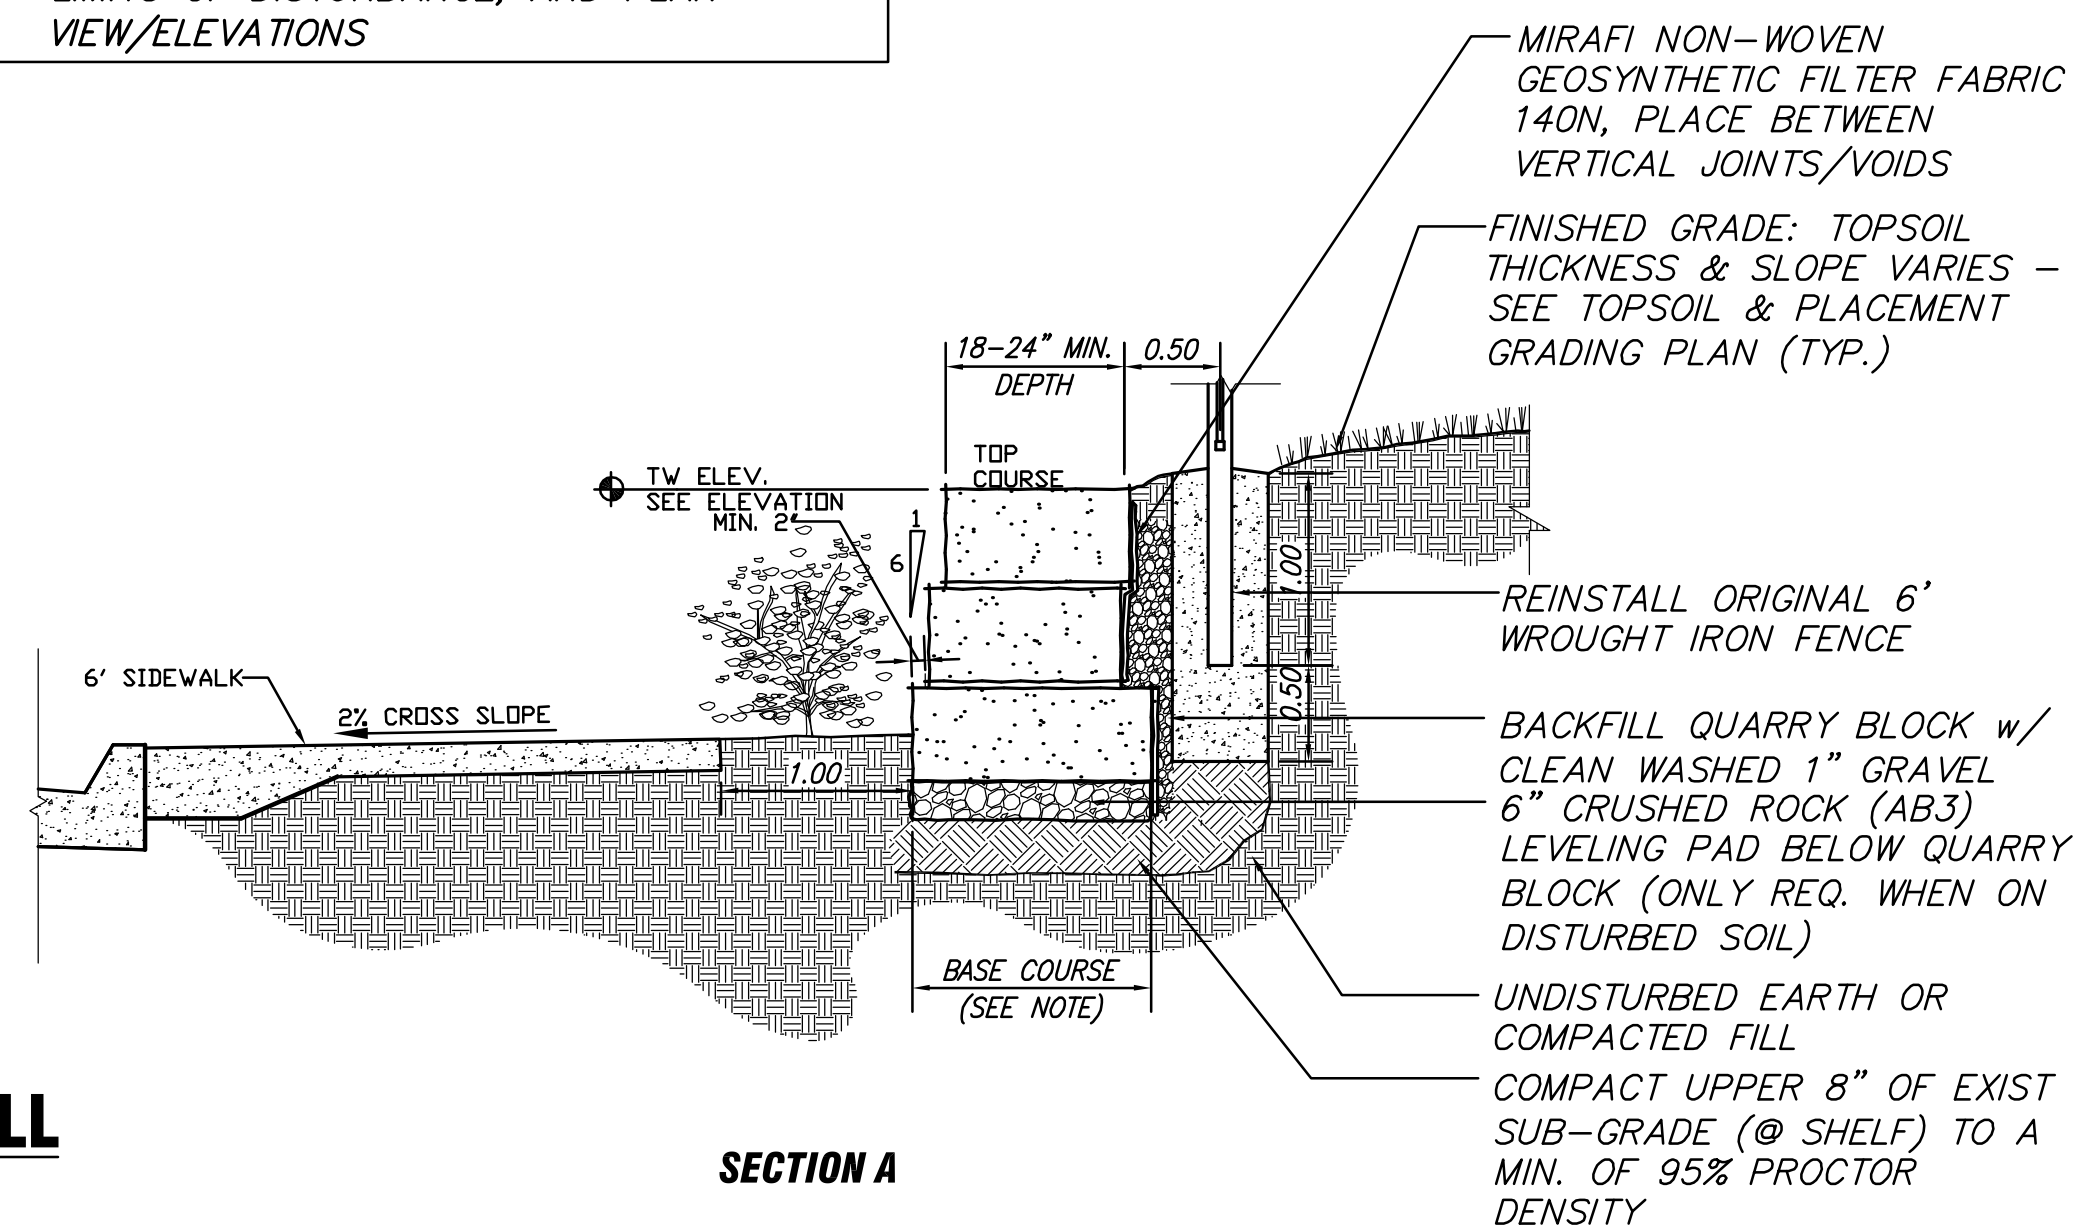

**SECTION A**

**Retaining Wall Details**

SHEET TITLE  
**87 N-0349-01**  
PROJECT NUMBER

JRA  
DESIGN BY  
JSB  
DRAWN BY  
JRA  
CHECKED BY

ISSUED  
**May 28, 2009**  
REVISED

SHEET NO.  
**53 of 133**