
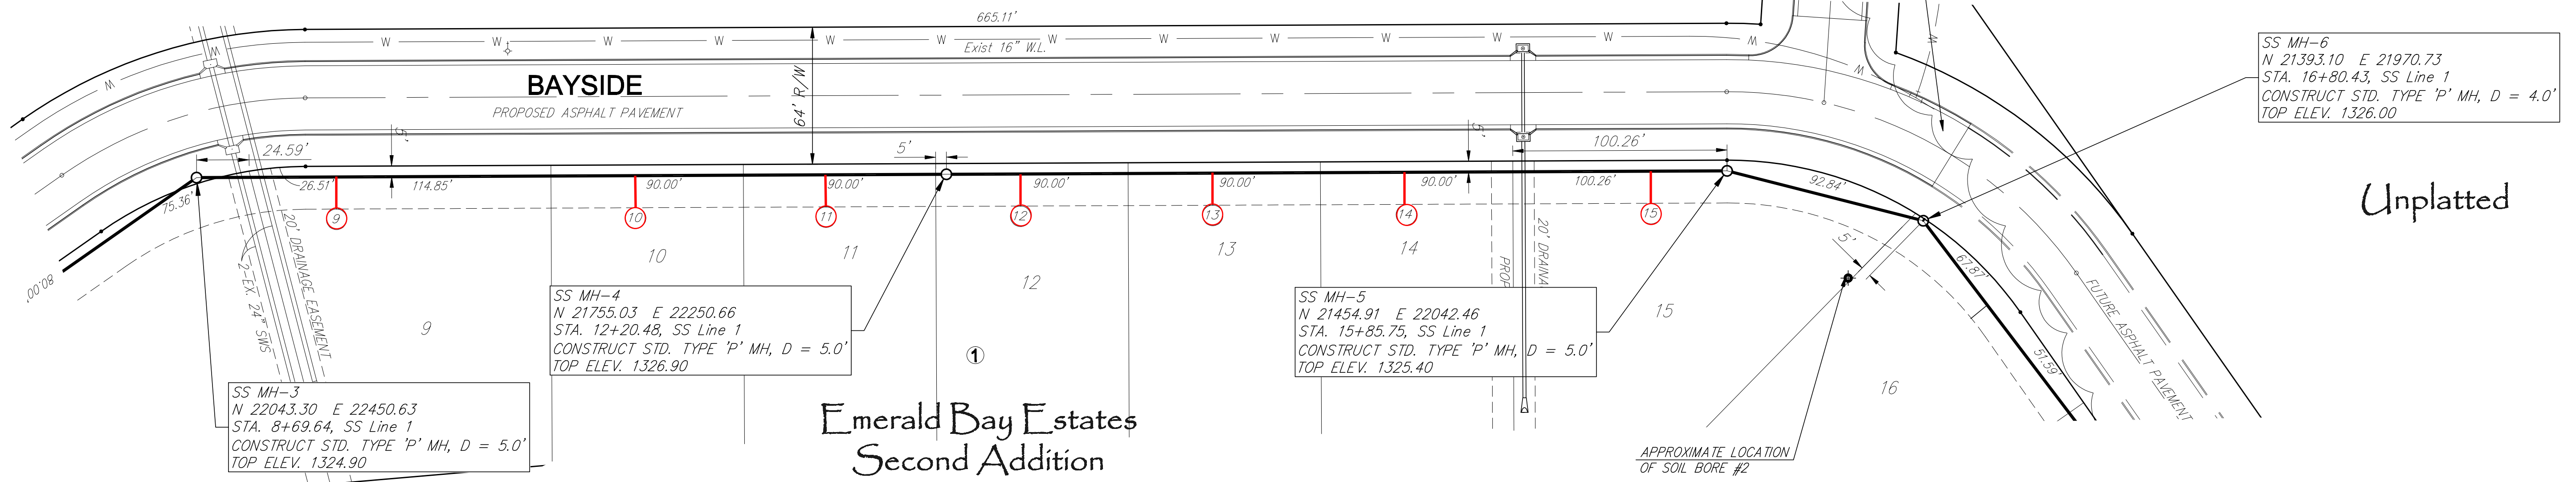


SEWER SERVICE TABLE


NUMBER	TYPE	LOCATION			STATION \ DIRECTION	FOR INFORMATION ONLY		DISTANCE FROM MAIN TO RISER (LT./RT.)	DISTANCE FROM	
		LOT NO.	BLOCK NO.	LINE NO.		APPROXIMATE LENGTH 4" PIPE			UPSTREAM MH	DOWNSTREAM MH
						VERTICAL	HORIZONTAL			
9	8" X 4" Tee Riser	9	1	1	9+35/R	11'	15'	15'	285'	65'
10	8" X 4" Tee Riser	10	1	1	10+75/R	11'	45'	14.95'	145'	210'
11	8" X 4" Tee Riser	11	1	1	11+64/R	11'	45'	14.90'	56'	293'
12	8" X 4" Tee Riser	12	1	1	12+55/R	11'	45'	15.10'	332'	35'
13	8" X 4" Tee Riser	13	1	1	13+45/R	10'	15'	15'	240'	125'
14	8" X 4" Tee Riser	14	1	1	14+35/R	9'	45'	14.80'	152'	215'
15	8" X 4" Tee Riser	15	1	1	15+50/R	9'	40'	9.90'	35'	330'

NOTE: Vertical Riser Pipe shall be extended to 2' minimum above ground water elevation and 4' maximum below proposed ground elevation.

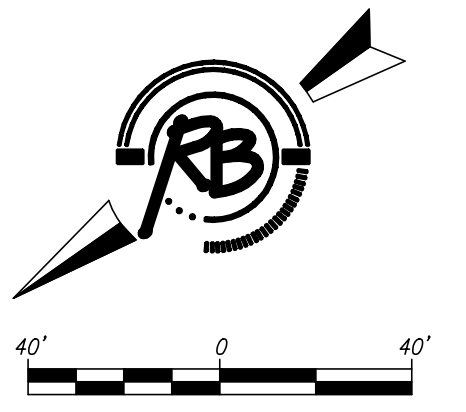

Unplatted

**Emerald Bay Estates
Second Addition**

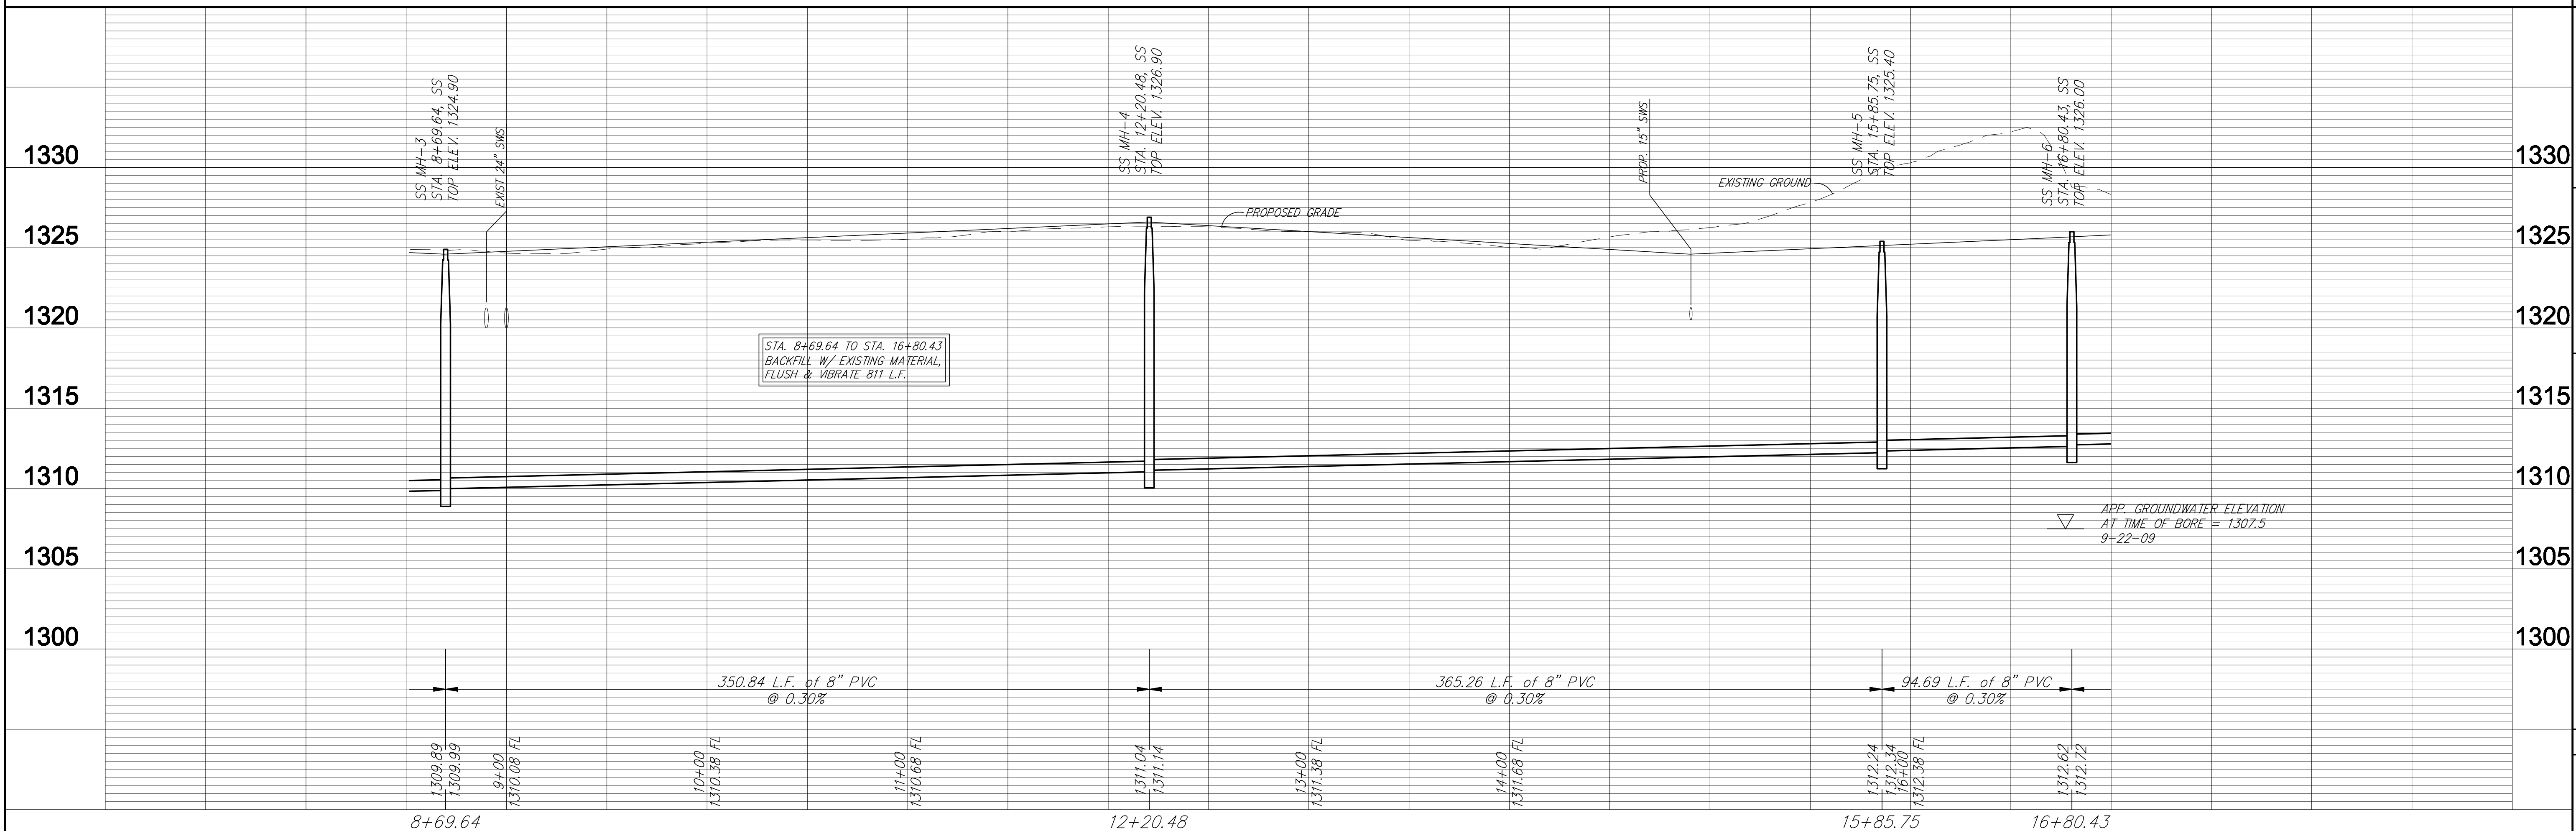

Ruggless & Bohlin P.A.
 Engineering & Surveying
 1000 W. 17th St., Suite 100
 Wichita, Kansas 67202
 Phone: 316-261-1111
 Fax: 316-261-1112
 Email: info@ruggless.com

**Sanitary Sewer Improvements
Line 1
Wichita, Kansas**

PROJECT NUMBER: 466-84209
 DRAWING FILE: ENGINEERING BASE {05 Line 1}
 DATE: Sept. 11, 2009
 DRAWN BY: AML
 CHECKED BY: AML
 UTILITY
 16