



1 TYPICAL REDUCED VOLTAGE AUTO-TRANSFORMER MOTOR STARTER WIRING DIAGRAM
NO SCALE

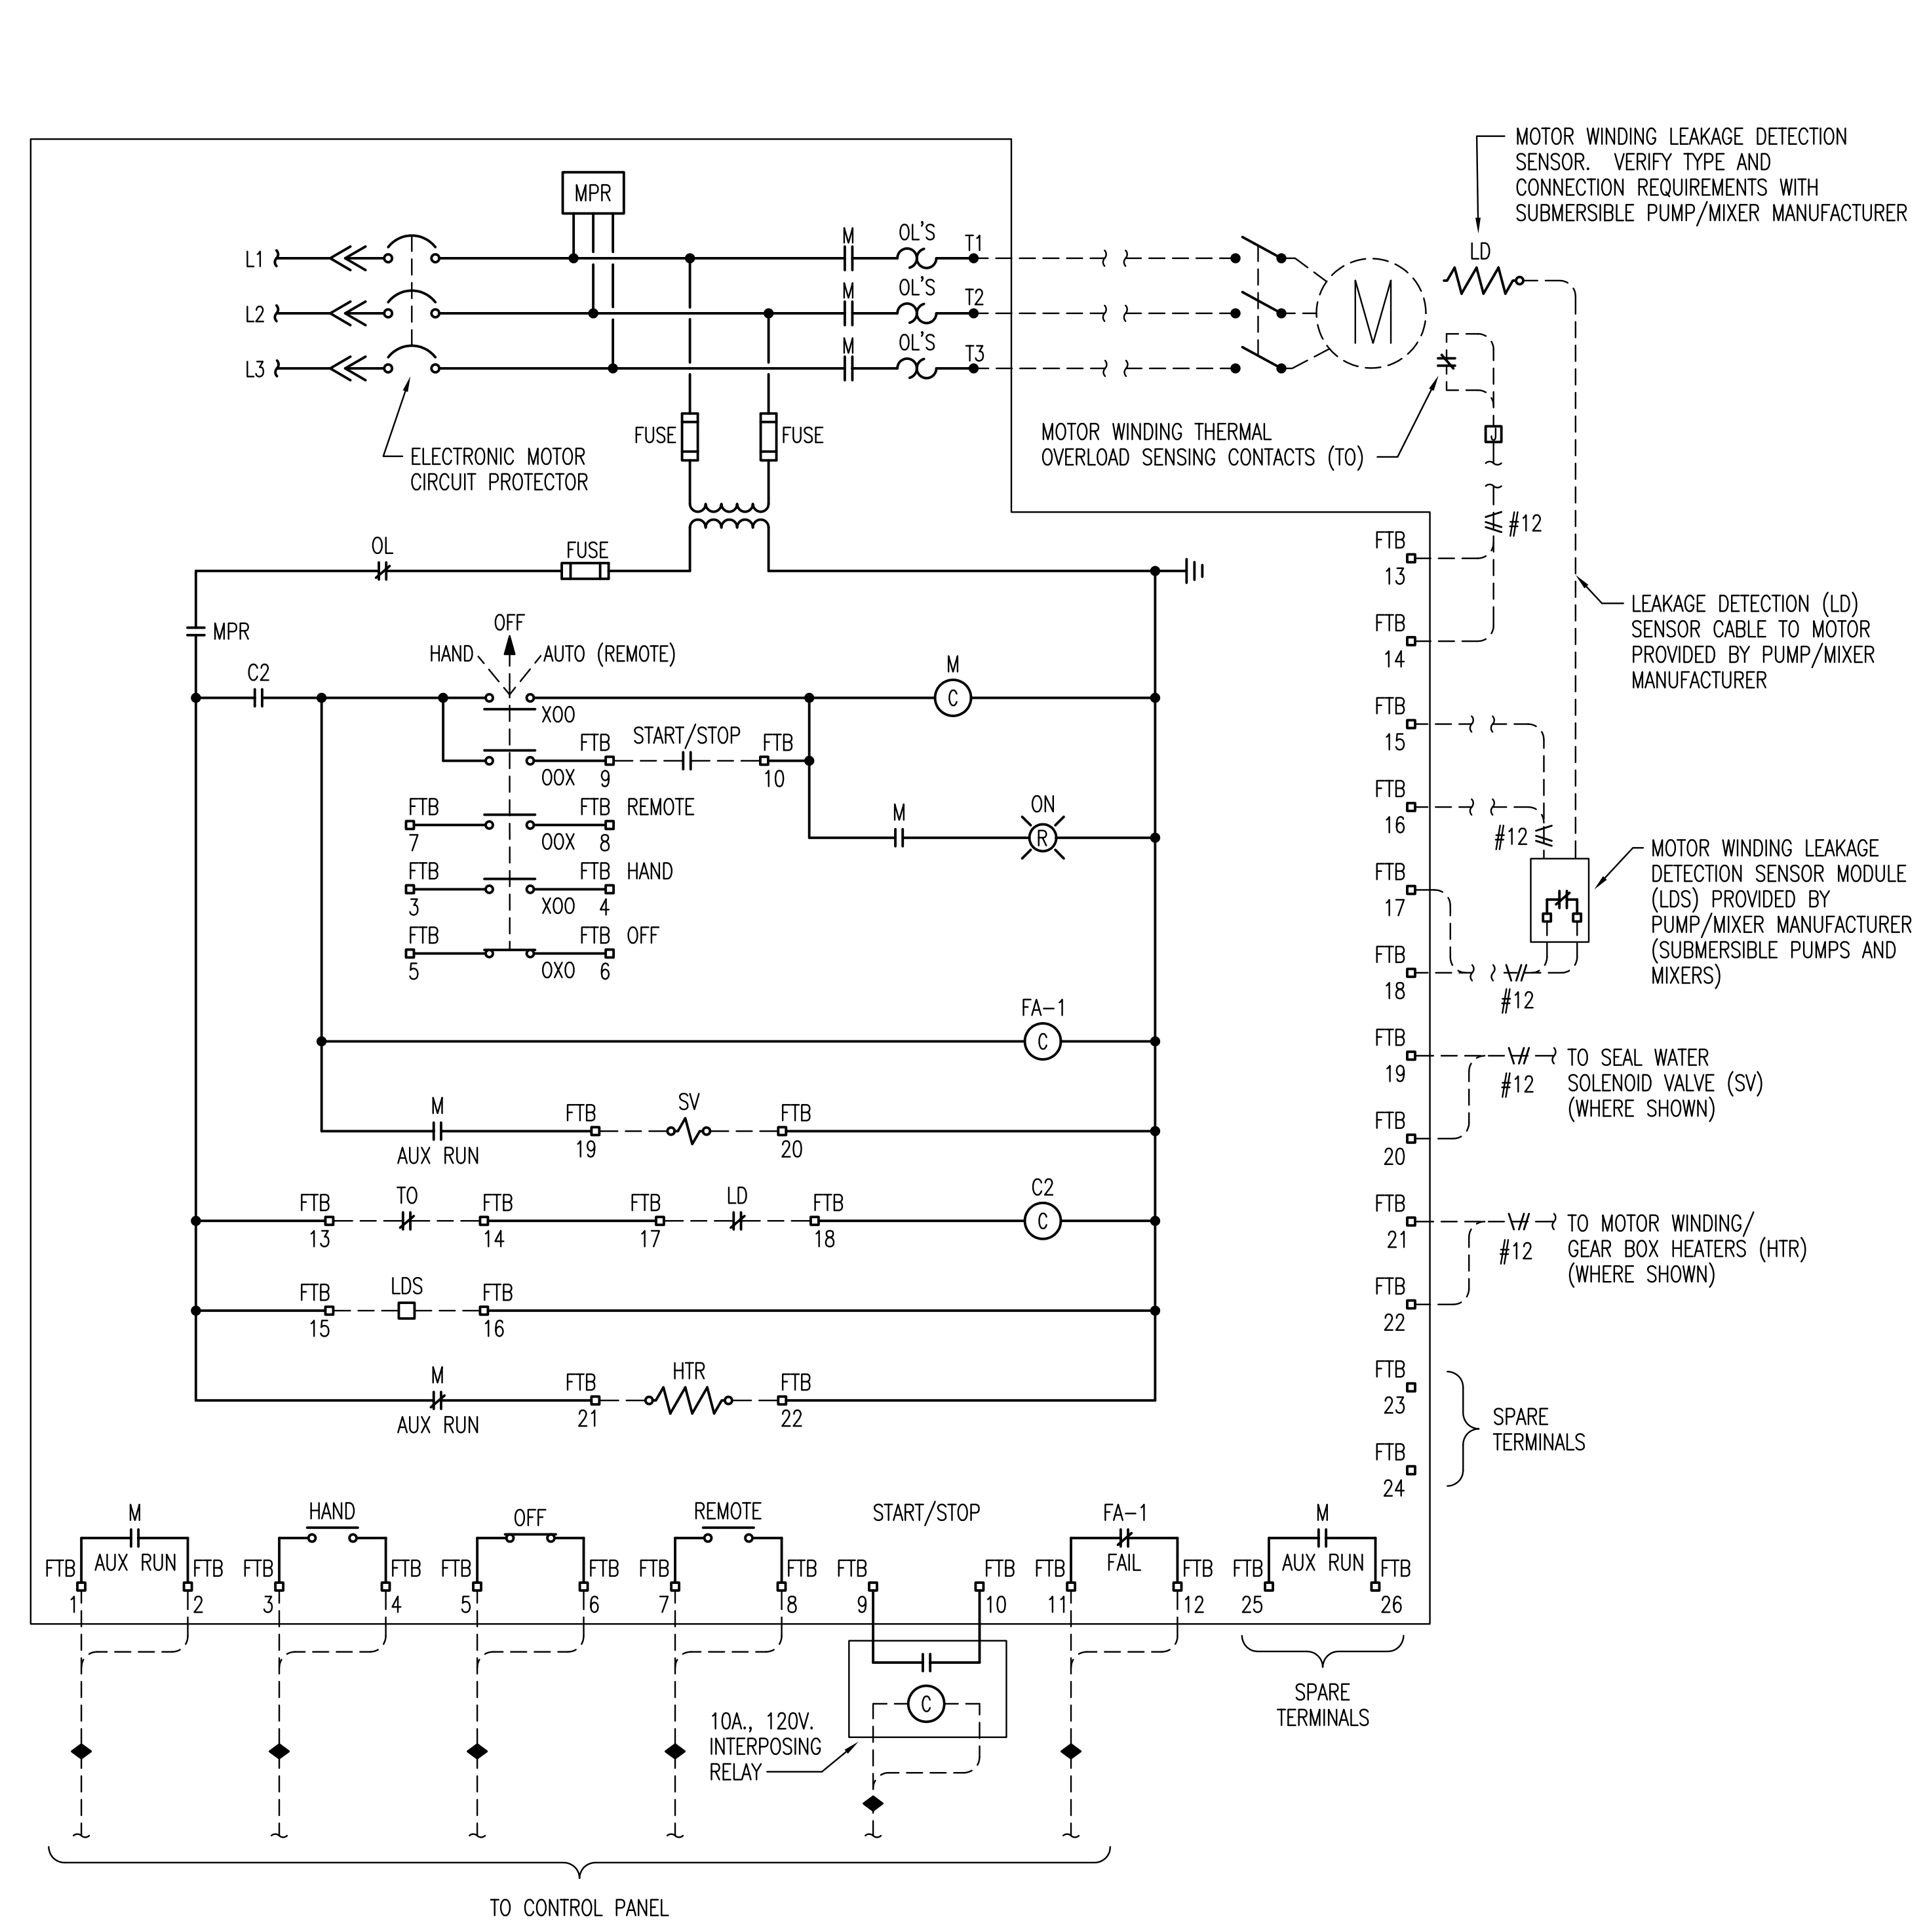

2 TYPICAL ACROSS-THE-LINE MOTOR STARTER WIRING DIAGRAM
NO SCALE

- NOTES:
1. WHEN STARTER IS LOCATED IN A MOTOR CONTROL CENTER, ALLOW AN ADDITIONAL 3" OF HEIGHT PER STARTER FOR THE RELAYS.
 2. ALL STARTERS SHOWN IN PROCESS EQUIPMENT CONNECTION SCHEDULES SHALL BE PROVIDED WITH THE RELAYS AND EQUIPMENT AS SHOWN IN THIS DIAGRAM.
 3. IF MECHANICAL EQUIPMENT IS CONTROLLED BY THE SCADA SYSTEM, ALL STARTERS SHOWN IN MECHANICAL EQUIPMENT CONNECTION SCHEDULES SHALL BE PROVIDED WITH THE RELAYS AND EQUIPMENT AS SHOWN IN THIS DIAGRAM.

Saved: 09-25-2009 10:27:48 AM by: NSM
 Plot Scale: 1:24 09-29-2009 4:30:45 PM
 \\net\local\is\local_data\Drawings\DWG\2004\04274\04274-004-24 - WEST - STARTER DIAGRAM.dwg by: CAE

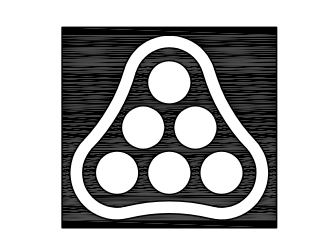

No.	Revision	By	Date
PHASE II - STORM WATER DRAIN #332 ELECTRICAL STARTER WIRING DIAGRAM WEST PUMP STATION JAMES L. ARMOUR, P.E. - CITY ENGINEER CITY OF WICHITA PROJECT NO. 468-84396 Professional Engineering Consultants, P.A. 303 S. TOPEKA • WICHITA, KANSAS 67202 316-262-2691 • FAX 316-262-3003			
Designed by	RDB	Job No.	35-04274-042
Drawn by	NSM	Date	SEPTEMBER 2009