

EXHAUST FAN SCHEDULE


MARK	LOC AT ROOM	TYPE	MIN. CAP		MAX. TIP SPEED (FPM)	DRIVE	MOTOR (BY M.C.)				REMARKS	CONTROLS	ELECT REF	
			CFM	SP			HP	RPM	SPEED	ELECT.				STARTER
EF-1	--	PROP	4700	.25	--	D	1/2	950	1	115/1	--	①	T-STAT	

① BASED ON LOREN COOK MODEL SPD SIZE 20, PACKAGED WALL FAN

UNIT HEATER SCHEDULE - ELECTRIC


MARK	LOC. AT ROOM	TYPE	FAN CFM	HEATING CAPACITY		MOTOR		SYSTEM ELECTRIC	REMARKS	ELECT. REF.
				KW	BTUH	HP	RPM			
EUH-1		HORIZ	700	7.5	25.6	1/50	1500	460/3		

① BASED ON MARKEL 5100 SERIES, W/ WALL T'STAT, DISCONNECT, WALL HANGING BRACKET

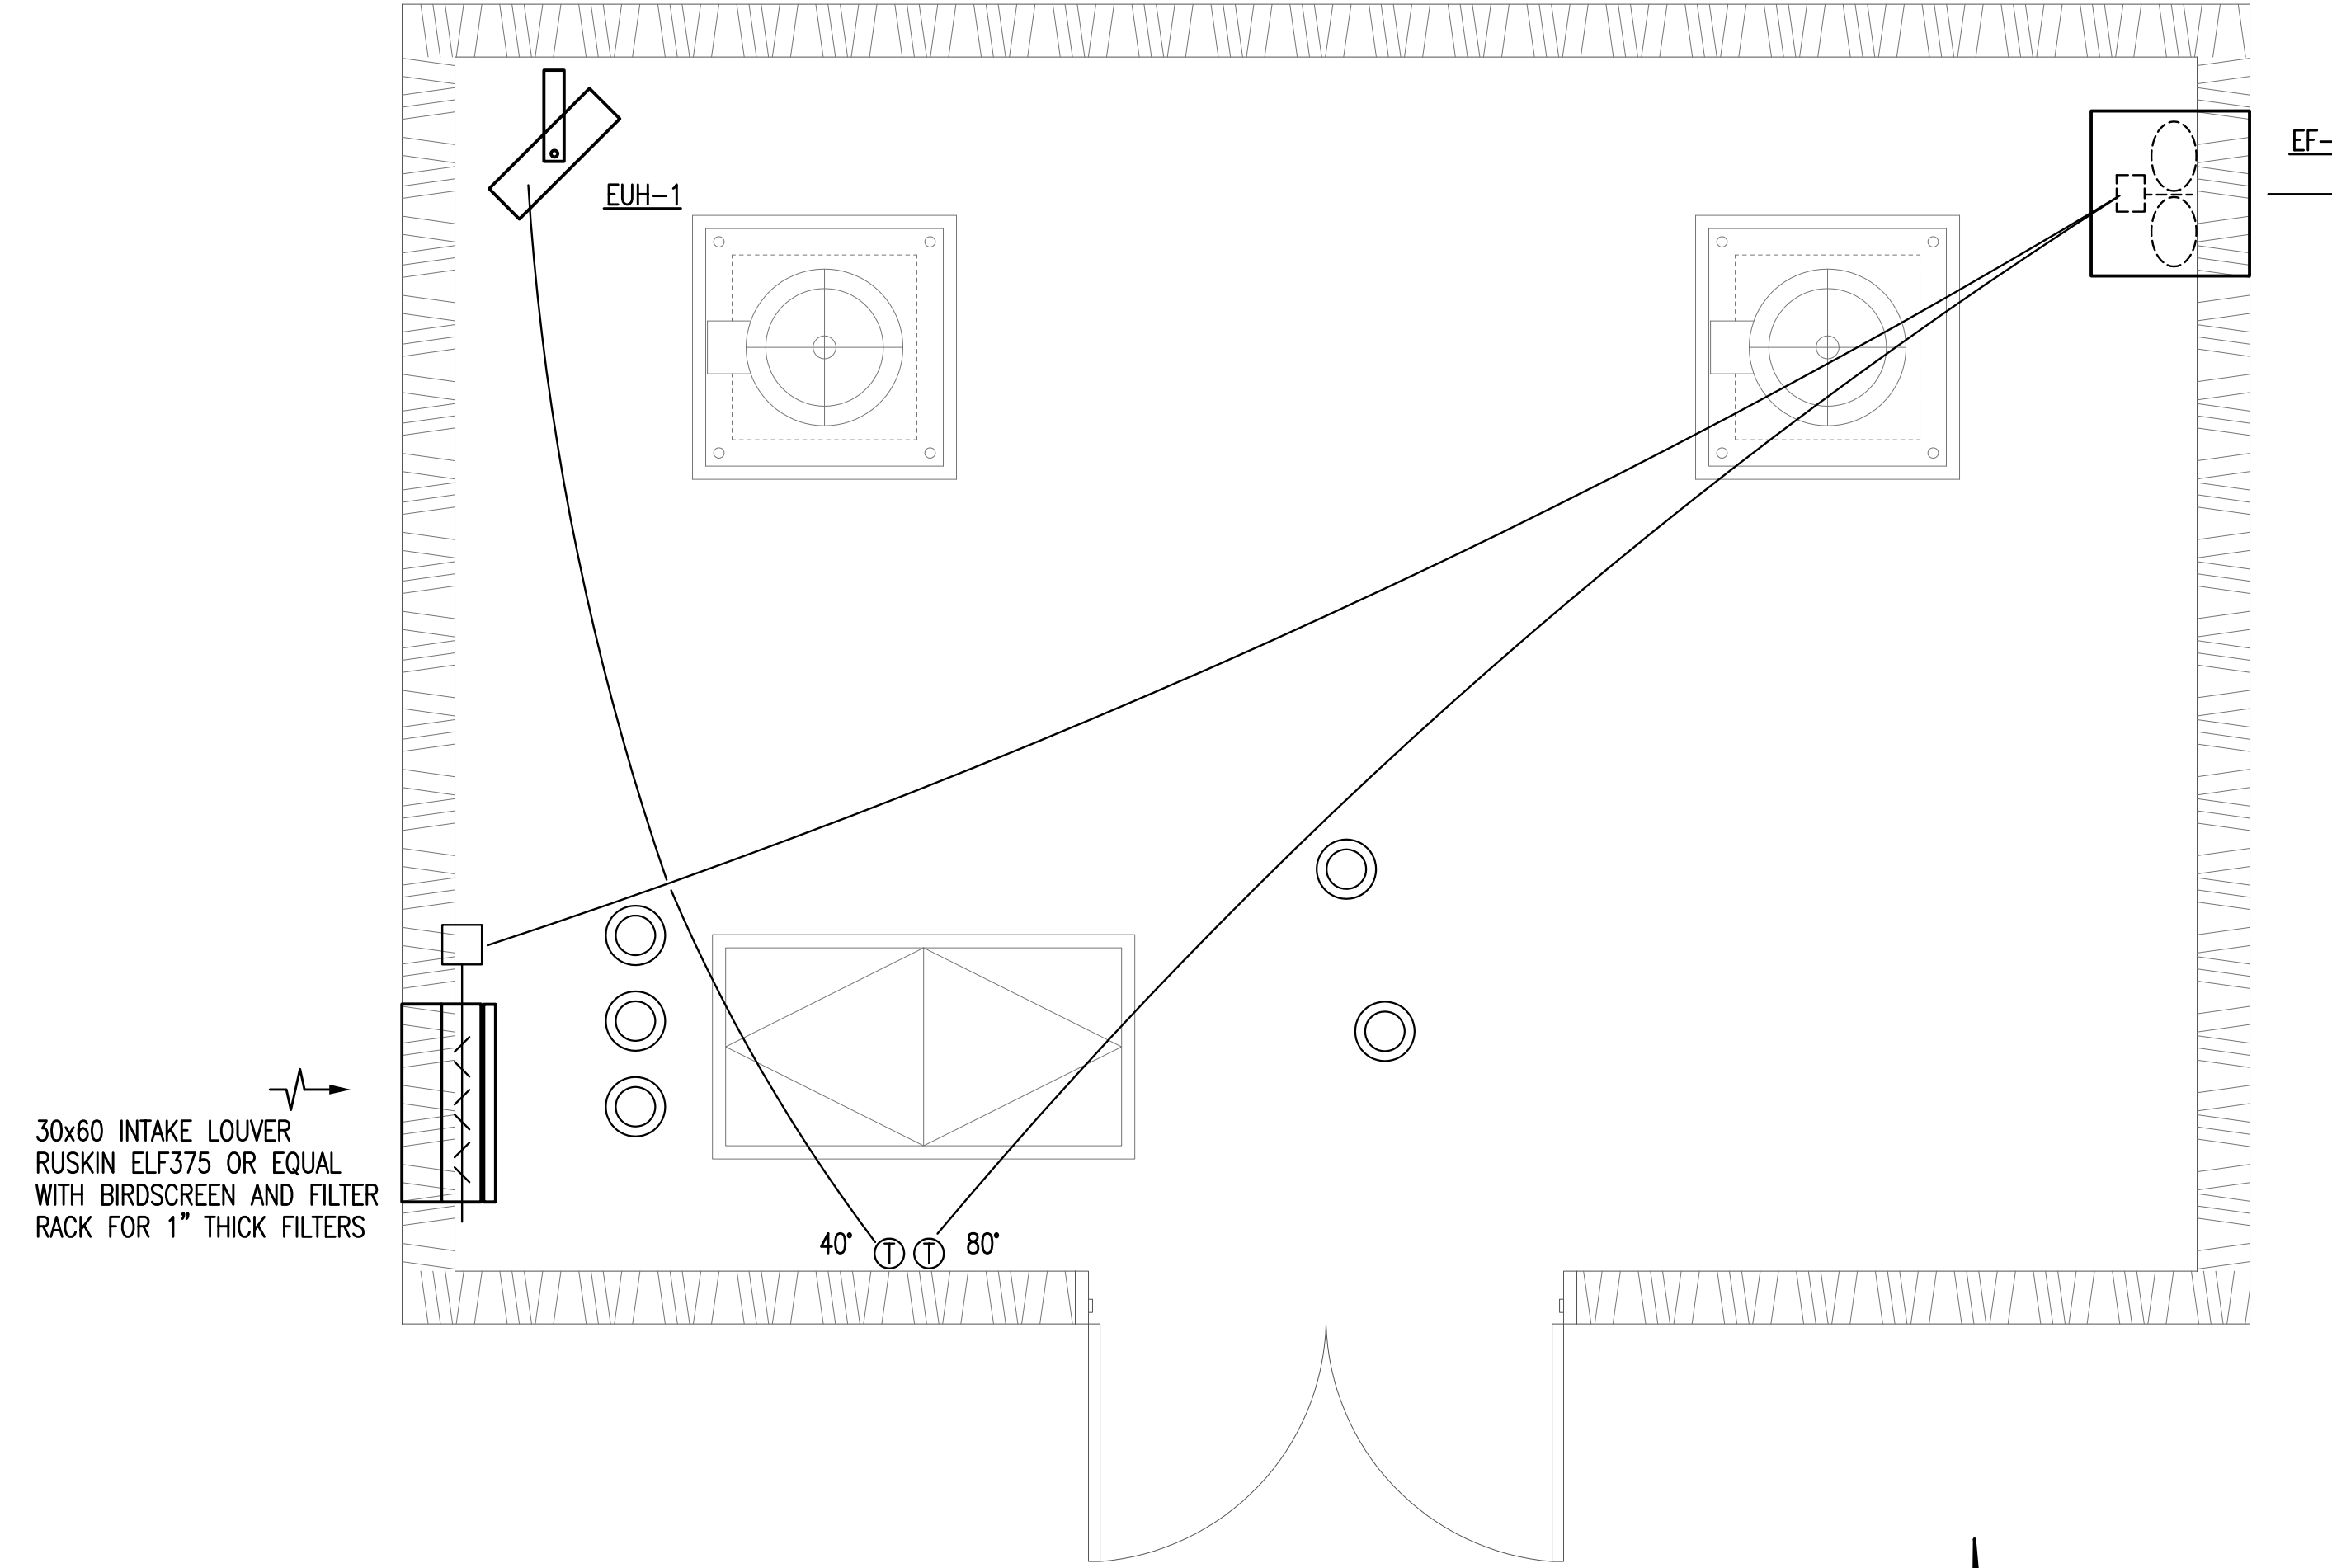


30x60 INTAKE LOUVER
RUSKIN ELF375 OR EQUAL
WITH BIRDSCREEN AND FILTER
RACK FOR 1" THICK FILTERS

A MECHANICAL MAIN LEVEL PLAN
1/2" = 1'-0"

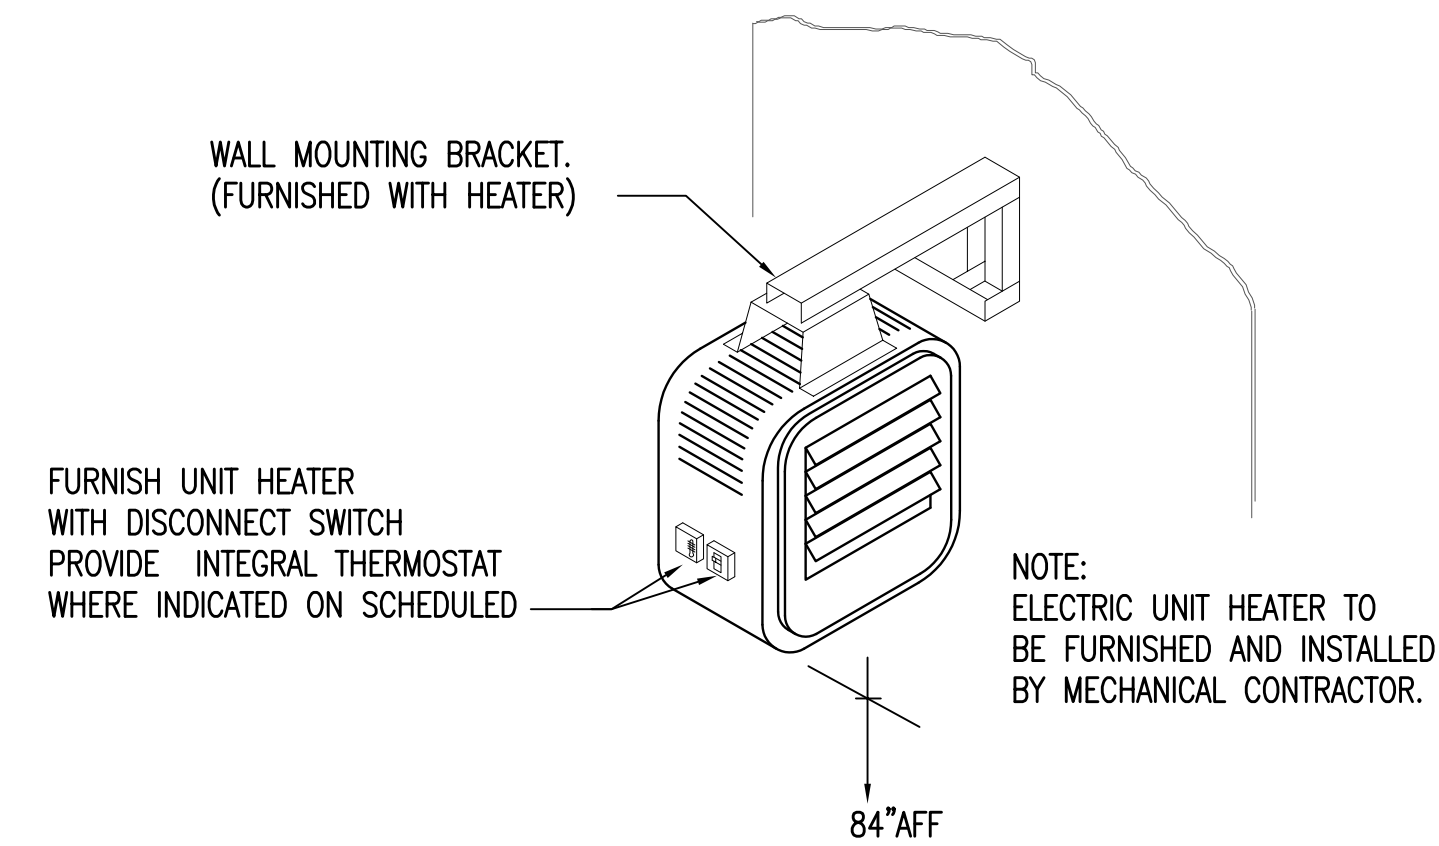

ELECTRIC UNIT HEATER
SCALE: NONE

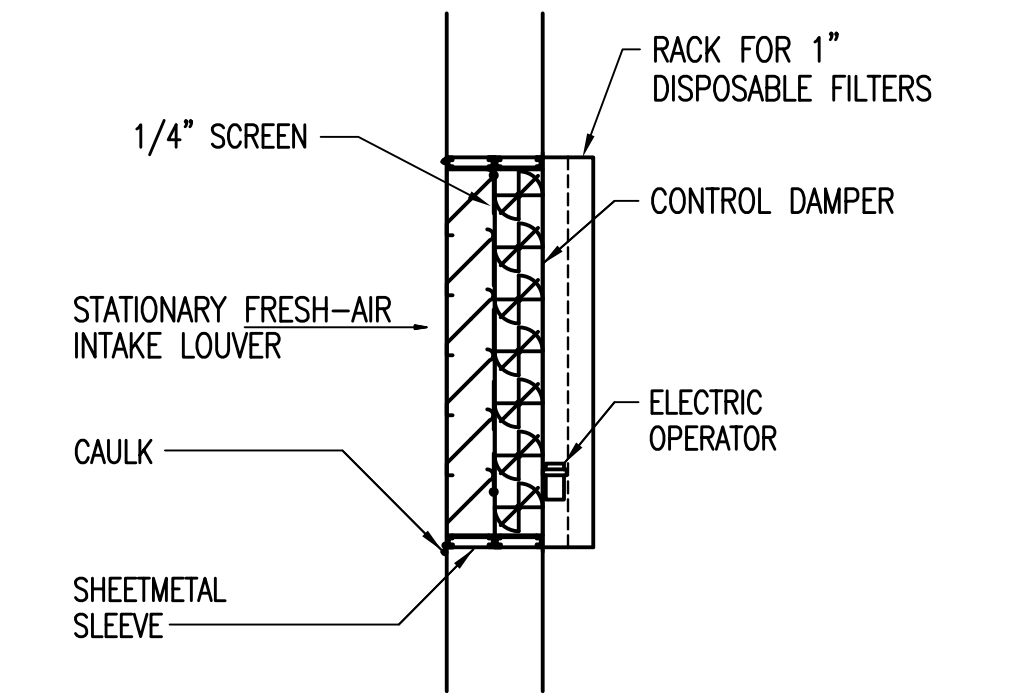

LOUVER DETAIL - INTAKE
SCALE: NONE

Saved: 07-09-2009 9:32:48 AM by SEB
Plot Scale: 1/24 09-29-2009 1:55:21 PM
\\vt_lcal_is\trac_data\Drawings\DWG\2004\0427A\004\0427A_M1-EAST by CAE

No.	Revision	By	Date
PHASE II - STORM WATER DRAIN #332 EAST PUMP STATION MECHANICAL PLAN AND DETAILS JAMES L. ARMOUR, P.E. - CITY ENGINEER CITY OF WICHITA PROJECT NO. 468-84396			
Professional Engineering Consultants, P.A. 303 S. TOPEKA • WICHITA, KANSAS 67202 316-262-2691 • FAX 316-262-3003			
Designed by	JBG	Job No.	35-04274-042
Drawn by	SEB	Date	SEPTEMBER 2009
			Sht. 53 of 63