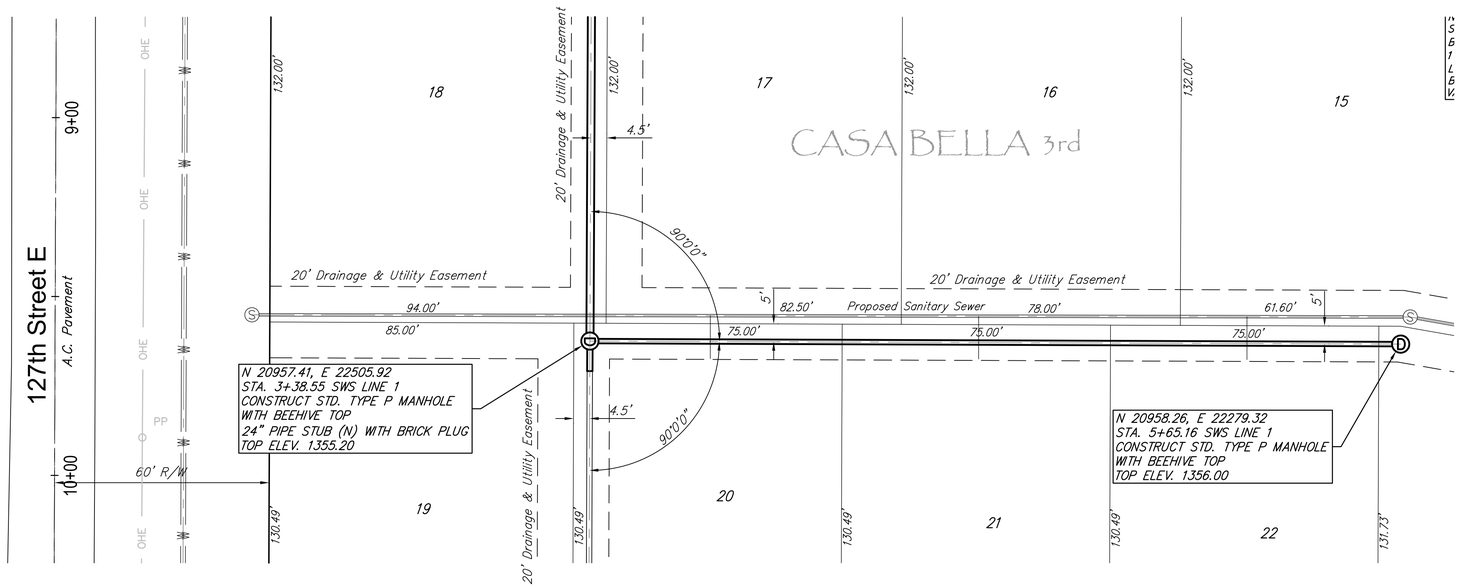





PIPE PLUG DETAIL

1. Mortar used in plug construction shall be in accordance with standard specifications.
2. All brick used in stack construction shall meet Grade ASTM C32 for MM and MS.
3. Pipe plugs shall be Subsidiary to the project.

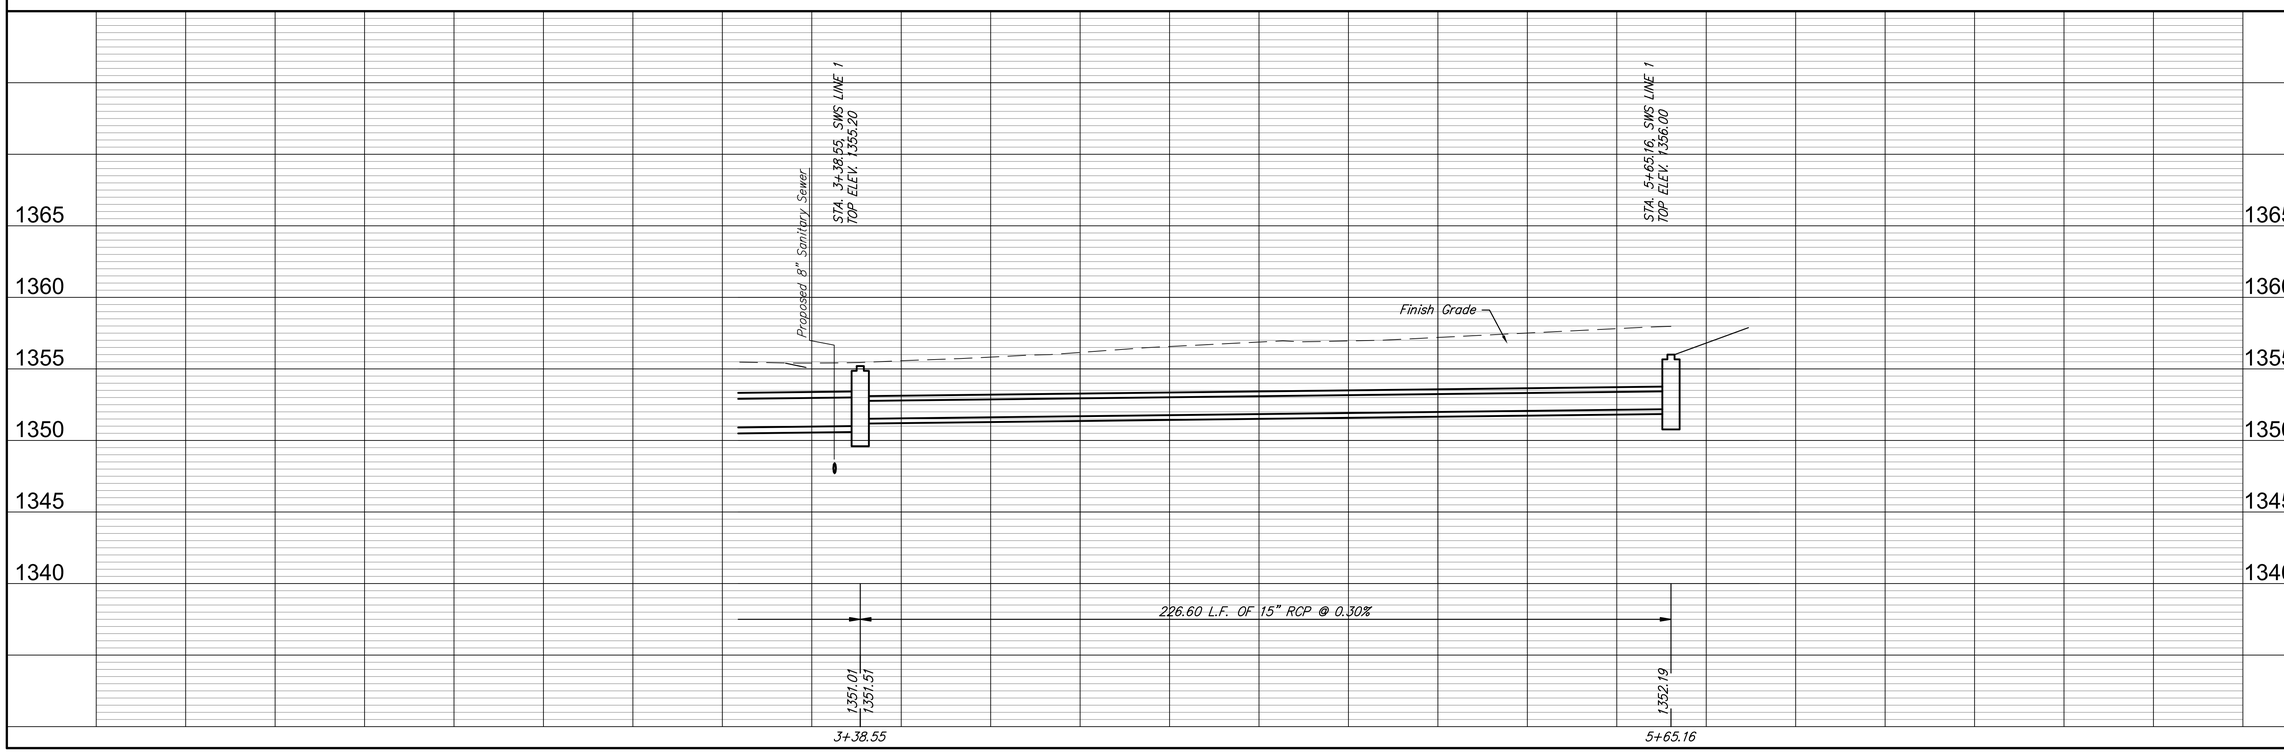

Ruggles & Bohm, P.A.
Engineering, Surveying, Land Planning
Water, Sewer, Streets, Drainage
934 North Rock Road
Wichita, Kansas 67203
www.ruglesbohm.com
(316) 264-4221
(316) 264-4222 fax
E-mail: info@ruglesbohm.com

DESIGN	KWL
DRAWN	RA
REVIEWED	
UTILITY	
DATE	
REVIEW	
PROJECT NUMBER	-
DRAWING FILE	Casa Bella 3 Eng Base (sws 2)

STORM WATER DRAINS
LINE 1
WICHITA, KANSAS

RB JOB 3743E

SHEET 7 OF 22