


- ① 1/2" Expansion Joint (EJ) along back of concrete sidewalk shall be "Sonolastic Expansion Joint Filler" (Color=Grey); Sonneborn, Chemrex Inc. or approved equal. Sealant shall be multi-part pourable urethane sealant: "Pourthane"; W.R. Meadows, Inc. or approved equal. All labor and materials for expansion joint shall be Subsidiary to 4" Concrete Sidewalk.
 - ② Backfill behind curb. Quantities for this work are included in the Earthwork Summary Table.
 - ④ Slope Varies. See Intersection Details for Spot Elevations.
- * Contractor to provide Milling as required to provide a 2" AC Overlay that meets proposed finished surface elevations. Milling thickness may vary from 0" to 4".

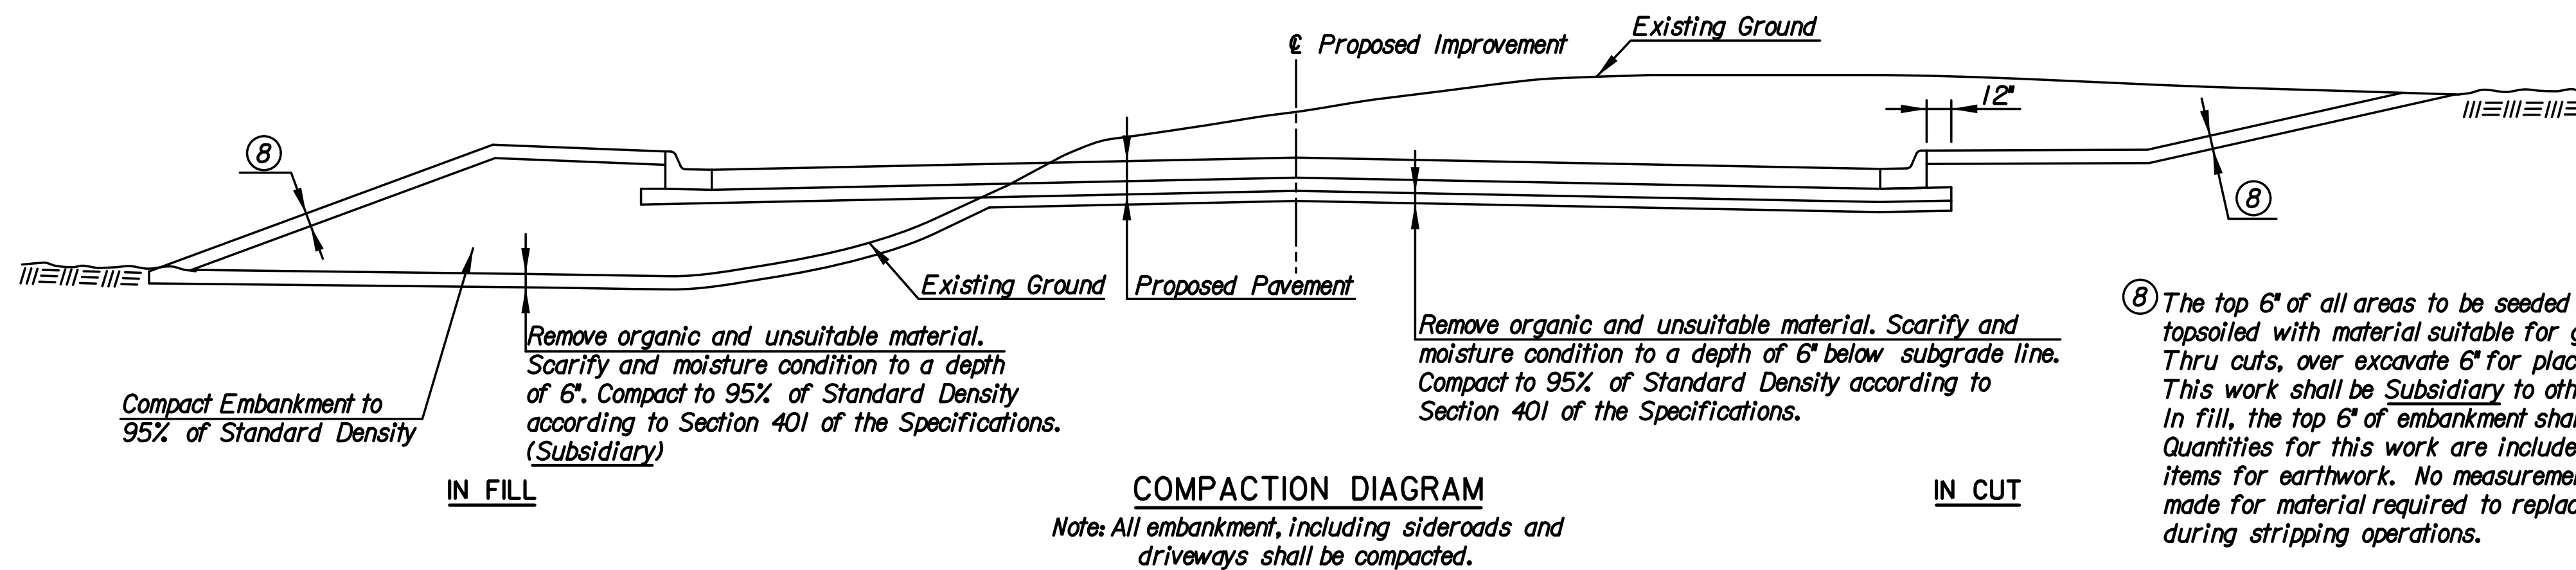

COMPACTION DIAGRAM
 Note: All embankment, including sideroads and driveways shall be compacted.

CRUSHED ROCK GRADATION REQUIREMENTS

PERCENT OF AGGREGATE RETAINED

2-1/2"	0
3/4"	20-60
#4	50-80
#40	80-94
#200	90-98

Rock quality shall conform to the requirements specified by the KDOT 2007 Edition Standard Specification Subsection 1102 for Durability Class I.

Plotted By: svb Date: 7/13/2011 2:03:56 PM
 FILE: I:\2010\10310\TypSec\10310-TypSec_3.dgn

No.	Revision	By	Date
ST. FRANCIS STREET			
TYPICAL SECTIONS			
JAMES L. ARMOUR, P.E.-CITY ENGINEER CITY OF WICHITA PROJECT NO. 472-84920			
Professional Engineering Consultants, P.A. 303 S. TOPEKA - WICHITA, KANSAS 67202 316-262-2691 • FAX 316-262-3003			
Designed by	JPS	Job No.	10310
Drawn by	SVB	Date	July, 2011
			Std. R4 of 101