

FIRE HYDRANT #9109  
ST. STA. 88+59.96, 44' RT.  
REMOVE VALVE, HYDRANT &  
BRANCH FROM EXIST. ANCH. TEE  
CONNECT 1-MJ 90° ANCH. BEND  
(LOOKING EAST)  
1-6" ANCH. VALVE ASSY.  
1-MJ ANCH. COUPLING (E)  
1-FIRE HYDRANT  
L=4.0'

FIRE HYDRANT #8704  
ST. STA. 92+02.56, 44' RT.  
REMOVE EXIST. FIRE HYDRANT  
CUT & REMOVE 6" HYDRANT  
BRANCH AS NEEDED  
L=4.0'

FIRE HYDRANT #8605  
ST. STA. 96+05.73, 44' RT.  
REMOVE EXIST. FIRE HYDRANT  
CUT & REMOVE 6" HYDRANT  
BRANCH AS NEEDED  
L=4.0'

Note:  
Contractor to verify location and  
elevation of exist. 8" water lines  
prior to construction.

**PLAN FIRE HYDRANT 9109**


**PLAN FIRE HYDRANT 8704**

**PLAN FIRE HYDRANT 8605**

**PROFILE FIRE HYDRANT 9109**

**PROFILE FIRE HYDRANT 8704**

**PROFILE FIRE HYDRANT 8605**

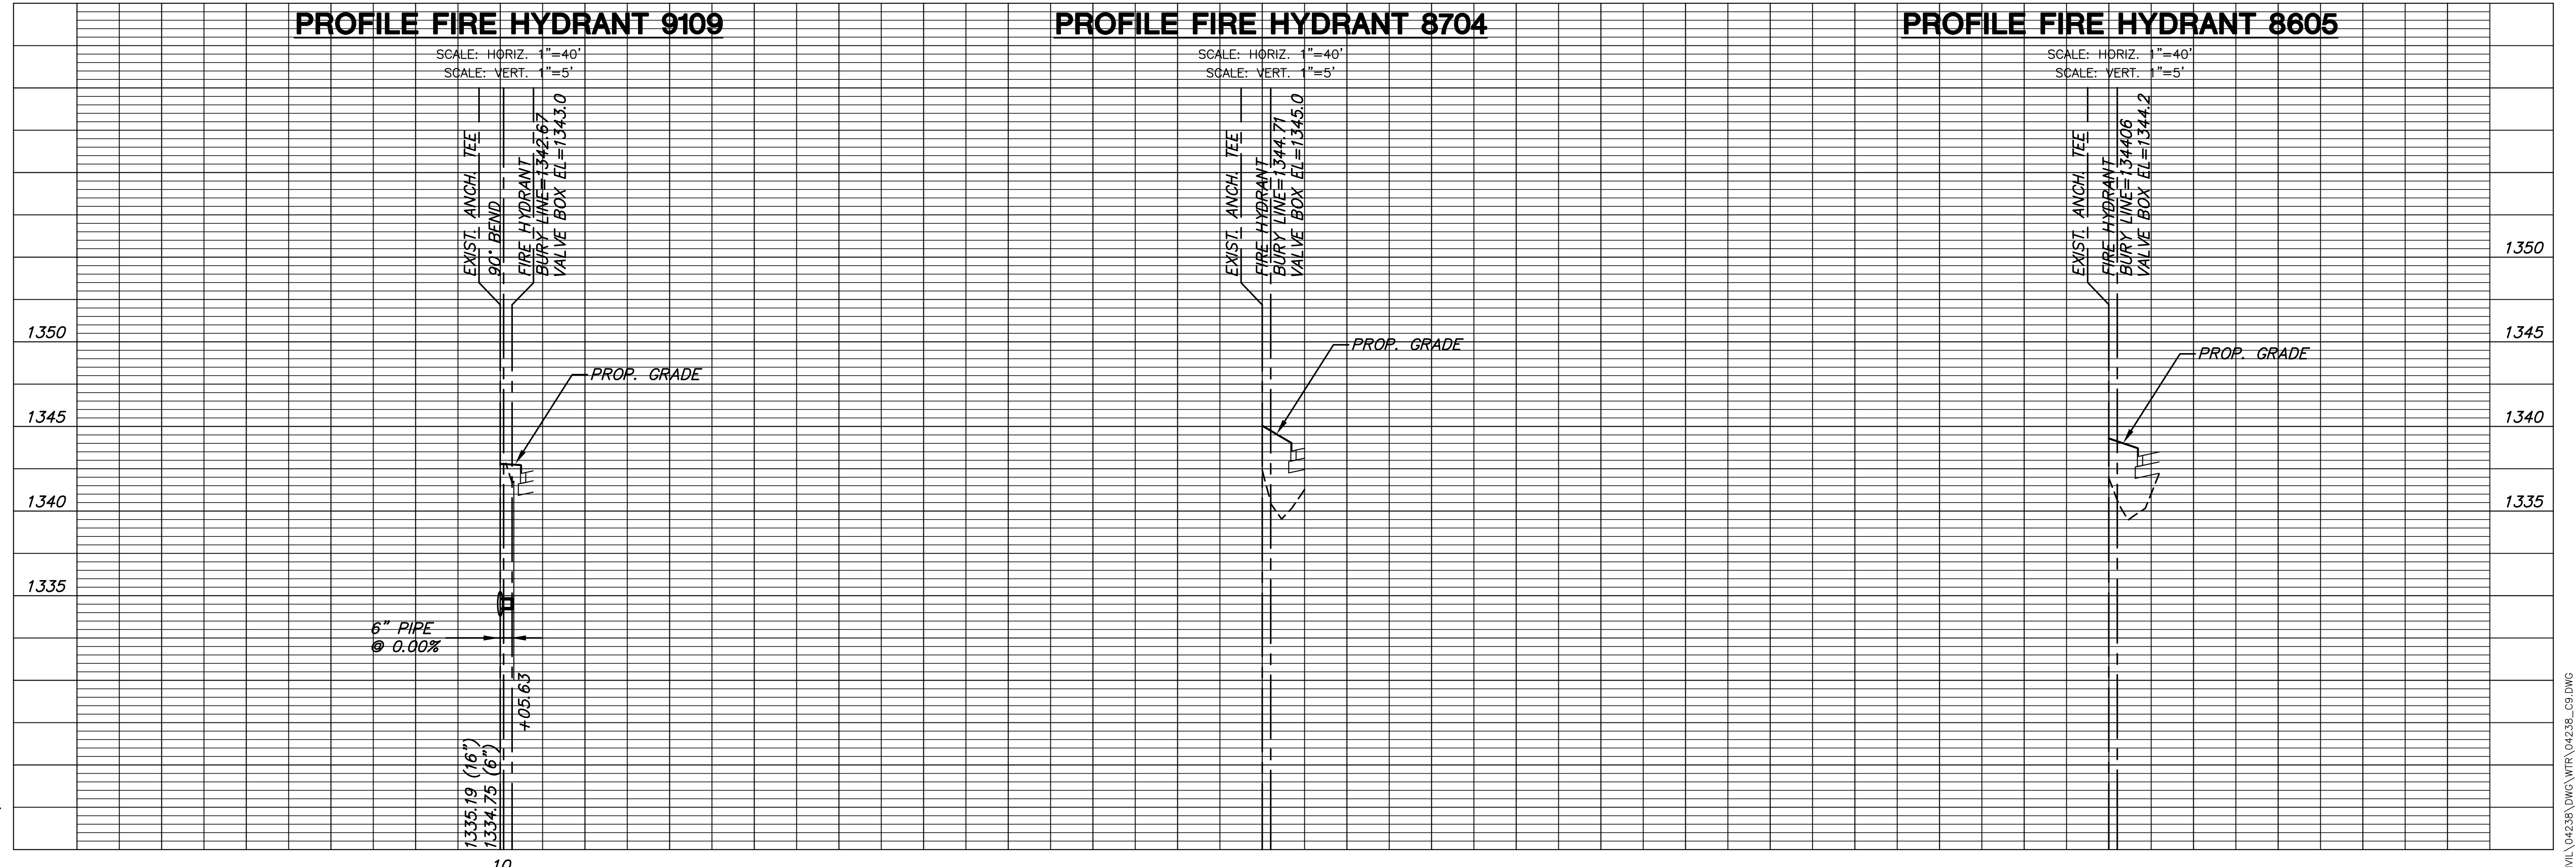

PLOTTED: Wednesday, November 14, 2012 @ 01:55PM

J:\CIVIL\04238\WG\WTR\04238\_C9.DWG

WATER MAIN PLANS  
**CENTRAL AVENUE**  
WEST OF 135th TO 119th ST. WEST

**FIRE HYDRANTS**

SHEET TITLE	448-
PROJECT NUMBER	

JRA / KKL / DFL
DESIGNED / DRAWN / CHECKED

ISSUED	September 2012
REVISED	