



STA. 10+00.00, LINE 1=  
 STA. 10+00.00, LINE 2=  
 ST. STA. 10+57.05, 26.0' LT.  
 REMOVE EXIST. 8" CAP AND  
 INSTALL 1-8" DIMJ TEE  
 2-8" VALVE ASSEMBLIES (N&W)  
 (MJ GATE VALVES)  
 VALVE BOX ELEV.=1342.77

NOTE:  
 CONTRACTOR TO VERIFY  
 LOCATION AND ELEVATION OF  
 EXIST. 8" WATER LINE AND  
 ALL OTHER UTILITIES PRIOR  
 TO CONSTRUCTION.

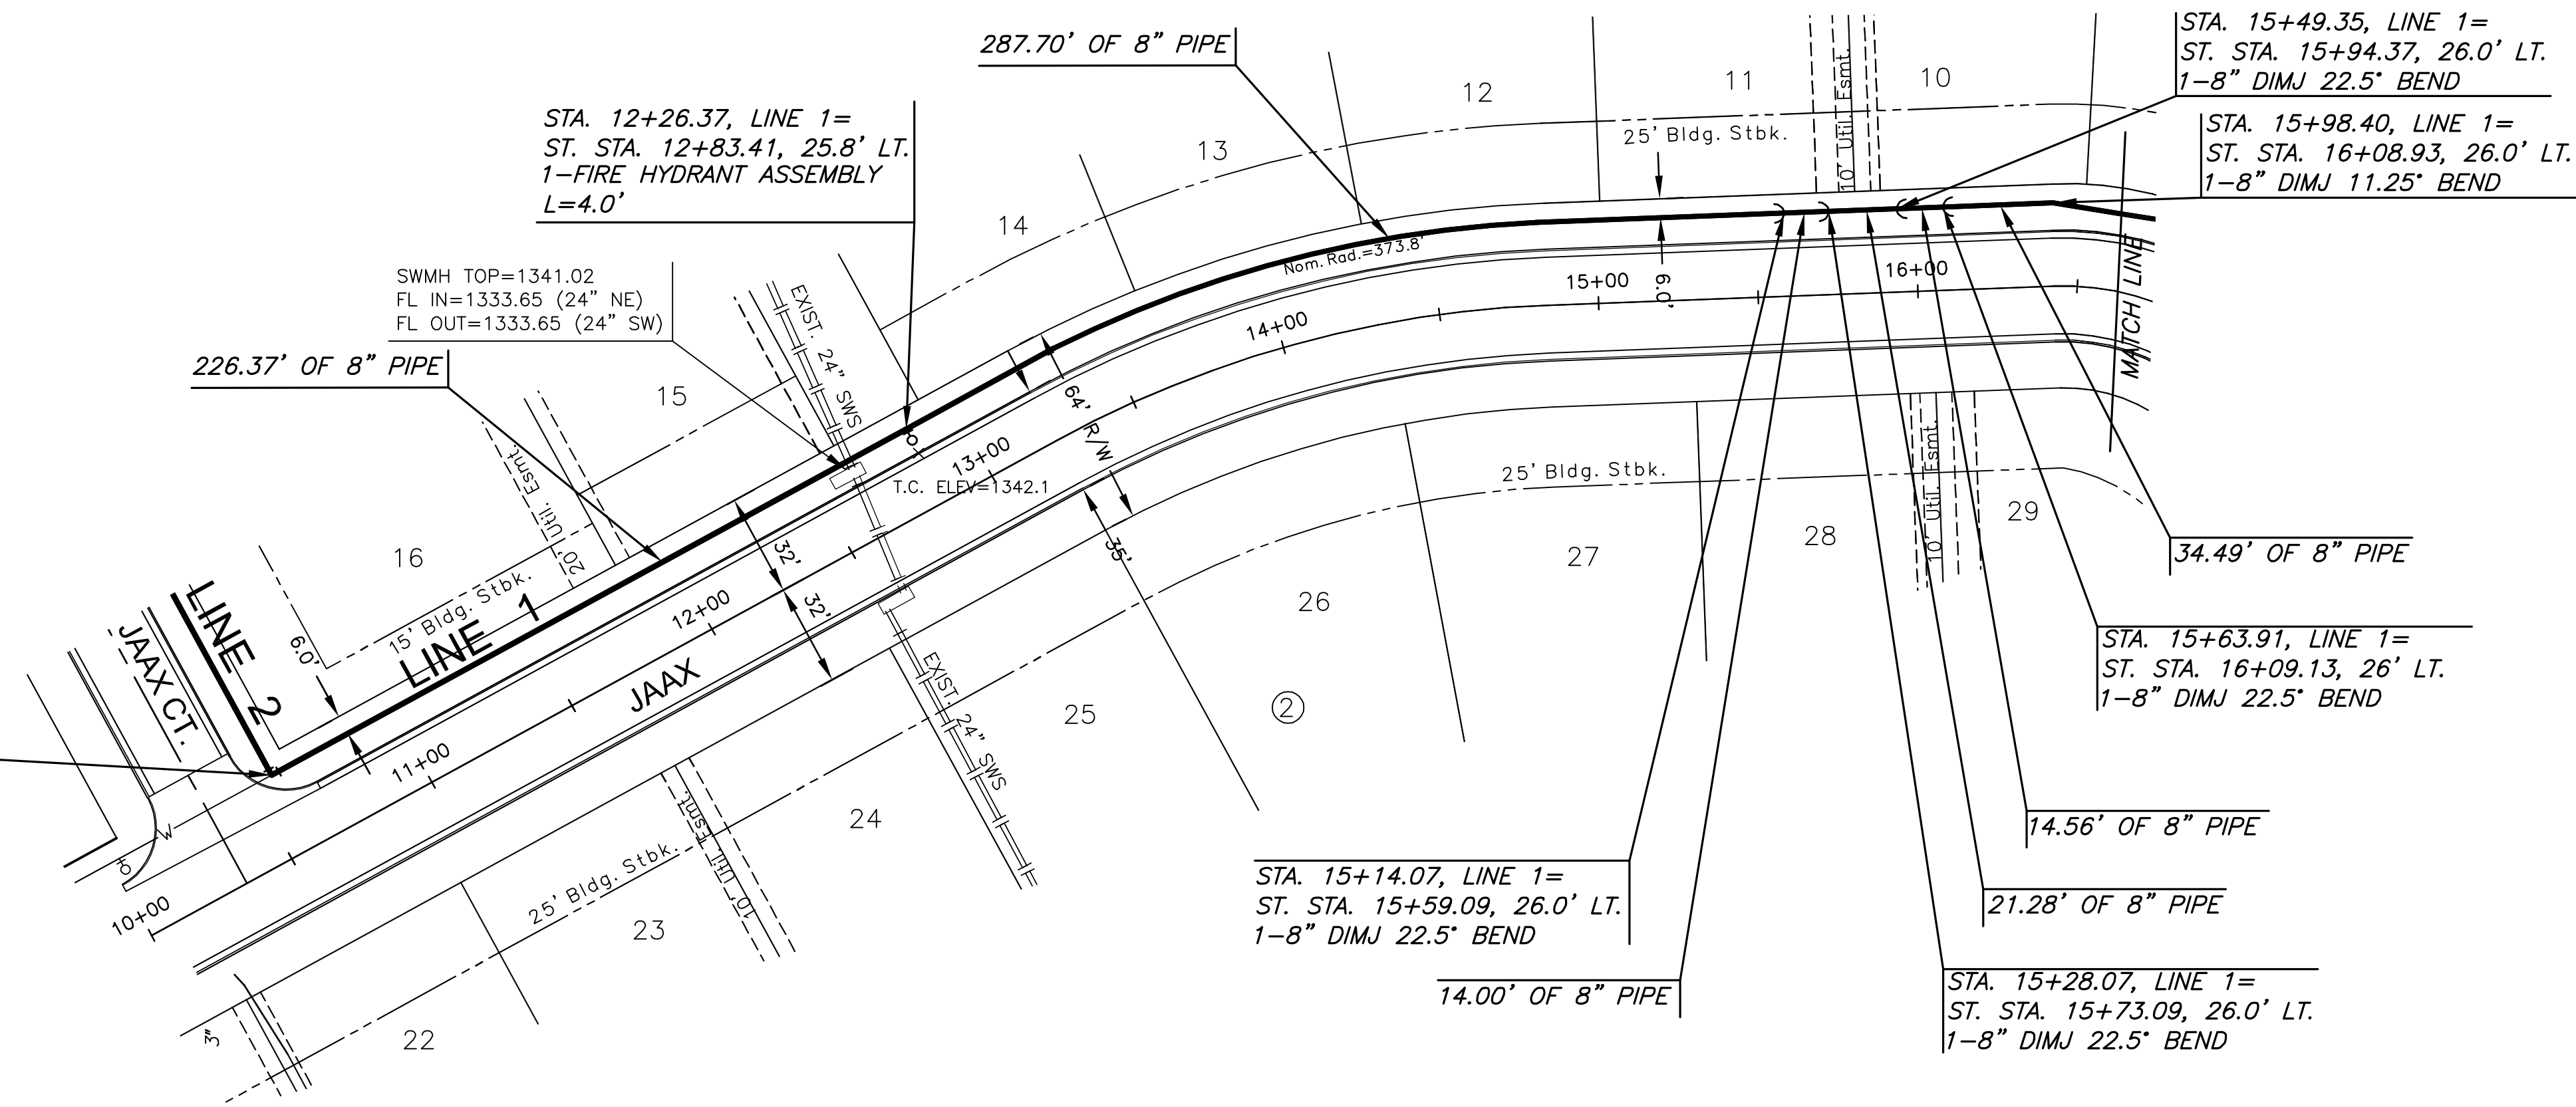

PLAN LINE 1  
 PROFILE LINE 1

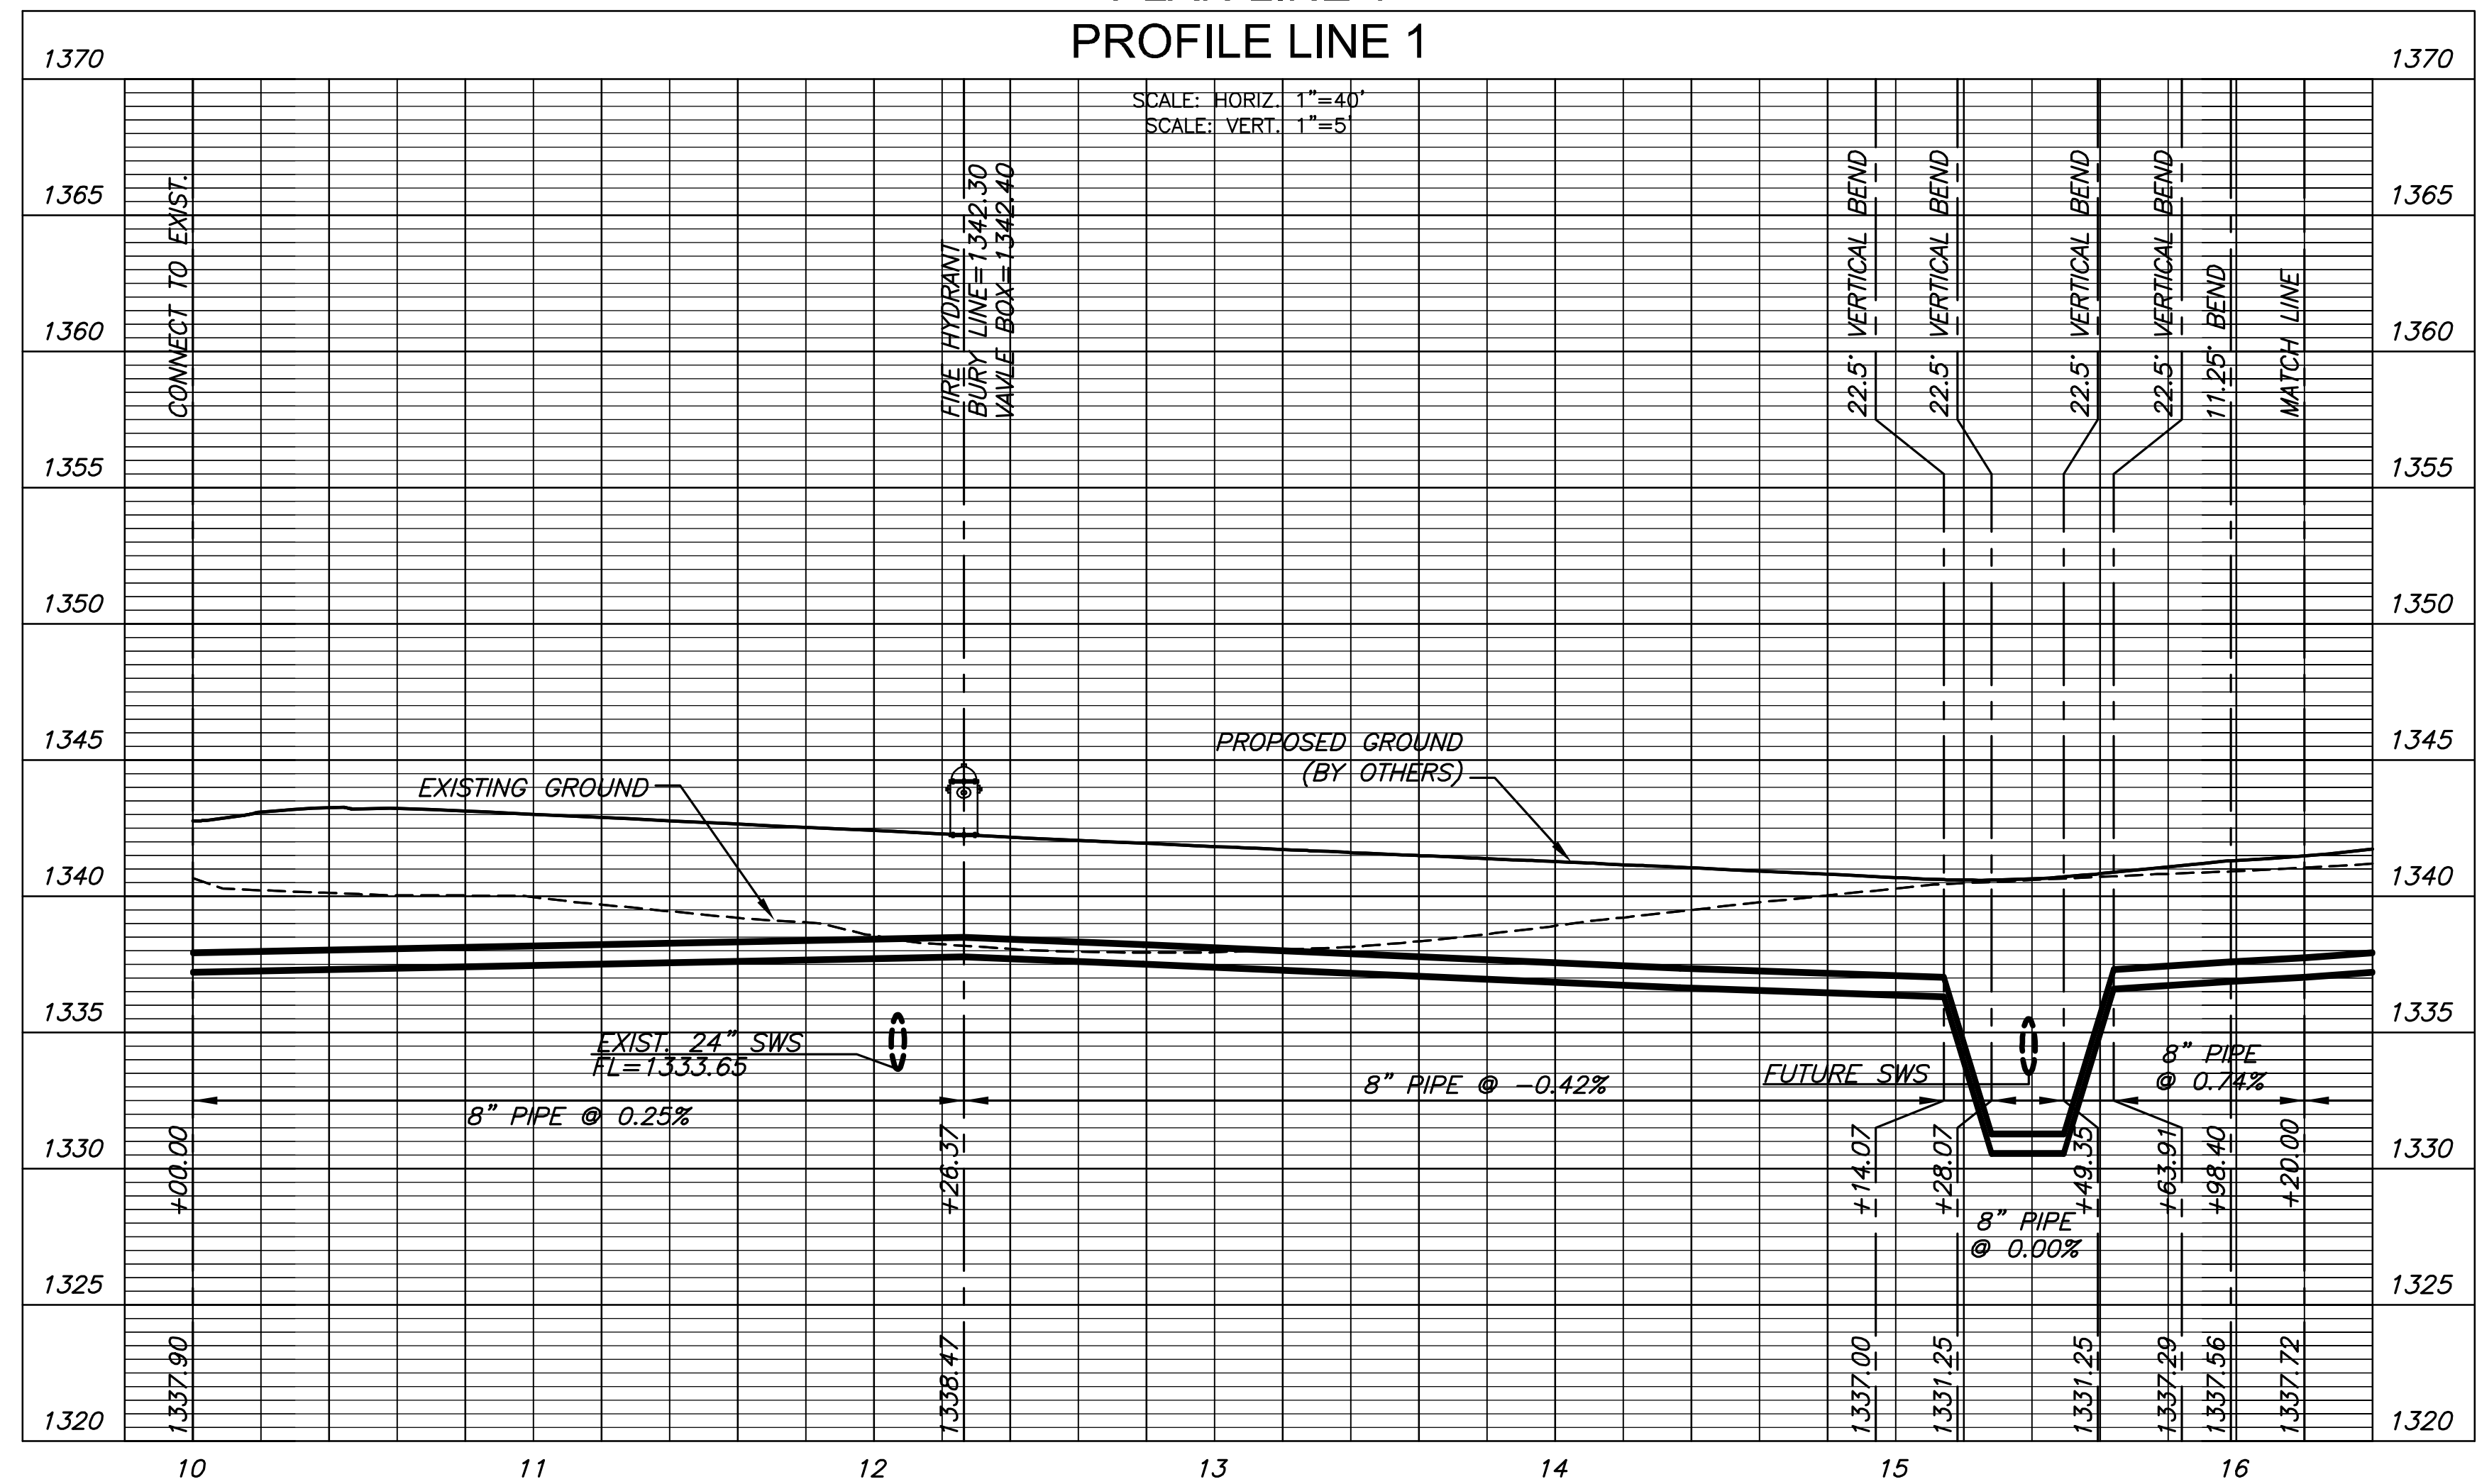

WATER DISTRIBUTION PLANS FOR  
**BAY COUNTRY ADDITION**  
 PHASE 1

©2013 MKEC Engineering All Rights Reserved  
 www.mkec.com  
 These drawings and their contents, including, but not limited to, all concepts, designs, & ideas are the exclusive property of MKEC Engineering (MKEC), and may not be used or reproduced in any way without the express consent of MKEC.

LINE 1 PLAN & PROFILE

PROJECT NO.	448-90598	
DATE	AUGUST 2013	
SCALE	1"=40'	
DESIGNED	DRAWN	CHECKED
SLF	SLF	SPE

#	REVISION	DATE

SHEET NO.