




© 2015 CDM SMITH ALL RIGHTS RESERVED. REUSE OF DOCUMENTS, THESE DOCUMENTS AND DESIGNS PROVIDED BY PROFESSIONAL SERVICE, INCORPORATED HEREIN, ARE THE PROPERTY OF CDM SMITH AND ARE NOT TO BE USED, IN WHOLE OR PART, FOR ANY OTHER PROJECT WITHOUT THE WRITTEN AUTHORIZATION OF CDM SMITH.


PIPE LINE SYMBOLS

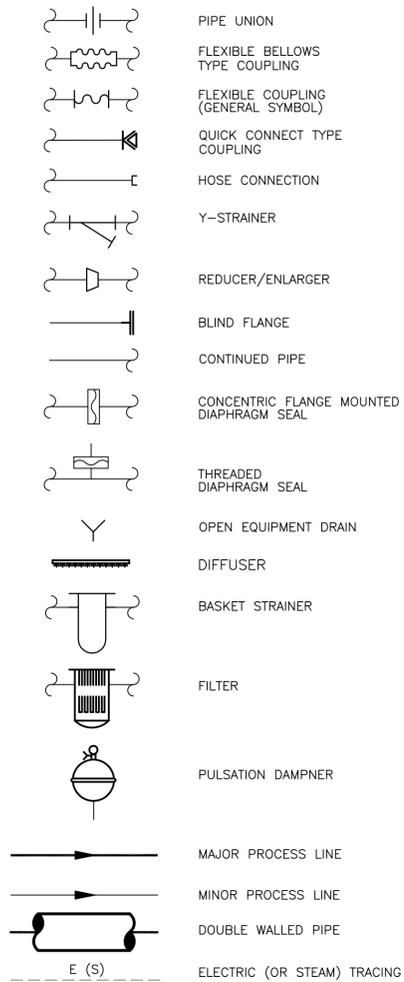






GATE SYMBOLS

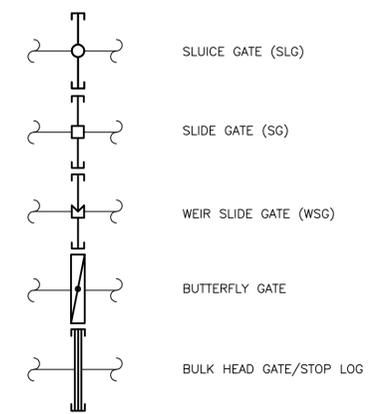


VALVE SYMBOLS

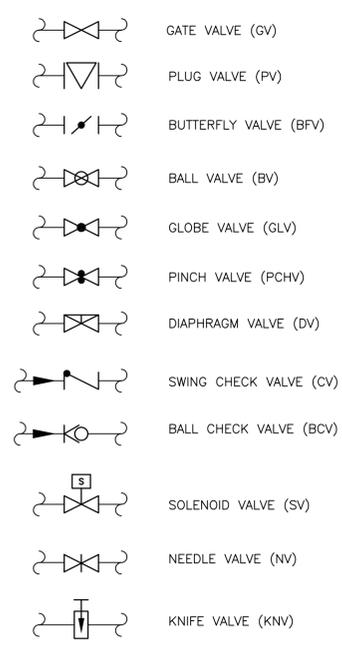


VALVE ACTUATORS

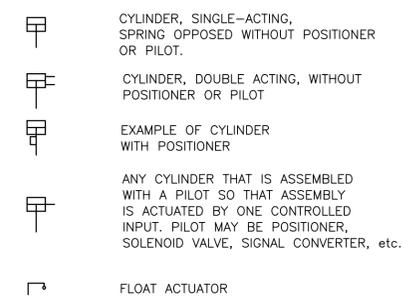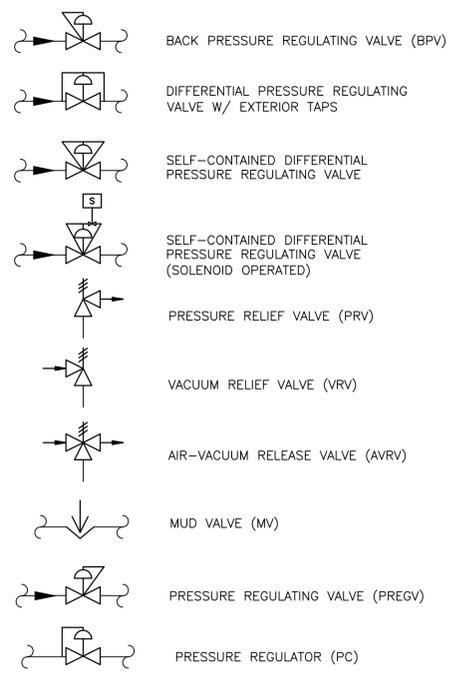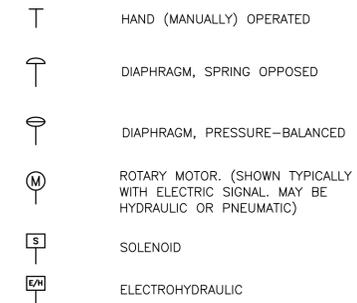

TYPICAL EQUIPMENT TAG NUMBERS & DESIGNATION


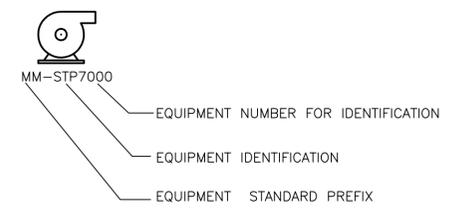


PROCESS EQUIPMENT

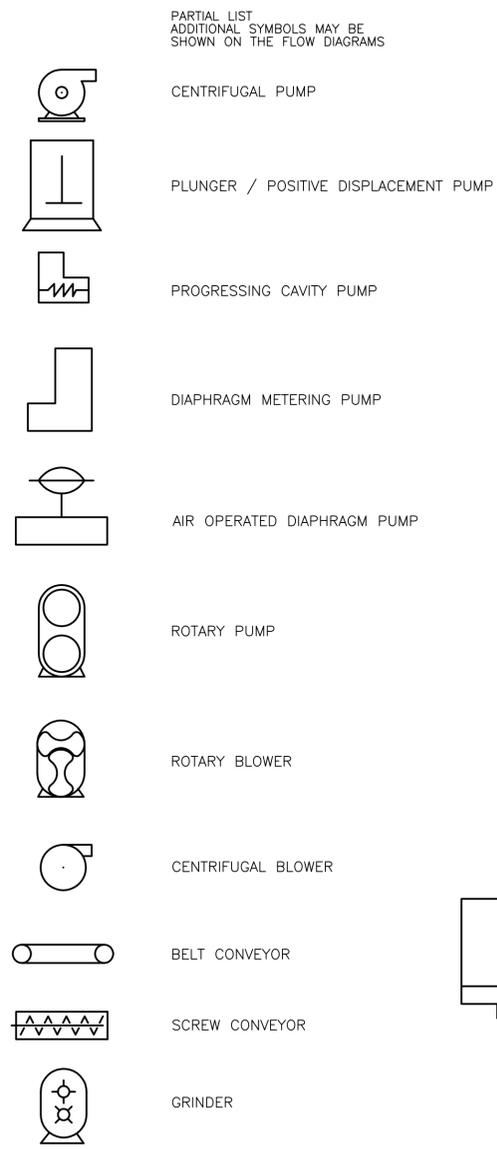

GENERAL NOTES

1. REFER TO SHEET I-1 FOR ADDITIONAL NOTES

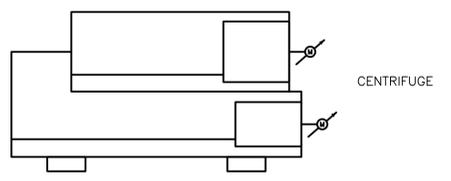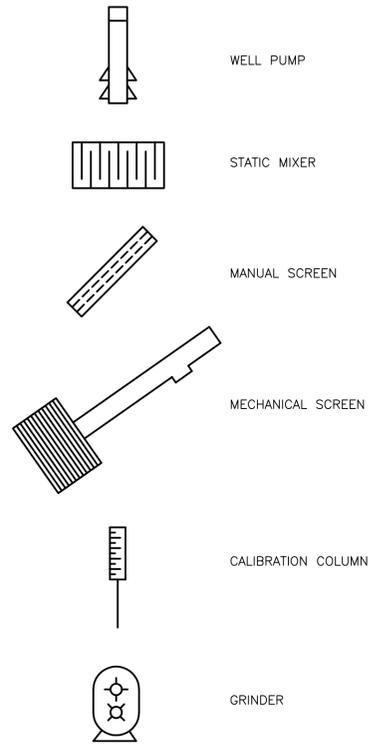


REV. NO.	DATE	DRWN	CHKD	REMARKS

DESIGNED BY: <u>K. ROOD</u>	<p>9200 Ward Parkway, Suite 500 Kansas City, MO 64114 Tel: (816) 444-8270 MO COA No. 001431</p>
DRAWN BY: <u>K. REESE</u>	
SHEET CHK'D BY: _____	
CROSS CHK'D BY: _____	
APPROVED BY: _____	
DATE: <u>APRIL 2015</u>	

CITY OF WICHITA, KANSAS
WATER AND SEWER DEPARTMENT
**SEWAGE TREATMENT PLANT NO.2 IMPROVMENTS
UV DISINFECTION**

**INSTRUMENTATION NOTES, LEGENDS, AND
ABBREVIATIONS II**



PROJECT NO. 2395-104609
FILE NAME: 1002SYMB.DWG
SHEET NO. I-2