



Scale For Microfitting
Millimeters

Inches

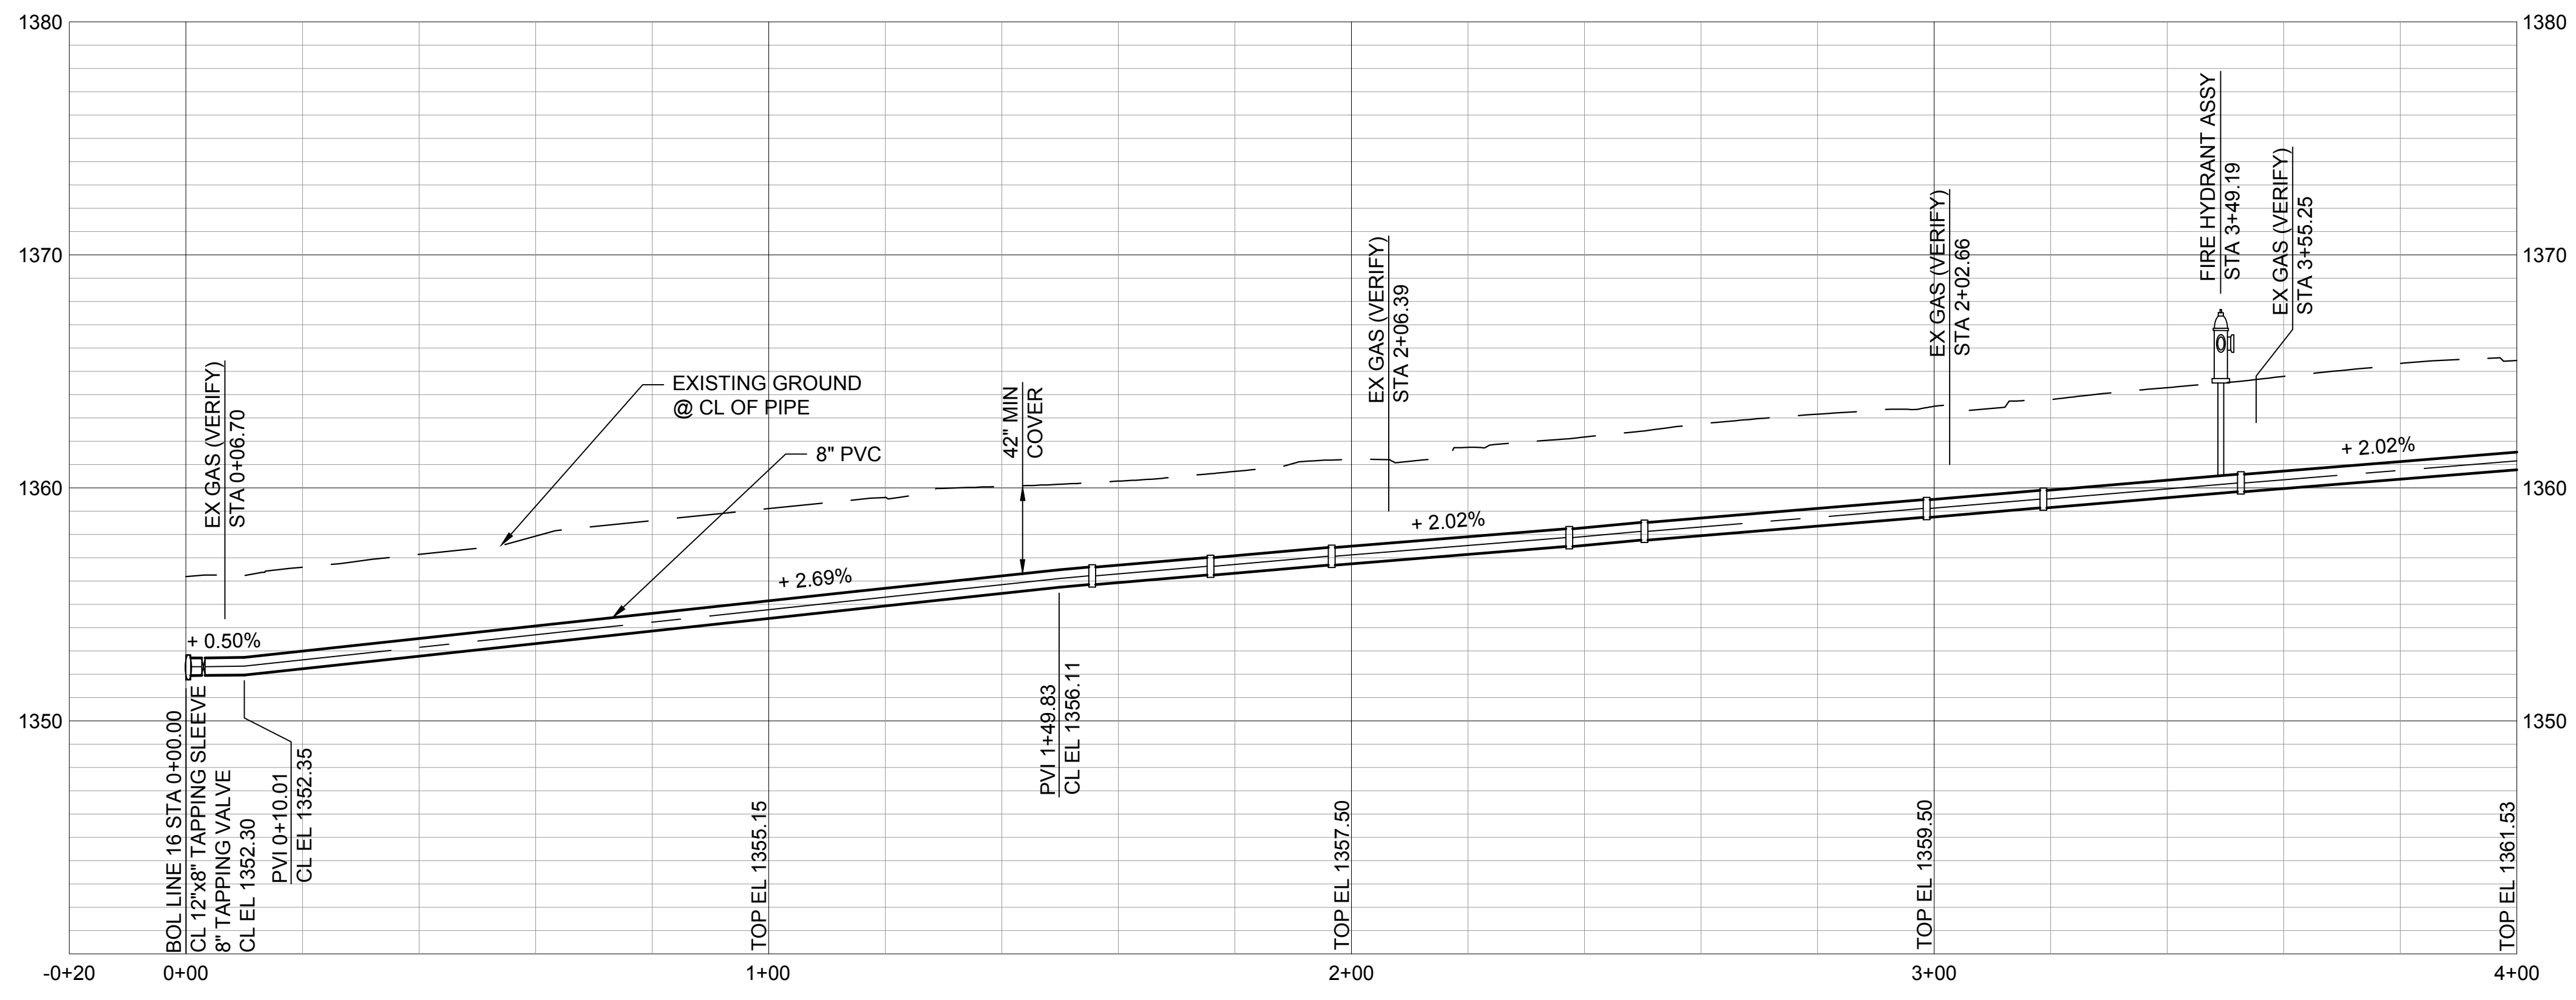

- NOTE:**
- REFER TO THE WATER SERVICE TRANSFER TABLES, DRAWINGS C092 - C093 FOR METER RELOCATES.
 - INSTALL WATERMAIN BY DIRECTIONAL DRILLING UNLESS OTHERWISE NOTED.
 - FOR SANITARY SEWER CROSSINGS LESS THAN 24" VERTICAL CLEARANCE FROM WATERMAIN, REBUILD SANITARY SEWER PER SPECIFICATION 803.4a.
 - CONTRACTOR SHALL VERIFY METER LOCATION NOT PICKED UP BY SURVEY.

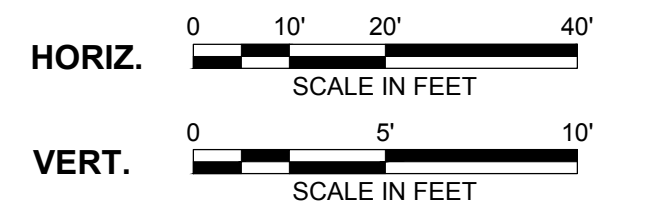

This document has been digitally signed.
05/08/15 9:51 AM

Name
Discipline
License No.



9400 WARD PARKWAY
KANSAS CITY, MO 64114
816-333-9400
LICENSEE NO. 000165

date	APRIL 24, 2014	detailed	M. CHARRETTE
designed	J. MCNIFF	checked	S. WILSON



**ETHEL NEIGHBORHOOD
WATER MAIN REPLACEMENT
LINE 16 - N LORRAINE AVENUE**

project	77025	contract	448-90612
drawing	rev. C040 - 0		
sheet	47	of	101 sheets
file	LINE 16.dwg		