


GENERAL NOTES:

1. ALL CIRCUITS INDICATED ON DRAWINGS SHALL BE 20A, 120V CIRCUITS WITH (2)-#12'S AND (1)-#12 G. IN 0.5" CONDUIT U.O.N.
2. LABEL ALL SNAP SWITCH COVERPLATES WITH THE PANEL AND CIRCUIT NUMBER.
3. REFER TO RELATED ARCHITECTURAL DRAWINGS FOR RELATED INFORMATION.
4. REFER TO THE SPECIFICATIONS FOR DATA NOT ON THE DRAWINGS.
5. WALL MOUNTING HEIGHTS TO CENTERLINE OF DEVICE UNLESS OTHERWISE NOTED.
6. A GROUND CONDUCTOR SIZED PER N.E.C. ARTICLE 250 IS REQUIRED IN ALL POWER, RECEPTACLE, AND LIGHTING CIRCUITS. GROUND CONDUCTORS ARE NOT SHOWN ON DRAWINGS.

PLAN NOTES:


- 1 CONTRACTOR TO ROUTE (5) 1" CONDUITS FROM MAIN CONTROL PANEL TO RAIL GRASS STRUCTURES. SEE OTHER PLAN NOTES FOR ADDITIONAL INFORMATION. VERIFY ROUTING WITH GENERAL CONTRACTOR AND ARTIST PRIOR TO INSTALL.
- 2 ROUTE BACK TO MAIN CONTROL PANEL.
- 3 GVA LIGHT FIXTURE. TYPICAL MOUNTING ON RAIL GRASS. INSTALLATION LOCATION AND REQUIREMENTS WITH GENERAL CONTRACTOR AND ARTIST. ELECTRICAL CONTRACTOR TO PROVIDE ALL MOUNTING AND CONNECTIONS OF LIGHT FIXTURE. ROUTE CONDUIT UP INTERIOR SPACE OF RAIL GRASS TO LIGHT FIXTURE.
- 4 COOPER LIGHTING #MS180 MOTION SENSOR LOCATED AT TOP OF RAIL GRASS WITH EAST ORIENTATION. MOUNT ON FARTHEST EAST RAIL GRASS STRUCTURE. ROUTE CONDUIT UP INTERIOR SPACE OF RAIL GRASS TO LIGHT FIXTURE. COORDINATE EXACT LOCATION WITH GENERAL CONTRACTOR AND ARTIST PRIOR TO ROUGH-IN.
- 5 APPROXIMATE LOCATION OF NEMA 3R ENCLOSURE WITH HINGED AND LOCKABLE FRONT COVER TO HOUSE (2) MEAN WELL #CL-150-12, 120V TO 12V DC POWER SUPPLIES FOR GVA LIGHTING. EACH POWER SUPPLY TO SUPPLY MAXIMUM OF 8 RAIL GRASS STRUCTURES. ELECTRICAL CONTRACTOR TO COORDINATE LOCATION WITH GENERAL CONTRACTOR AND ARTIST PRIOR TO ROUGH-IN.
- 6 (3) 1" CONDUITS FROM MAIN CONTROL PANEL TO 120V TO 12V POWER SUPPLY CABINET FOR RAIL GRASS. ONE CONDUIT ACTIVE FOR LIGHTING. ONE CONDUIT ACTIVE FOR MOTION SENSOR AND ONE SPARE WITH PULLSTRING. COORDINATE EXACT LOCATION WITH POWER SUPPLY LOCATION PRIOR TO ROUGH-IN.
- 7 (2) 1" EMPTY CONDUITS WITH PULLSTRING TO FUTURE RAIL GRASS STRUCTURE. COORDINATE LOCATION OF STUB UP OF CONDUIT WITH GENERAL CONTRACTOR AND ARTIST PRIOR TO ROUGH-IN.
- 8 MAIN LIGHTING CONTROL PANEL LOCATION. VERIFY LOCATION PRIOR TO ROUGH-IN.

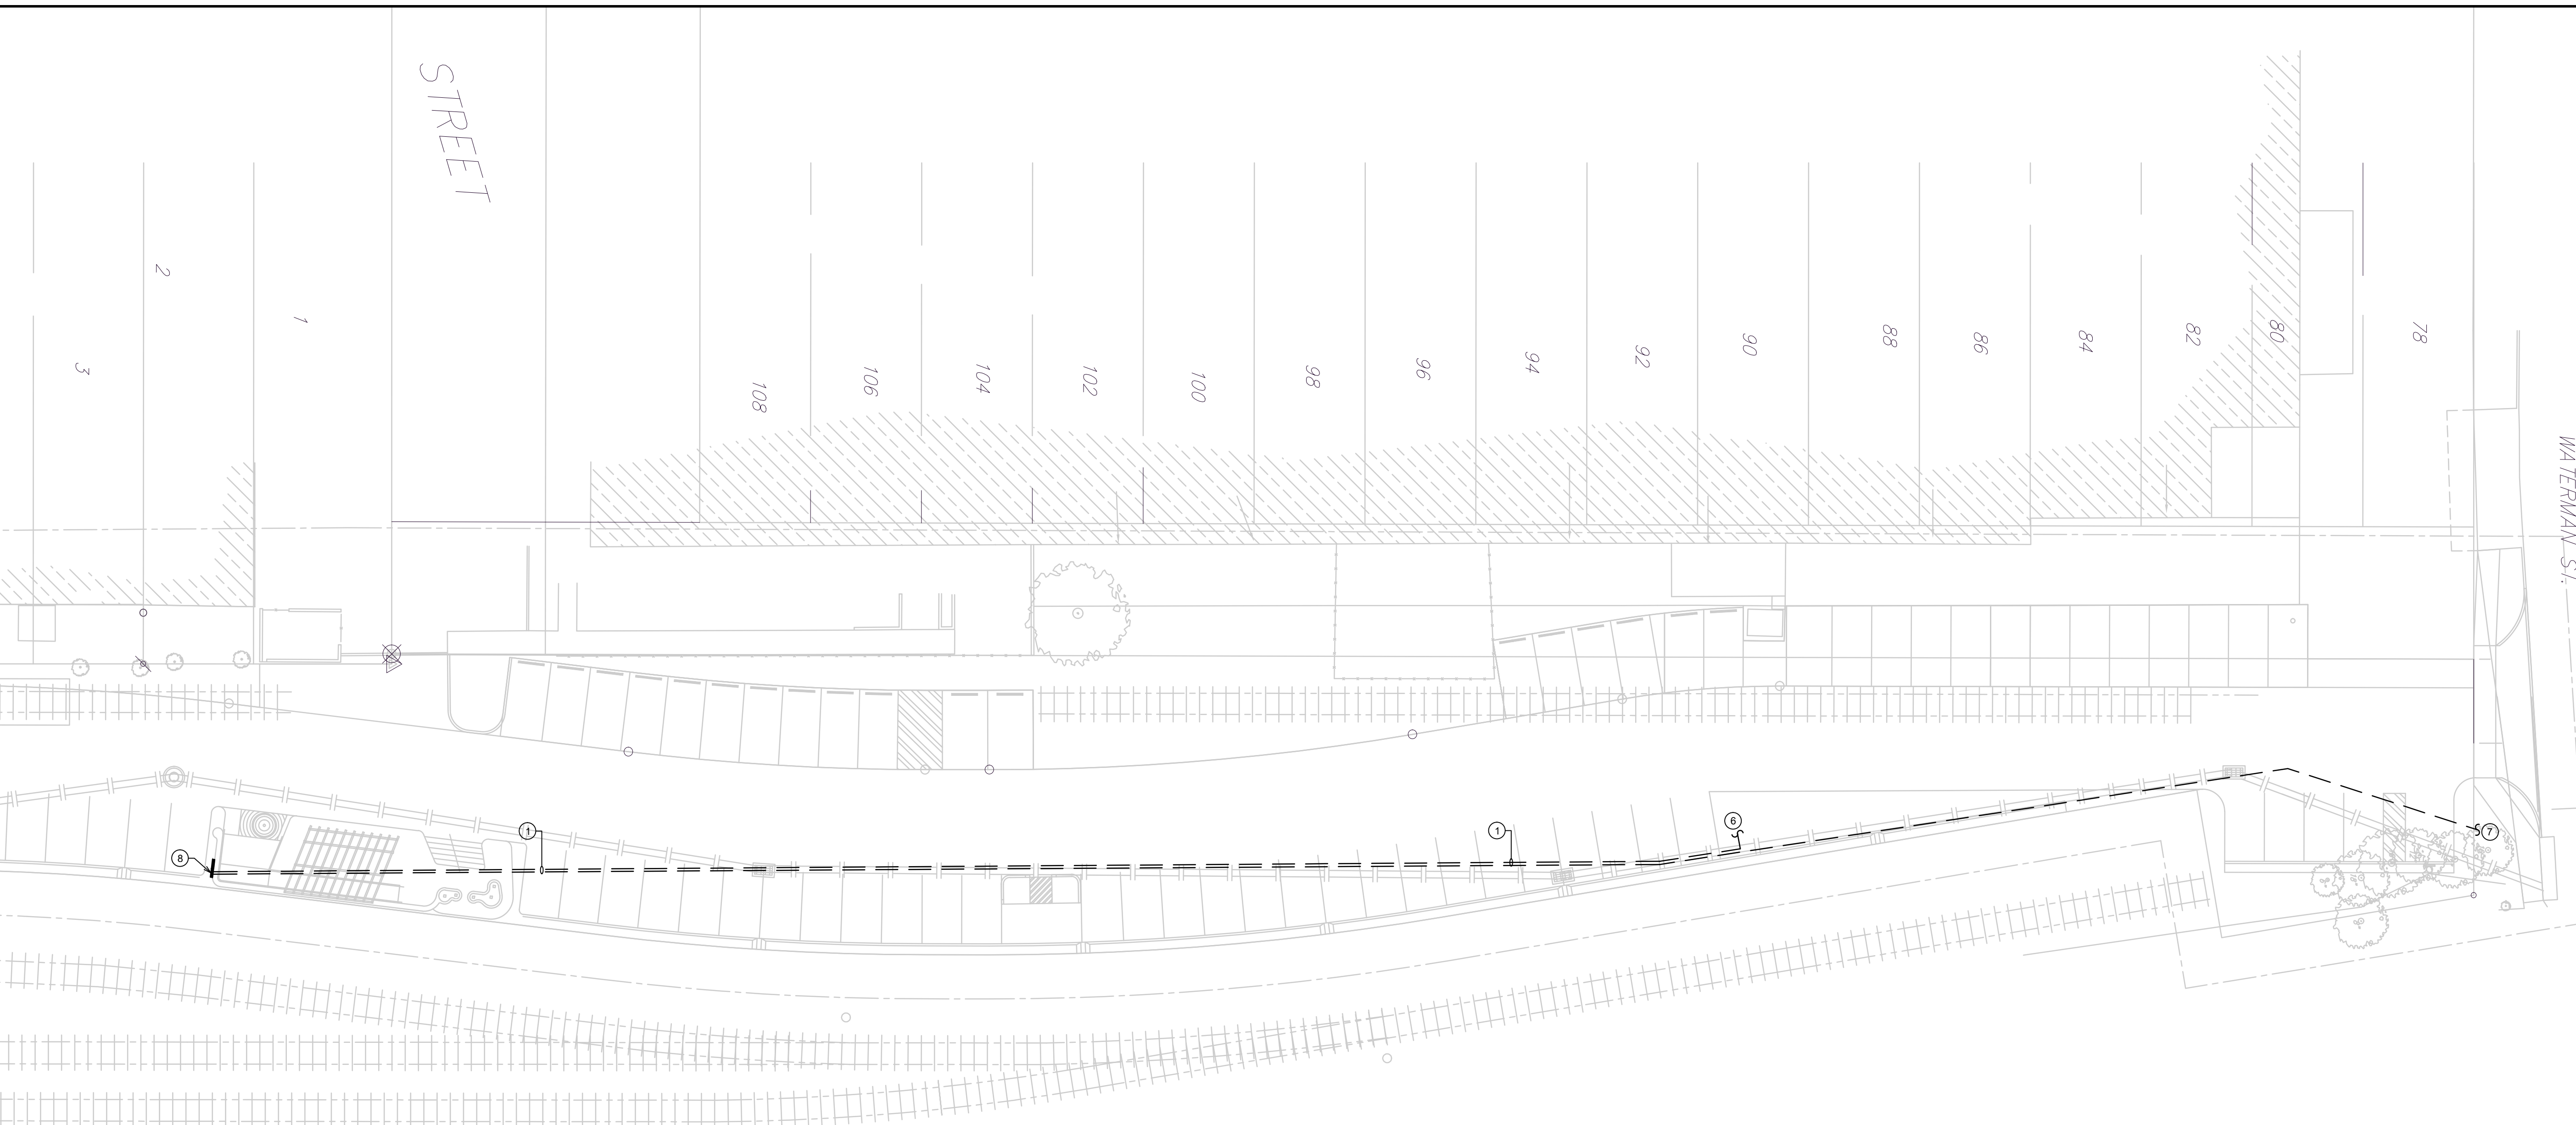


A ELECTRICAL OVERALL PLAN
SCALE: 1" = 20'-0"
NORTH



C RAIL GRASS DETAIL
SCALE: 1/8" = 1'-0"

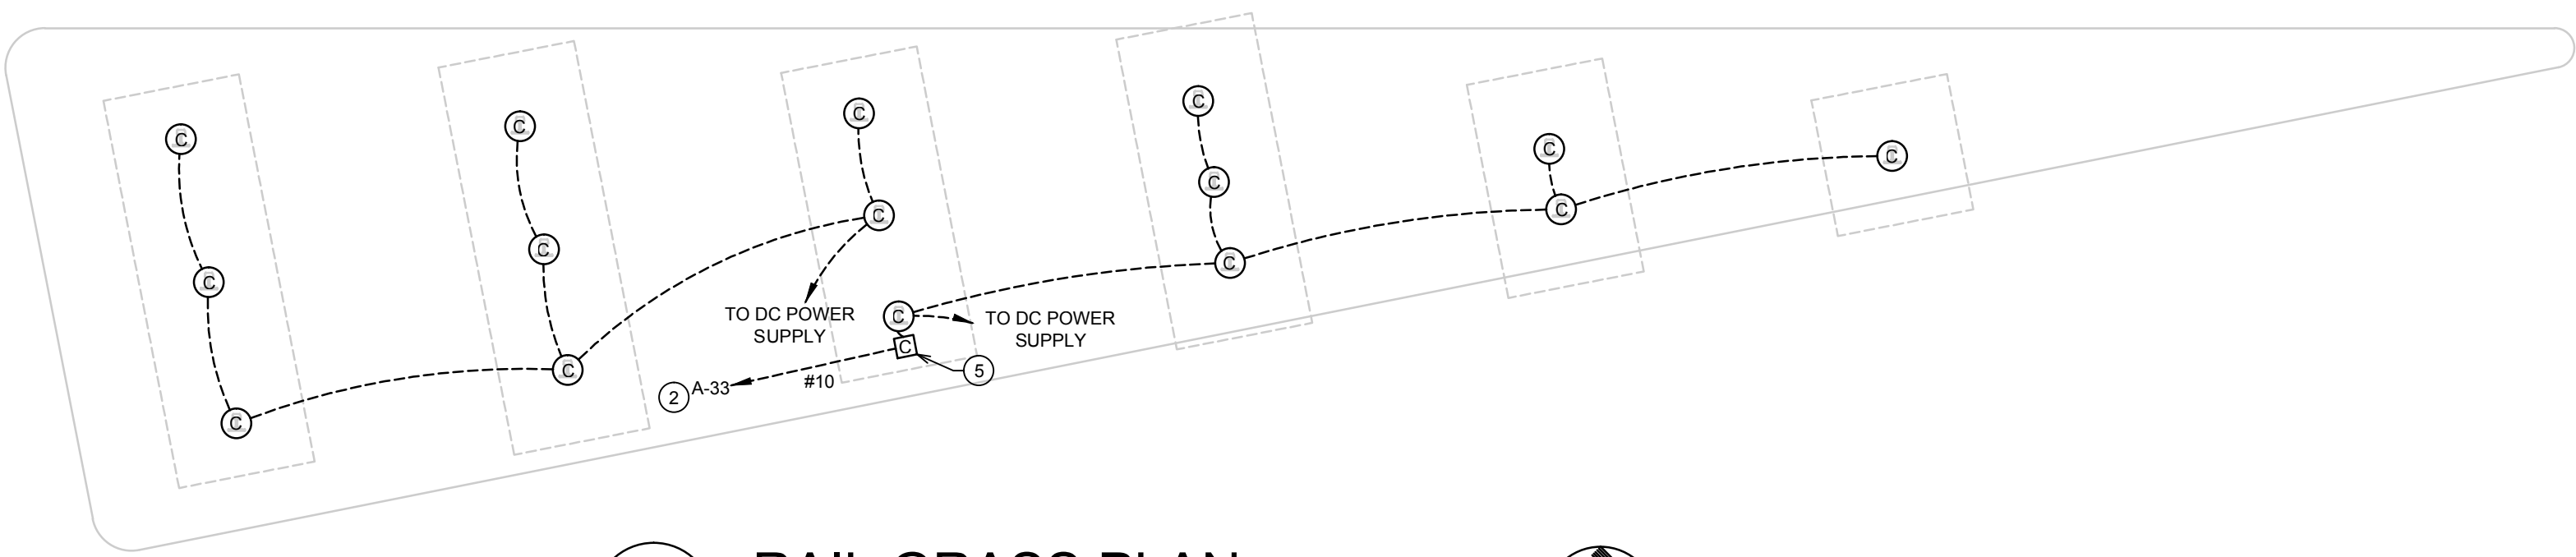

B RAIL GRASS PLAN
SCALE: 1/4" = 1'-0"
NORTH

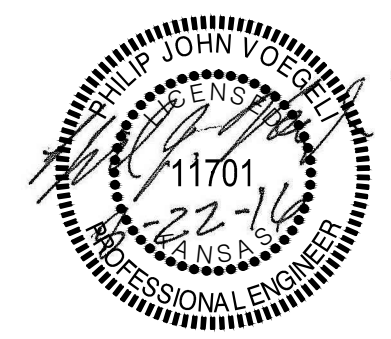

Integrated Consulting Engineers, Inc.
349 South Hydraulic • Wichita, KS 67211
316.264.3588 • 316.264.3948 • www.icengr.com

Drawing File: M:\2016\16223.00 - 015 - Rail Yard Stage\Electrical Files\16223.00 - E1.dwg
Project No. 1410-e149
Design: PV
Drawn: CK
Approved: PV
Scale: NOTED

COMMERCE PARKING LOT SITE PLAN
COMMERCE ART DISTRICT

Baughman Company, P.A.
315 Ellis St. Wichita, KS 67211 P 316-262-7271 F 316-262-0149
ENGINEERING | SURVEYING | PLANNING | LANDSCAPE ARCHITECTURE