

1
GENERAL NOTES

PROVIDE ALL MATERIALS AND PERFORM CONSTRUCTION IN ACCORDANCE WITH THE LATEST EDITION OF CITY OF WICHITA STANDARD SPECIFICATIONS, UNLESS SHOWN OR STATED OTHERWISE ON THESE DRAWINGS OR IN THE SPECIAL PROVISIONS.

EXCAVATION SAFETY

PROVIDE A MINIMUM ADVANCE NOTICE OF SEVENTY-TWO (72) HOURS TO UTILITY COMPANIES PRIOR TO STARTING ANY EXCAVATION, AS FOLLOWS:

KANSAS ONE-CALL OR LOCAL WICHITA 1-800-344-7233 316-687-2470

THE CONTRACTOR MUST NOTIFY THE FOLLOWING IN CASE OF AN EMERGENCY:

AT&T (TELEPHONE) 1-800-870-8390
COX COMMUNICATIONS (CABLE) 316-262-0661
WESTAR (ELECTRIC) 316-383-8600
KANSAS GAS SERVICE (GAS) 1-888-482-4950
CITY OF WICHITA, WATER & SEWER MAINTENANCE 316-262-6000
BLACK HILLS (GAS) 316-946-0096

PRESERVE EXISTING PROPERTY IRONS SHOWN ON DRAWINGS THAT ARE TO REMAIN. REESTABLISH ANY PROPERTY IRONS DAMAGED OR DESTROYED BY CONSTRUCTION OPERATIONS. REESTABLISHMENT OF DAMAGED IRONS SHALL BE AT THE CONTRACTOR'S EXPENSE BY A LICENSED LAND SURVEYOR IN ACCORDANCE WITH KANSAS STATE LAWS.

PROJECT SURVEYS USED THE NAD83 STATE PLANE COORDINATE SYSTEM, SOUTH ZONE. NO COORDINATES WERE MODIFIED TO GROUND. ELEVATIONS ARE IN USGS MEAN SEA LEVEL DATUM (NAVD 88).

OTHERS WILL ADJUST UTILITY SERVICE LINES, POLES, VALVE BOXES, METERS, ETC., AS NECESSARY, PRIOR TO CONSTRUCTION UNLESS THE DRAWINGS SPECIFICALLY CALL FOR THEIR ADJUSTMENT BY CONTRACTOR. EXISTING UTILITIES AND THEIR LOCATION, AS SHOWN ON THE DRAWINGS, REPRESENT THE BEST INFORMATION AVAILABLE FOR DESIGN. SOME UTILITIES WERE RELOCATED AND MAY NOT REFLECT SO ON THE DRAWINGS. VARIOUS UTILITY COMPANIES PROVIDED UTILITY LOCATION INFORMATION FROM RECORD DRAWINGS OR FIELD LOCATIONS; THE PLAN LOCATIONS SHOWN ARE NOT GUARANTEED. ADDITIONAL EXISTING UTILITIES MAY ALSO BE ENCOUNTERED. CONTRACTOR SHALL WORK AROUND EXISTING UTILITIES THAT DO NOT CONFLICT WITH PROPOSED CONSTRUCTION.

CONTRACTOR SHALL RELOCATE ALL BUSINESS SIGNS, POSTS AND LANDSCAPING FEATURES THAT CONFLICT WITH THE NEW CONSTRUCTION PRIOR TO CONSTRUCTION. CONTRACTOR SHALL REMOVE AND DISPOSE OF ALL ITEMS THAT REMAIN WITHIN THE CONSTRUCTION LIMITS UPON THE START OF CONSTRUCTION, UNLESS OTHERWISE NOTED.

CONTRACTOR SHALL PROVIDE DISPOSAL SITES FOR AND DISPOSE OF ALL RUBBLE FROM THE REMOVAL OF MISCELLANEOUS STRUCTURES AND EXCESS EXCAVATION THAT IS TO BE WASTED. ENGINEER SHALL APPROVE THE SUITABILITY, APPEARANCE AND SITE LOCATION OF DISPOSAL SITES. ENGINEER SHALL NOT APPROVE LOCATIONS THAT WILL LEAVE AN UNSIGHTLY APPEARANCE, IN ENGINEER'S OPINION. OBTAIN APPROVAL FROM KANSAS DEPARTMENT OF HEALTH AND ENVIRONMENT FOR ALL DISPOSAL SITES. OBTAIN KANSAS STATE BOARD OF AGRICULTURE PERMITS FOR ANY MATERIAL STOCKPILED OR DISPOSED OF IN A FLOOD PLAIN. OBTAIN APPROVAL AND PERMITS FROM U. S. ARMY CORPS OF ENGINEERS FOR ANY MATERIAL DUMPED IN WATERS OF THE UNITED STATES OR WETLANDS. PROVIDE ADDITIONAL ARCHEOLOGICAL INVESTIGATIONS FOR ANY MATERIAL BURIED OR STOCKPILED BEYOND APPROVED CONSTRUCTION LIMITS UNLESS BURIED OR STOCKPILED IN A PREVIOUSLY APPROVED DISPOSAL LOCATION.

MAINTAIN ACCESS CONTROL WITHIN PARKING LOT THROUGHOUT CONSTRUCTION. CONSTRUCT TEMPORARY FENCE AT NO ADDITIONAL COST TO THE CITY OF WICHITA, IF NECESSARY, TO MAINTAIN ACCESS CONTROL.

SITE RESTORATION NOTES

REPAIR OR REPLACE DAMAGED ITEMS NOT PART OF THE PROJECT AT NO ADDITIONAL COST TO CITY OF WICHITA.

PLACE TOPSOIL AS APPLICABLE TO A MINIMUM DEPTH OF 6 INCHES OR AS SPECIFIED ON THE DRAWINGS. THE FINISHED GRADE ON DRAWINGS INDICATES THE SURFACE ELEVATION AFTER PLACEMENT OF THE PRESCRIBED TOPSOIL THICKNESS. OFFSITE TOPSOIL BORROW SHALL BE FERTILE NATURAL TOPSOIL, TYPICAL OF THE LOCALITY, OBTAINED FROM WELL-DRAINED AREAS. STOCKPILED TOPSOIL MAY BE USED. IT SHALL BE WITHOUT ADMIXTURE OF SUBSOIL OR SLAG AND SHALL BE FREE OF STONES, LUMPS, STICKS, PLANTS, OR THEIR ROOTS, TOXIC SUBSTANCES OR OTHER EXTRANEOUS MATTER THAT MAY BE HARMFUL TO PLANT GROWTH OR WOULD INTERFERE WITH FUTURE MAINTENANCE. TOPSOIL PH RANGE SHALL BE 5.5 TO 7.0. ENGINEER SHALL APPROVE TOPSOIL PRIOR TO PLACEMENT.

RAKE ALL GRAVEL OR OTHER SIMILAR DEBRIS LARGER THAN 1/2 INCH IN DIAMETER AND REMOVE DURING FINAL GRADE PREPARATION.

EROSION CONTROL NOTES:

THE CONTRACT DOCUMENTS PROVIDE FOR THE CONSTRUCTION OF ALL IMPROVEMENTS WITHOUT THE NECESSITY OF ENTERING OR DISTURBING THE ADJACENT DITCH. IF THE CONTRACTOR DETERMINES THAT ENTERING THE DITCH WILL BE NECESSARY, CONTRACTOR WILL BE RESPONSIBLE FOR OBTAINING ALL PERMITS AND ADHERING TO ALL REGULATORY REQUIREMENTS. THE CONTRACTOR SHALL PREVENT ALL CONSTRUCTION MATERIAL AND DEBRIS FROM COMING IN CONTACT WITH THE DITCH.

GRADING NOTES

THIS CONSTRUCTION OCCURS IN NARROW STRIP WITH LIMITED ACCESS FOR EQUIPMENT TO TRANSPORT, PLACE, SPREAD, AND COMPACT THE FILL. TO ASSURE STABILITY AND RESISTIVITY TO THE FORCES OF WATER, IT IS CRITICAL THAT THE FOUNDATION BE PROPERLY PREPARED PER THE "PREPARATION" SECTION, MEET THE "GRANULAR FILL" SECTION, AND THAT SATISFACTORY COMPACTION BE ACCOMPLISHED PER THE "ROUTINE DENSITY TESTS" SECTION. BECAUSE THE CONSTRUCTION USUALLY TAKES PLACE IN A NARROW STRIP, CONVENTIONAL MASS GRADING TECHNIQUES AND TESTING FREQUENCIES ARE USUALLY NOT APPROPRIATE.

PREPARATION

CLEAR THE WORK AREA BY COMPLETE REMOVAL OF ALL OBJECTIONABLE MATTER AND/OR OBSTRUCTIONS ABOVE THE GROUND SURFACE. OBJECTIONABLE MATTER INCLUDES ALL TREES, ROOT BALLS, FALLEN TIMBER, BRUSH, VEGETATION, LOOSE STONE, ABANDONED STRUCTURES, FENCING, AND SIMILAR DEBRIS. DISPOSE OF OBJECTIONABLE MATTER AND/OR OBSTRUCTIONS IN APPROVED DISPOSAL AREA.

WITHIN AREA DESIGNATED ON THE PLANS, REMOVE THE EXISTING CONCRETE PAVEMENT AND UNDERLYING MATERIALS TO A DEPTH OF AT LEAST 2.5 FEET BENEATH THE PROPOSED PAVEMENT SURFACE. DISPOSE OF EXCAVATED MATERIALS IN APPROVED DISPOSAL AREA.

HAVE ENGINEER VERIFY THAT FURTHER EXCAVATION IS NOT REQUIRED PRIOR TO FILL PLACEMENT.

2
FILL

IN GENERAL, SOIL EXCAVATED IN WORK AREAS IS SUITABLE FOR USE AS GRANULAR OR ENGINEERED FILL IF IT IS FREE OF ORGANIC MATTER AND OTHER OBJECTIONABLE MATERIAL (I.E. ROOTS, ROCKS, AND DEBRIS), IS OF SUITABLE MOISTURE CONTENT, AND IT MEETS THE REQUIREMENTS OF AN APPROVED USC CLASSIFIED SOIL AS STATED IN THE RECORD TESTS SECTION.

TEST PROPOSED GRANULAR FILL AND ENGINEERED FILL SOIL AS INDICATED IN "RECORD TESTS" PRIOR TO BEGINNING FILL PLACEMENT FOR THE WORK. ONCE PLACEMENT OF FILL COMMENCES, THE NEW SET OF "RECORD TESTS" SHALL BE COMPLETED A MINIMUM OF ONCE EVERY 5,000 CUBIC YARDS (OR FRACTION THEREOF) OF FILL PLACED. RETEST THE FILL AS INDICATED IN "RECORD TESTS" IF THE CONSISTENCY, COLOR, TEXTURE, OR APPEARANCE OF THE FILL CHANGES SIGNIFICANTLY OR IF THREE OR MORE ROUTINE DENSITY TESTS ON THE SAME MATERIAL FAIL BY YIELDING RELATIVE COMPACTION PERCENTAGES BELOW 95% OR ABOVE 105% OF MAXIMUM DRY DENSITY (MDD).

MAINTAIN CONSTRUCTION SLOPES AND GRADES TO PROVIDE POSITIVE DRAINAGE DURING ALL GRADING OPERATIONS; IF NECESSARY, INSTALL SUMPS AND PROVIDE PUMPS TO MAINTAIN THE WORK FREE OF STANDING WATER.

1
RECORD TESTS

TEST EACH TYPE OF GRANULAR AND ENGINEERED FILL USED FOR THE WORK TO DETERMINE THE MDD AND OPTIMUM MOISTURE CONTENT (OMC) PER ASTM D-698 (STANDARD PROCTOR) AND THE SOIL CLASSIFICATION PER ASTM D2487 (USC) OF THE MATERIAL. PERFORM ALL TESTS NECESSARY TO PROVIDE THE USC CLASSIFICATION (E.G., PLASTICITY CHARACTERISTICS PER ASTM D4318 (ATTERBERG LIMITS), PARTICLE SIZE DISTRIBUTION PER ASTM D422, SPECIFIC GRAVITY ASTM D854) FOR EACH TYPE OF GRANULAR AND ENGINEERED FILL SOIL. ASSURE THAT ALL GRANULAR FILL FOR THE SUBBASE MEETS UD-1 KDOT REQUIREMENTS FOR MATERIAL. BASE MATERIALS SHOULD MEET THE REQUIREMENTS FOR KDOT AB-1 OR UD-1 MATERIAL. ENGINEERED FILL USED FOR WORK SHALL MEET USC TYPE SM, SC, CL OR ML.

IDENTIFY EACH RECORD TEST WITH A UNIQUE DESIGNATION THAT INCLUDES A CLEAR DESCRIPTION AND COLOR PHOTOGRAPHS OF THE SOIL IN BOTH MOIST AND DRY STATES SO THE ROUTINE DENSITY TESTS CAN BE READILY MATCHED TO THE APPROPRIATE RECORD TEST. PUBLISH COPIES OF ALL RECORD TESTS TO CITY OF WICHITA, ENGINEER, TESTING SERVICE, CONTRACTOR, AND/OR OTHER ENTITIES ON THE DISTRIBUTION LIST. MAINTAIN AT LEAST ONE UP-TO-DATE SET OF COPIES AT ALL WORK SITE(S).

1
COMPACTION & MOISTURE CONTROL

THE LOWER 18 INCHES OF GRANULAR FILL SHALL BE PLACED IN MAXIMUM 8 INCH THICK, LOOSE LIFTS AND COMPACTED TO AT LEAST 90% OF ITS MDD. SUBSEQUENT LIFTS OF GRANULAR FILL SHALL BE PLACED IN MAXIMUM 8 INCH, LOOSE LIFTS AND COMPACT TO AT LEAST 95% OF ITS MDD. MAINTAIN GRANULAR FILL MOISTURE CONTENT BETWEEN -2% TO +2% OF ITS OMC PRIOR TO AND DURING COMPACTION.

PLACE APPROVED ENGINEERED FILL IN MAXIMUM 8-INCH THICK, LOOSE LIFTS AND COMPACT TO AT LEAST 95% OF ITS MAXIMUM DRY DENSITY. MAINTAIN ENGINEERED FILL MOISTURE CONTENT BETWEEN -3% TO +3% OF ITS OPTIMUM MOISTURE CONTENT PRIOR TO AND DURING CONSTRUCTION.

ROUTINE DENSITY TESTS

THE CONTRACTORS' INSPECTOR SHALL PERFORM ROUTINE DENSITY TESTS AT A FREQUENCY OF AT LEAST ONE TEST PER EACH 2000 SQUARE FEET, PER LIFT, ON ALL GRANULAR AND ENGINEERED FILL PLACED FOR THE WORK WITH A MINIMUM OF AT LEAST THREE TESTS FOR EACH COMPLETE LIFT OF GRANULAR OR ENGINEERED FILL. ROUTINE DENSITY TEST SHALL BE COMPLETED IN ACCORDANCE WITH ASTM D6938 FOR NUCLEAR IN-PLACE DENSITY TESTING. THE RESULTS OF ALL DENSITY TESTING SHALL BE REPORTED TO AND VERIFIED BY AN INSPECTOR DESIGNATED BY THE CITY OF WICHITA.

IDENTIFY EACH ROUTINE DENSITY TEST WITH A UNIQUE DESIGNATION AND PROVIDE WRITTEN DOCUMENTATION OF EACH TEST LOCATION, ELEVATION, ACTUAL LIFT THICKNESS MEASUREMENT, MATCHING RECORD TEST, ACTUAL MOIST DENSITY, ACTUAL MOISTURE CONTENT, ACTUAL DRY DENSITY, PERCENT OF MDD AND OMC RELATIVE TO THE MATCHED RECORD TEST, WHETHER THE TEST PASSES OR FAILS, AND, IF A RETEST OF A FAILED TEST, THE ORIGINAL TEST'S UNIQUE DESIGNATION.

THE FOLLOWING TABLE INDICATES THE REQUIRED PRECISION FOR TEST LOCATIONS:

LOCATION STATION AND OFFSET	TO THE NEAREST TEN FEET
ELEVATION	TO THE NEAREST 1/2 FOOT
LIFT THICKNESS	TO THE NEAREST 1/10 FOOT

A TEST FAILS IF THE COMPACTION IS LESS THAN THE SPECIFIED CRITERIA FOR MDD OR IF THE MOISTURE IS OUTSIDE OF THE SPECIFIED RANGE FOR OMC (E.G., A TEST MAY HAVE ACCEPTABLE COMPACTION BUT FAIL DUE TO BEING TOO DRY OR TOO WET). IF ROUTINE DENSITY TESTS INDICATE INADEQUATE COMPACTION OR EXCESSIVELY DRY OR MOIST SOIL, REWORK THE WHOLE LIFT REPRESENTED BY THE FAILING TEST. RETEST THE FAILED AREA AFTER IS HAS BEEN REWORKED AND RECOMPACTED.

GENERAL UTILITY NOTES

1. WATER AND SEWER CONSTRUCTION SHALL BE PERFORMED IN ACCORDANCE WITH ALL LOCAL, STATE CODES AND SPECIFICATIONS.
2. THE CONTRACTOR SHALL PAY ALL FEES AND OBTAIN ALL PERMITS
3. ALL EXISTING UNDERGROUND UTILITY LOCATIONS ARE APPROXIMATE AND ARE BASED ON TOPOGRAPHIC SURVEYS AND RECORD DRAWINGS FROM THE FACILITY OR MUNICIPALITY. ADDITIONAL UTILITIES MAY BE PRESENT. SHOULD UNCHARTERED UTILITIES BE ENCOUNTERED DURING EXCAVATION OPERATIONS, THE CONTRACTOR SHALL NOTIFY THE ENGINEER AS SOON AS POSSIBLE FOR INSTRUCTIONS.
4. THE CONTRACTOR SHALL NOTIFY THE KANSAS ONE-CALL SYSTEM.
5. MAINTAIN 10-FOOT HORIZONTAL AND 18-INCH VERTICAL SEPARATION BETWEEN SANITARY SEWER AND WATER SUPPLY LINES, WHERE APPLICABLE.
6. CONTRACTOR SHALL VERIFY THE EXACT LOCATION OF ALL EXISTING UTILITIES AND TAKE CARE TO PROTECT UTILITIES THAT ARE TO REMAIN. REPAIR DAMAGED UTILITIES ACCORDING TO LOCAL STANDARDS AND AT THE CONTRACTOR'S EXPENSE. COORDINATE ALL CONSTRUCTION WITH THE APPROPRIATE UTILITY COMPANY.
7. THE CONTRACTOR SHALL BE RESPONSIBLE FOR COORDINATING THE SEQUENCE OF CONSTRUCTION FOR ALL UTILITY LINES SO THAT WATER LINES AND UNDERGROUND ELECTRIC DO NOT CONFLICT WITH SANITARY SEWER OR STORM SEWER SYSTEMS.
8. BACKFILL UTILITY TRENCHES UNDER PAVEMENT AREAS WITH CRUSHED STONE OR GRAVEL BACKFILL (#57). BACKFILL UTILITY TRENCHES IN LAWN AREAS WITH SATISFACTORY FILL MATERIAL COMPACTED TO

AT LEAST 98% OF MAXIMUM PER ASTM D698.

9. ADJUST ALL EXISTING CASTINGS TO MATCH PROPOSED FINISHED GRADES.
10. CONTRACTOR SHALL PROVIDE POWER AND TELEPHONE SERVICES TO FACILITY DURING CONSTRUCTION.
11. PROVIDE AS-BUILT DRAWINGS WHICH INCLUDE AT LEAST TWO DIMENSIONS TO EACH VALVE OR STRUCTURE FROM KNOWN SITE FEATURES. DRAWINGS SHALL INCLUDE VERTICAL AND HORIZONTAL INFORMATION ON ALL NEW UTILITIES AS WELL AS EXISTING UTILITIES ENCOUNTERED.
12. THE CONTRACTOR SHALL BE RESPONSIBLE FOR COORDINATION WITH ALL UTILITY SERVICES AND COMPANIES, INCLUDING ELECTRICAL AND COMMUNICATIONS, TO ENSURE ALL UTILITY SERVICES ARE MAINTAINED TO THE BUILDING AT ALL TIMES.
13. ELECTRICAL ENGINEERING DESIGN PACKAGE SHALL BE COORDINATED WITH WESTAR ENERGY (SHANE PRICE, (316) 261-6315, CELL (316) 706-6702) AND SHALL BE SUBMITTED TO CITY FOR APPROVAL AND REQUIRED PERMITTING.
14. CONTRACTOR SHALL PROVIDE ELECTRICAL DESIGN/INSTALLATION SERVICES AND COORDINATION WITH WESTAR TO MODIFY THE EXISTING SITE ELECTRICAL SYSTEM AND RE-ESTABLISH ITS CONNECTION TO THE BUILDING AND PARKING LOT SITES.

DEMOLITION NOTES

1. DEMOLITION AND REMOVAL OPERATIONS SHALL COMMENCE ONLY AFTER ALL EROSION AND SEDIMENT CONTROL MEASURES ARE IN PLACE, APPROVED (IF, REQUIRED) AND FUNCTIONAL.
2. PROVIDE A NEAT AND STRAIGHT SAWCUTS OF EXISTING PAVEMENT ALONG ALL LIMITS OF PAVEMENT DEMOLITION OR REMOVAL FOR CONSTRUCTION.
3. ALL DEMOLISHED MATERIALS ARE SUBSIDIARY TO OTHER ITEMS OF WORK AND BECOME THE PROPERTY OF THE CONTRACTOR UNLESS OTHERWISE DESIGNATED. DISPOSE MATERIALS OFF THE OWNER'S PROPERTY IN A LEGAL MANNER.
4. ALL PAVEMENT, BASE COURSES, SIDEWALKS, CURBS, BUILDING FOUNDATIONS, ETC., IN THE AREAS TO BE REMOVED SHALL BE REMOVED TO THE FULL DEPTH. EXISTING BASE COURSE MATERIAL MAY BE WORKED INTO THE NEW PAVEMENT OR BUILDING SUBGRADE PROVIDED THAT THE GRADATION, CONSISTENCY, COMPACTION, ETC., ARE IN ACCORDANCE WITH LOCAL SPECIFICATIONS.
5. CONTRACTOR SHALL OBTAIN ALL PERMITS REQUIRED FOR EXCAVATION OF THE WORK.
6. ALL ITEMS OF CONSTRUCTION REMAINING AND NOT SPECIFICALLY MENTIONED THAT INTERFERE WITH THE NEW CONSTRUCTION SHALL BE IMMEDIATELY BROUGHT TO THE ATTENTION OF THE ENGINEER OR OWNER.
7. CONTRACTOR SHALL PROVIDE PROTECTION TO ALL STREETS, FENCES, UTILITIES AND STRUCTURES THAT ARE TO REMAIN. CONTRACTOR-CAUSED DAMAGE SHALL BE REPAIRED TO MATCH EXISTING AT NO ADDITIONAL COST TO THE OWNER.
8. CAVITIES LEFT BY STRUCTURE REMOVAL SHALL BE BACKFILLED WITH SATISFACTORY MATERIAL AND COMPACTED TO 98% OF MAXIMUM DENSITY PER ASTM D698.
9. CONTRACTOR SHALL LOCATE AND MARK ALL EXISTING UTILITIES PRIOR TO COMMENCING WORK. COORDINATE WITH LOCAL UTILITY COMPANIES AND/OR OWNER PRIOR TO UTILITY DISCONNECT.
10. EXISTING INFORMATION / TOPOGRAPHIC SURVEY WAS PREPARED BY GARBER SURVEY, DATED 4/8/2016.
11. PAVEMENT MARKINGS TO BE REMOVED SHALL BE PAINTED OVER TO MATCH PAVEMENT OR REMOVED WITH WIRE BRUSHING.
12. EXCEPT AS SHOWN, NO TREES SHALL BE REMOVED AND/ OR VEGETATION DISTURBED WITHOUT APPROVAL OF THE ENGINEER OR OWNER.
13. CONTRACTOR SHALL INSTALL APPROPRIATE CONSTRUCTION FENCING AROUND WORK AREA TO INSURE PUBLIC SAFETY.


TABLE OF QUANTITIES		
ITEM	QUANTITY	UNIT
4' CHAIN LINK FENCE	260	FT
METAL GUARD RAIL	190	FT
TEMPORARY CONSTRUCTION FENCE	246	FT
POWER POLE	2	EA
LIGHT POLE AND BASE	3	EA
ELECTRIC METERS	3	EA
ELECTRIC METER RACK	1	EA
2" CONDUIT FOR FUTURE TELEPHONE LINE	60	FT
CONCRETE CURB	270	FT
18" REINFORCED CONCRETE PIPE	32	FT
TYPE II CURB INLET	4	EA
GABION PENETRATIONS	4	EA
PORTLAND CEMENT CONCRETE	60	CY
GRANULAR FILL	300	CY
(1) ENGINEERED FILL	110	CY
GEOTEXTILE FABRIC	500	SY
TEMPORARY UTILITIES	1	LS
TEMPORARY UNDERGROUND ELECTRIC	250	FT
WOODEN TRASH ENCLOSURE	1	EA
ELECTRICAL DESIGN PACKAGE	1	LS

(1) ENGINEERED FILL BASED ON 1/3 OF GRANULAR FILL



DATE:	OCTOBER 31, 2016
PROJECT NO.:	8-2750-0252
DESIGNED BY:	MJH
DRAWN BY:	JMR
CHECK BY:	NL
SUBMITTED BY:	Ampex Foster Wheeler Environment & Infrastructure, Inc.
FILE NAME:	Dopps-Chiropractic Design, Inc.
PLOT SCALE:	N/A
SIZE:	ANSI D
MARK	1
DESCRIPTION	ADDITIONUM 1
DATE	04/05/2017
NL	
APPR	

DESIGNED BY:	MJH
DRAWN BY:	JMR
CHECK BY:	NL
SUBMITTED BY:	Ampex Foster Wheeler Environment & Infrastructure, Inc.
FILE NAME:	Dopps-Chiropractic Design, Inc.
PLOT SCALE:	N/A
SIZE:	ANSI D

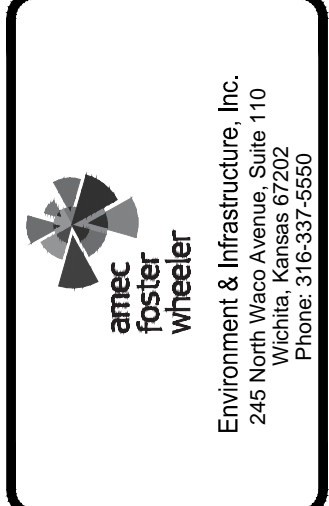

100% DESIGN

NOTES
SWS #711 - WEST BRANCH DRY CREEK OF GYPSUM CREEK SWS IMPROVEMENTS
5119 E. KELLOGG DR., DOPPS-CHIROPRACTIC PARKING LOT

SHEET IDENTIFICATION
2
SHEET 2 OF 11