
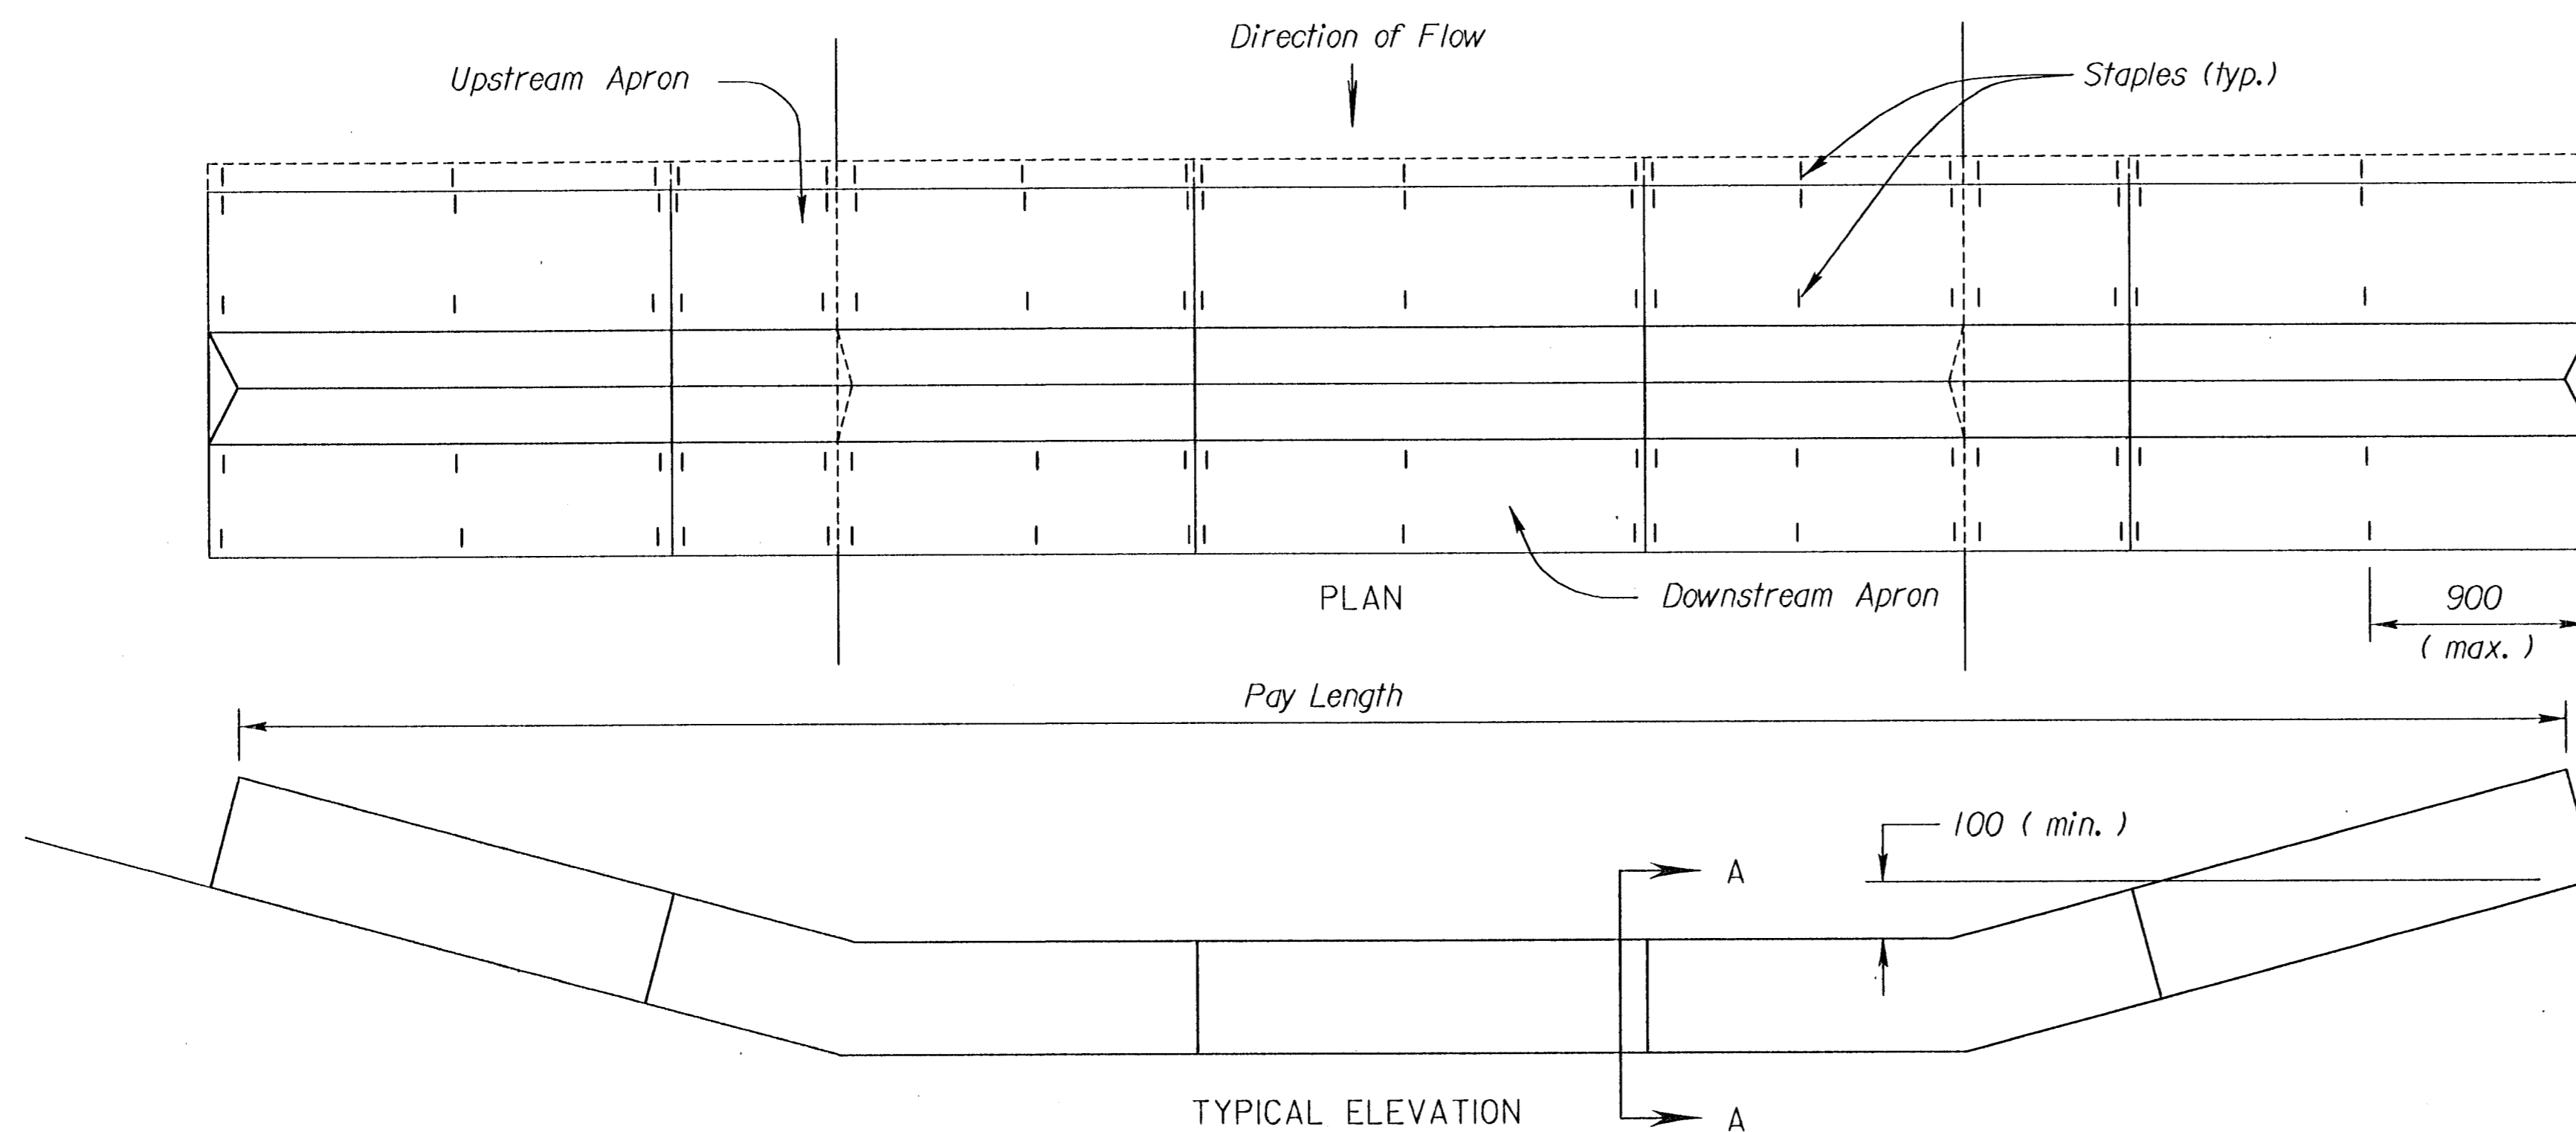


STATE	PROJECT NO.	YEAR	SHEET NO.	TOTAL SHEETS
KANSAS	87 N-0203-01	2003	32	48

**SILT FENCE NOTES:**

- Stakes shall be 1 200 mm (min.) long and of one of the following materials:
  - Hardwood - 30 mm x 30 mm;
  - Southern Pine (No. 2) - 65 mm x 65 mm;
  - Steel U, T, L, or C Section - 600 grams per 300 mm; or
  - Synthetic - same strength as wood stakes.
- Attach fence fabric to stakes with staples, wire or nails.
- Use as much Silt Fence as necessary to insure water does not flow around end of ditch check.
- Use support fencing when tributary area is greater than 1 hectare or when ditch gradient is greater than 2 percent.

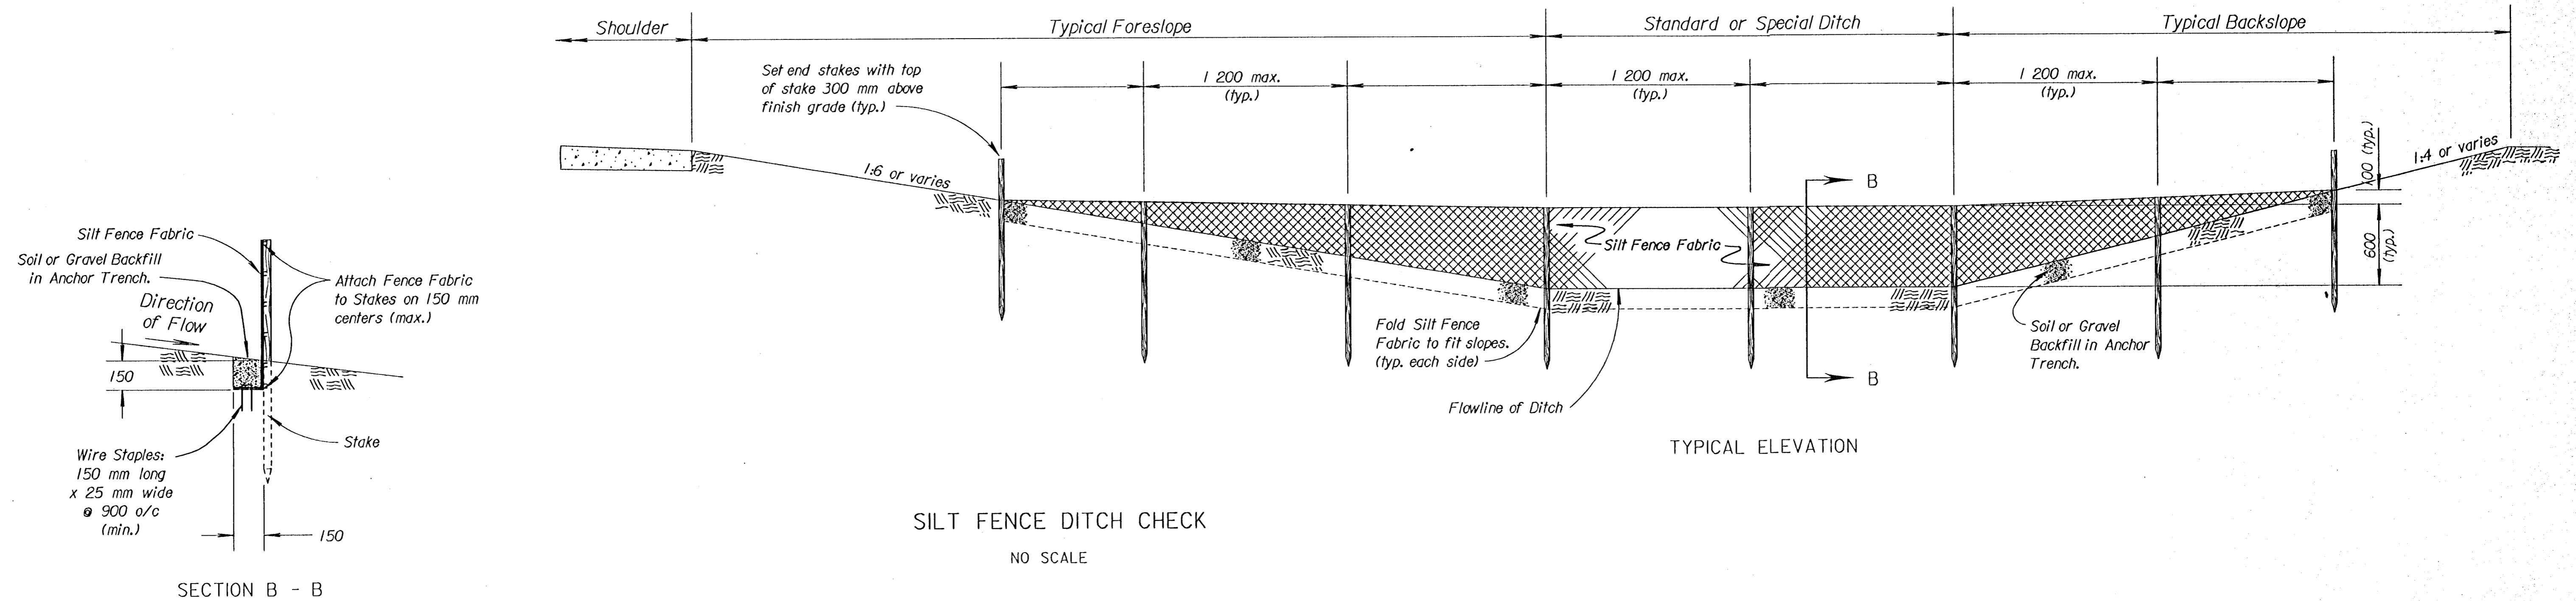

**TRIANGULAR SILT DIKE NOTES**

- Place Triangular Silt Dike sections tightly together, with apron material overlapping end-to-end by 150 mm.
- Wire Staples shall be 150 mm long by 25 mm wide, minimum.
- Use as many Triangular Silt Dike sections as necessary to insure water does not flow around end of ditch check.

3					
2					
1					
NO.	DATE	REVISIONS	BY	APP'D	
<b>KANSAS DEPARTMENT OF TRANSPORTATION</b> <b>TEMPORARY EROSION AND POLLUTION CONTROL</b> <b>SILT FENCE DITCH CHECKS</b> <b>TRIANGULAR SILT DIKE DITCH CHECKS</b> LA852F SI					
DESIGNED	WCL	DETAILS	WCL	QUANTITIES	TRACED
DESIGN CK.	RDR	DETAIL CK.	RDR	QUAN. CK.	TRACE CK.
F.H.W.A. APPROVAL			5/20/99	APP'D	Richard D. Rosa

Drawn By: mark  
 Dgn File: G:\CIVIL\01079\06\0852f.s.dgn  
 Plotted: 07/27/03 View: PLOT 1