

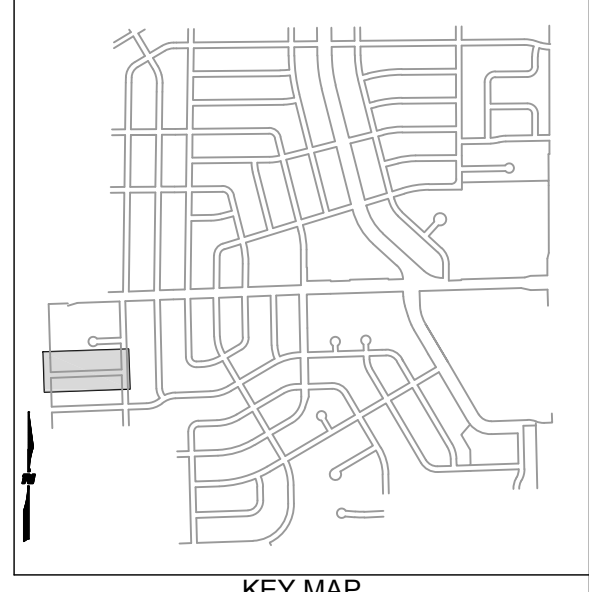
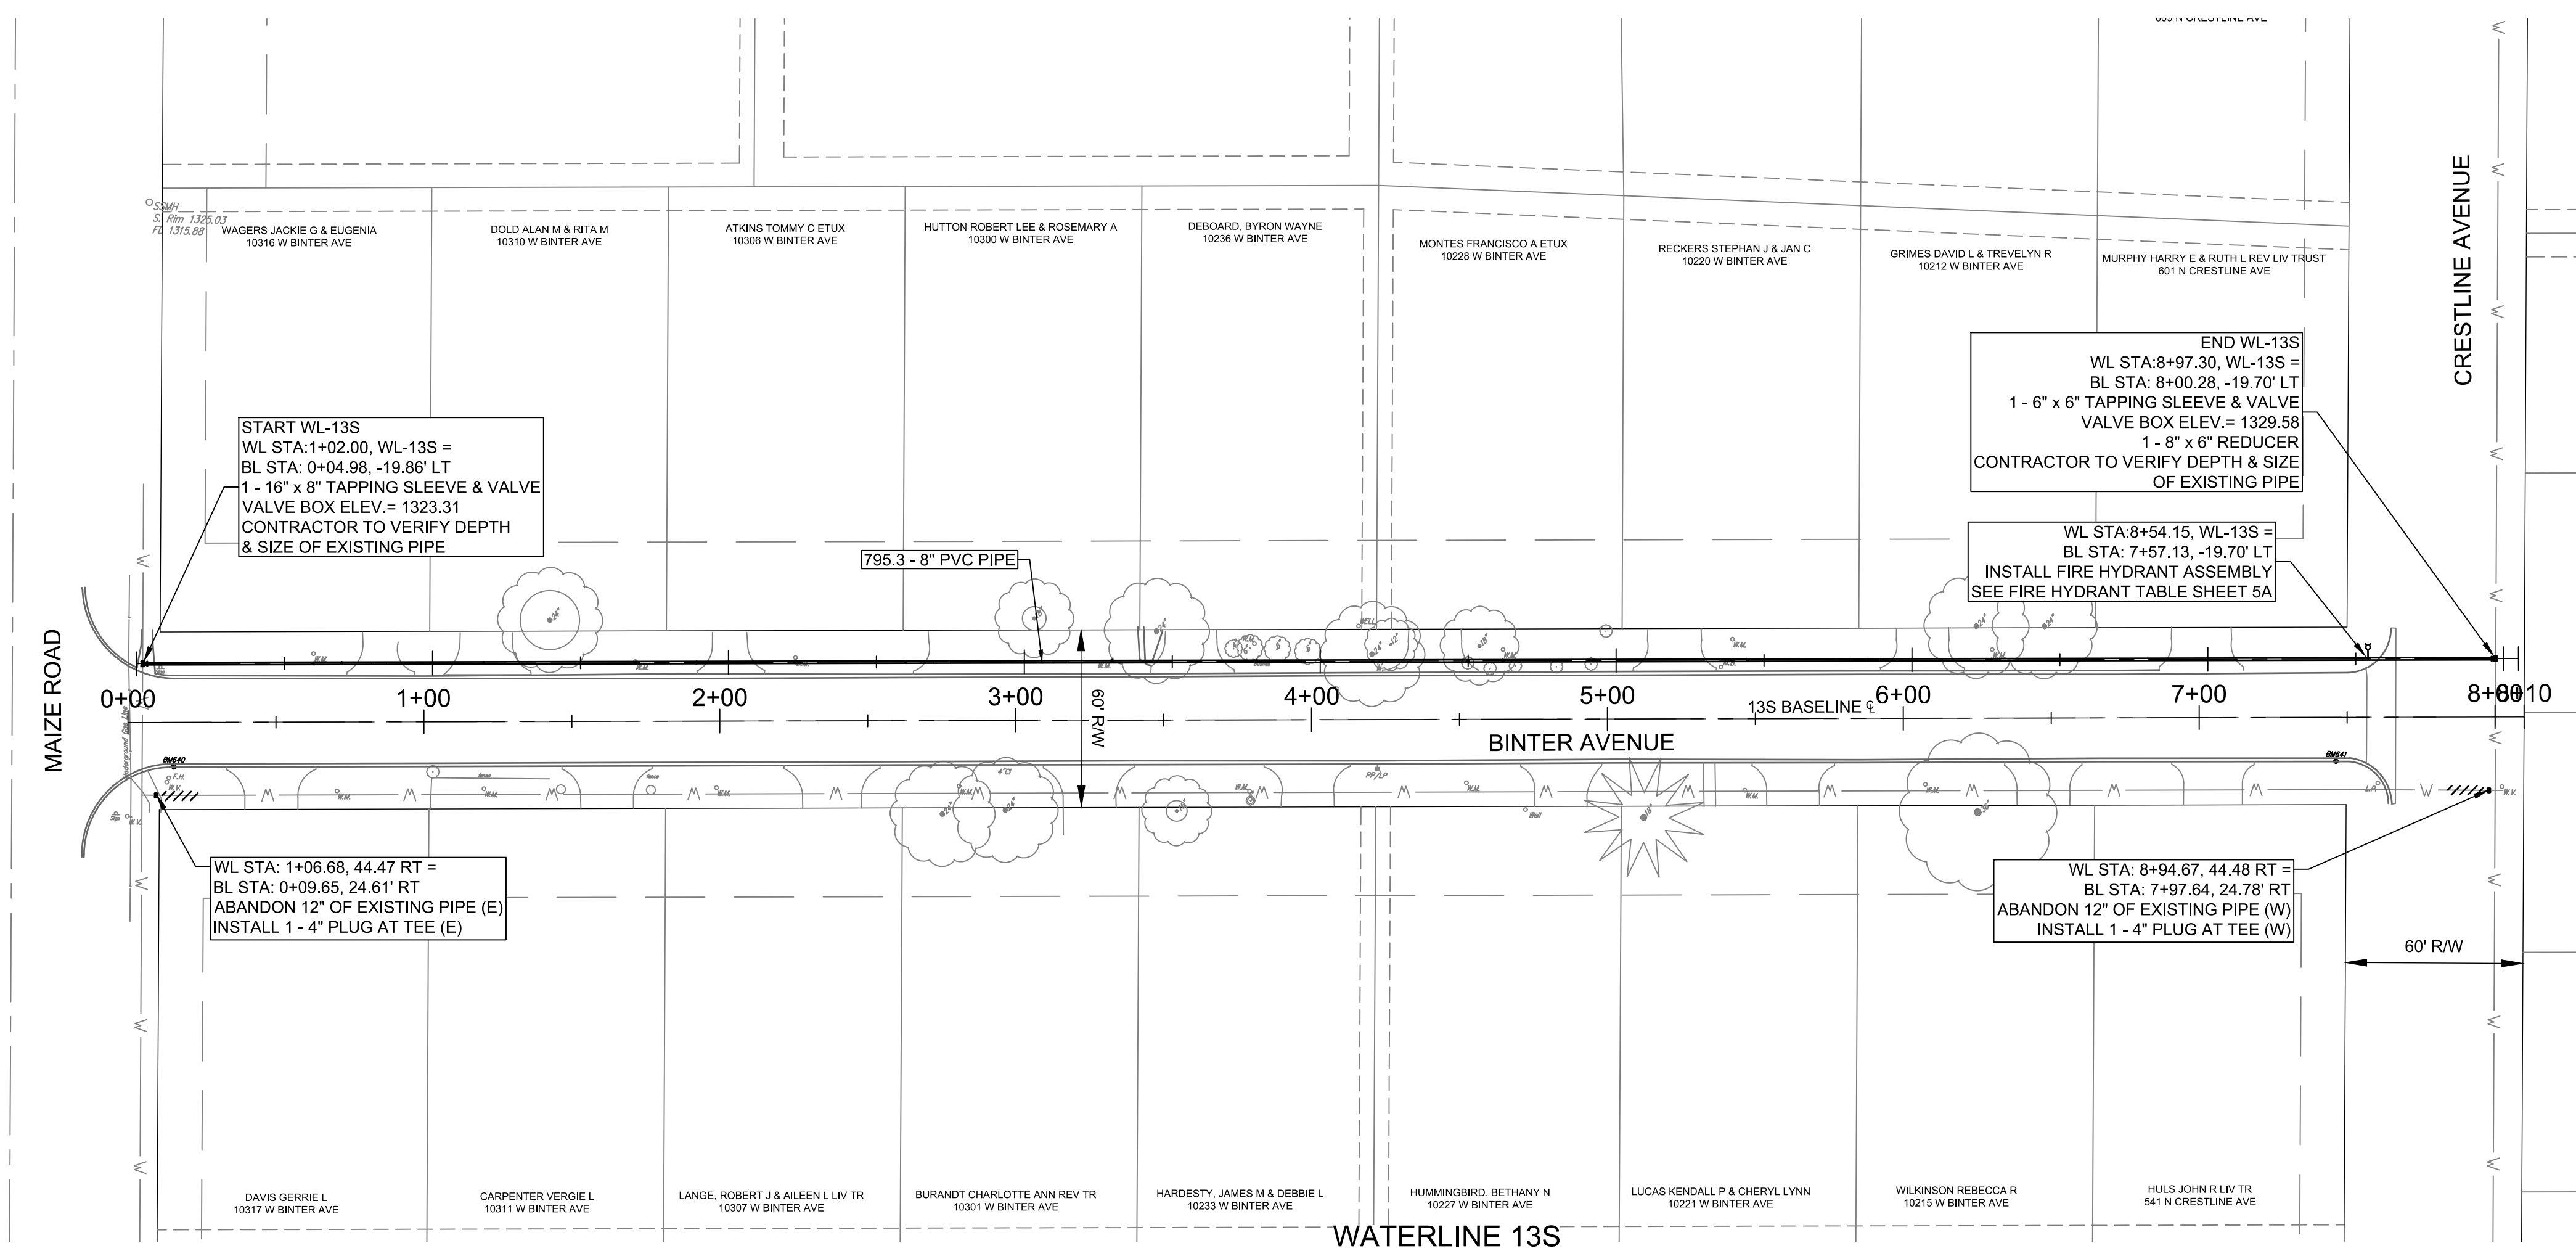


M:\FS14-600-509-00\CADD\SHEETS\Deliverables 07_2017\SOUTH WL 90711\SOUTH PNP's\146509_PnP_11-13S.dwg 8/17/2017 1:45 PM

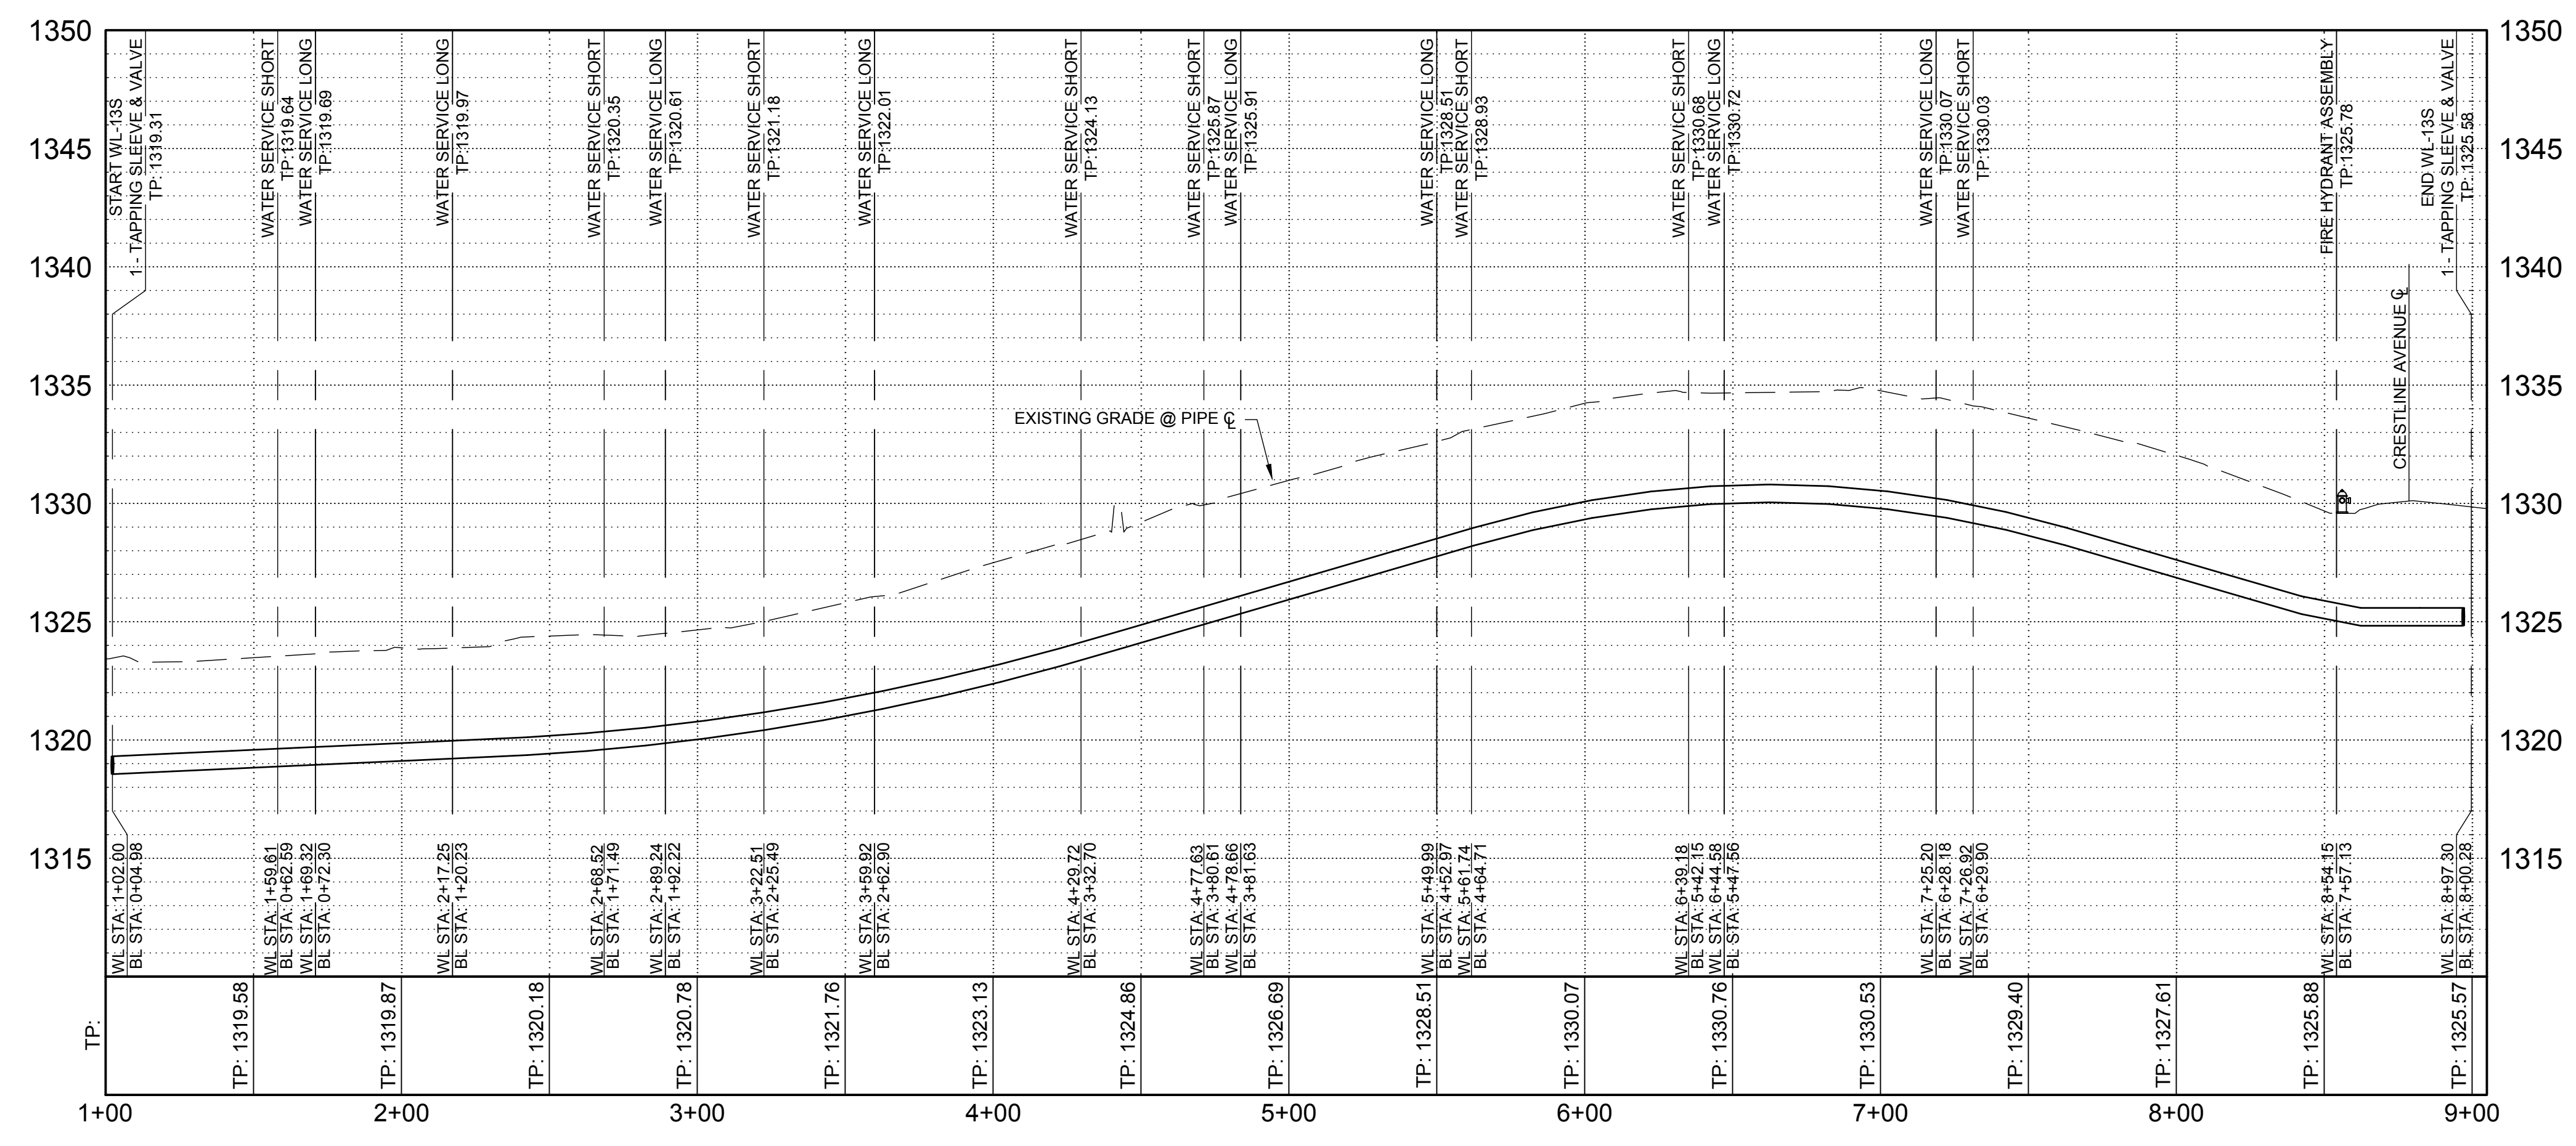

QUANTITIES:
PIPE:
 8" C900 PVC - 795.3'
TAPPING SLEEVE & VALVE
 16" x 8" - 1
 8" x 8" - 1
HYDRANT:
 NEW - 1
SERVICES:
 LONG - 8
 SHORT - 8

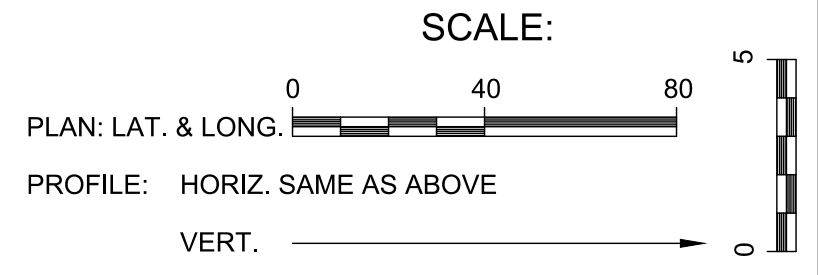

WICHITA COUNTRY ACRES
 WATER MAIN REPLACEMENT PHASE 2B
 WATERLINE 13S PLAN & PROFILE

1700 EAST BROWN AVE
 SALINA, KS 67401
 PHONE: 785-827-0833
 FAX: 785-827-0836
 WWW.WILSON-AND-COMPANY.COM



WILSON & COMPANY
 Designed By: BPS
 Drawn By: DCK
 Job No.: 14-600-509-00
 Date: FEBRUARY 2016