


FHWA REGION NO.	STATE	PROJECT NO.	YEAR	SHEET NO.	TOTAL SHEETS
7	KANSAS	87 N-0092-01	1999	8	75



1. ALL STORM DRAINAGE PIPE CONNECTIONS TO STRUCTURES SHALL BE GROUTED WITH NON-SHRINK GROUT TO PROVIDE FOR WATER TIGHT CONNECTION.
2. STORM SEWER PIPE MEASURED FROM CENTER OF STRUCTURE TO CENTER OF STRUCTURE.



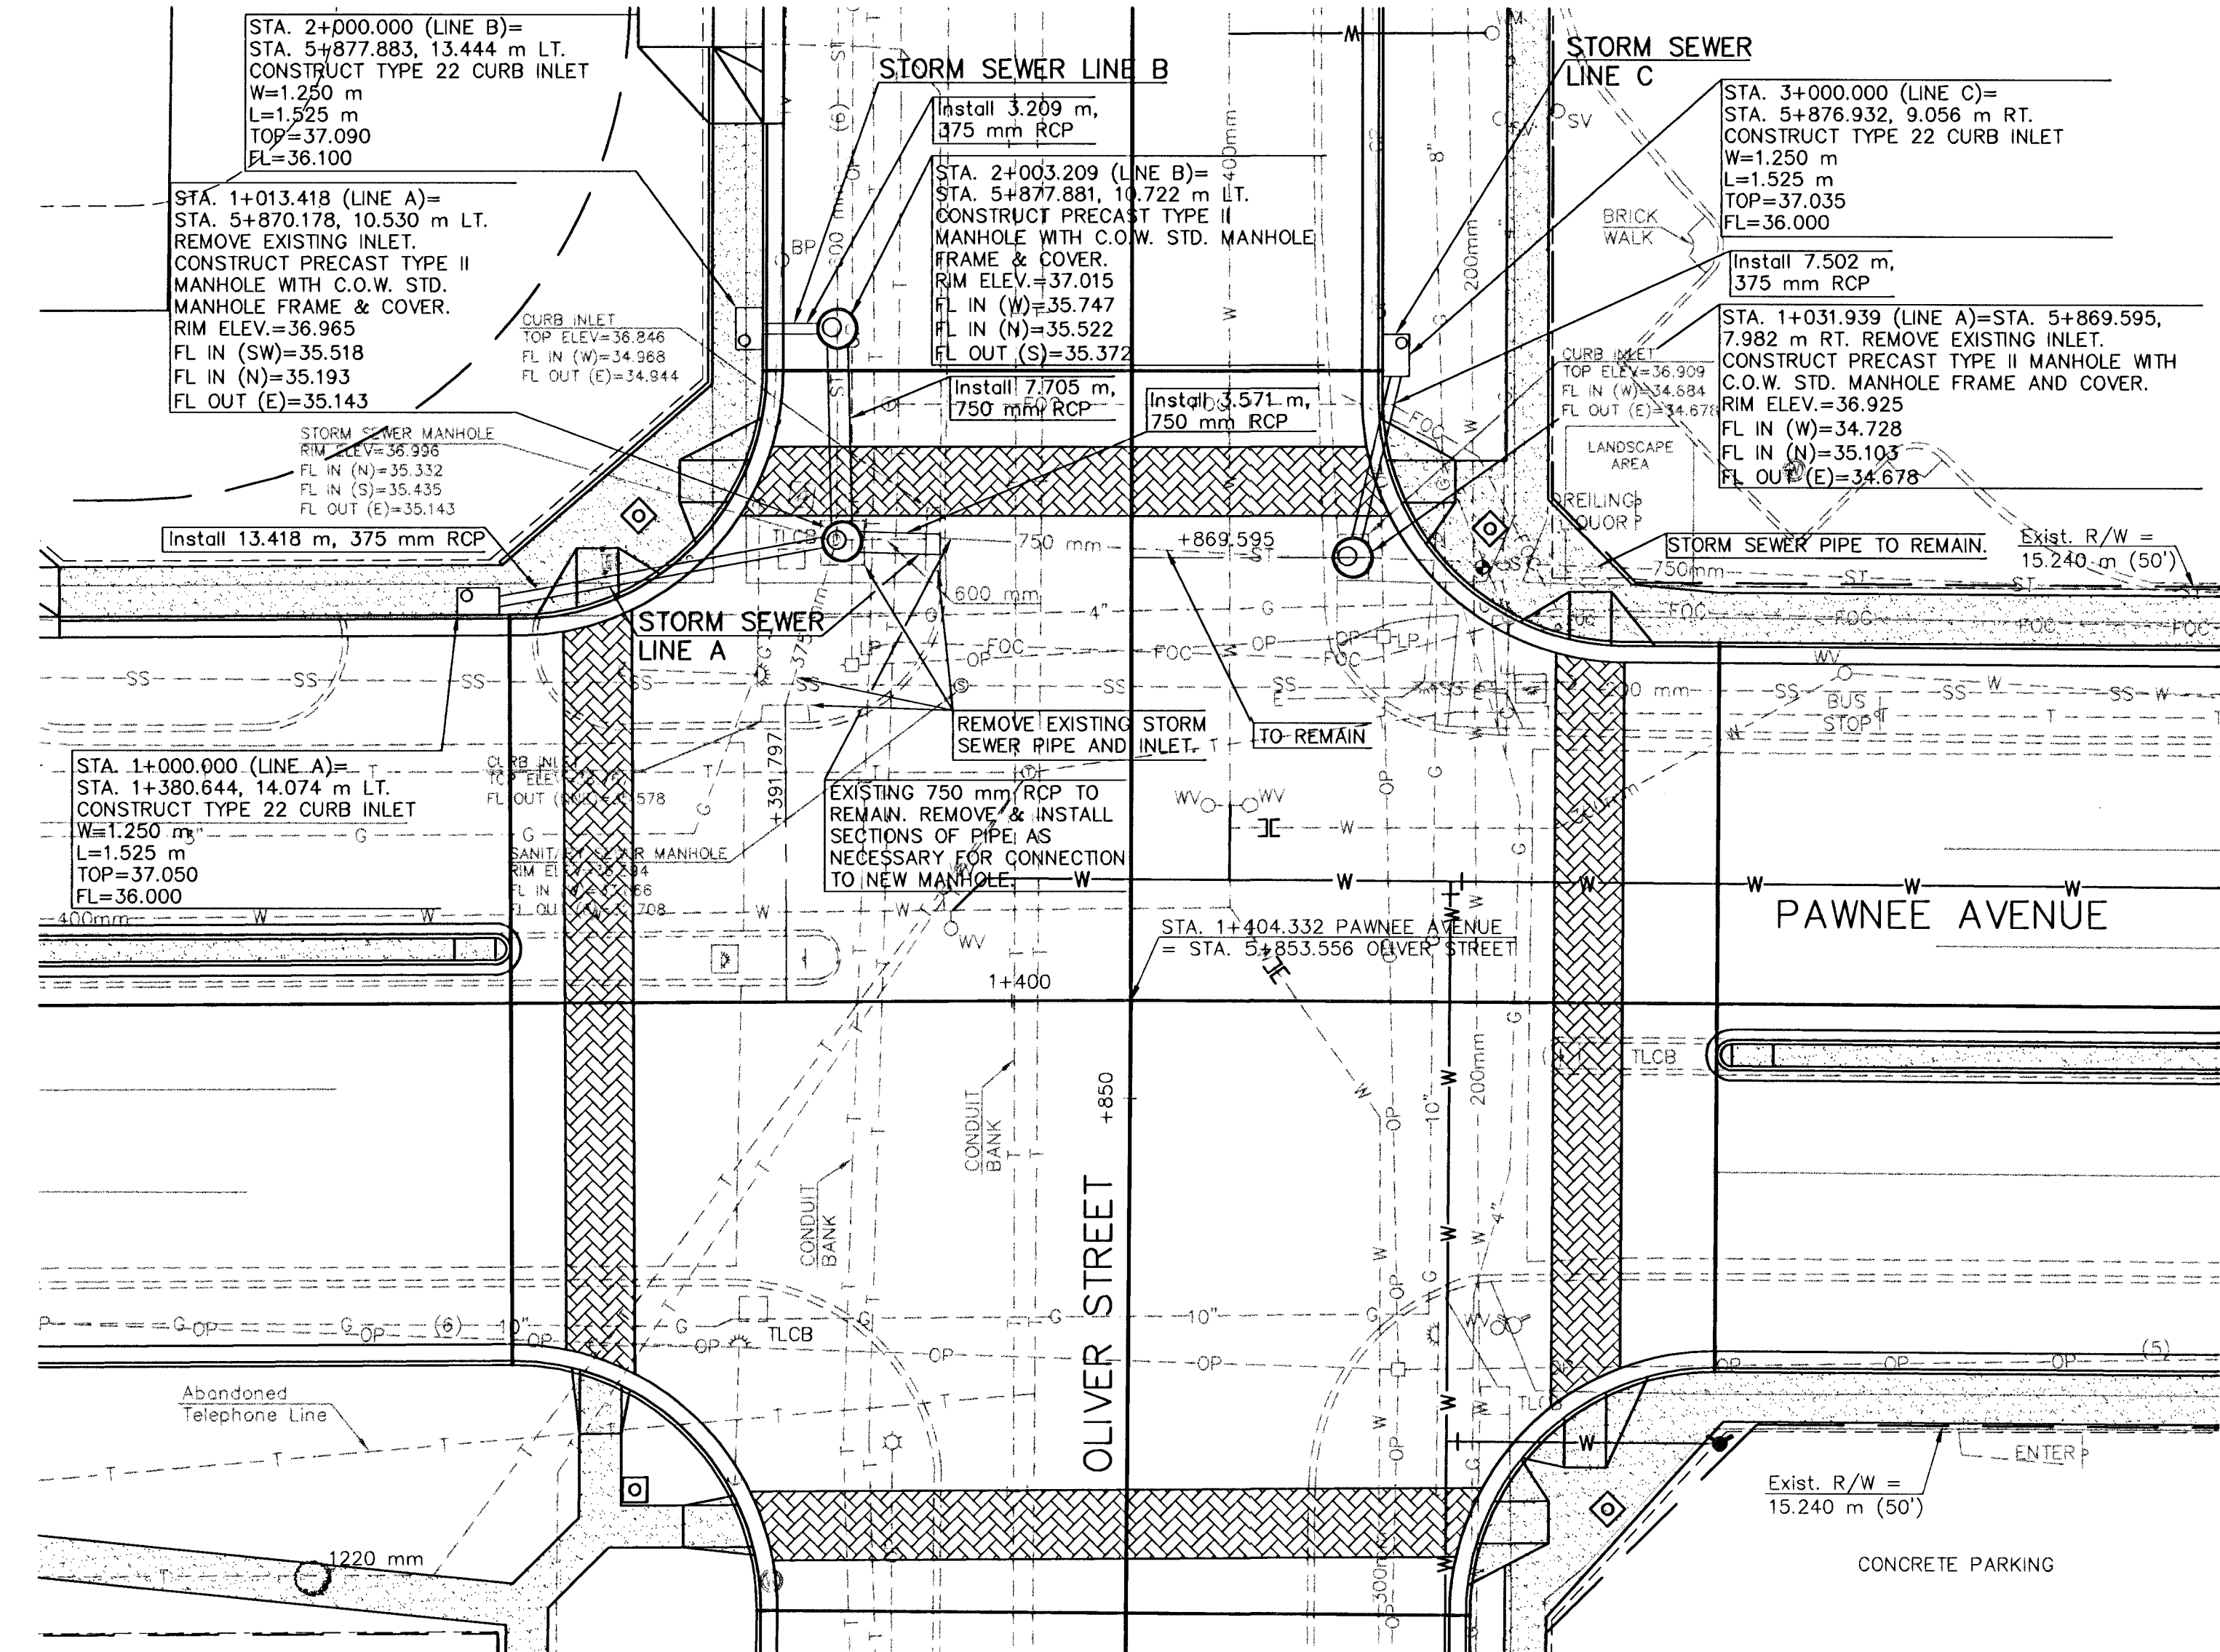


SCALE:
PLAN 1:200
PROFILE 1:10 VERT.


See Sheet No's. 9-12 for Water Main Replacement.

See Intersection Detail Sheet for intersection grading.

Note:
Southwestern Bell telephone manhole ring and lid to be adjusted by others during construction. Contact Greg Shorpe at 785-268-2245 5 days prior to needed adjustment.

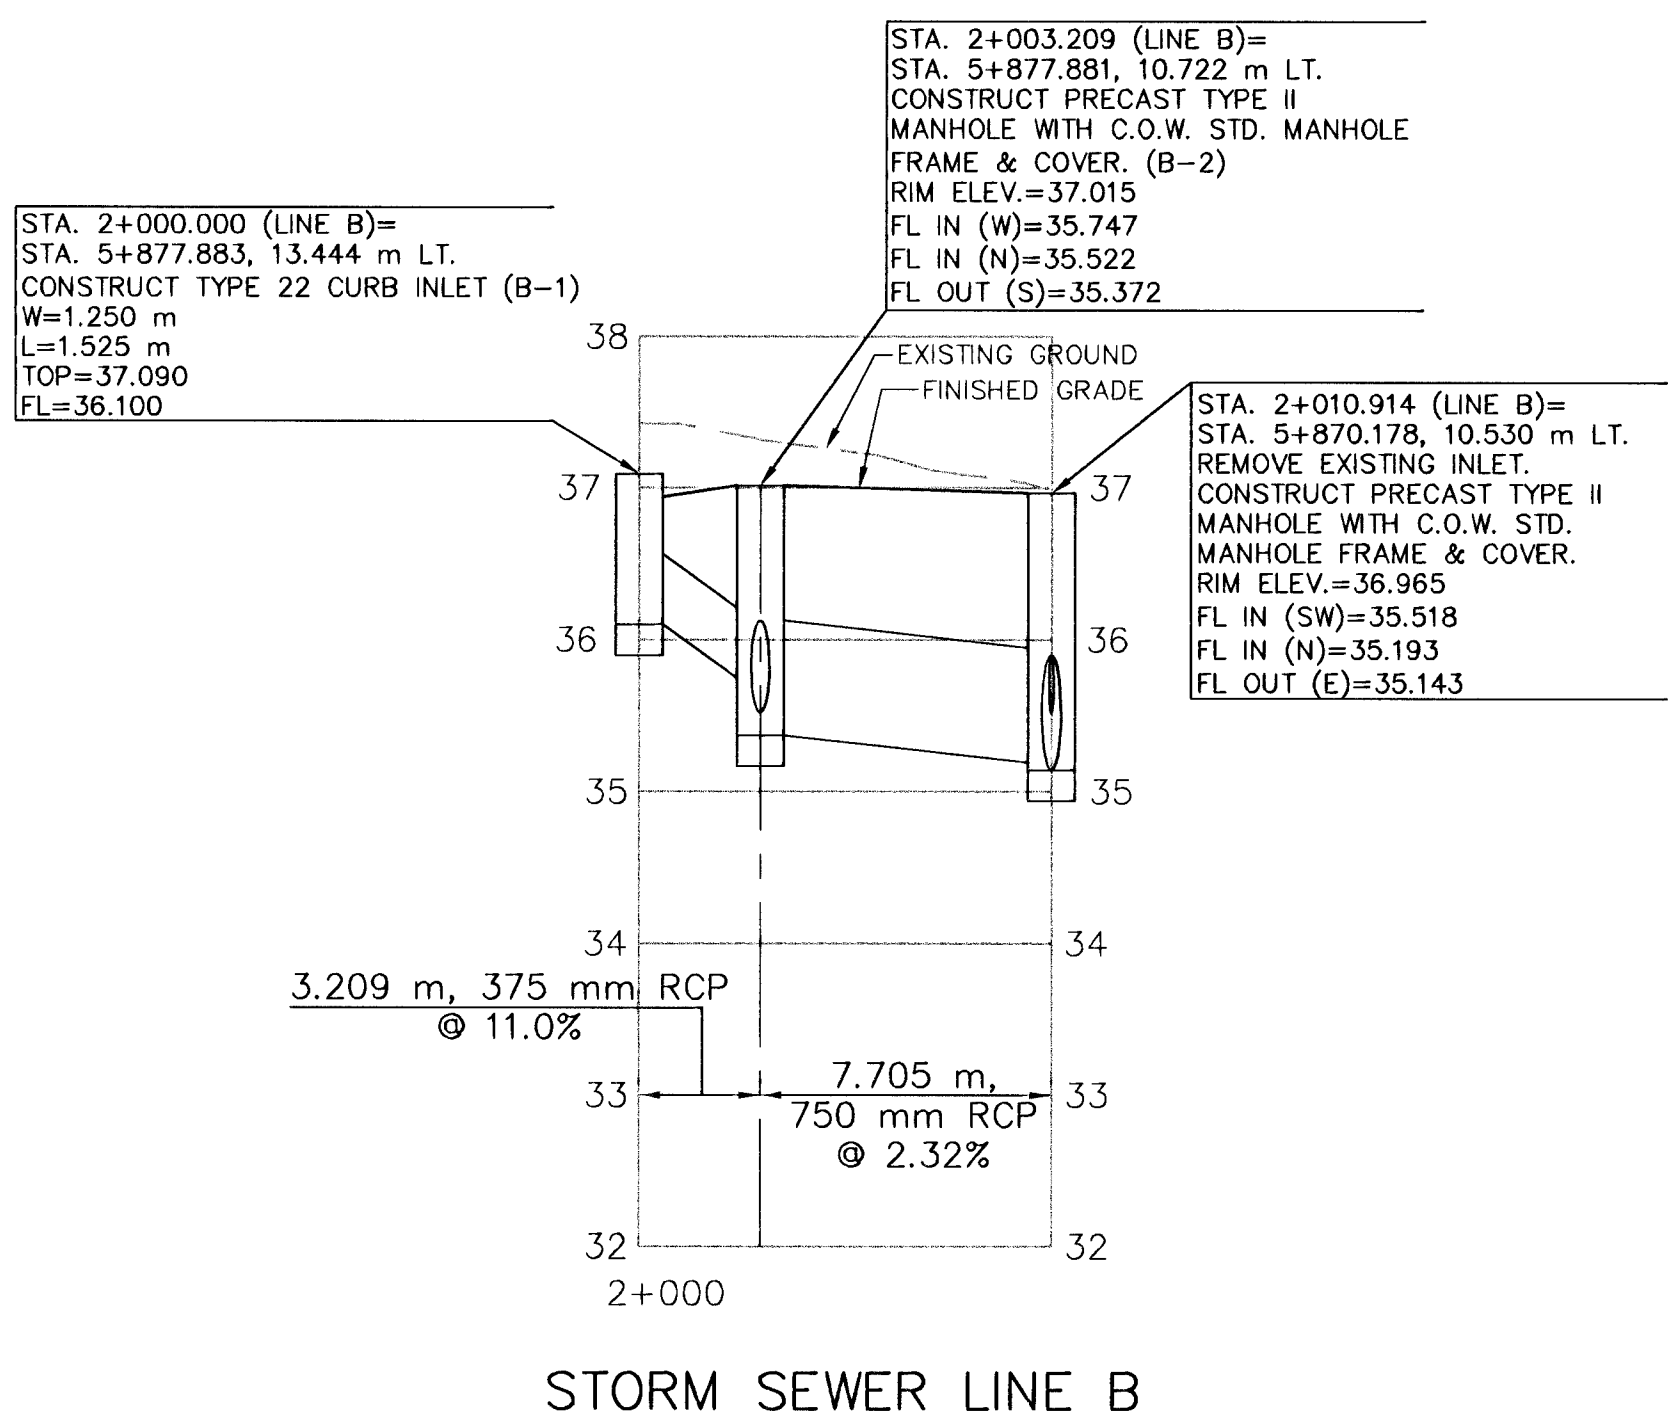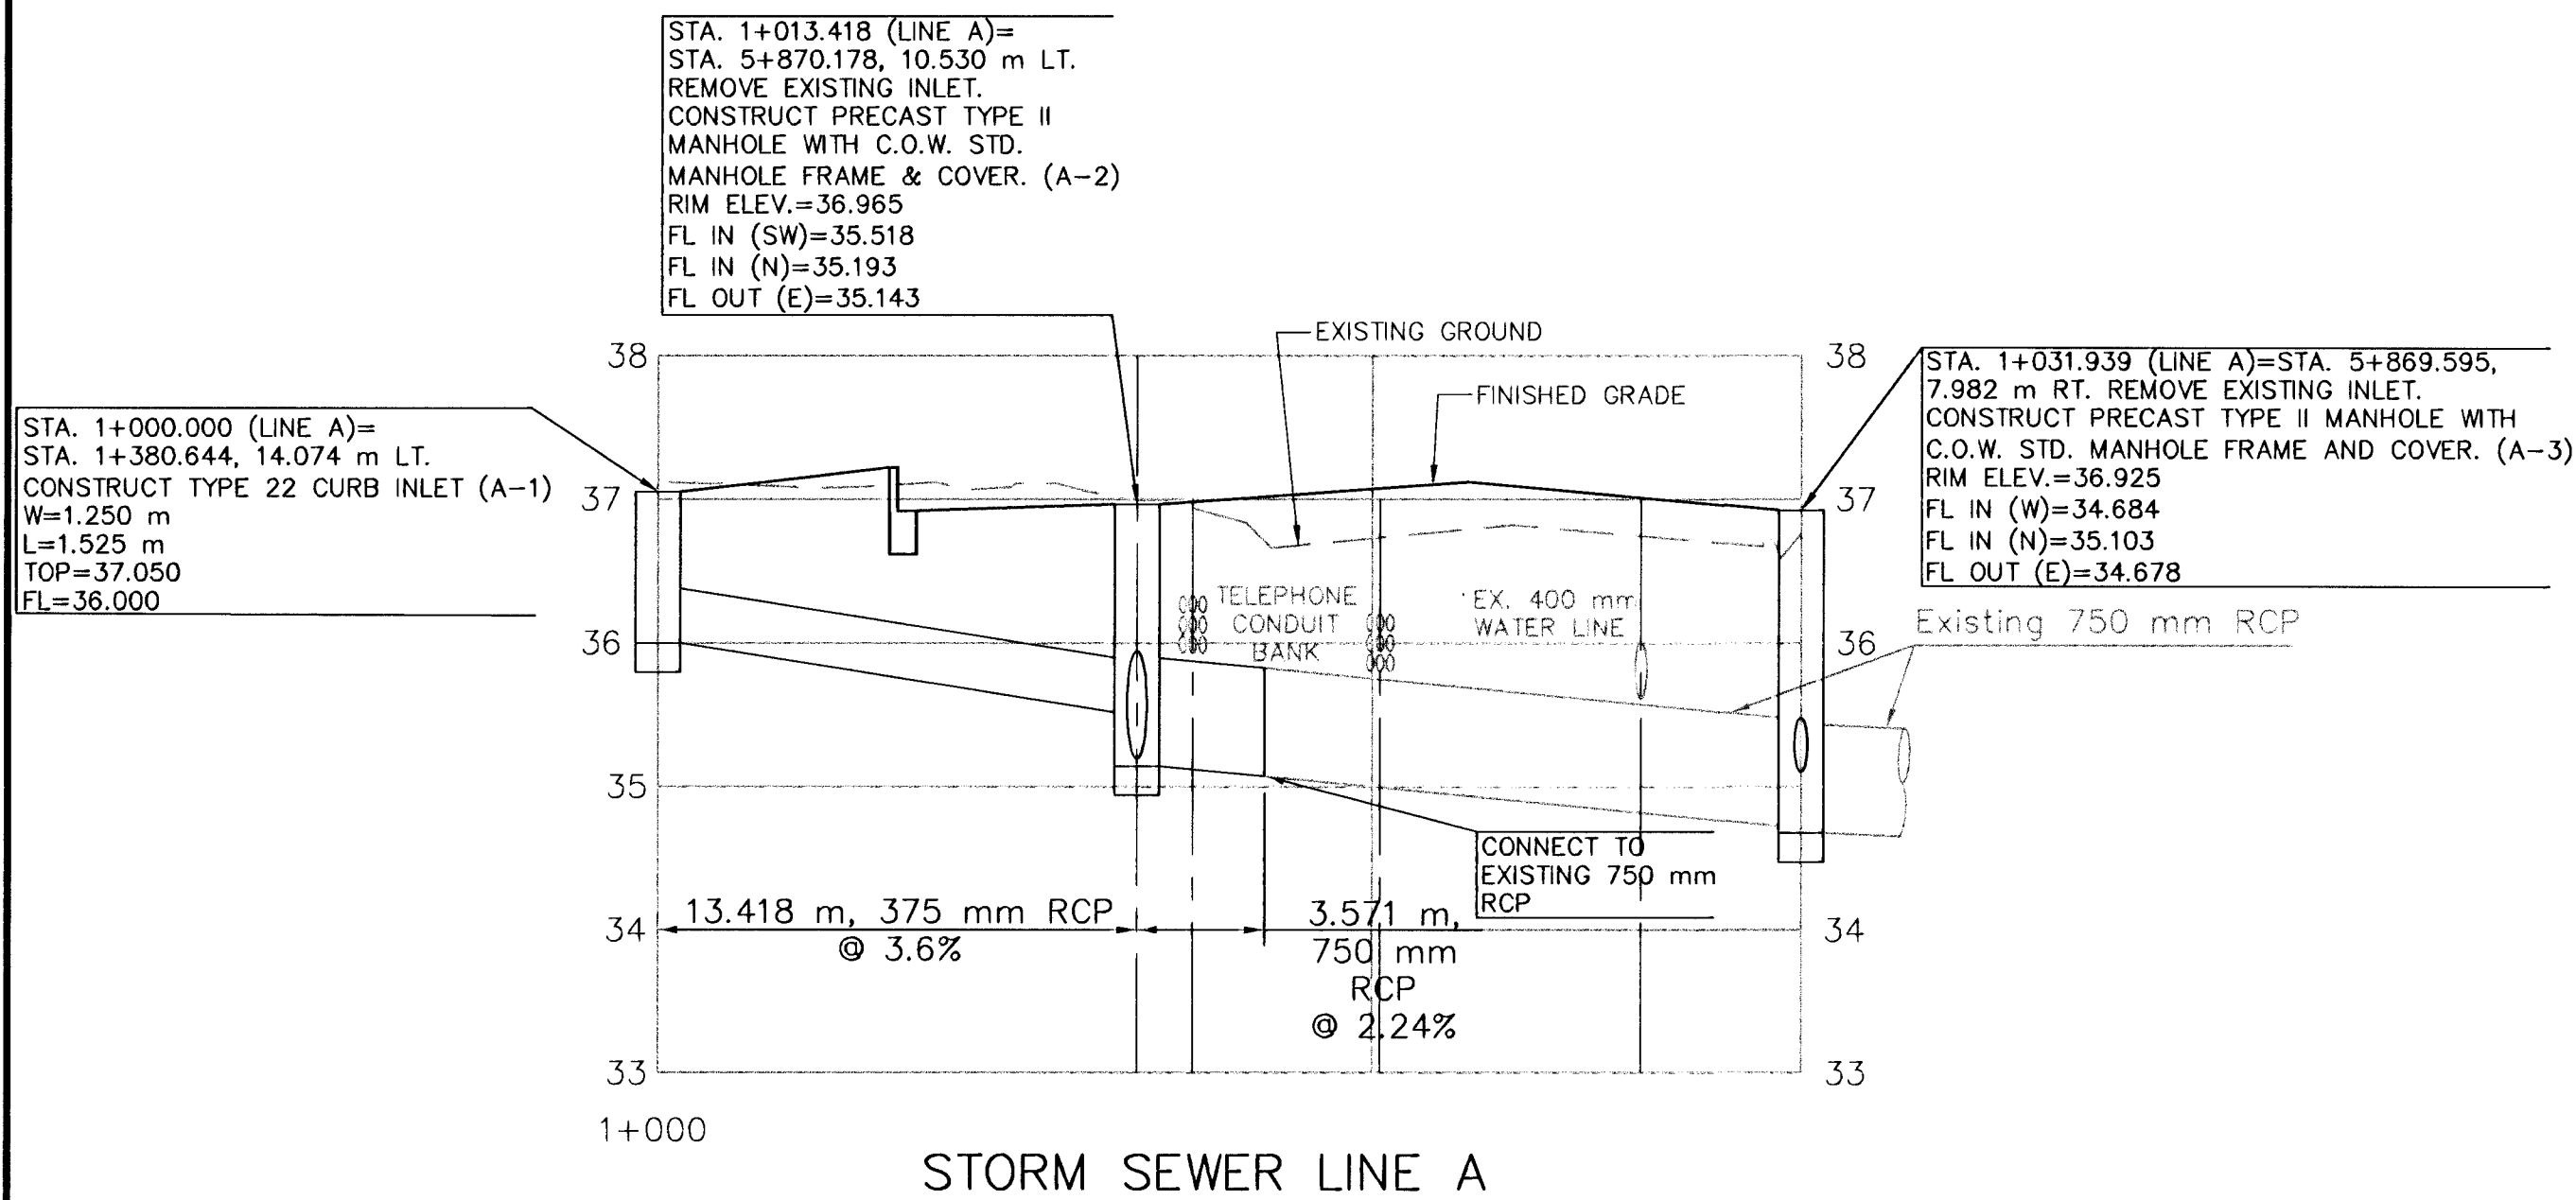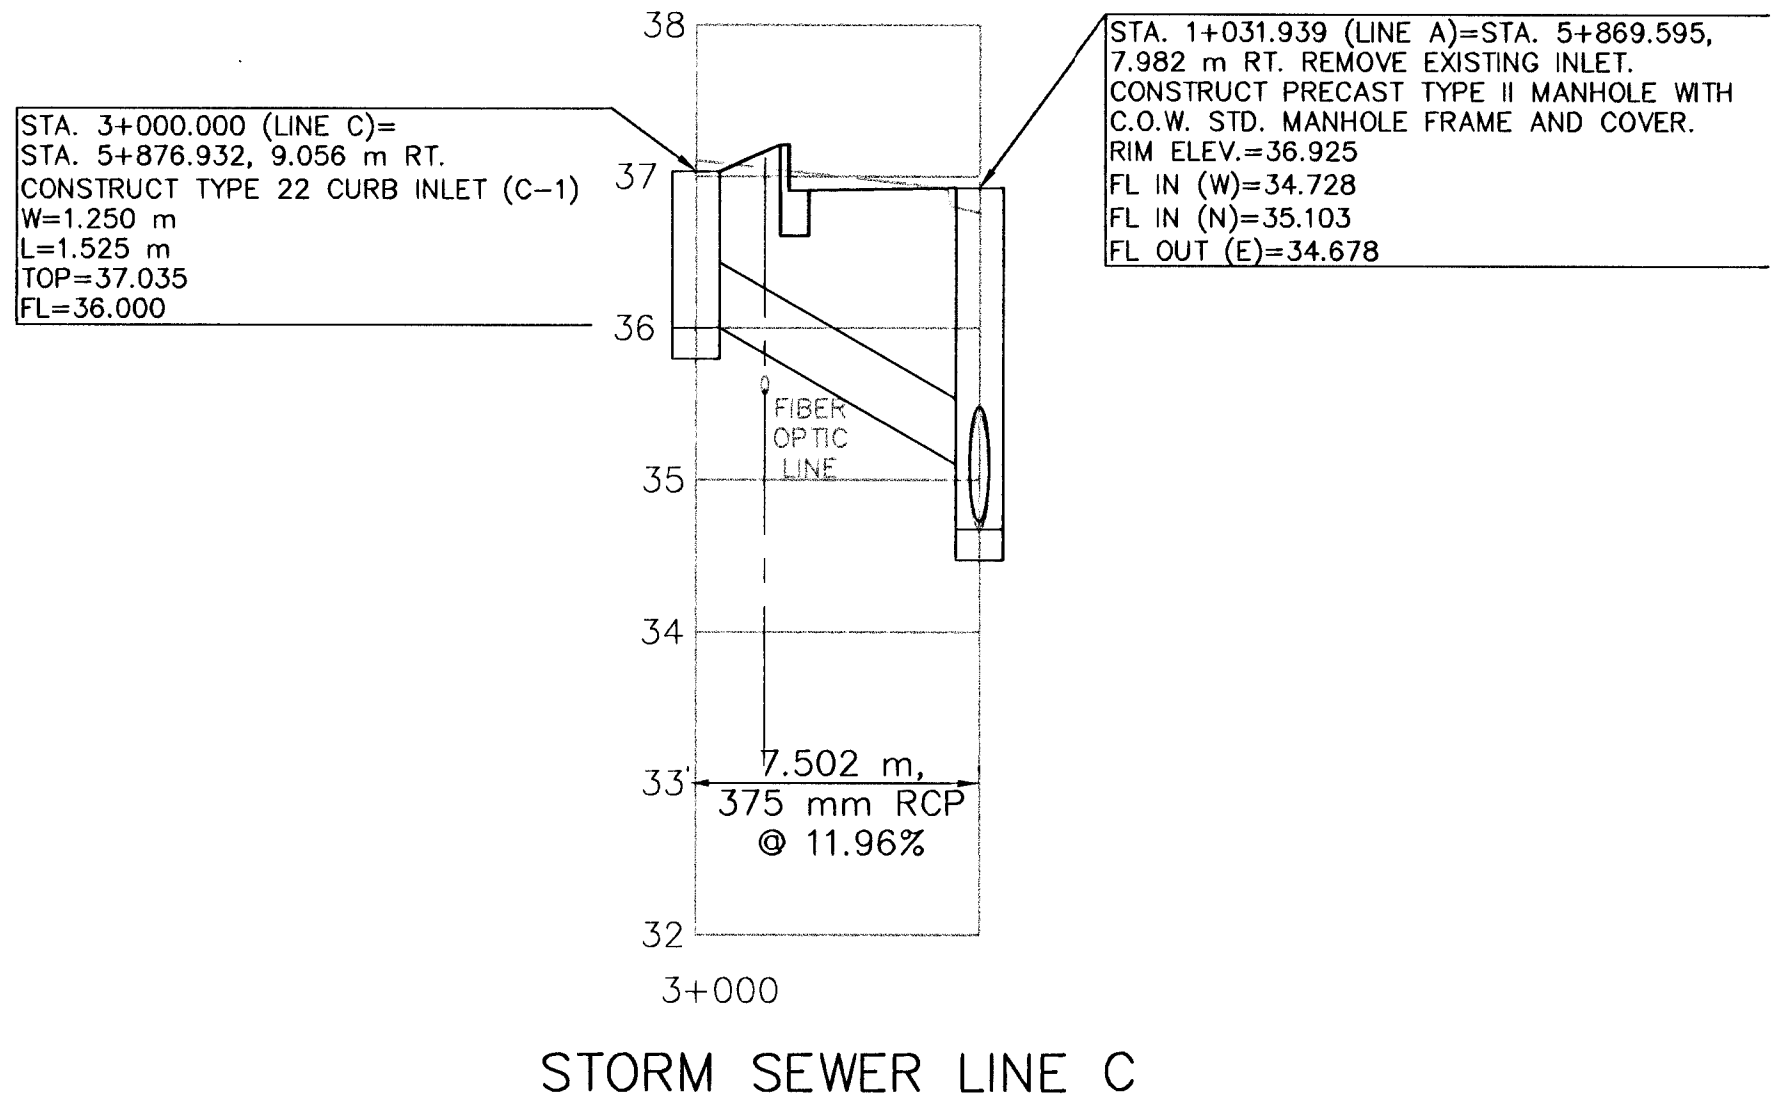

STORM SEWER PLAN & PROFILE

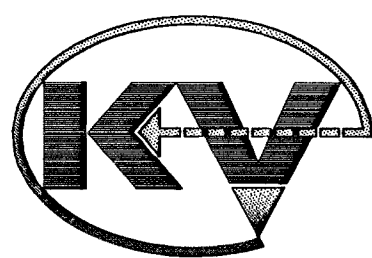

KAW VALLEY ENGINEERING
ENGINEERS AND LAND SURVEYORS
2319 NORTH JACKSON
P.O. BOX 1304
JUNCTION CITY, KANSAS 66441
(785)762-5040 FAX (785)762-7744
E-MAIL jckve@jckve.net

PROJ. NO.
97-1827
DATE
JULY 1999
DESIGNER
KB/SM
DRAWN BY
JO
CHECKED BY
CFN
1827STS
SHEET
8 OF 75