



W.L. Sta. 0+00, Line 1 =
B.L. Sta. 49+55, 76.0' Rt.
Tap Ex. 8" AC Water Main
1 - 8"x 6" Tapping Sleeve
1 - 6" Tapping valve w/valve box
To be furnished & installed by the
City of Wichita.
1 - Reinstall Ex. Fire Hydrant
(L=4.5')
Bury Line Elev. = 74.97
Valve Box Elev. = 74.91

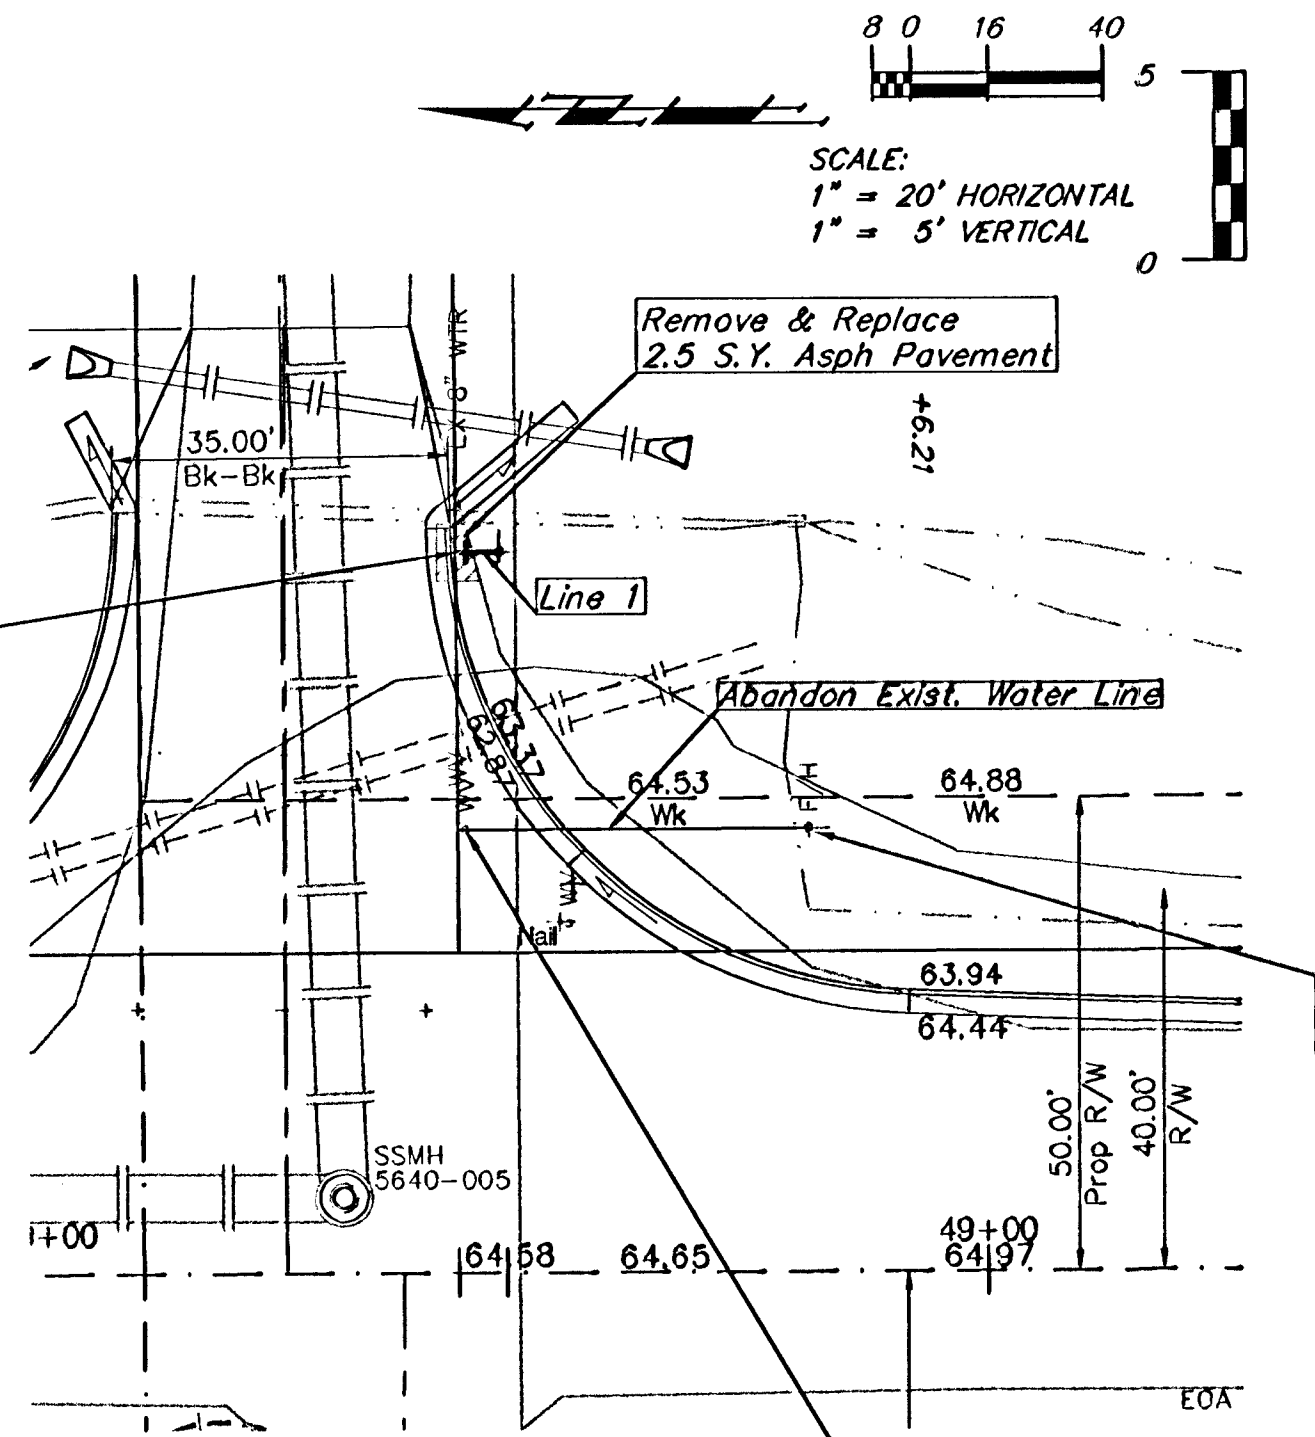


Line 1

W.L. Sta. 0+00, Begin Line 16 =
B.L. Sta. 111+75.5, 30.5' Rt.
1 - 45' CIMJ Bend (rolled)

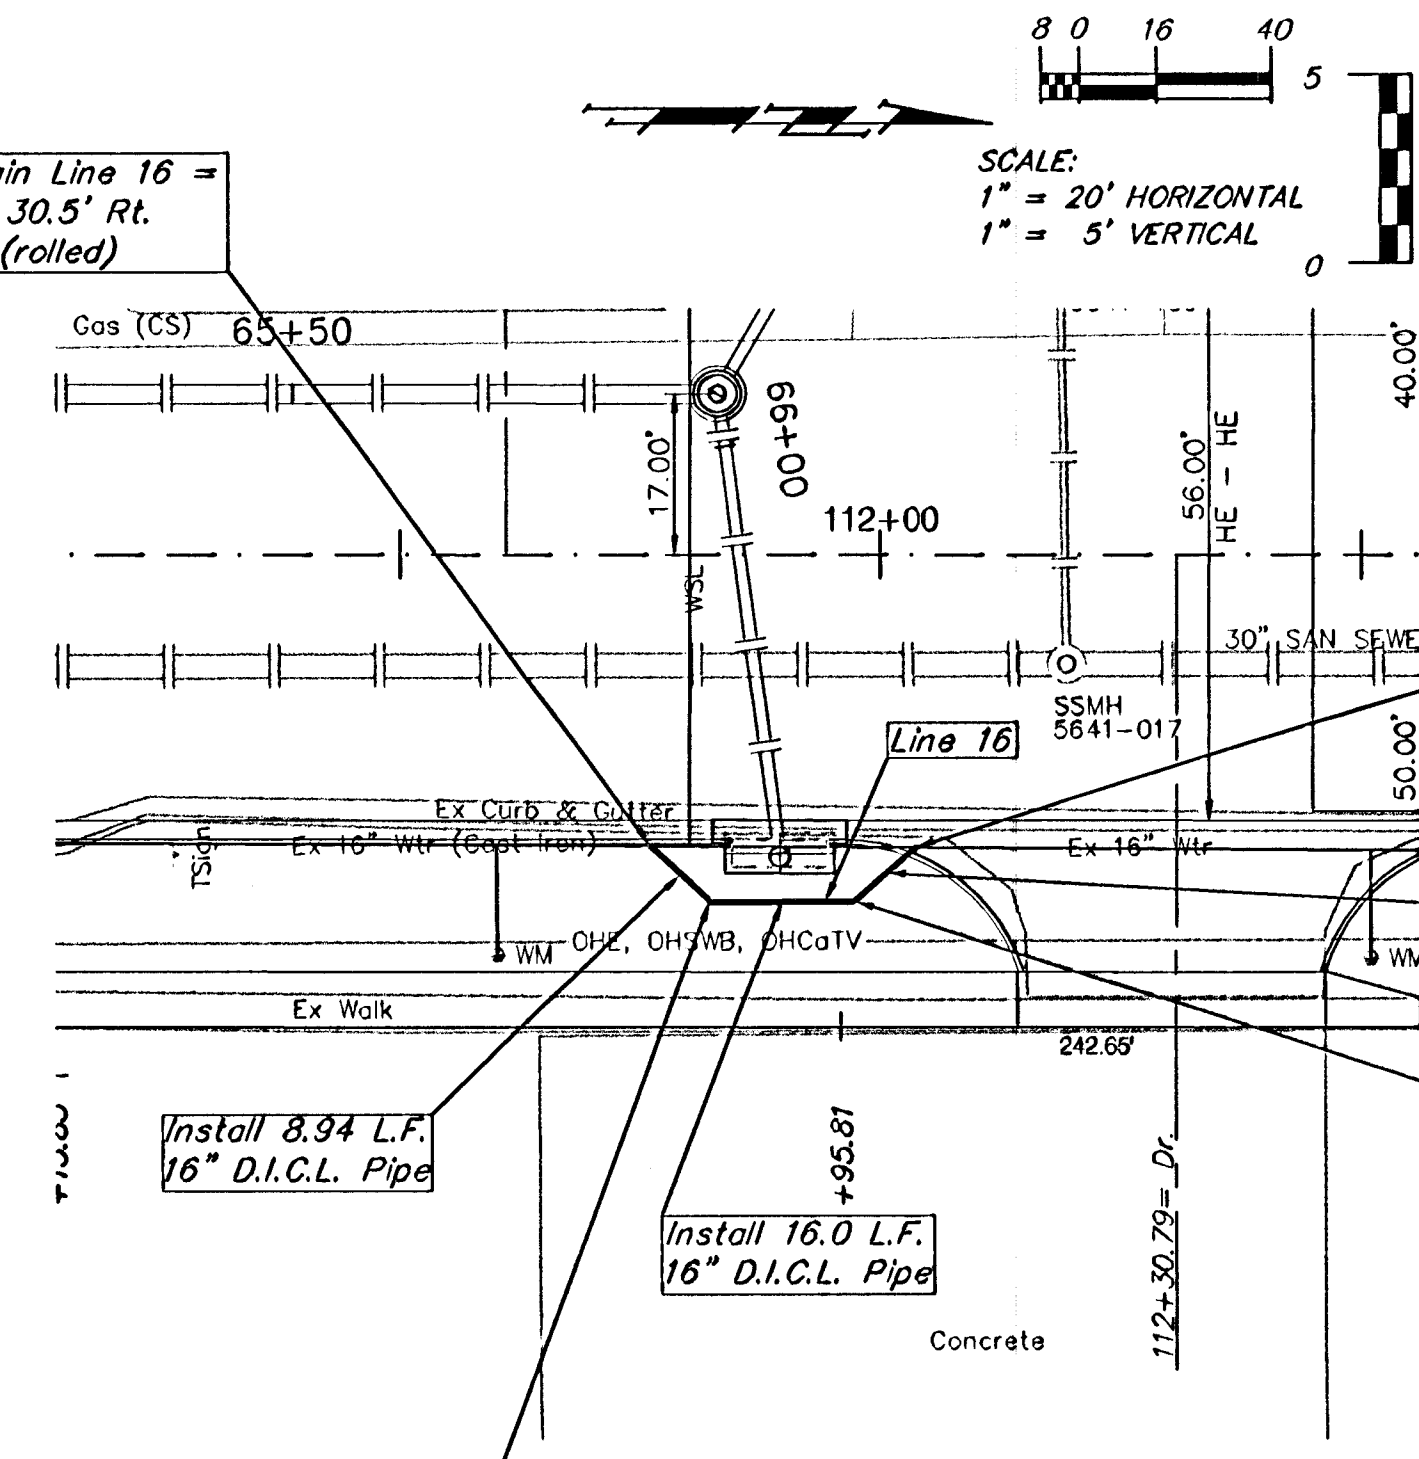

Line 16

W.L. Sta. 0+33.89, Line 16 =
B.L. Sta. 112+04.14, 30.5' Rt.
1 - 45' CIMJ Bend (rolled)

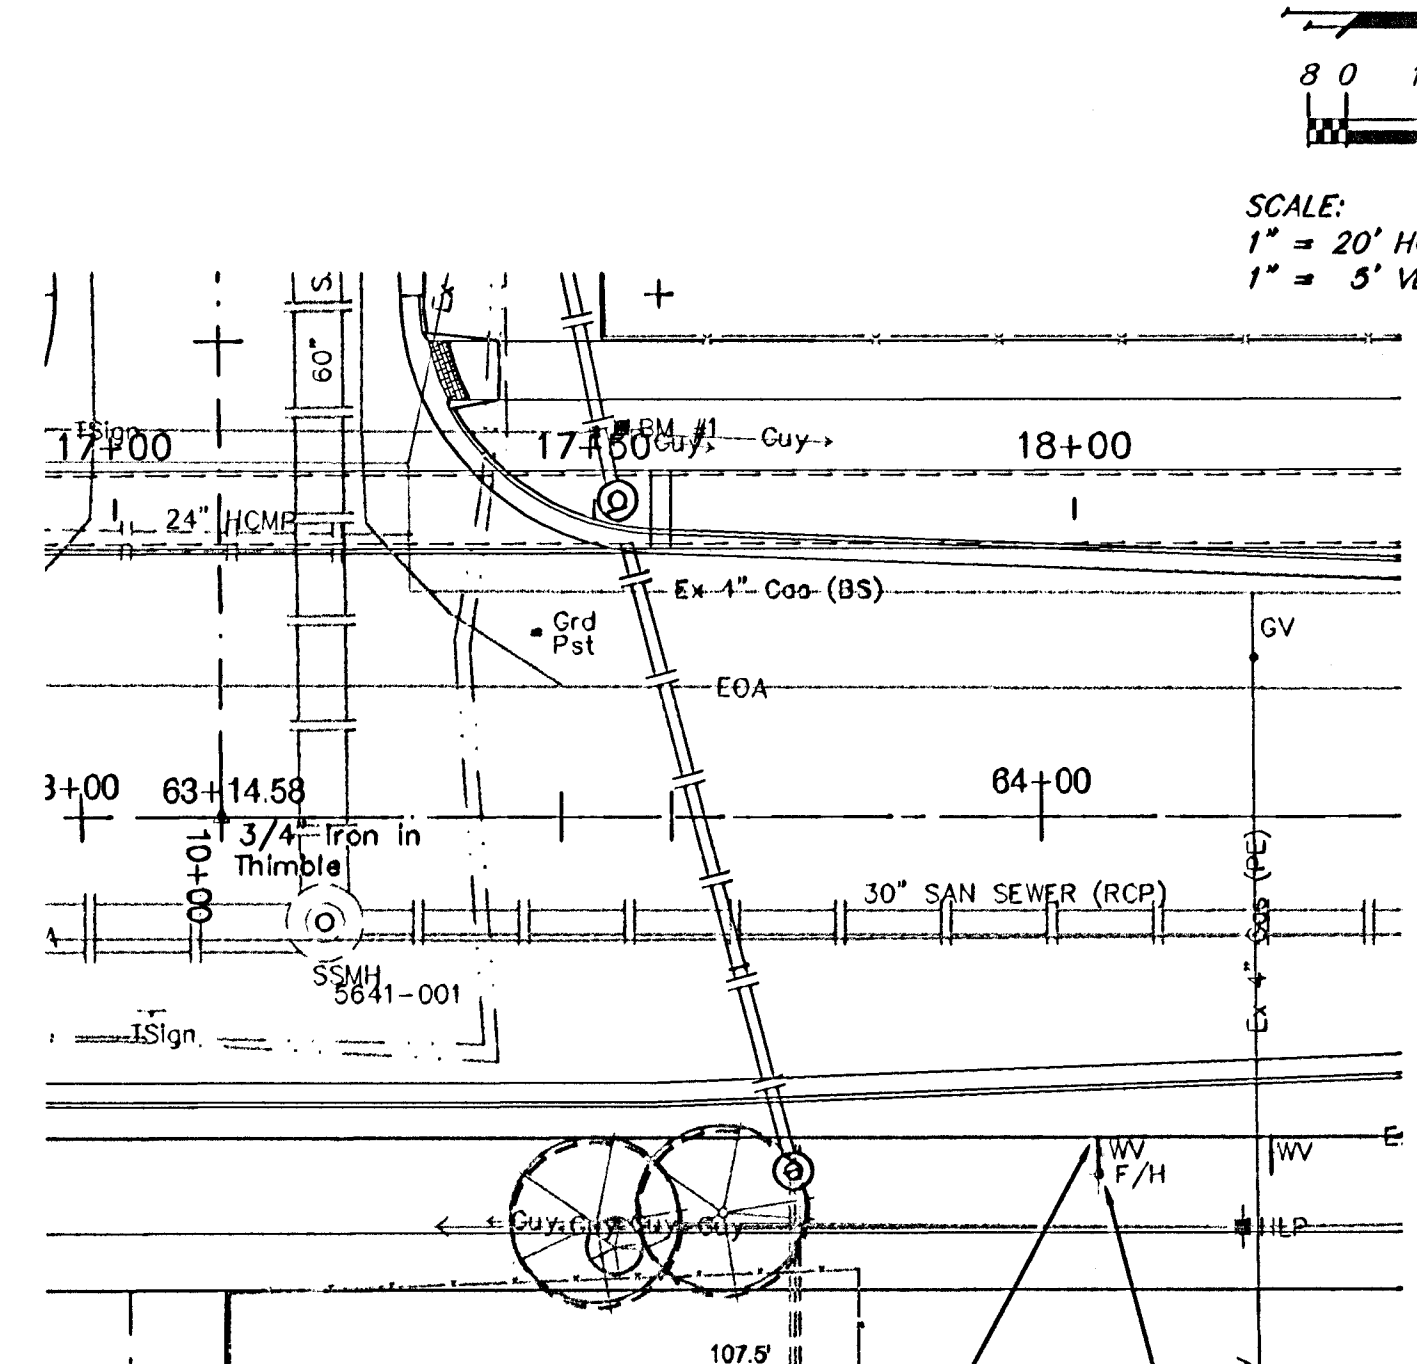

FH 1

B.L. Sta. 64+05.5, 38' Rt.
Adjust Exist. Fire Hydrant
New Bury Line Elev. = 79.71

Note:
Trees/Shrubs to be
removed are marked thus:

Note:
Pavement, Sidewalks, and
Etc. To Be Removed Are
Indicated By:

80	80	90	90
75	75	85	85
70	70	80	80
65	65	75	75
60	60	70	70