



Note:
 If the Tap at Sta. 0+00 Cannot be made out to other utilities, the contractor will cut in a Tee and Anchor Valve.

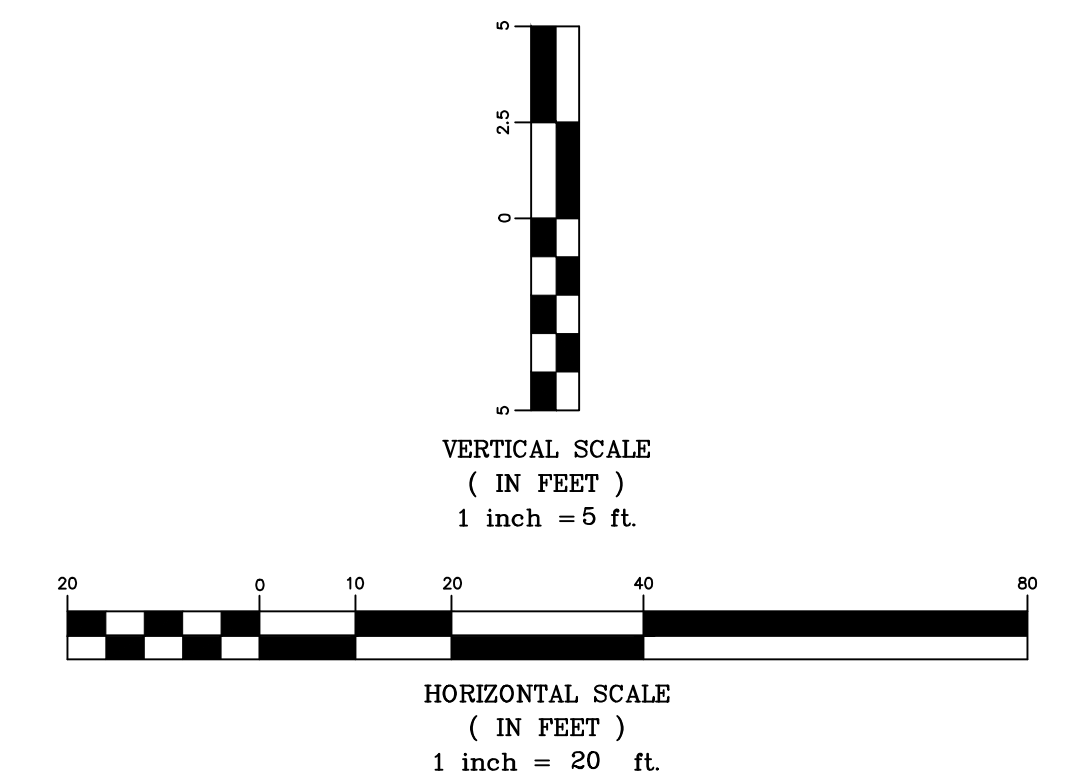

DATE: 12.28.2018
 THIS SHEET HAS BEEN SIGNED, SEALED AND DATED ELECTRONICALLY

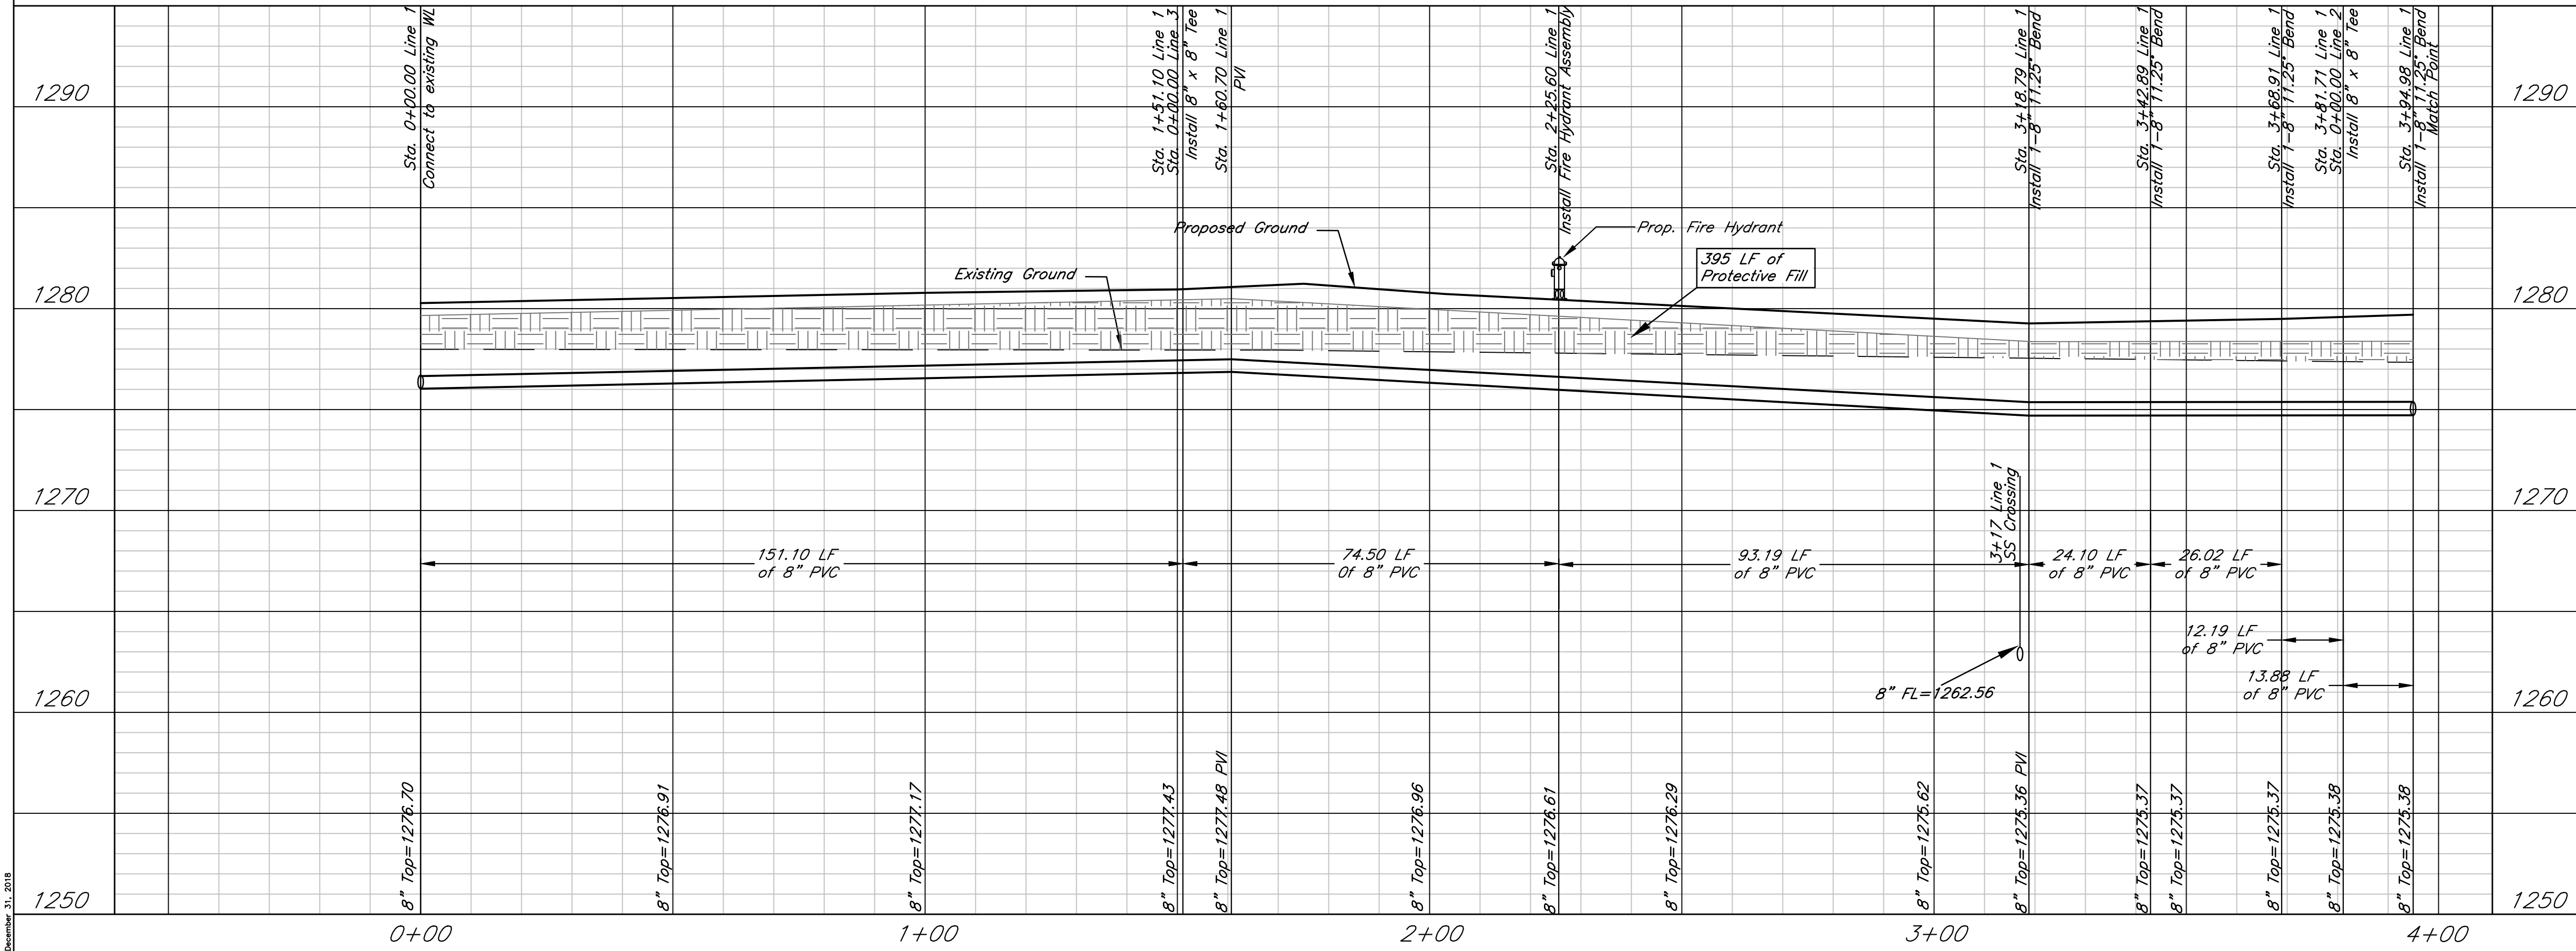

Fox Run Addition
 Water - Line 1
 Wichita, Kansas

	PROJECT NUMBER			
	KEM NO. 17063	FILE	DATE 07/2018	SHEET 3.0
DESIGN KM	DRAWN BJ	REVISED		

December 31, 2018