




NOTE: THE POND BOTTOM AND SIDES, UP TO THE STATIC POOL, ARE TO BE SCARIFIED A MINIMUM OF 8 INCHES, MOISTURE CONDITIONED AND RECOMPACTED TO A MINIMUM OF 95 PERCENT OF STANDARD PROCTOR DENSITY (ASTM D-698) FROM MINUS 3 TO PLUS 3 PERCENT OF OPTIMUM MOISTURE CONTENT. ADDITIONALLY, ALL GYPSUM/CALICHE SEAMS, SANDY CLAY AND CLAY SHALE ENCOUNTERED SHOULD BE OVER-EXCAVATED A MINIMUM OF 1 FOOT AND REPLACED WITH CLAY. THE MATERIAL USED TO LINE THE PONDS SHALL HAVE A MINIMUM PI OF 30, WHETHER EXISTING OR PLACED.

THE PLAZA AT CHERRY CREEK HILLS
POND PLAN
WICHITA, KANSAS

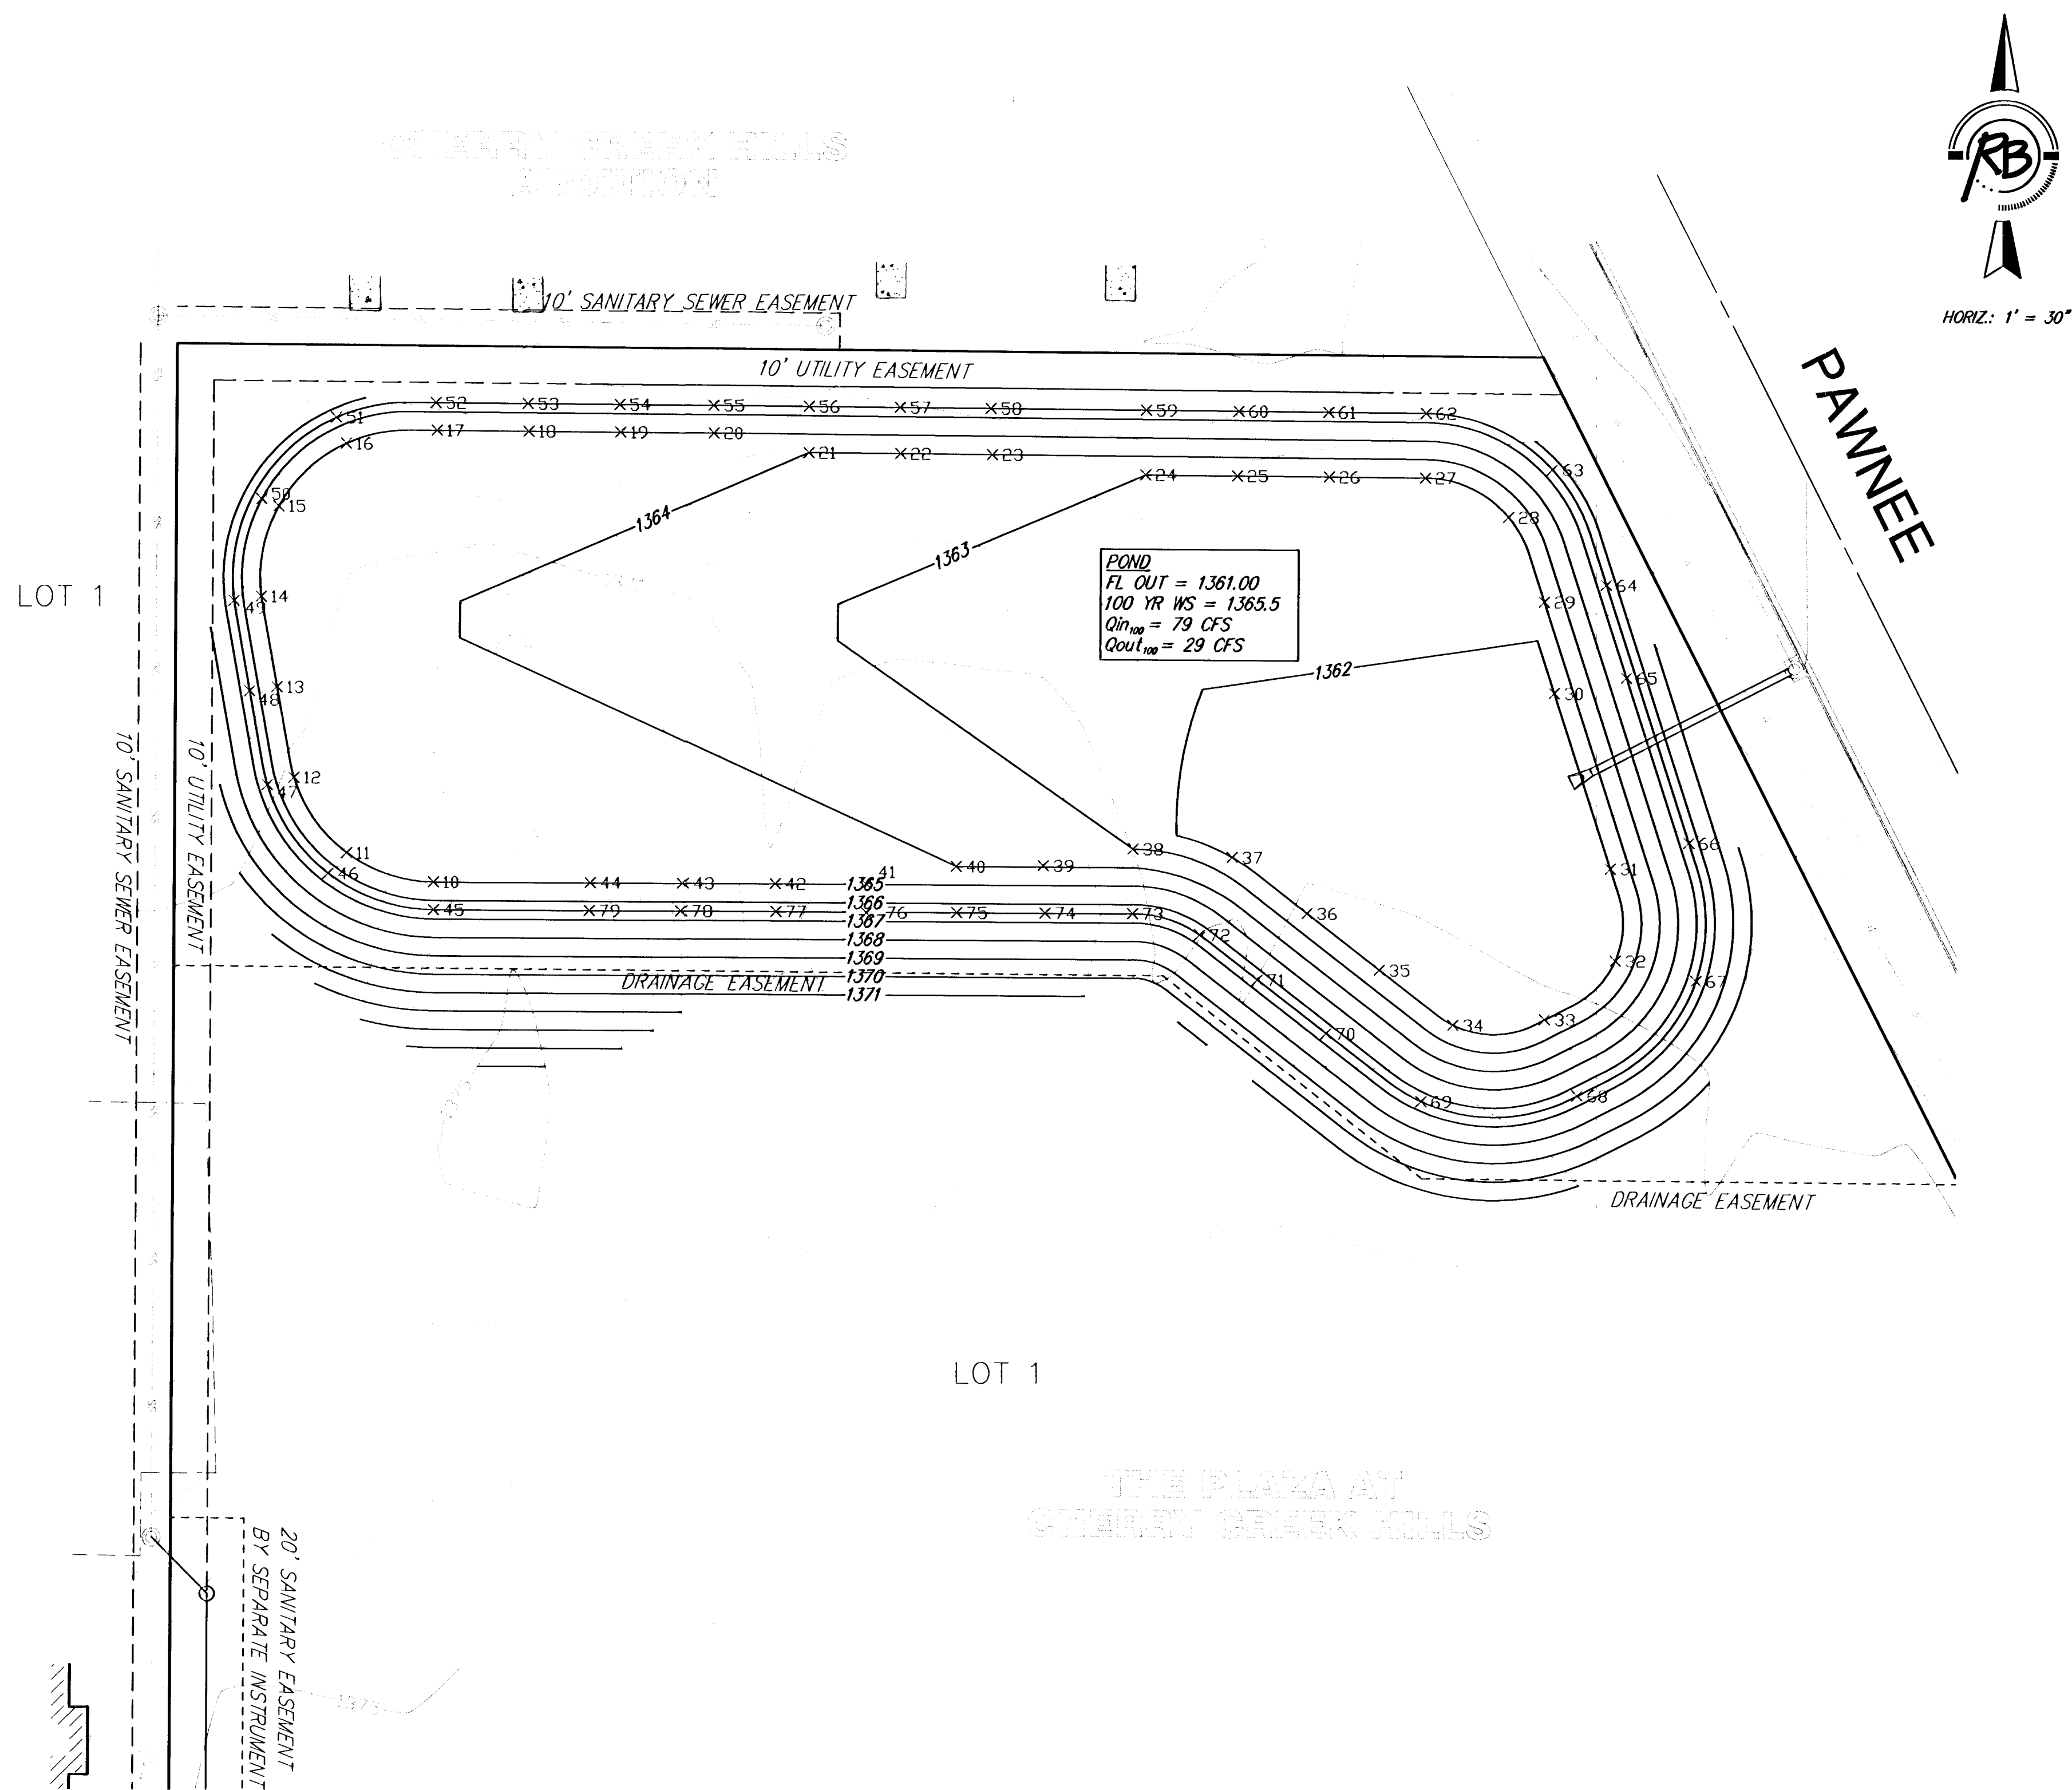

RUGGLES & BOHM, P.A.

Engineering, Surveying, Land Planning

924 North Main
Wichita, Kansas 67203
www.rbkansas.com

(316) 264-8008
(316) 264-4621 fax
E-mail: info@rbkansas.com

DESIGN	AML
DRAWN	AML
REVIEW	
UTILITY	

DRAWING FILE
ENGG BASE {POND}

PROJECT NUMBER

DATE
Oct. 11, 2004

DESIGN AML || DRAWN | AML |
| REVIEW | |
| UTILITY | |

3

OF

9