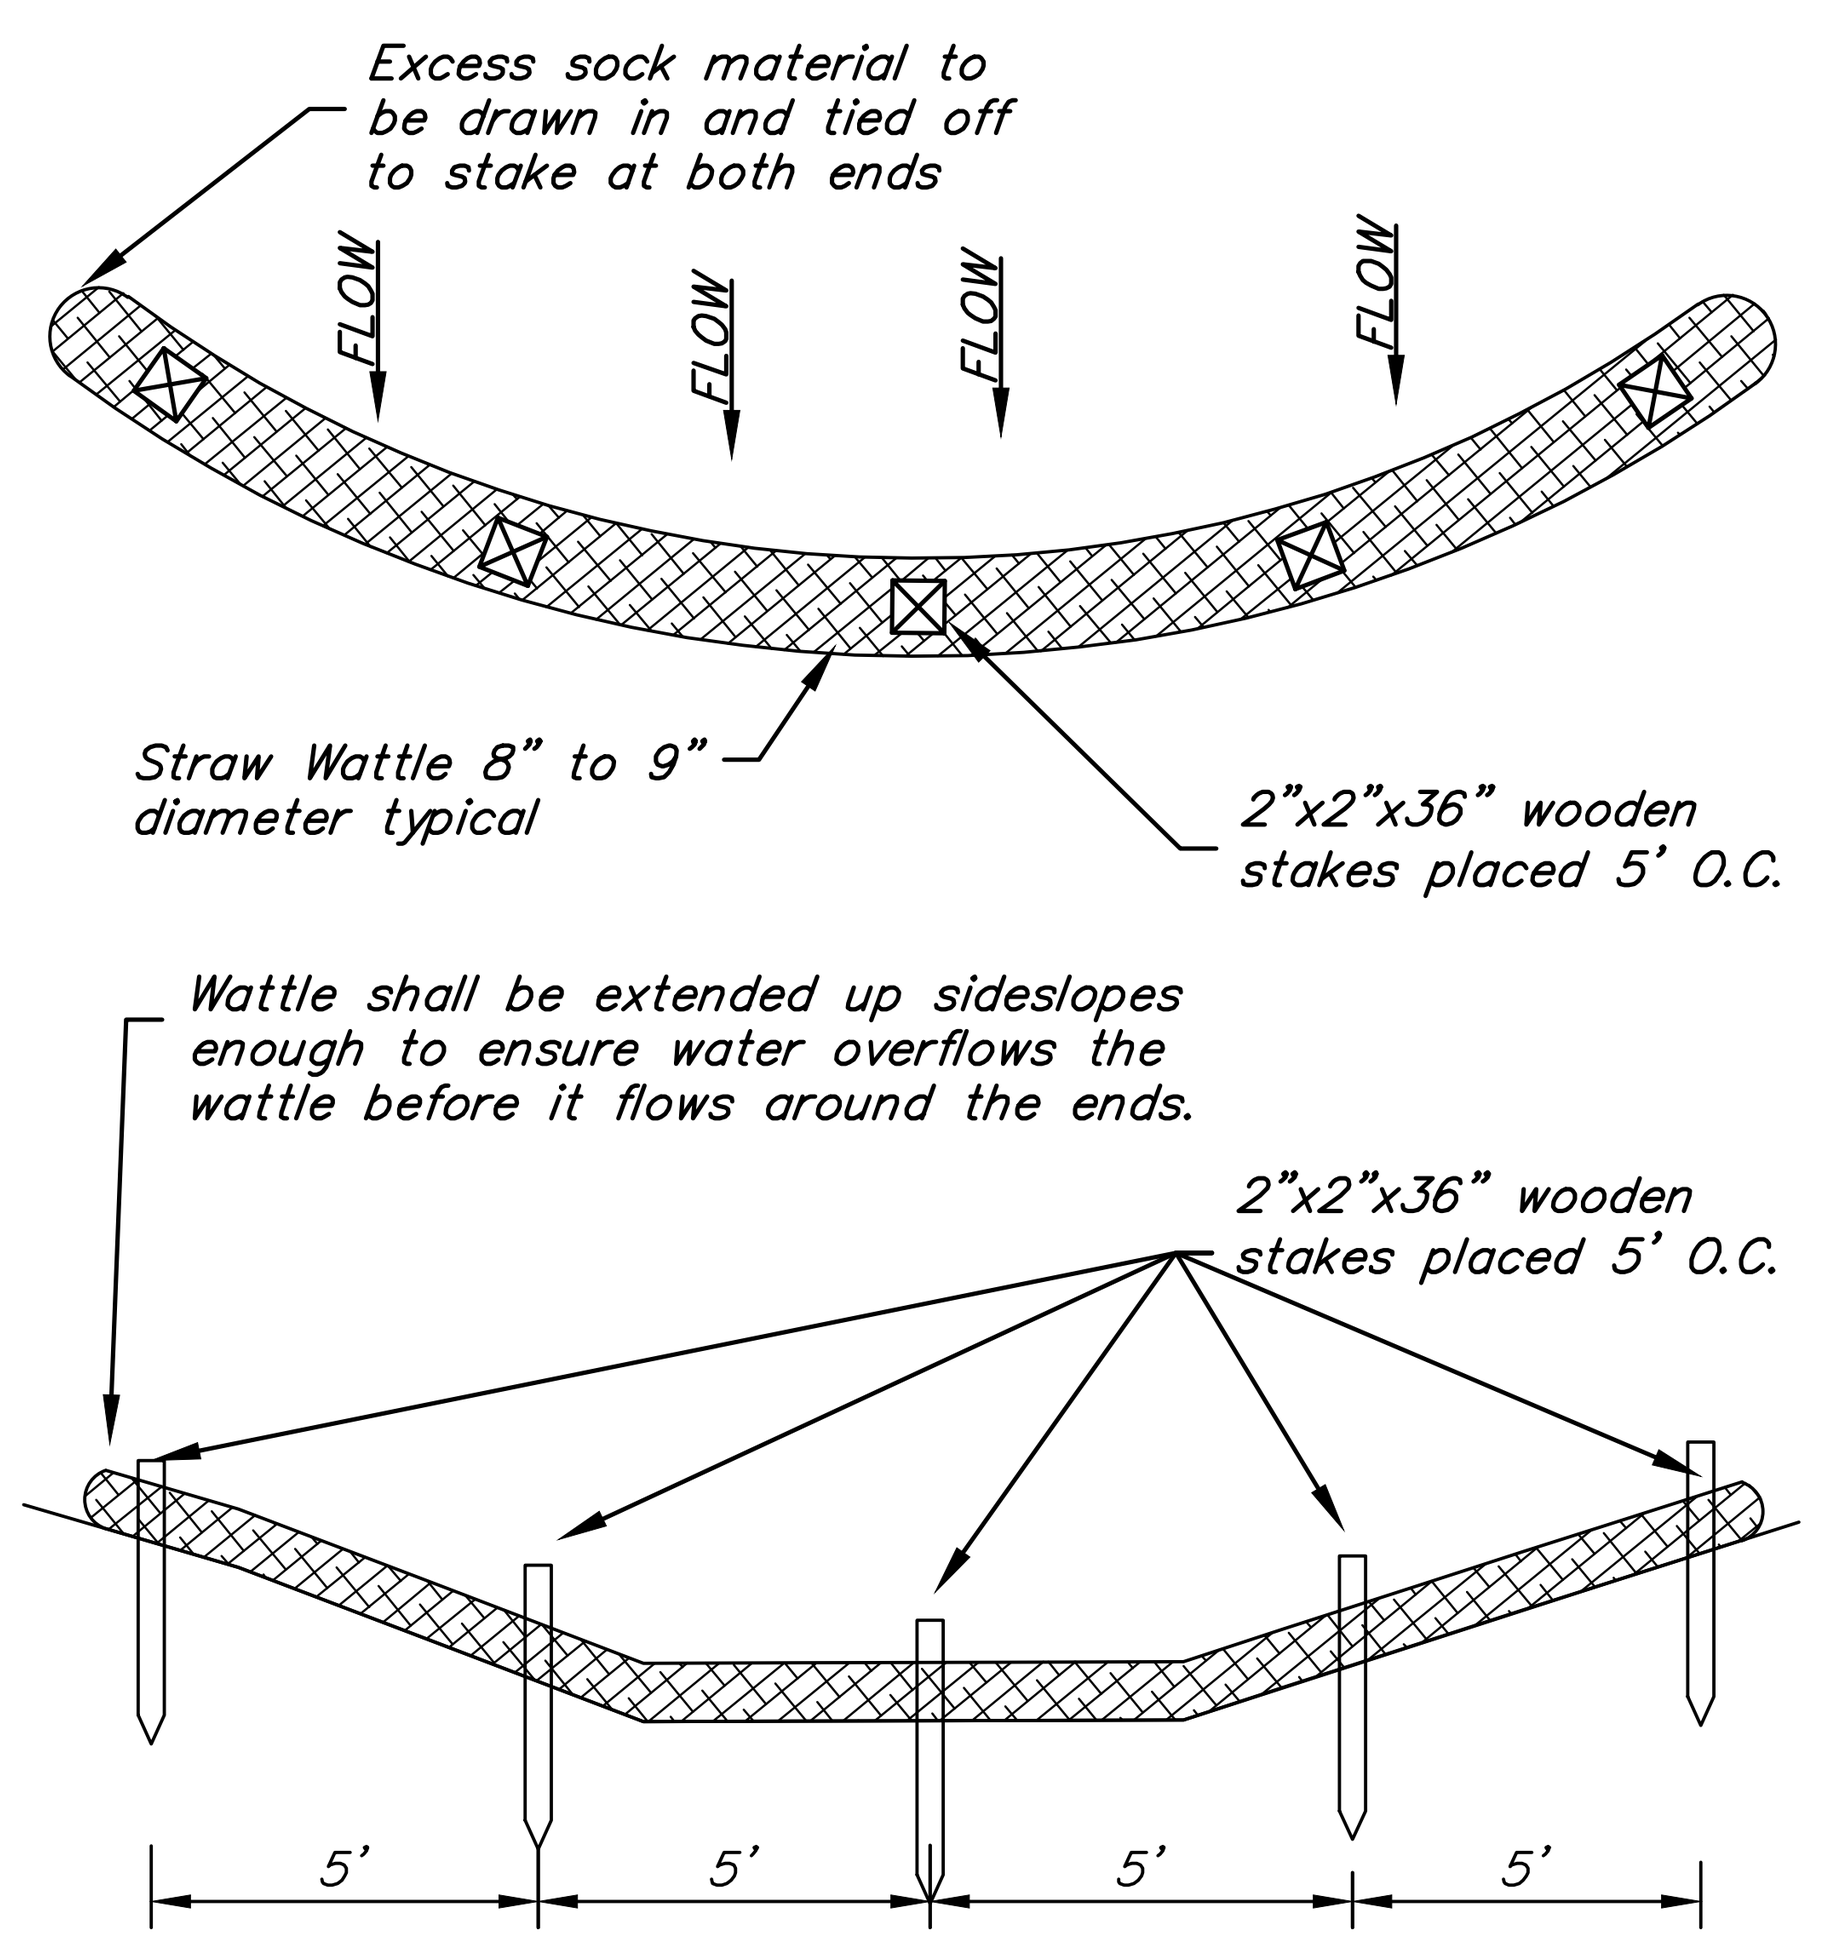

STRAW WATTLE DITCH CHECK DETAIL

NOTES:
1. All material to meet manufacturer specifications.
2. Ditch Check should be used in areas that drain 10 acres or less.
3. Sediment should be removed from behind check dam once the accumulated height has reached ½ height of the check dam.
4. Check dam can be direct seeded at the time of installation.
5. See Sheet X for spacing requirements.

TEMPORARY TYPICAL DITCH SECTION
NOT TO SCALE

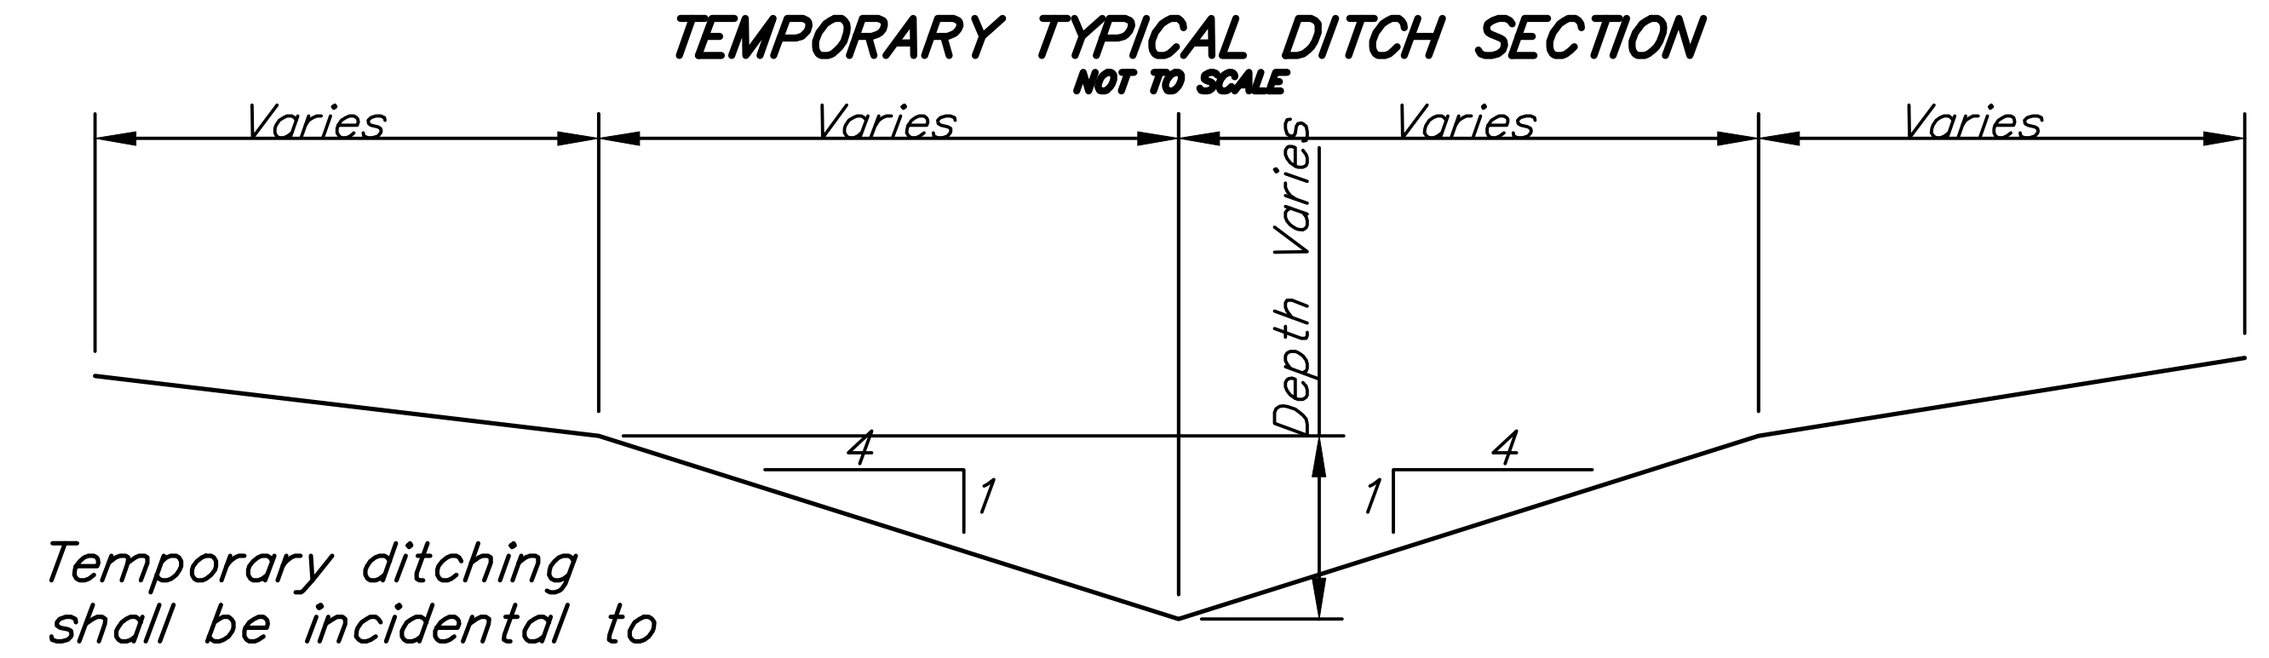

Temporary ditching shall be incidental to lump sum bid item "Mass Grading".

Ditch Checks

Temporary Ditch

Area to be graded

---1385--- Existing Grade

60 0 60

Scale: 1"=60'

Earthwork shall NOT be stockpiled. Excess material shall be used to fill lots as indicated on this sheet up to, but not above, the grades indicated. Front lot corners shall be set at 0.5' above top of curb grades. Fill shall be compacted to same specifications as area included in Mass Grading Plan. Lots shall be filled starting from the west going east. No areas on this sheet shall be excavated, except for temporary ditches needed to relieve drainage issues, if any (incidental to "Mass Grading"). No areas within the street R/W or around existing structures or trees shall be graded at this time, except to promote positive drainage to temporary ditching.

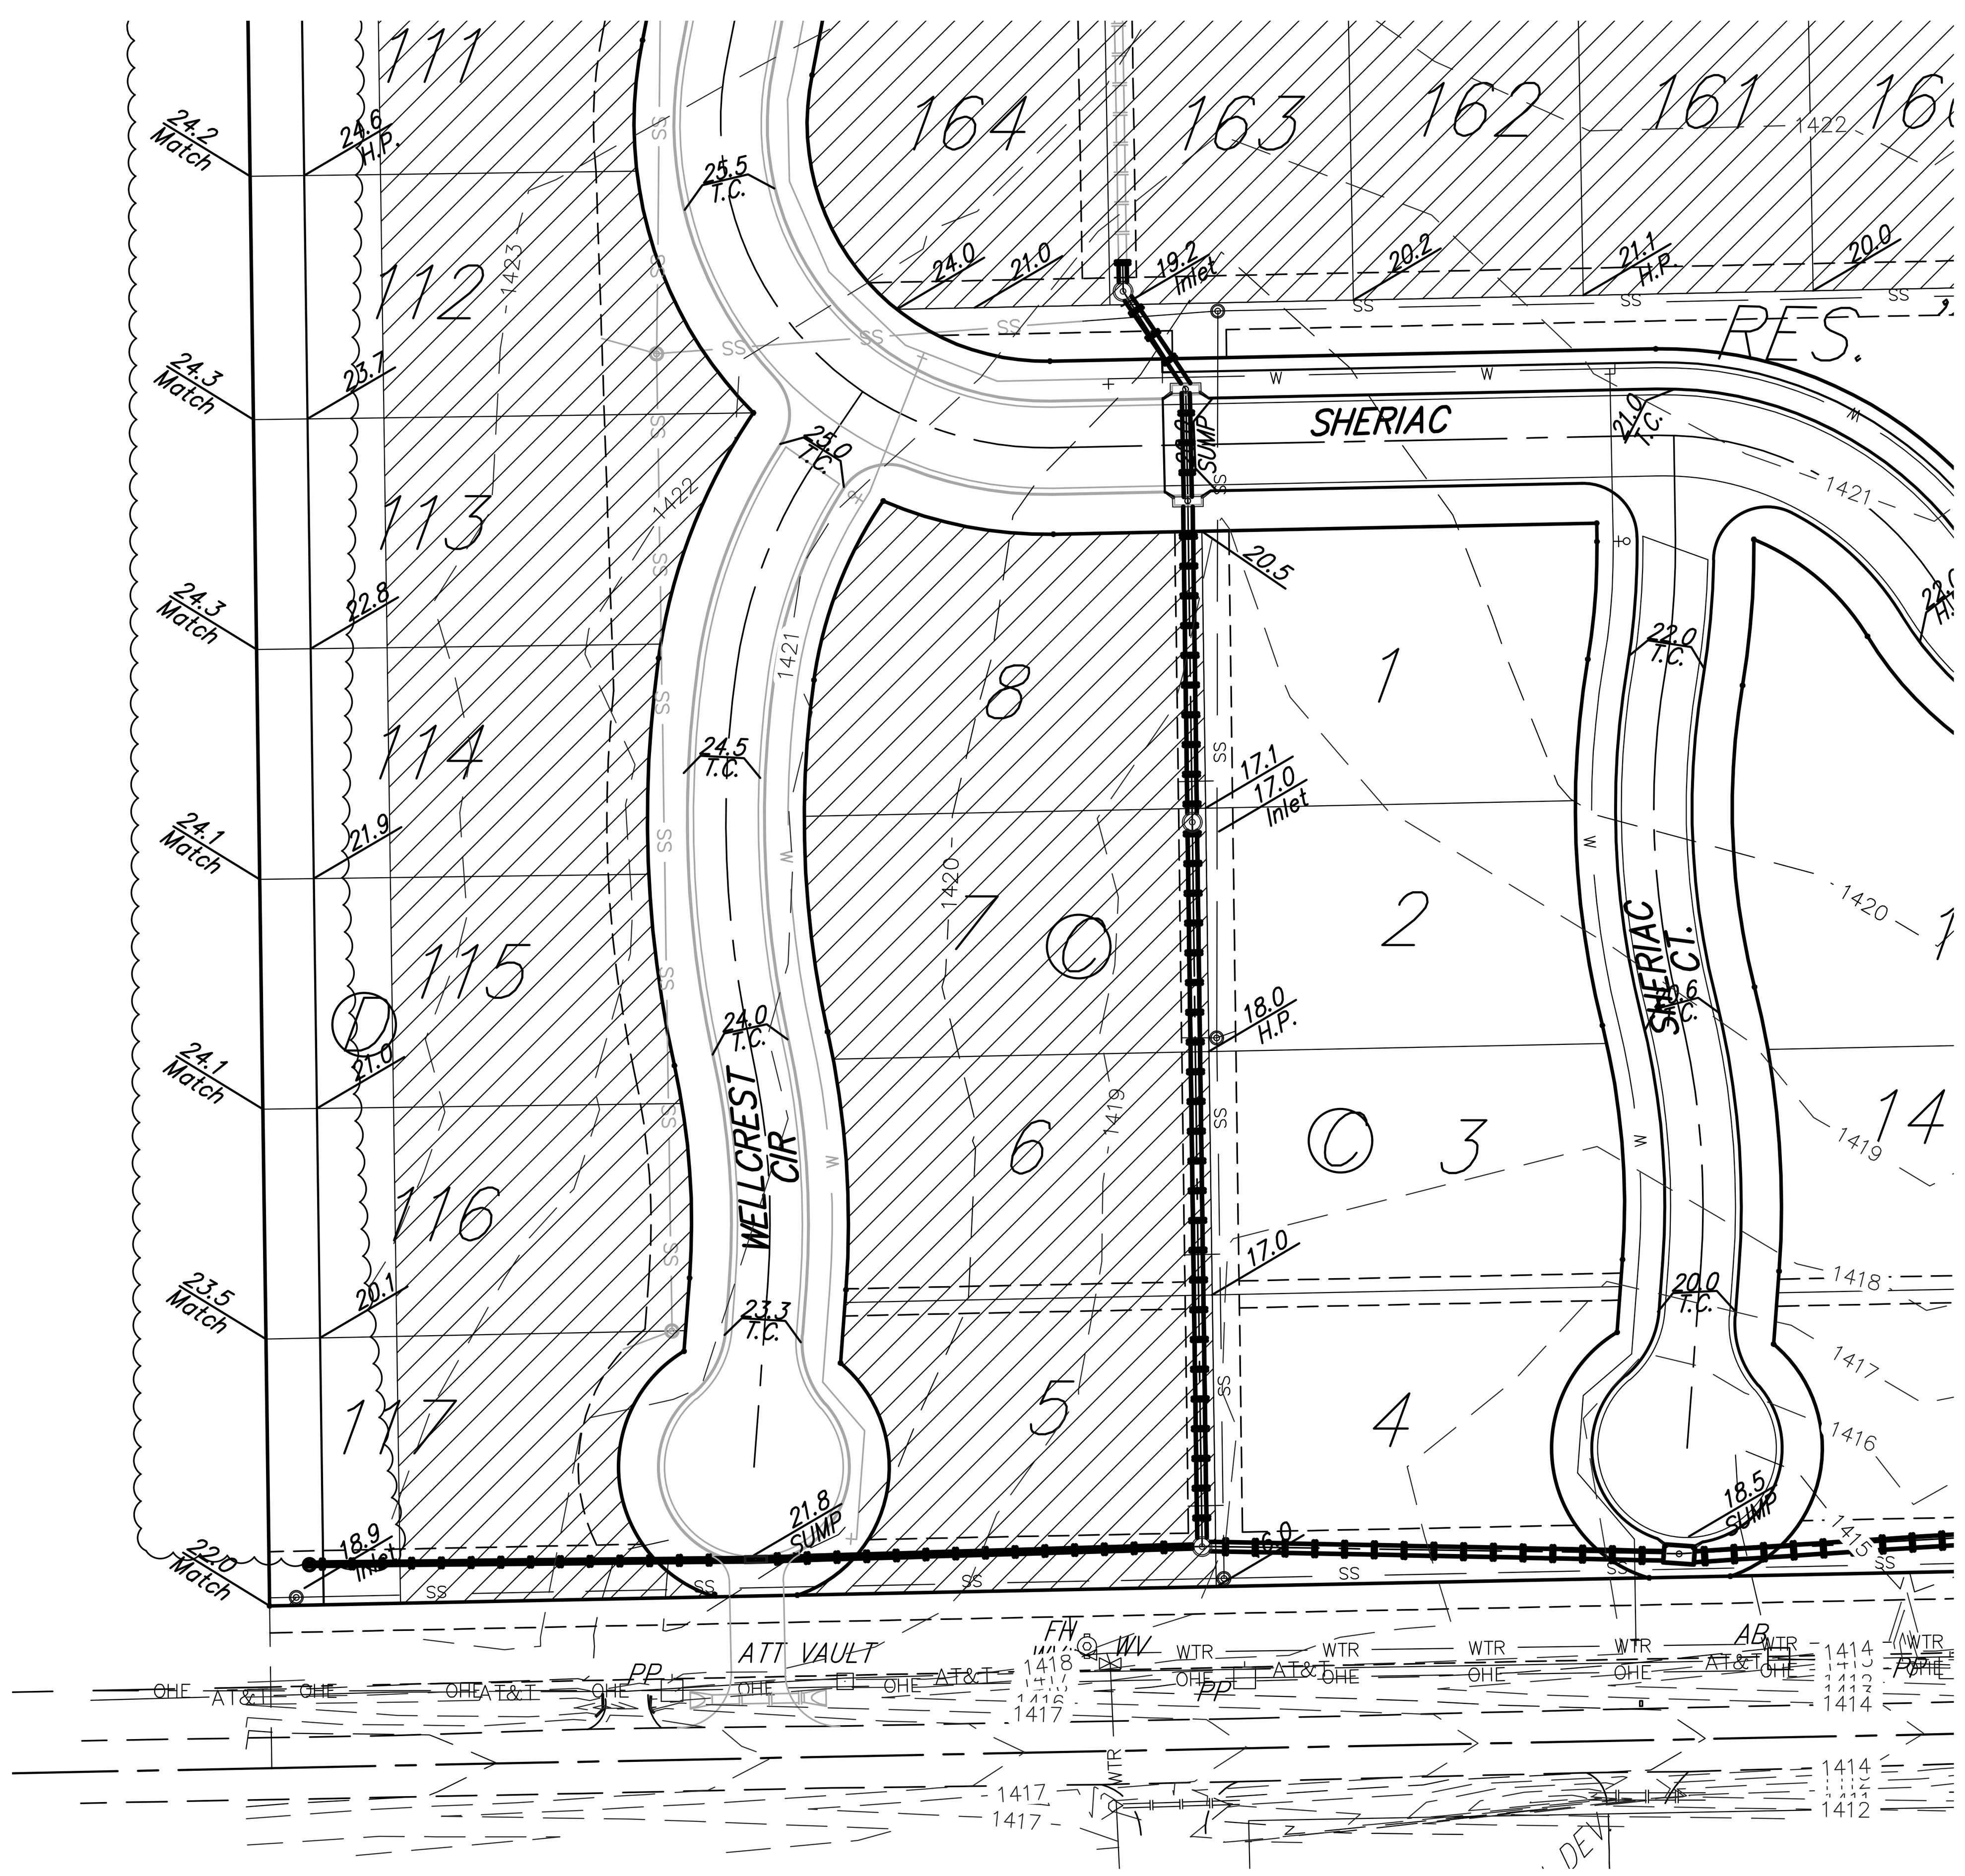

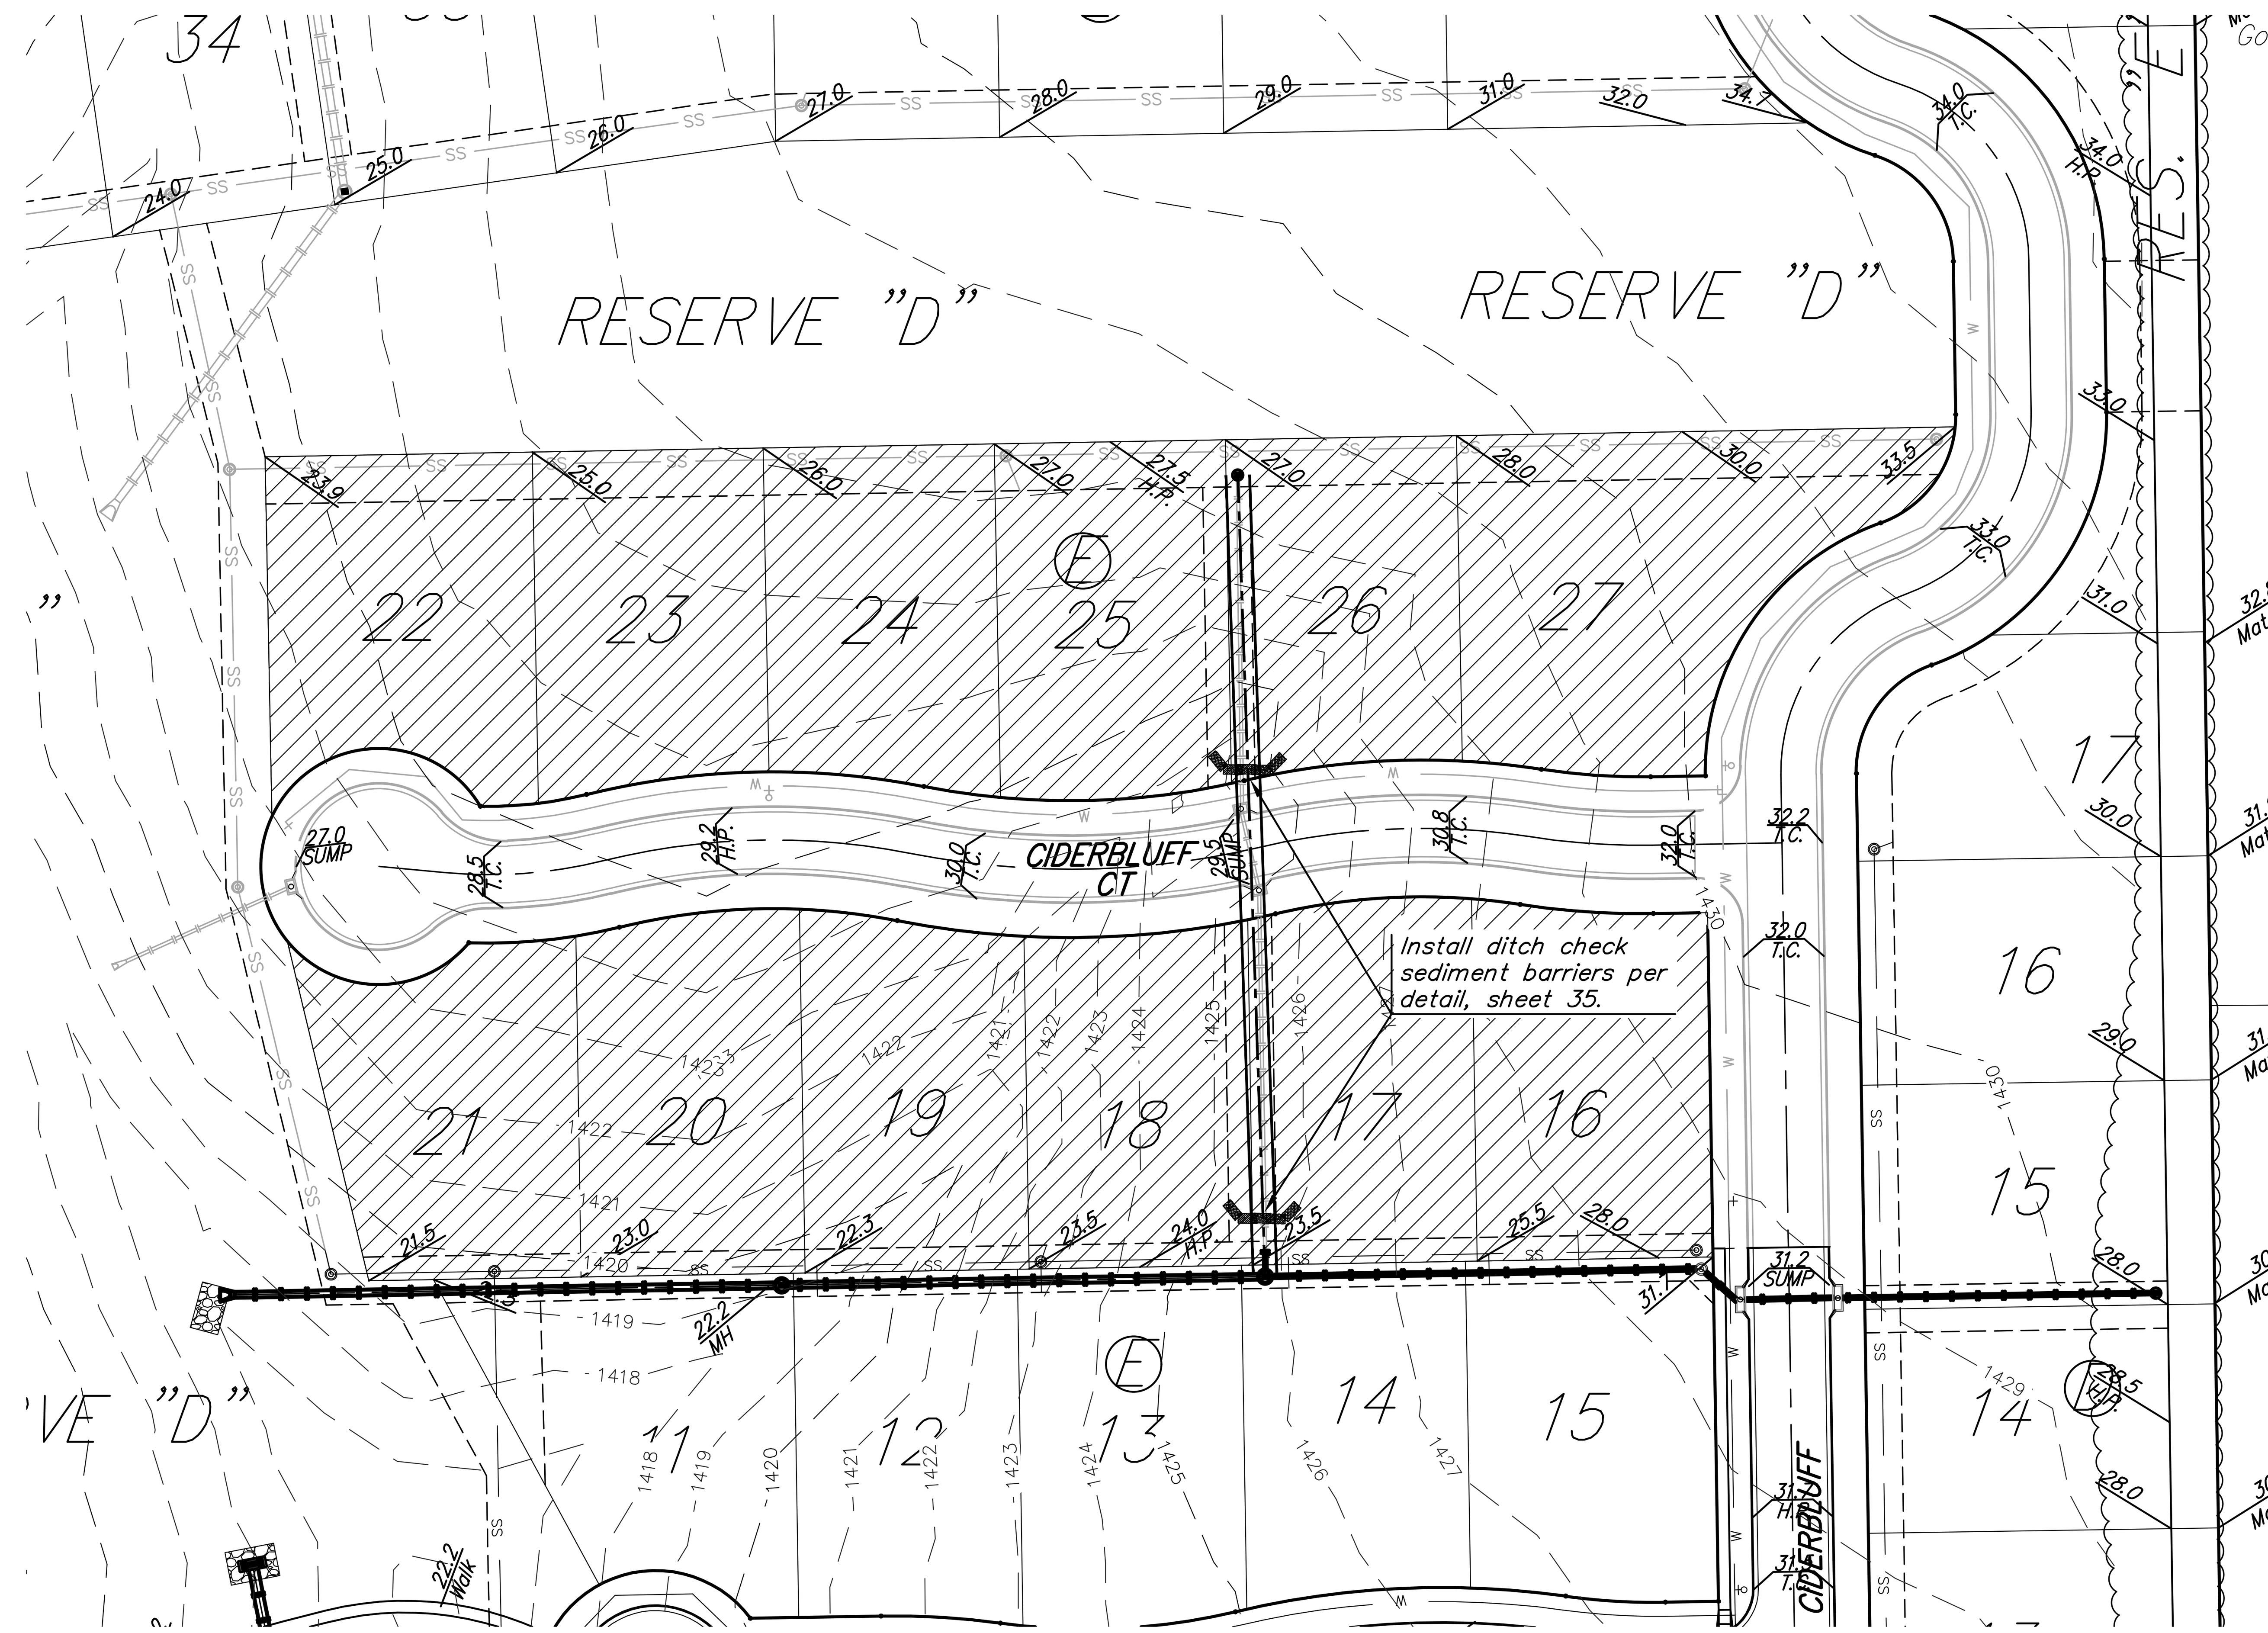

Baughman Company, P.A.

PIKE ADDITION
FILL PLAN
STORM WATER DRAIN IMPROVEMENTS

REVISIONS

SHEET 22 OF 40