
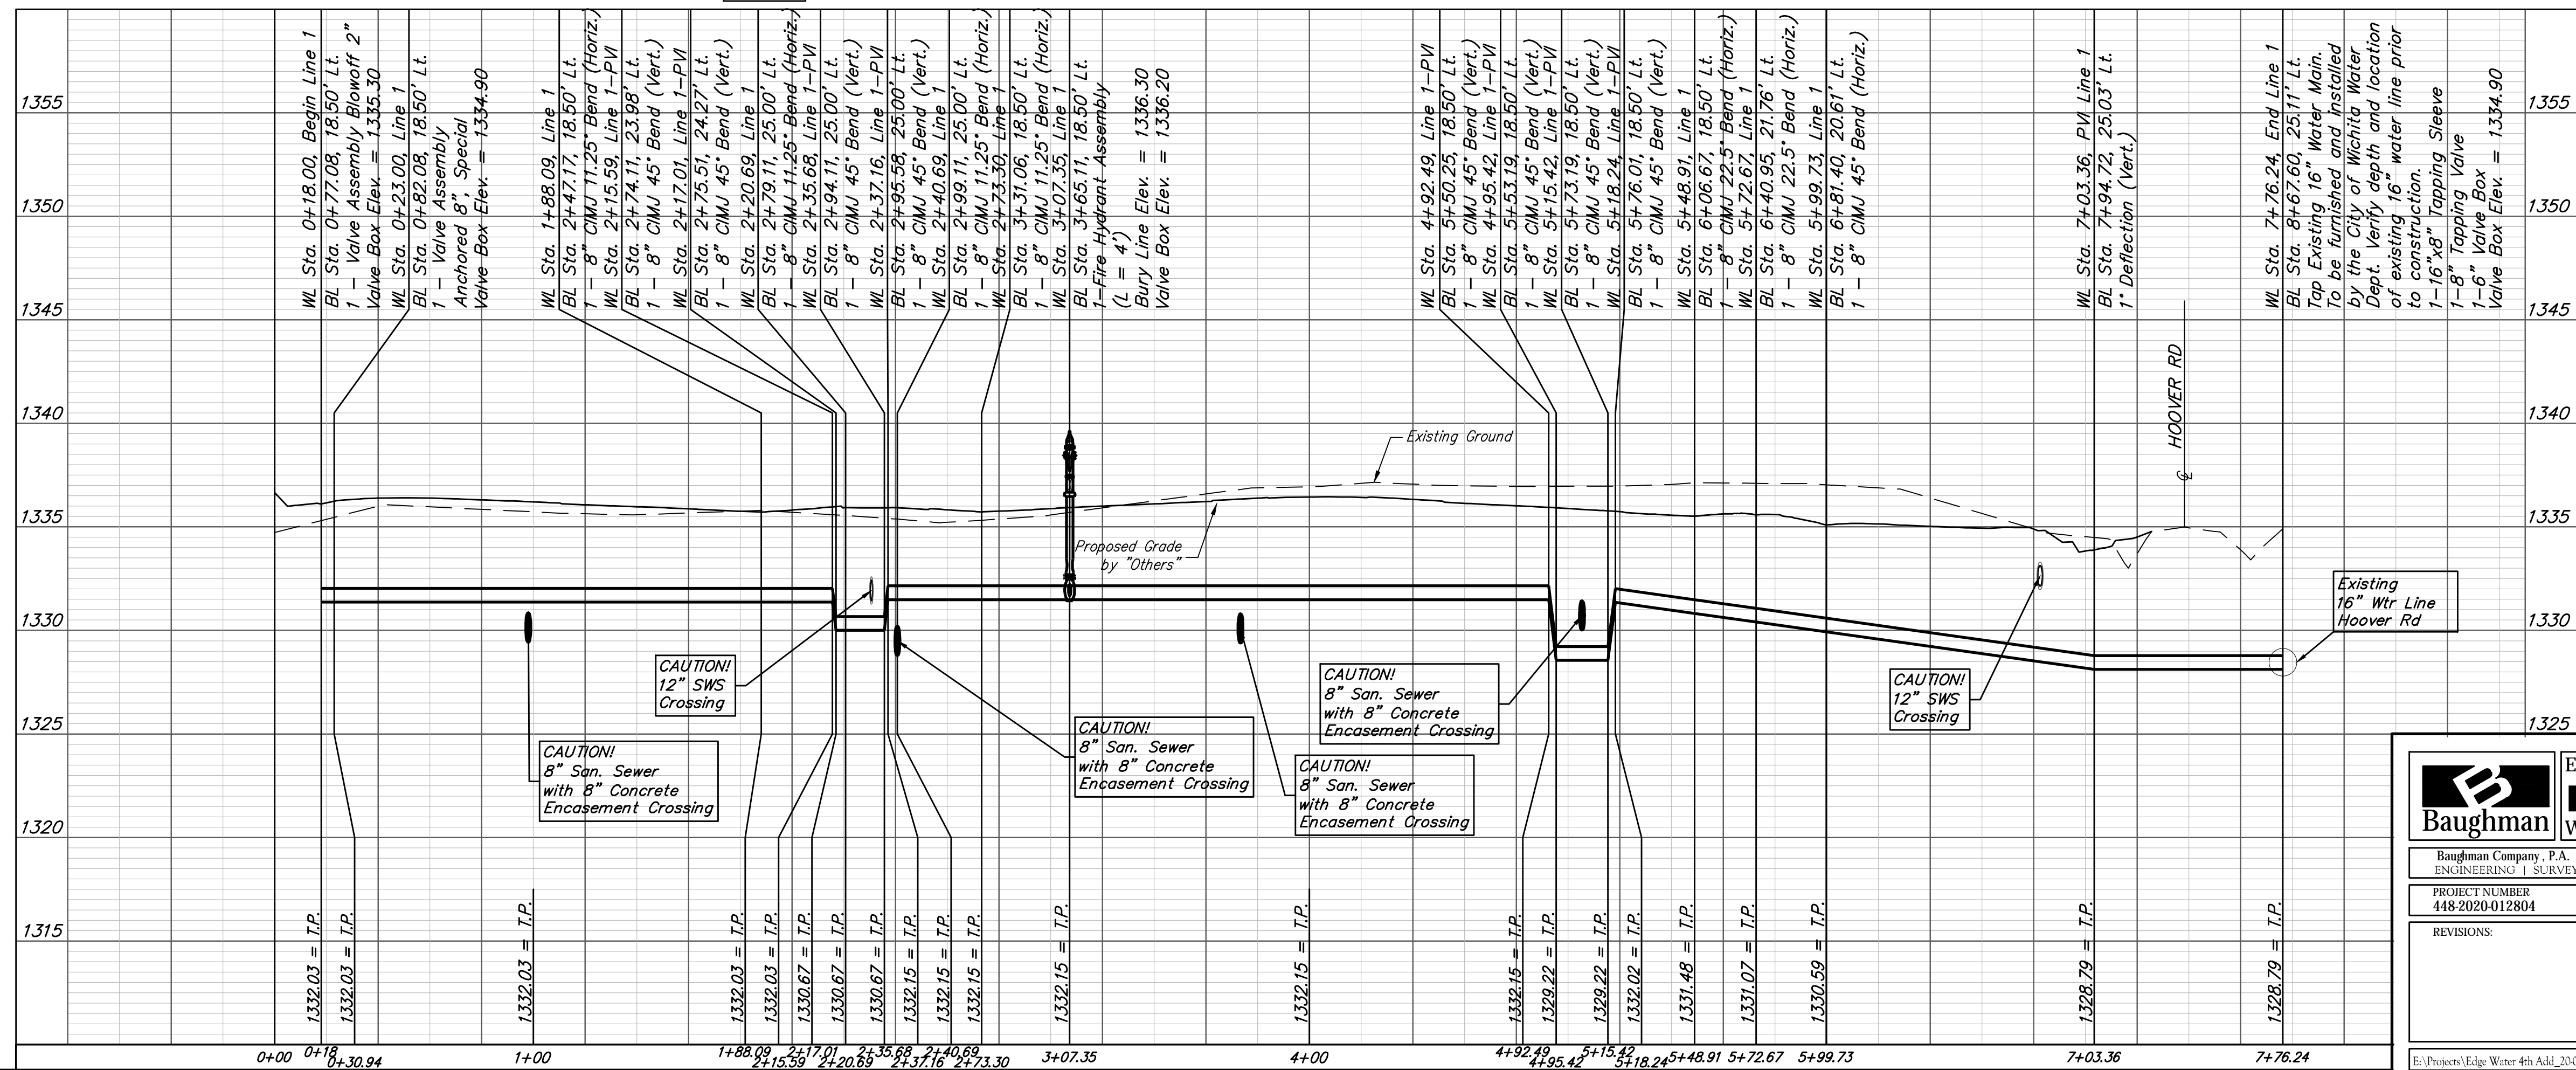
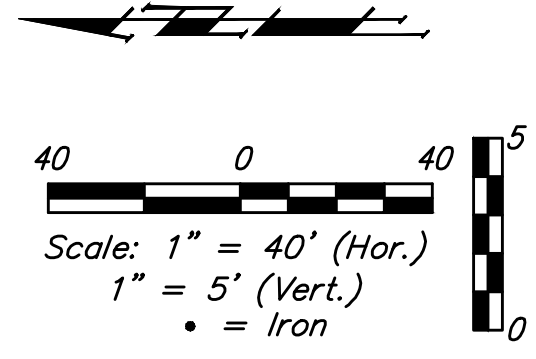


BENCHMARKS:
 disk adjacent to fire hydrant in SW corner of Lot 22 BLK A, Edgewater 3rd Addition
 Elev. = 1337.95 NAVD29

rail road spike in N face of power pole E of Lot 3 BLK A, Edgewater 4th Addition
 Elev. = 1336.93 NAVD29

NOTE: Contractor shall maintain 10' min. outer diameter horizontal separation between all water and sewer.

BL Sta. -0+00.00 = ϕ Froli St

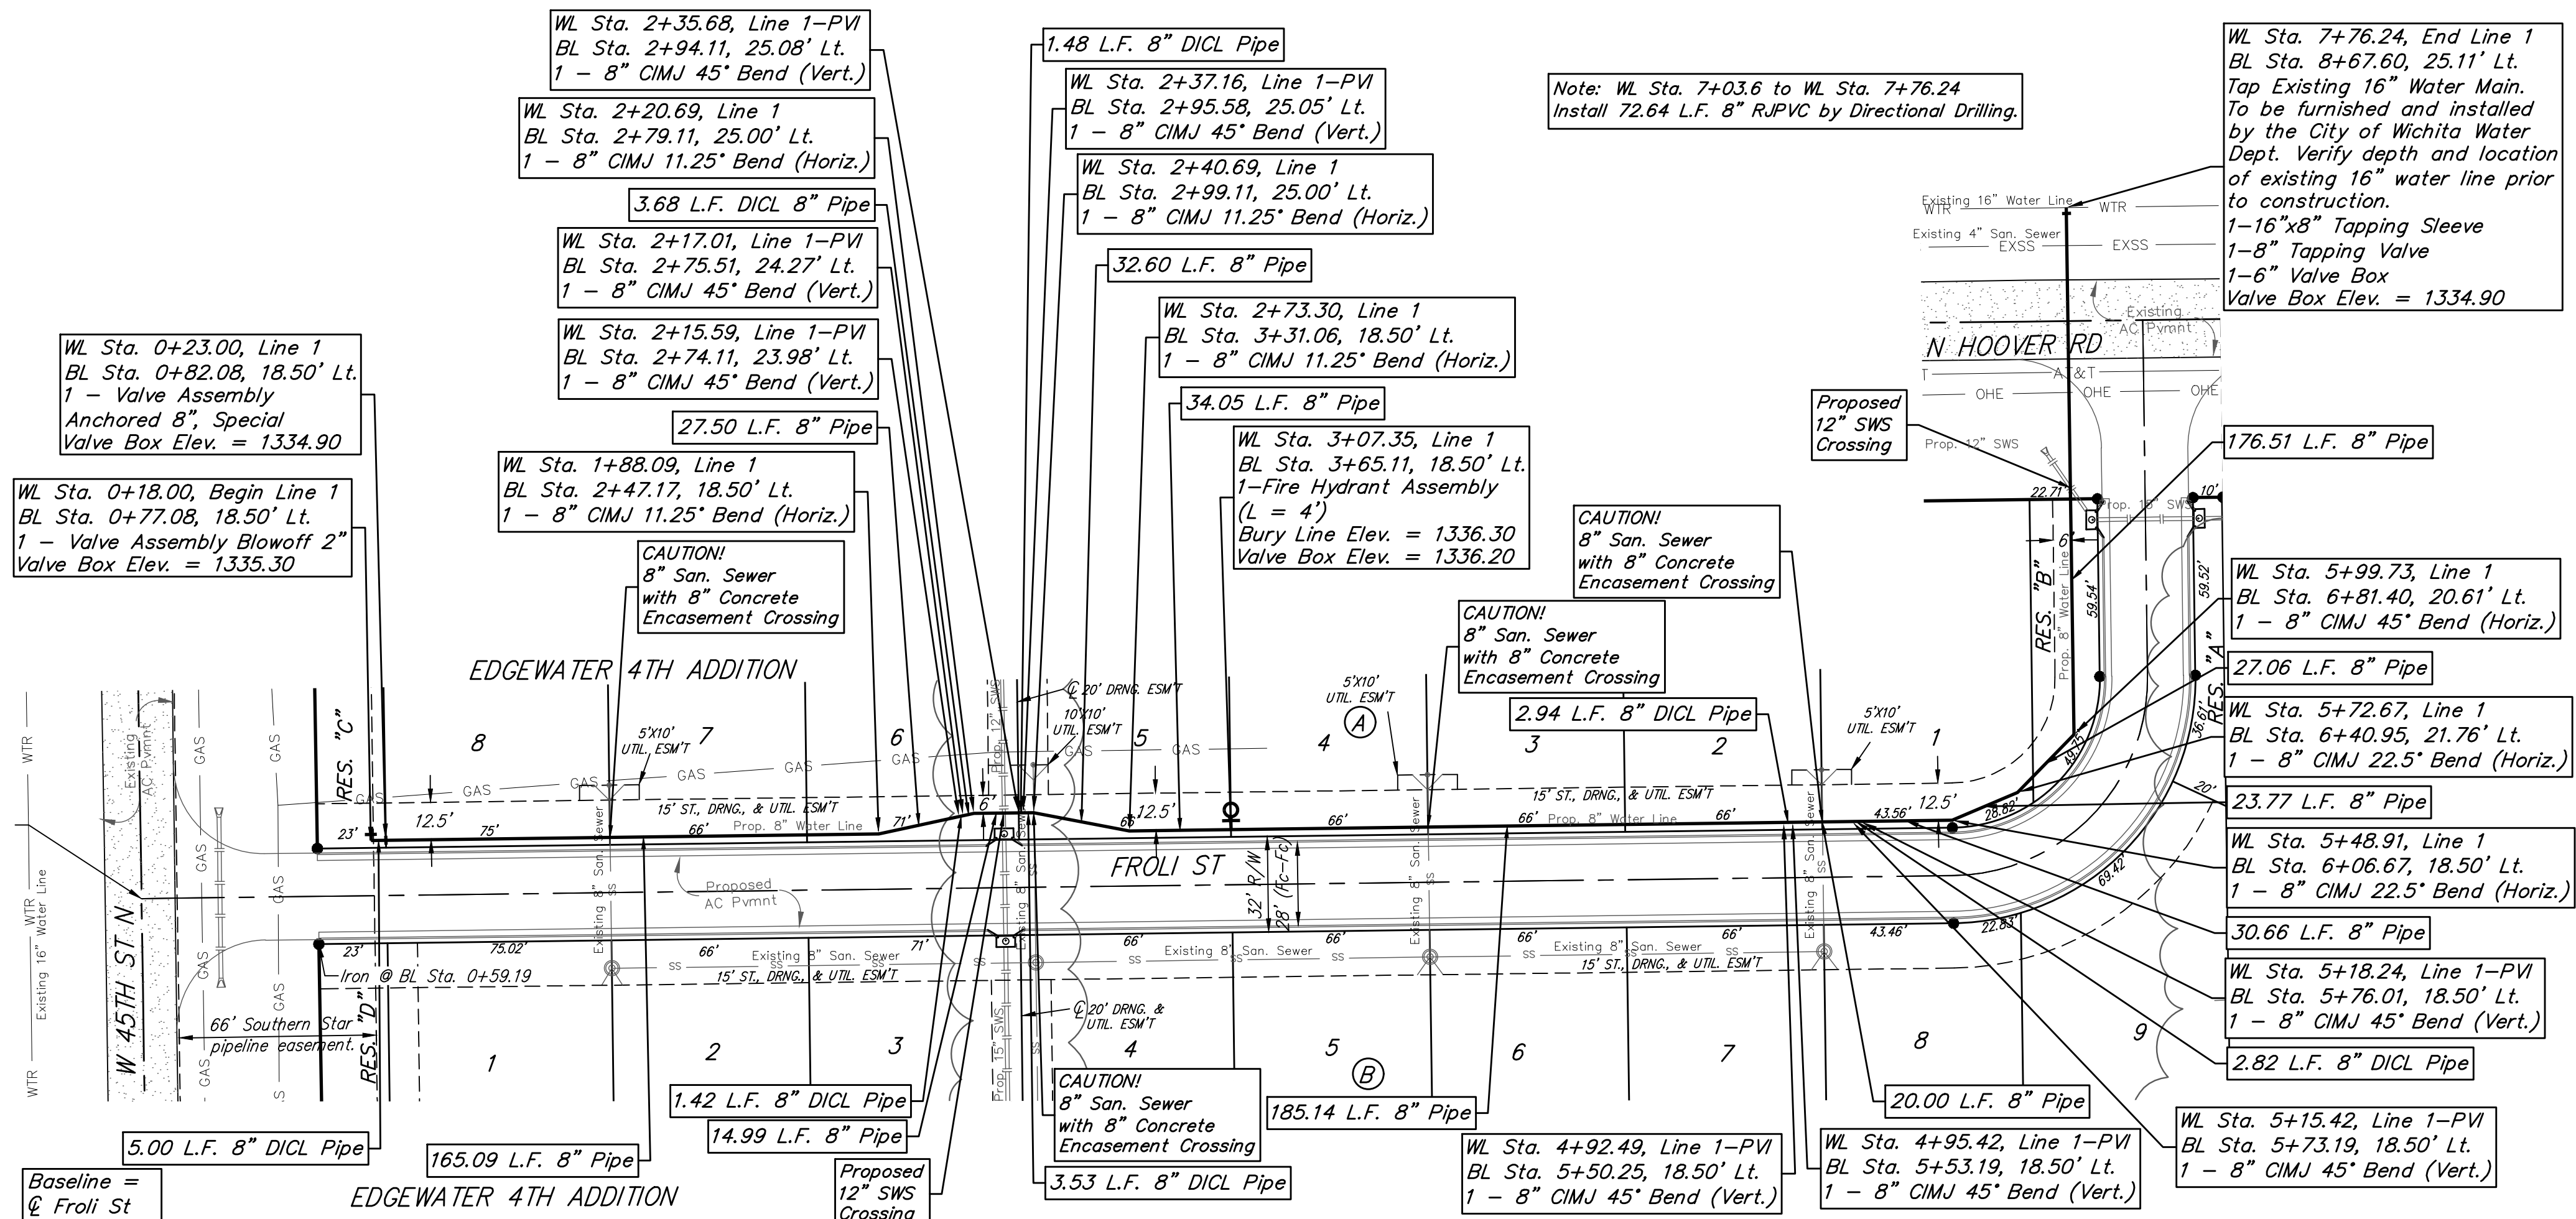

Baughman Edge Water 4th Addition
LINE 1
 Water Distribution System

Baughman Company, P.A. 315 Ellis St. Wichita, KS 67211 P 316-262-7271 F 316-262-0149
 ENGINEERING | SURVEYING | PLANNING | LANDSCAPE ARCHITECTURE

PROJECT NUMBER: 448-2020-012804
 DESIGN: AEG
 DRAWN: CDW
 APPROVED: [Signature]
 DATE: 09/10/20

REVISIONS:

SCALE: Noted
 SHEET: **4 OF 12**

E:\Projects\Edge Water 4th Add_2020\1513\Engineering\Phase 1\WTR_2024E356\WTR PLANS.dwg

