

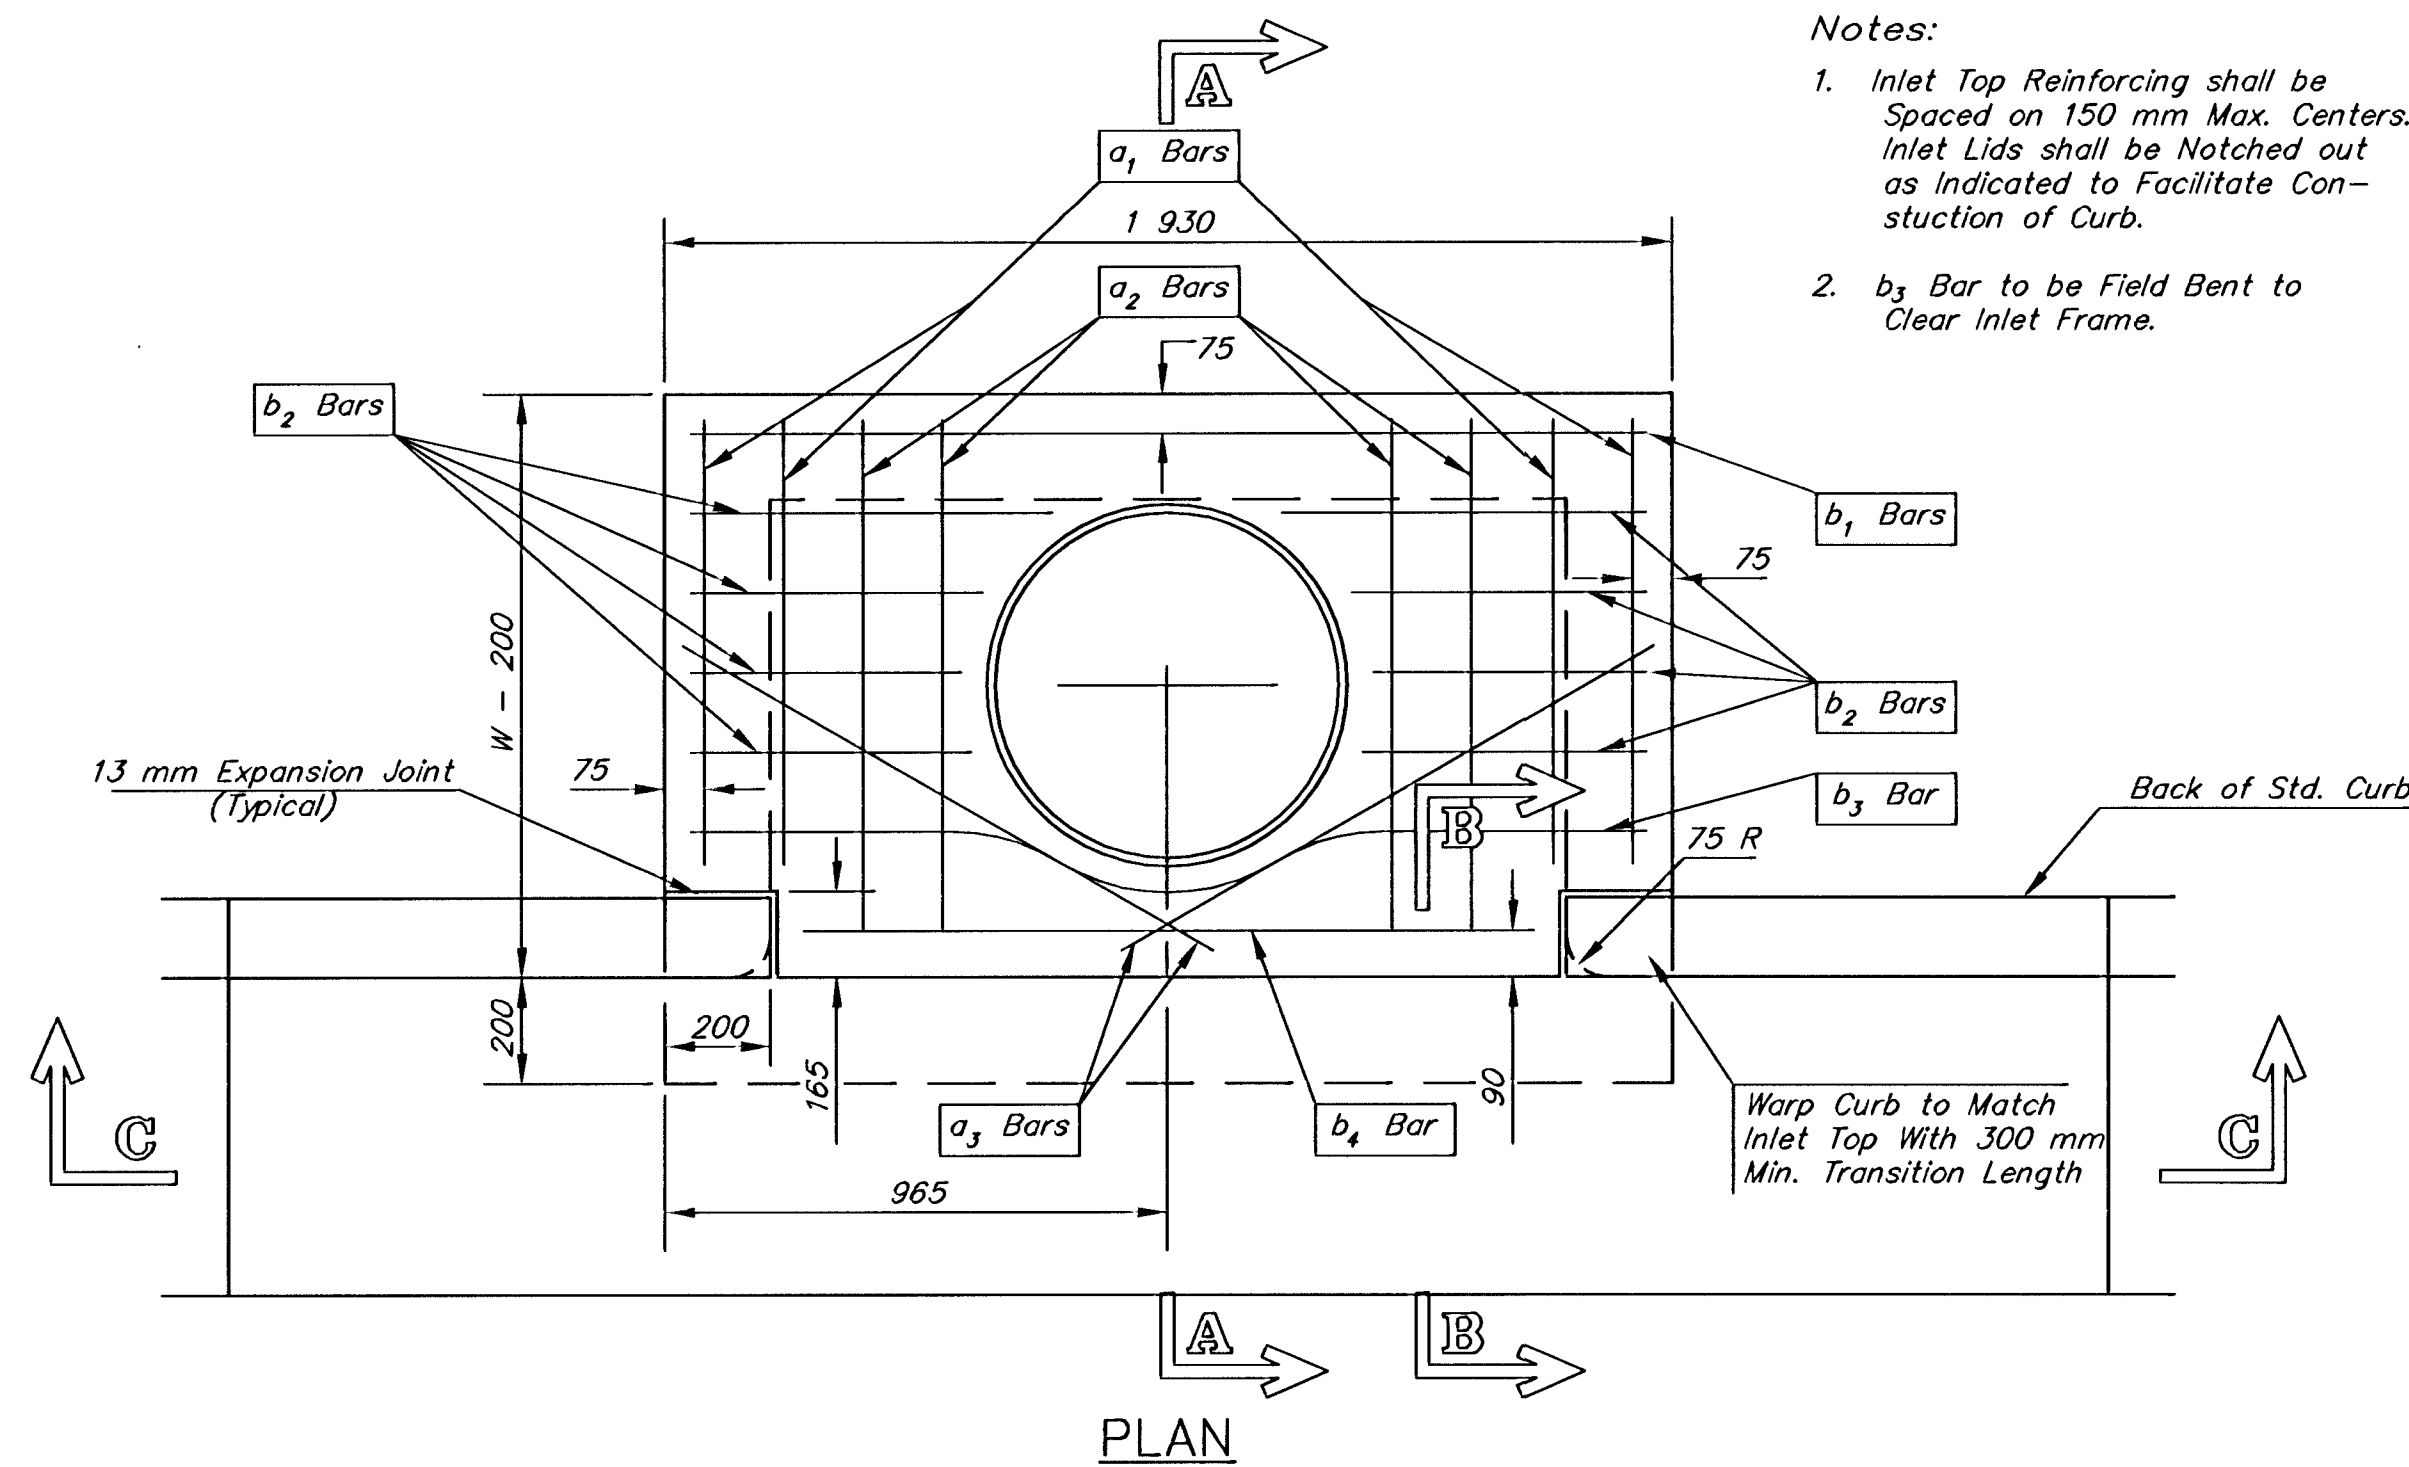
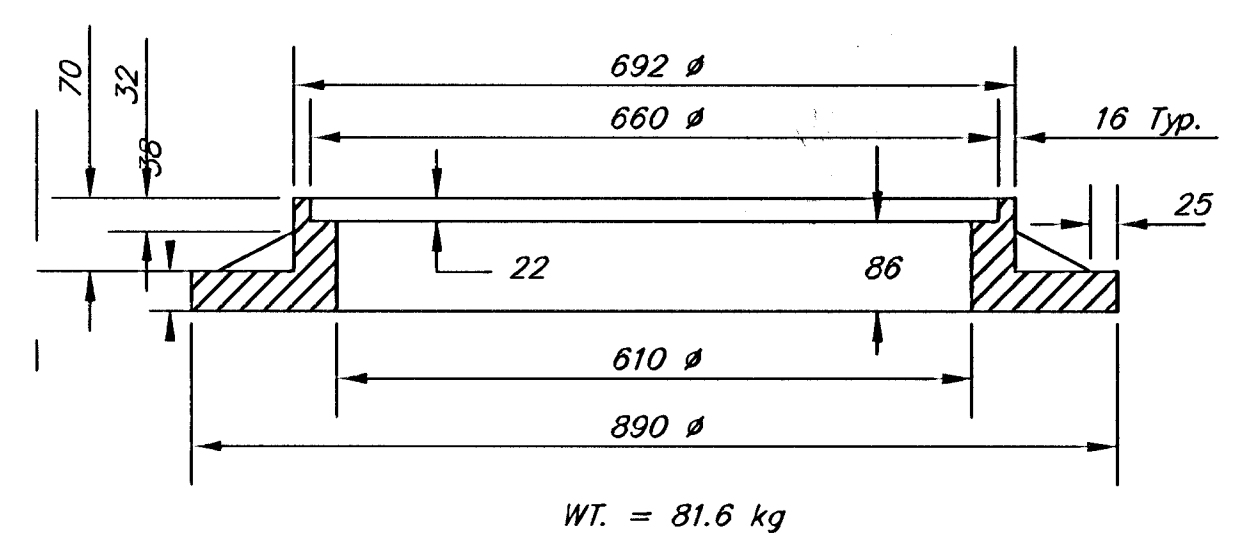
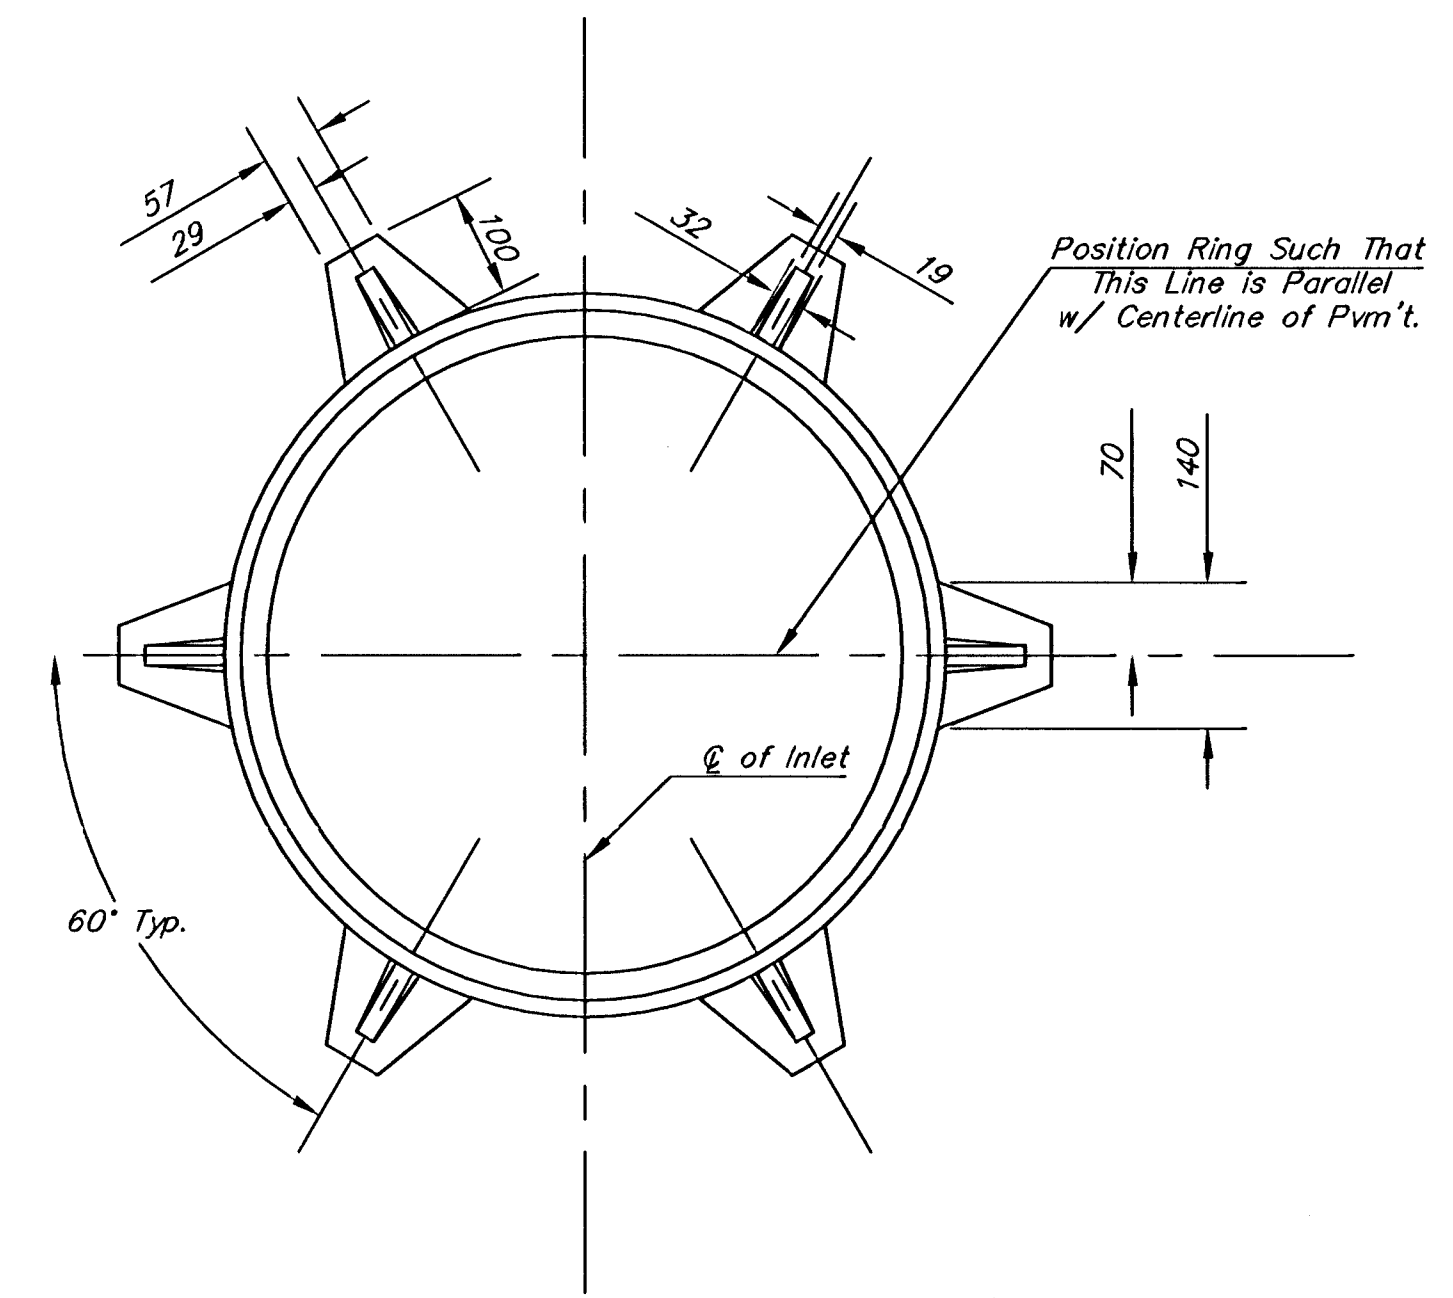
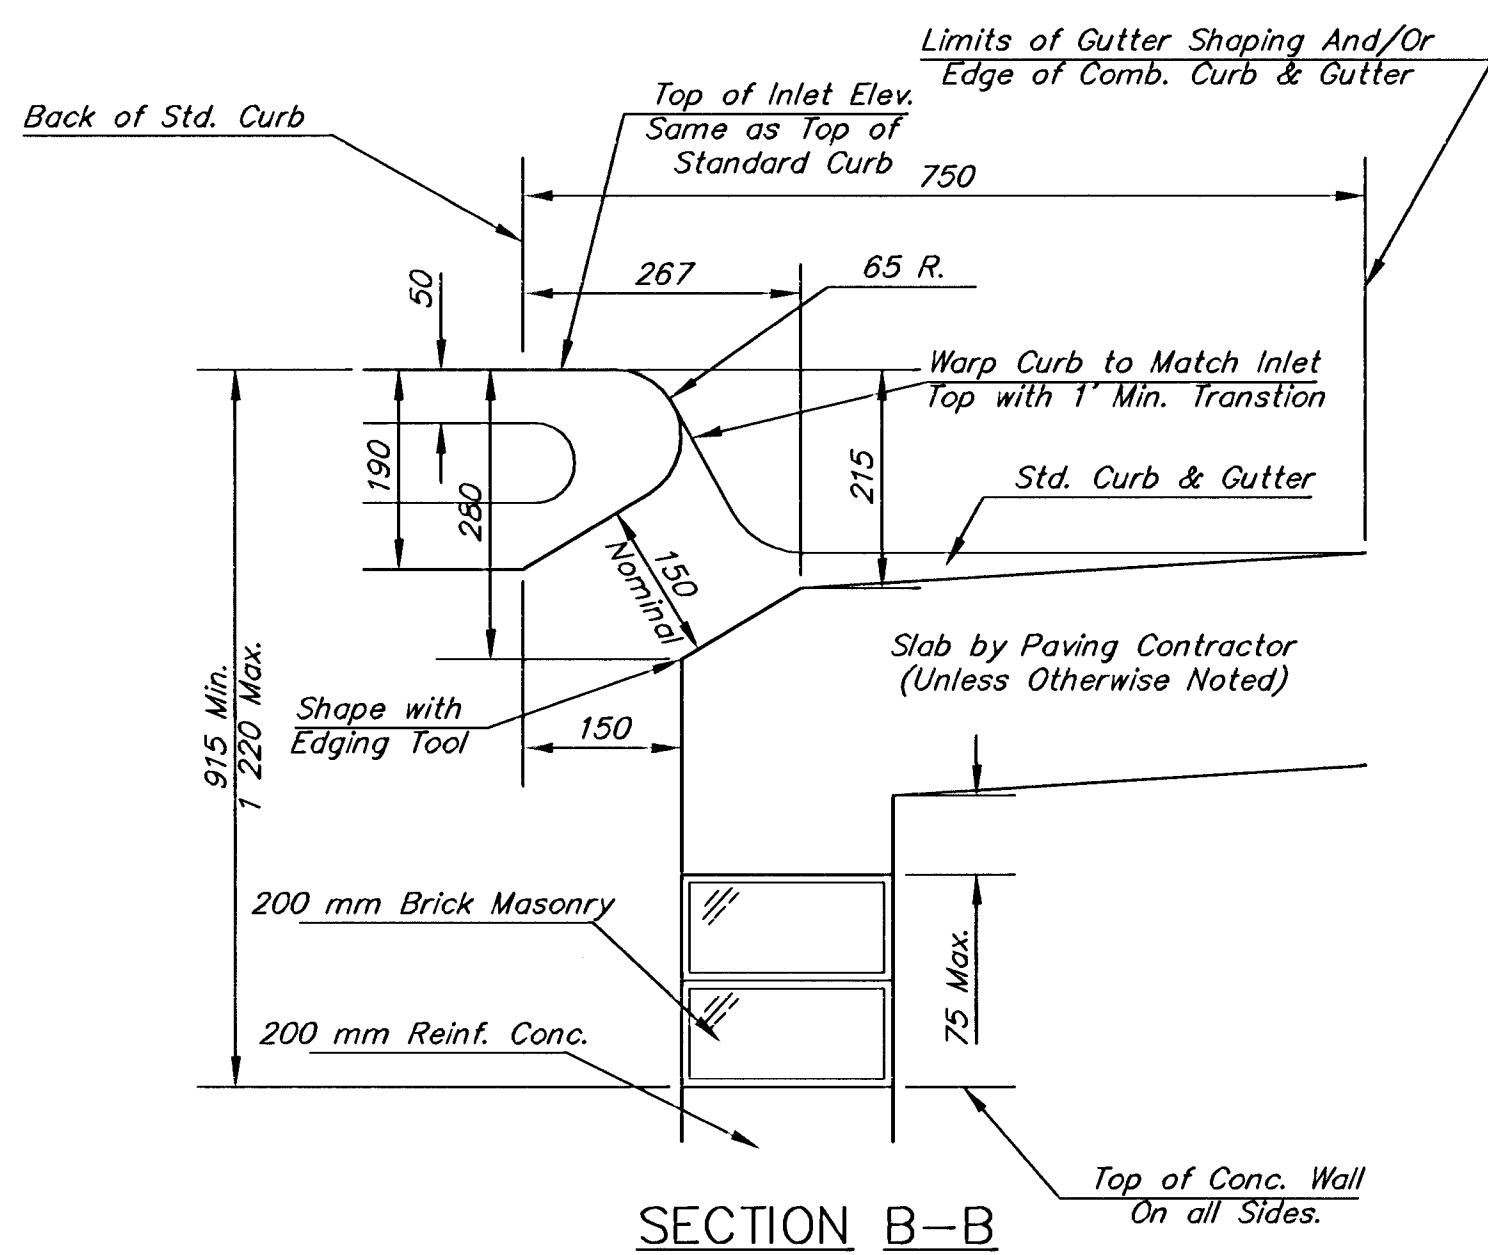


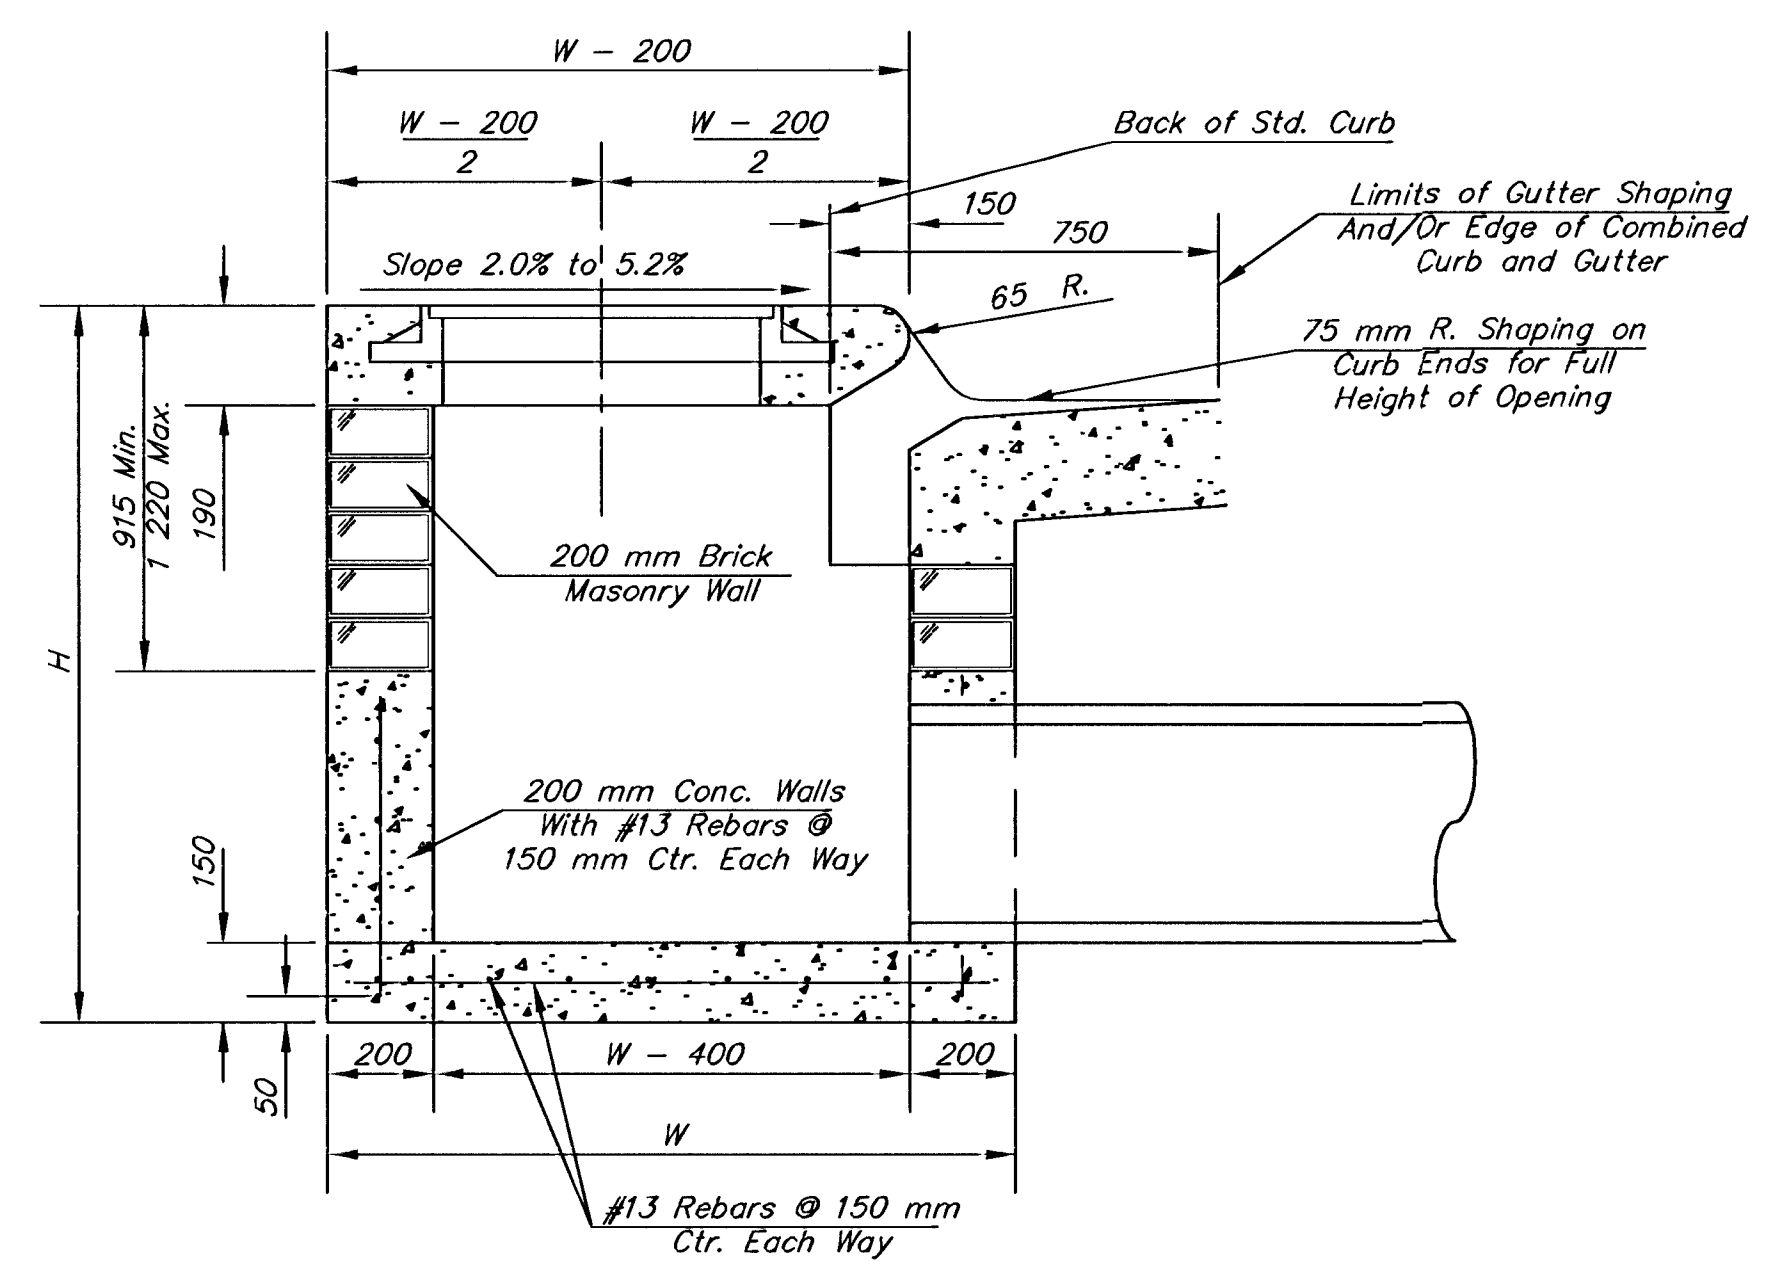


- Notes:**
1. Inlet Top Reinforcing shall be Spaced on 150 mm Max. Centers. Inlet Lids shall be Notched out as Indicated to Facilitate Construction of Curb.
 2. b_3 Bar to be Field Bent to Clear Inlet Frame.

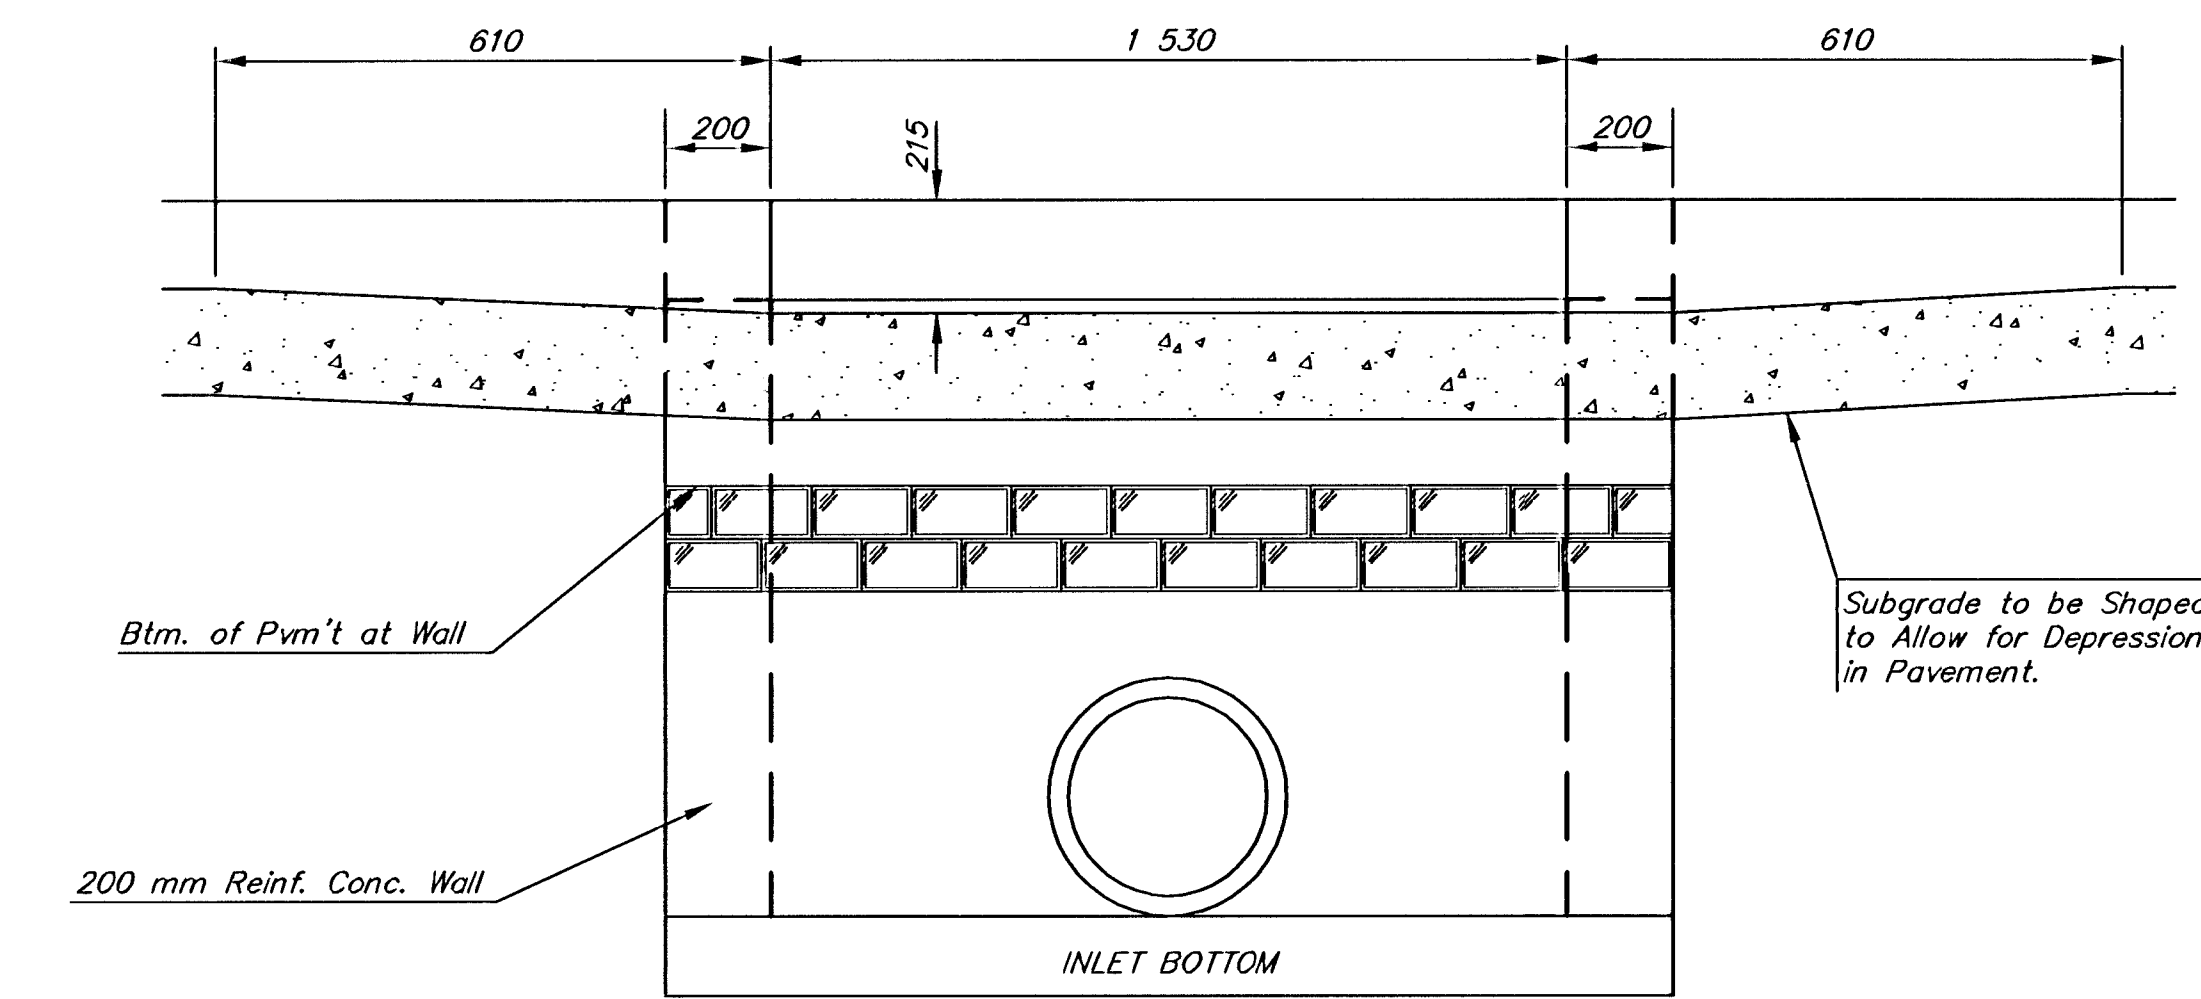

MANHOLE RING AND COVER

*See City of Wichita Standard Manhole Ring and Cover Detail Sheet for Cover Details to Be Used With Inlet Frame.

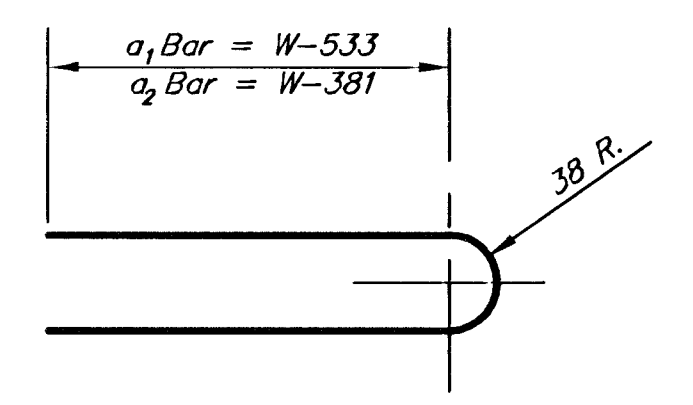

STEEL SCHEDULE											
BAR	a_1	a_2	a_3	b_1					b_2	b_3	b_4
NUMBER	4	4	2	1	3	5	7	9	6	1	1
SIZE	#13	#13	#13	#13	#13	#13	#13	#13	#13	#13	#19
LENGTH	W=1 320	1 700	2 010	1 420	1 855	-	-	-	535	1 880	1 420
	W=1 630	2 310	2 615	1 525	-	1 855	-	-	535	1 880	1 420
	W=1 930	2 920	3 225	1 830	-	-	1 855	-	535	1 880	1 420
	W=2 240	3 530	3 835	2 135	-	-	-	1 855	535	1 880	1 420
	W=2 540	4 140	4 445	2 440	-	-	-	-	1 855	535	1 880
											Wt. kg
											27±
											37±
											46±
											55±
											64±

Note: a_3 Bars to be Placed Approx. 50 mm Below Top of Inlet Cover.

STANDARD CURB INLET PRECAST TOPS				
W	PRE-CAST TOP SIZE			PIPE SIZE
1 320	1 120	1 930	190	535 mm & SMALLER
1 630	1 430	1 930	190	600 mm & 750 mm
1 930	1 730	1 930	190	900 mm & 1 050 mm
2 240	2 040	1 930	190	1 200 mm & 1 350 mm
2 540	2 340	1 930	190	1 500 mm & 1 680 mm
				m ³ CONC.
				0.29±
				0.39±
				0.49±
				0.59±
				0.69±

GENERAL NOTES

1. Concrete tops to be installed on thin mortar cushion to insure full support along brick walls. Concrete tops may be cast in place or precast. Concrete used for inlet construction shall be concrete pavement mix.
2. Contractor shall have the option of constructing 200 mm brick masonry walls between the concrete inlet base and top on this inlet when W=1 930 mm and H=2 135 mm or less.
3. Inlet invert shall be shaped with 8 sack sand mix concrete to create flow channels and to increase hydraulic efficiency such that the inlet will be self cleaning between all inlet and/or outlet pipes.
4. The ends of all pipes installed in inlets shall be cut off flush with the inside face of the inlet wall.

H:\CIVIL\01053\PAVE\6X5-1SI.DWG 04/30/03 03:26:15 PM CDT

MKEC
ENGINEERING
CONSULTANTS
411 N. WEBB ROAD
WICHITA, KS. 67208
316-684-9600

**NORTH HILLSIDE STREET
PAVING PLANS**

PROJECT NAME
**STANDARD TYPE 1 CURB INLET
OPENING 150 x 1 530 mm**

SHEET TITLE

JRA DESIGN BY: DPG DRAWN BY: JRA CHECKED BY:

APRIL 2003 DATE 01053 JOB NO. 19 / 73 SHEET/OF