

COORDINATE LIST		
POINT	NORTHING	EASTING
5000	1,677,488.0897	1,672,606.5293
5001	1,677,339.6058	1,672,621.7025
5002	1,677,277.5348	1,672,472.3486
5003	1,677,281.3931	1,672,428.2477
5004	1,677,360.2297	1,672,370.3022
5005	1,677,382.3621	1,672,373.7485
5006	1,677,410.7237	1,672,412.8094
5007	1,677,468.3787	1,672,370.9470
5008	1,677,484.8934	1,672,393.6919
5009	1,677,484.8934	1,672,516.2114
5010	1,677,422.4506	1,672,561.5502
5013	1,677,489.8314	1,672,523.0122
5014	1,677,495.7437	1,672,537.3799
5015	1,677,497.8408	1,672,551.0014
5016	1,677,508.6706	1,672,565.8502
5017	1,677,470.3279	1,672,526.7871
5018	1,677,475.2659	1,672,533.5879
5019	1,677,477.9533	1,672,540.1187
5020	1,677,478.7108	1,672,545.0391
5021	1,677,467.8690	1,672,565.9802
5022	1,677,444.3446	1,672,594.7194
5023	1,677,463.1280	1,672,542.4011
5025	1,677,458.9437	1,672,548.0822
5026	1,677,517.6079	1,672,547.9582

GENERAL SHEET NOTES



- ALL DISTURBED AREAS SHALL BE SEEDED AND OR SODDED IN ACCORDANCE WITH THE EROSION CONTROL PLANS.
- SEE SHEET V001 FOR ZONING DATA AND ADDITIONAL SITE INFORMATION.
- COORDINATE POINTS ARE TO THE EDGE OF PAVEMENT OR BACK OF CURB UNLESS OTHERWISE NOTED.

KEYNOTES

- INSTALL 6" CONCRETE PAVEMENT. REF. JOINTING PLAN, SHEET CP-101
- INSTALL CHAIN LINK FENCE 8' BLACK PVC COATED CHAINLINK WITH DOUBLE ROW OF BARB WIRE - ONE ROW FACING IN, ONE ROW OUT. INSTALL PER CITY OF WICHITA DETAILS. SEE FENCE NOTES, THIS SHEET.
- RESET CARD READER.
- RESET GATE SENSORS.
- INSTALL 16' WIDE CANTILEVER GATE.
- RESET GATE CONTROLLER
- INSTALL BOLLARD. SEE DETAIL, THIS SHEET.
- INSTALL 38.3" OF CURB AND GUTTER PER CITY OF WICHITA STANDARDS.
- ELECTRICAL HANDHOLE. REFERENCE ELECTRICAL PLANS.
- LIGHT POLE. REFERENCE ELECTRICAL PLANS.
- PROPOSED CONDENSING UNIT. REFERENCE MECHANICAL PLANS.

FENCE NOTES:

- FENCE GUIDELINE IS GALVANIZED STEEL CHAIN-LINK FENCE POST WITH AN 8-FOOT HEIGHT.
- FENCE FABRIC SHALL BE ONE PIECE AND SHOULD BE PVC OVER ZINC-COATED STEEL. (BLACK).
- FABRIC WIRE GAUGE SHALL BE NO.8 GAUGE AND SELECT MESH PATTERNS LESS THAN 1-INCH ACROSS.
- POST STRENGTH AND STIFFNESS SHALL MEET ASTM F1043, "STANDARD SPECIFICATION FOR STRENGTH AND PROTECTIVE COATINGS ON STEEL INDUSTRIAL CHAIN LINK FENCE FRAMEWORK," GROUP 1A REQUIREMENTS (ASTM 2005C) FOR HEAVY INDUSTRIAL FENCES.
- THE AVERAGE DIMENSION BETWEEN LINE POSTS FOR CHAIN LINK FENCES IS RECOMMENDED TO BE NO MORE THAN 10 FEET WHEN MEASURED CENTER-TO-CENTER BETWEEN POSTS AND PARALLEL TO THE FENCE GRADE.
- POST HOLE DEPTH SHALL BE 36-INCHES. THE HOLE SHOULD BE BACKFILLED WITH 2500 PSI CONCRETE.
- USE DOUBLE Y-STYLE OUTRIGGERS WITH 3-STRAND BARBED WIRE.
- FOR ANCHORAGE OF FABRIC, THE BOTTOM FENCE FABRIC SHOULD BE SECURED TO A BOTTOM AND TOP RAIL AND SECURELY ANCHORED AT THE MIDPOINT BETWEEN THE FENCE POSTS ALONG THE FENCE LINE.

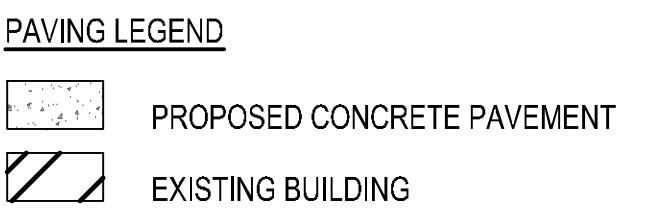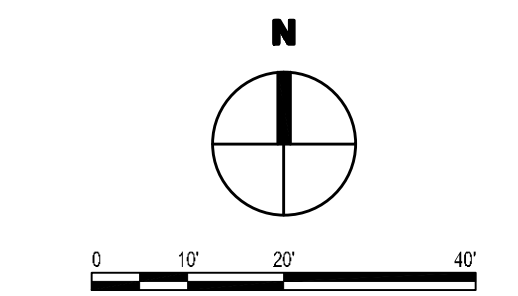

* COORDINATE WITH GENERATOR ENCLOSURE DOORS



INSTALL FENCE 9" FROM EDGE OF PAVEMENT

CONCRETE DOME AT TOP OF PIPE

6" DIA. STEEL PIPE PAINTED WITH 2 COATS (PAINT COLOR PER OWNER). CONCRETE FILLED.



Saved: 03-04-2021 4:10:03 PM by ROY, THOMAS
 Plot Scale: 1:1 03-04-2021 4:22:37 PM by ROY, THOMAS
 U:\Wichita-Facility\180537\000\Drawings\Plans\180537-000-CS101

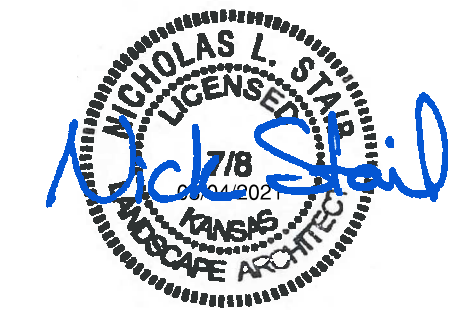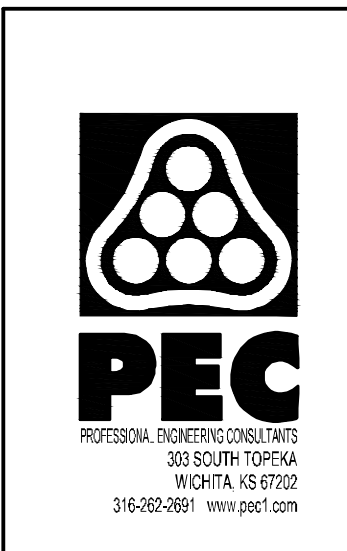

4			
3			
2			
1	CONSTRUCTION DOCUMENTS		03-04-21
No.	Revision	By	Date
CITY OF WICHITA, KANSAS			
SITE PLAN			
STANDBY POWER GENERATION - SOUTHEAST PUMP STATION			
Professional Engineering Consultants, P.A. 303 S. TOPEKA • WICHITA, KANSAS 67202 316-262-2691 • FAX 316-262-3003			
Designed by	NLS	Job No.	180537-000
Drawn by	RFT	Checked by	MEB
Date	MARCH 2021	Dwg No.	CS101