
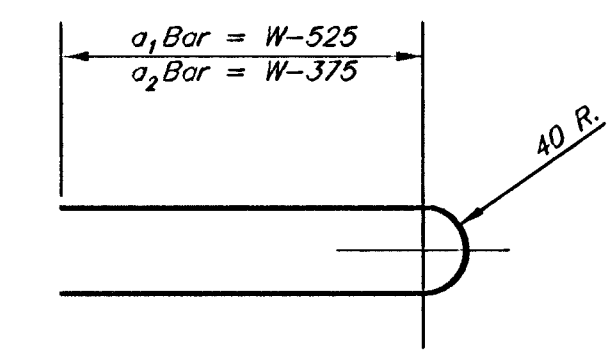
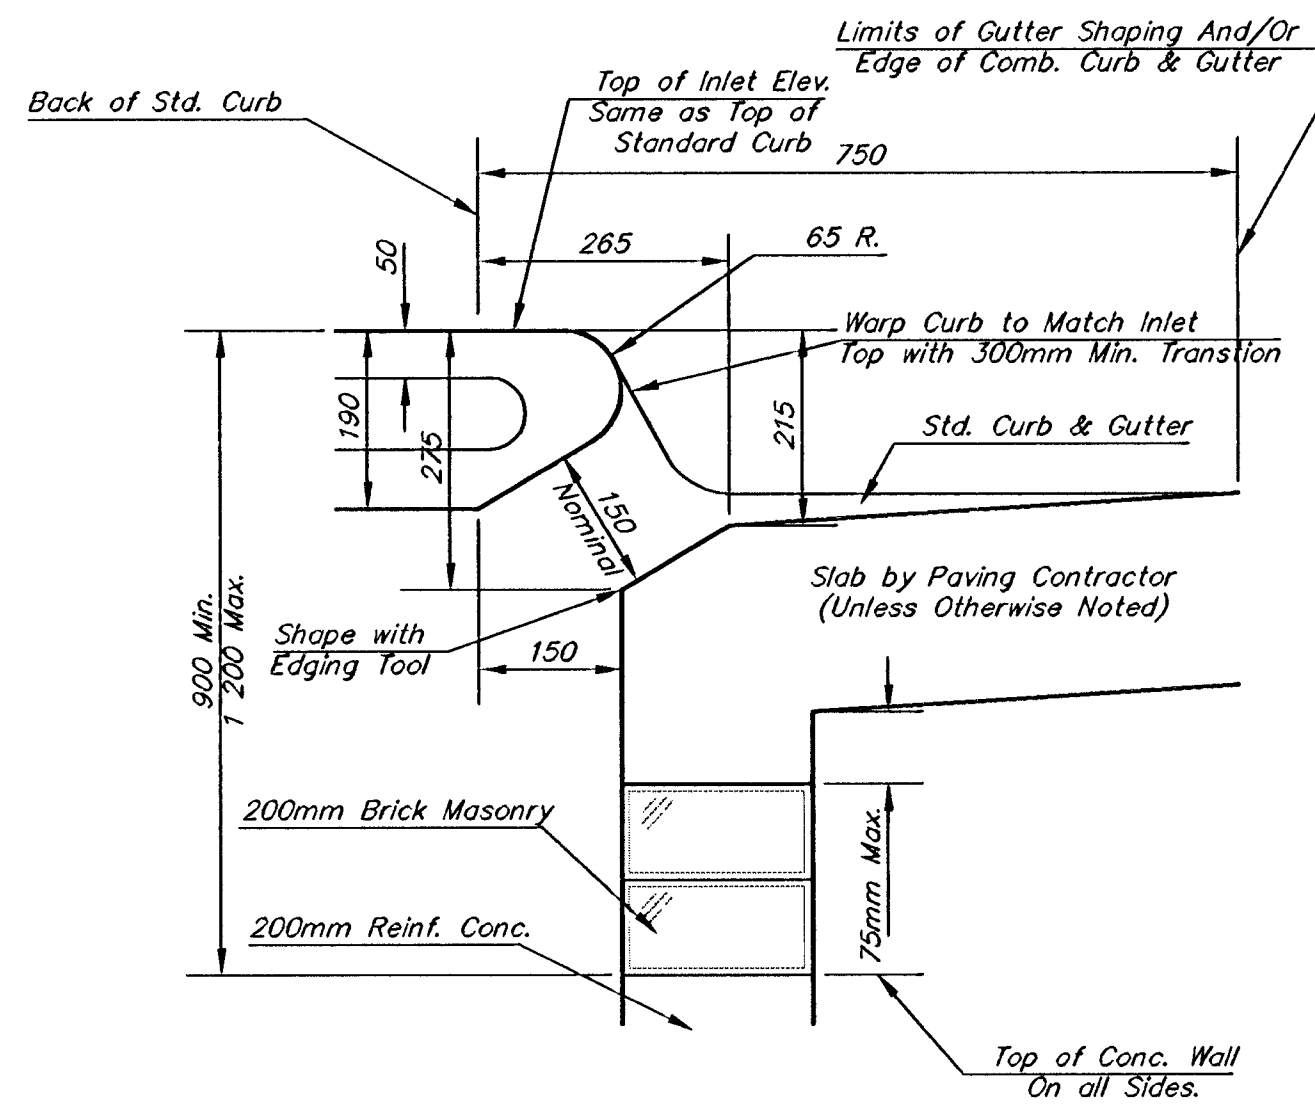
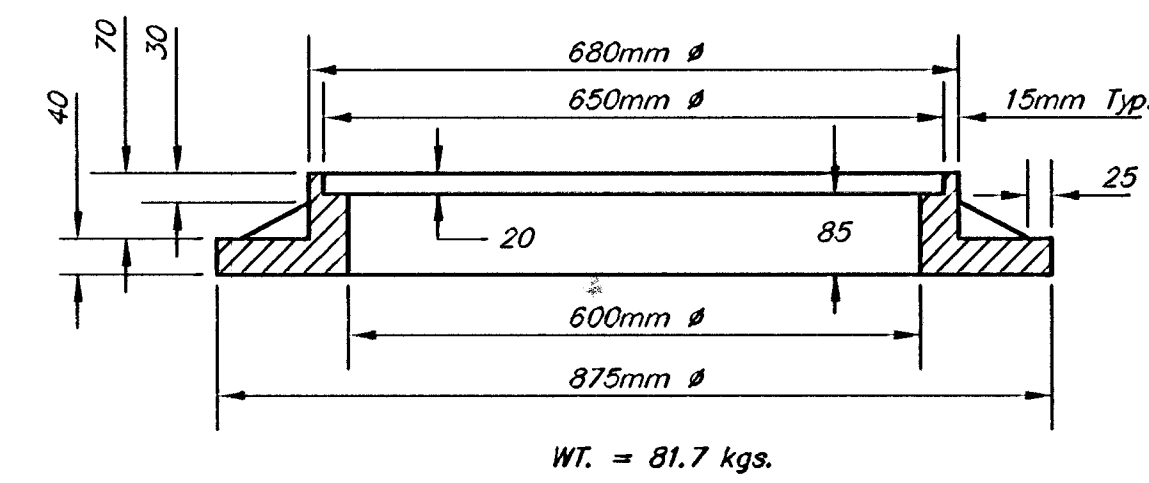


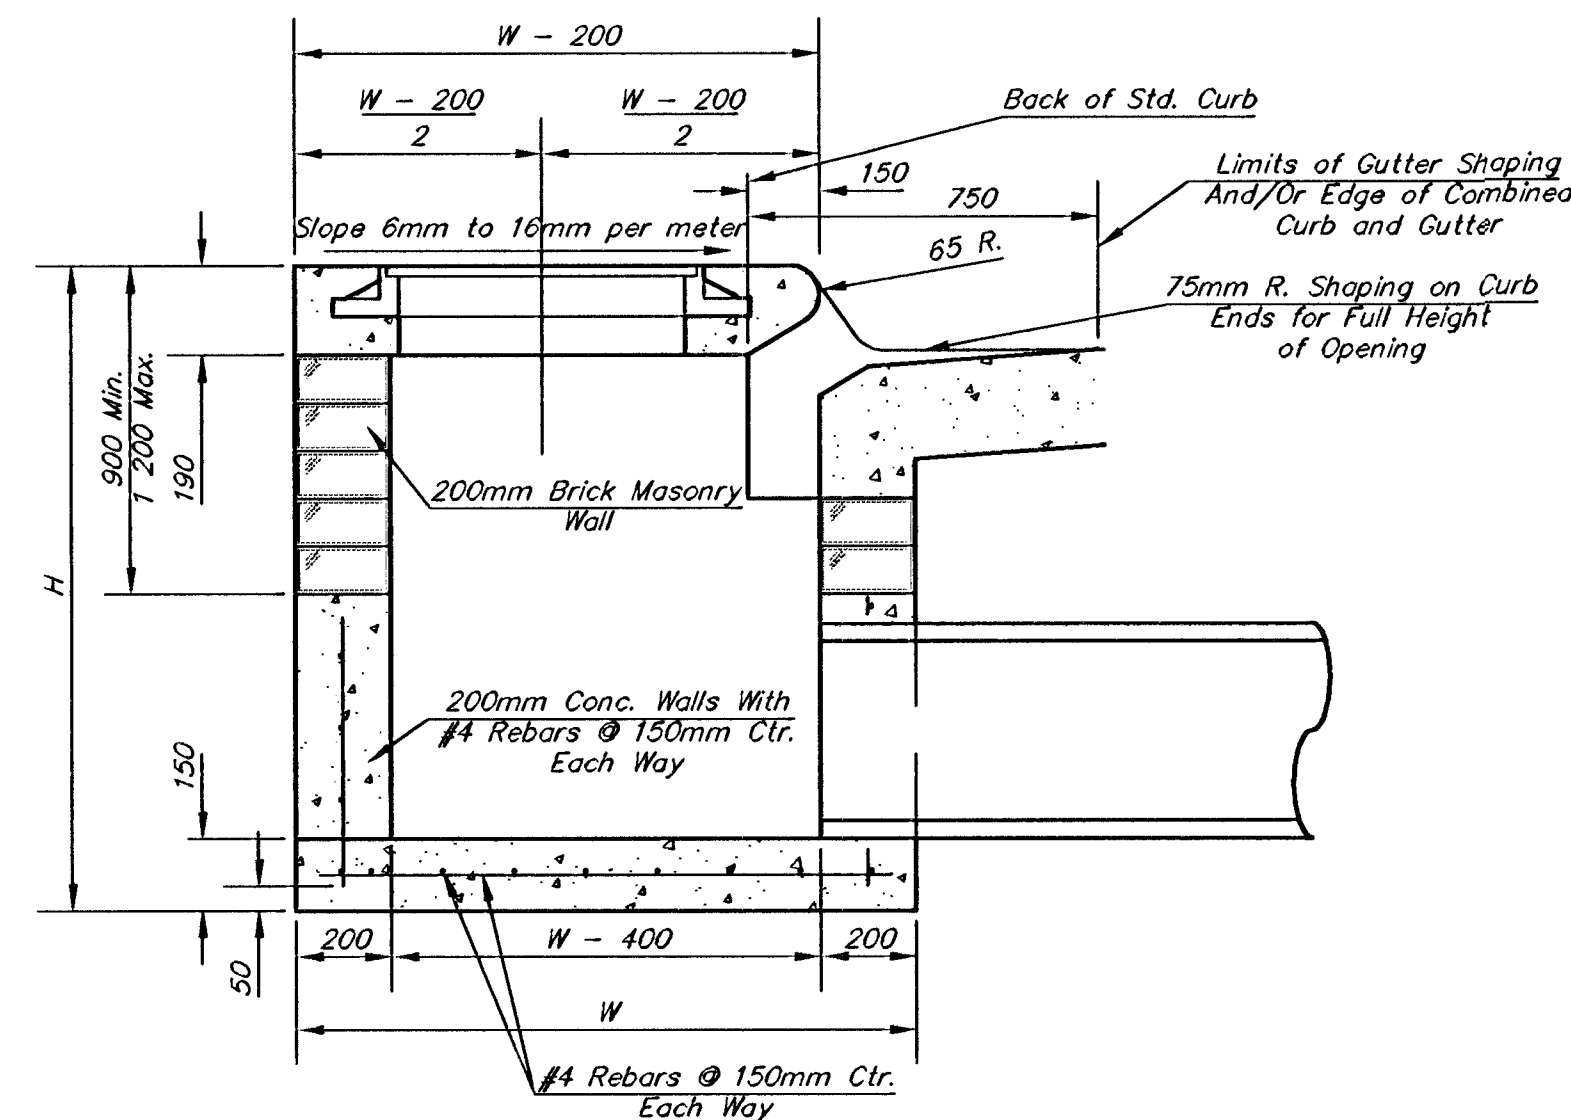

SECTION B-B

BENDING DIAGRAM

GENERAL NOTES

1. Concrete tops to be installed on thin mortar cushion to insure full support along brick walls. Concrete tops may be cast in place or precast. Concrete used for inlet construction shall be concrete pavement mix.
2. Contractor shall have the option of constructing 200mm brick masonry walls between the concrete inlet base and top on this inlet when $W=1900\text{mm}$ and $H=2100\text{mm}$ or less.
3. Inlet invert shall be shaped with 3 sack sand mix concrete to create flow channels and to increase hydraulic efficiency such that the inlet will be self cleaning between all inlet and/or outlet pipes.
4. The ends of all pipes installed in inlets shall be cut off flush with the inside face of the inlet wall.

STANDARD CURB INLET PRECAST TOPS			
W	PRE-CAST TOP SIZE	PIPE SIZE	CU. YD. CONC.
1 300	1 100 x 1 900 x 190	525mm & SMALLER	0.29±
1 600	1 400 x 1 900 x 190	600mm & 750mm	0.39±
1 900	1 700 x 1 900 x 190	900mm & 1050mm	0.49±
2 200	2 000 x 1 900 x 190	1200mm & 1350mm	0.59±
2 500	2 300 x 1 900 x 190	1500mm & 1650mm	0.69±

STANDARD TYPE 1 CURB INLET OPENING = 150mmX150mm					
	924 NORTH MAIN WICHITA, KANSAS 67203 http://www.teak.com/~srb		316-264-8008 FAX 264-4621 E-Mail: srb@teak.com		REVISED
	SAVOY, RUGGLES & BOHM, P. A. ENGINEERING & SURVEYING				36
PROJECT NUMBER 472-76-245-83053-000-000-001					
DRAWN Staff	DESIGN Staff	REVIEW	DATE 5-25-99	UTILITY	SRB JOB 1218T