
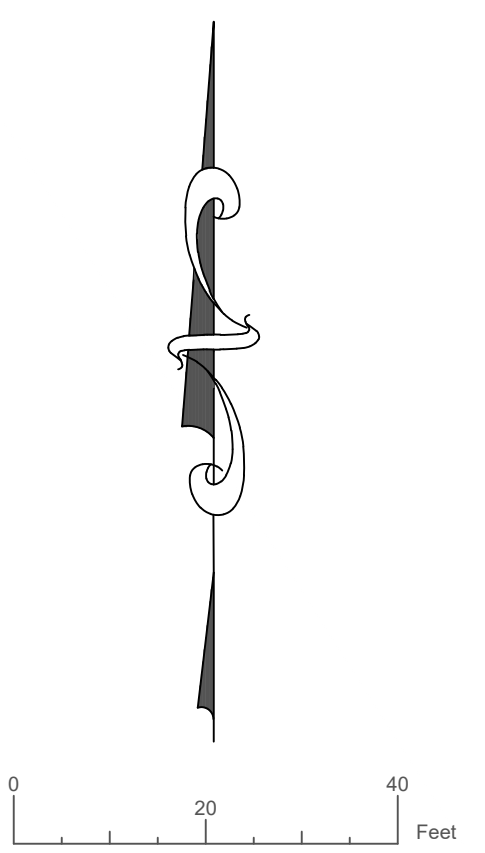


PRIVATE WATER SERVICE LINES TO BE INSTALLED MUST MAINTAIN A MINIMUM OF A 10' HORIZONTAL CLEARANCE FROM EXISTING SANITARY SEWER MAINS AND MANHOLES. WHERE PRIVATE WATER SERVICE LINES CROSS SANITARY SEWER MAINS, 25" OF VERTICAL CLEARANCE MUST BE MAINTAINED OR THE SANITARY SEWER LINE MUST BE ENCASED 10' ON EITHER SIDE OF THE CROSSING.

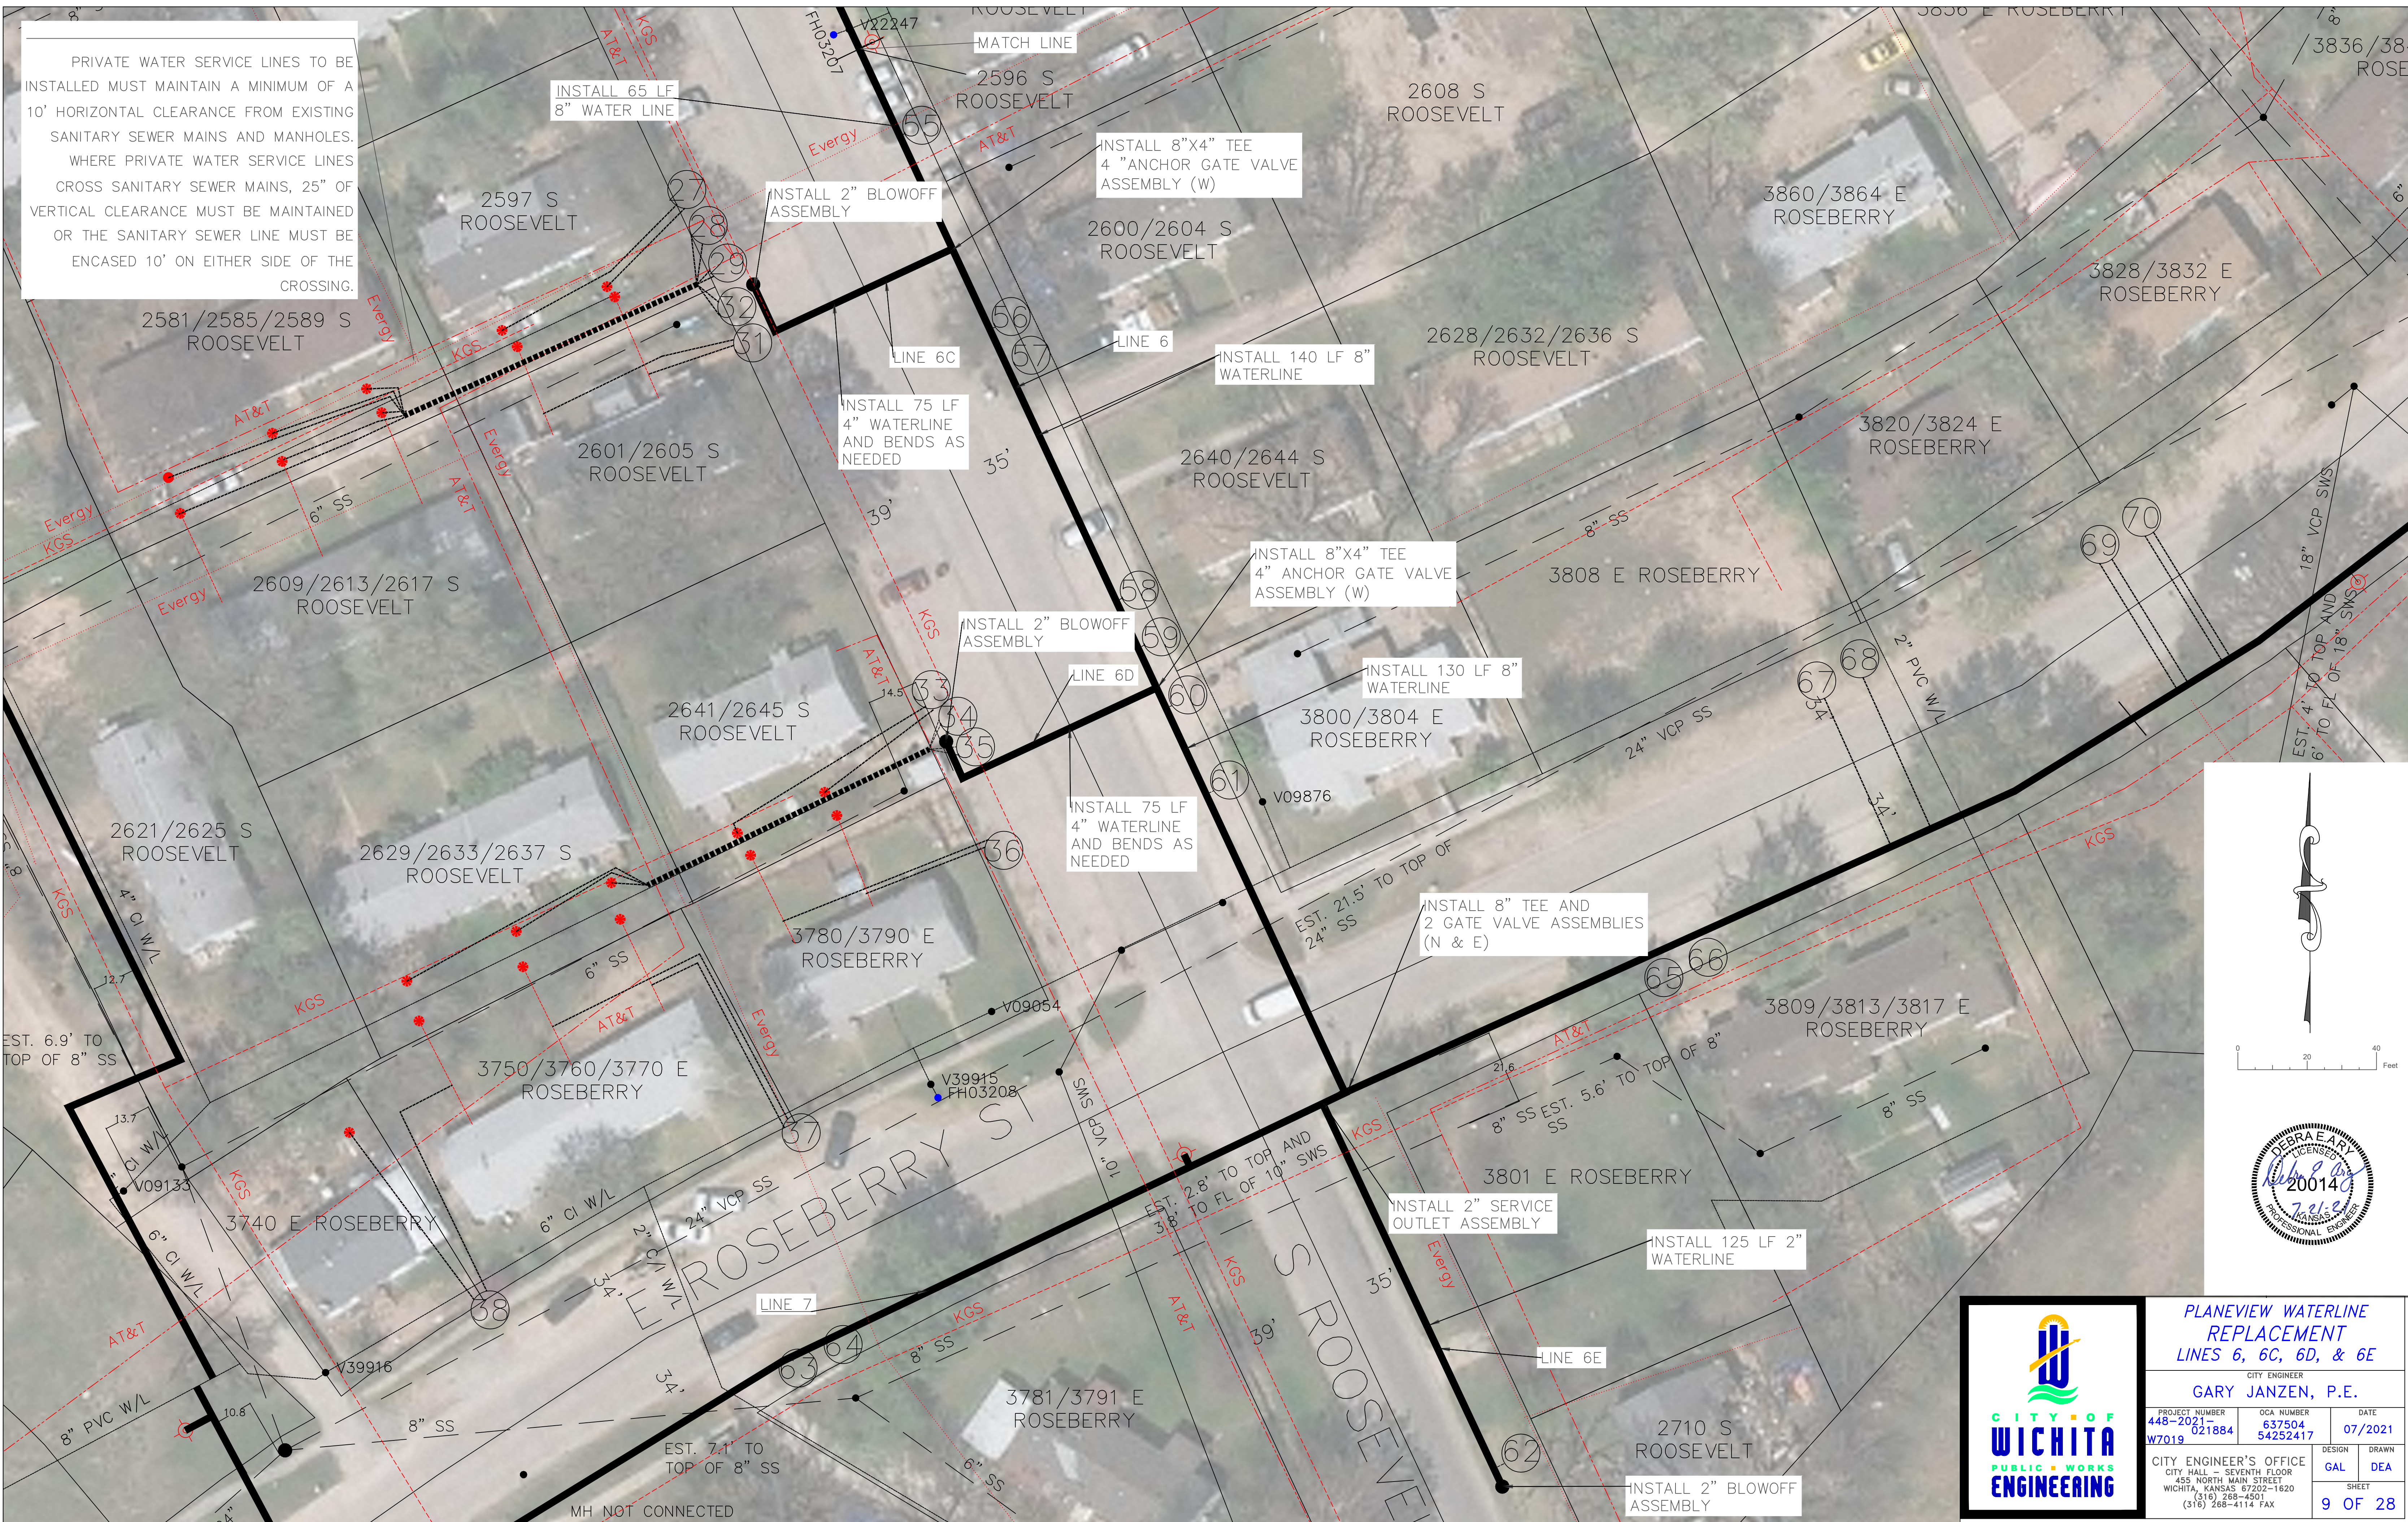

<b>PLANEVIEW WATERLINE REPLACEMENT LINES 6, 6C, 6D, &amp; 6E</b>		
CITY ENGINEER <b>GARY JANZEN, P.E.</b>		
PROJECT NUMBER 448-2021- W7019 021884	OCA NUMBER 637504 54252417	DATE 07/2021
CITY ENGINEER'S OFFICE CITY HALL - SEVENTH FLOOR 455 NORTH MAIN STREET WICHITA, KANSAS 67202-1620 (316) 268-4501 (316) 268-4114 FAX		DESIGN GAL DRAWN DEA SHEET 9 OF 28