


N: 1672956.7027, E: 1684343.9785
 PAWNEE STREET, STA. 42+32.40
 REPLACE EXISTING FIRE HYDRANT PER
 CITY STANDARDS.
 EXISTING TEE AND VALVE TO REMAIN.
 L= 4'
 TOP VALVE BOX EL.= 1387.4
 FH BURY LINE EL.= 1387.4

WATER SERVICE LINE RECONNECTION (TYPICAL)
 SEE DETAIL AND SCHEDULE, SHEET NO. 13

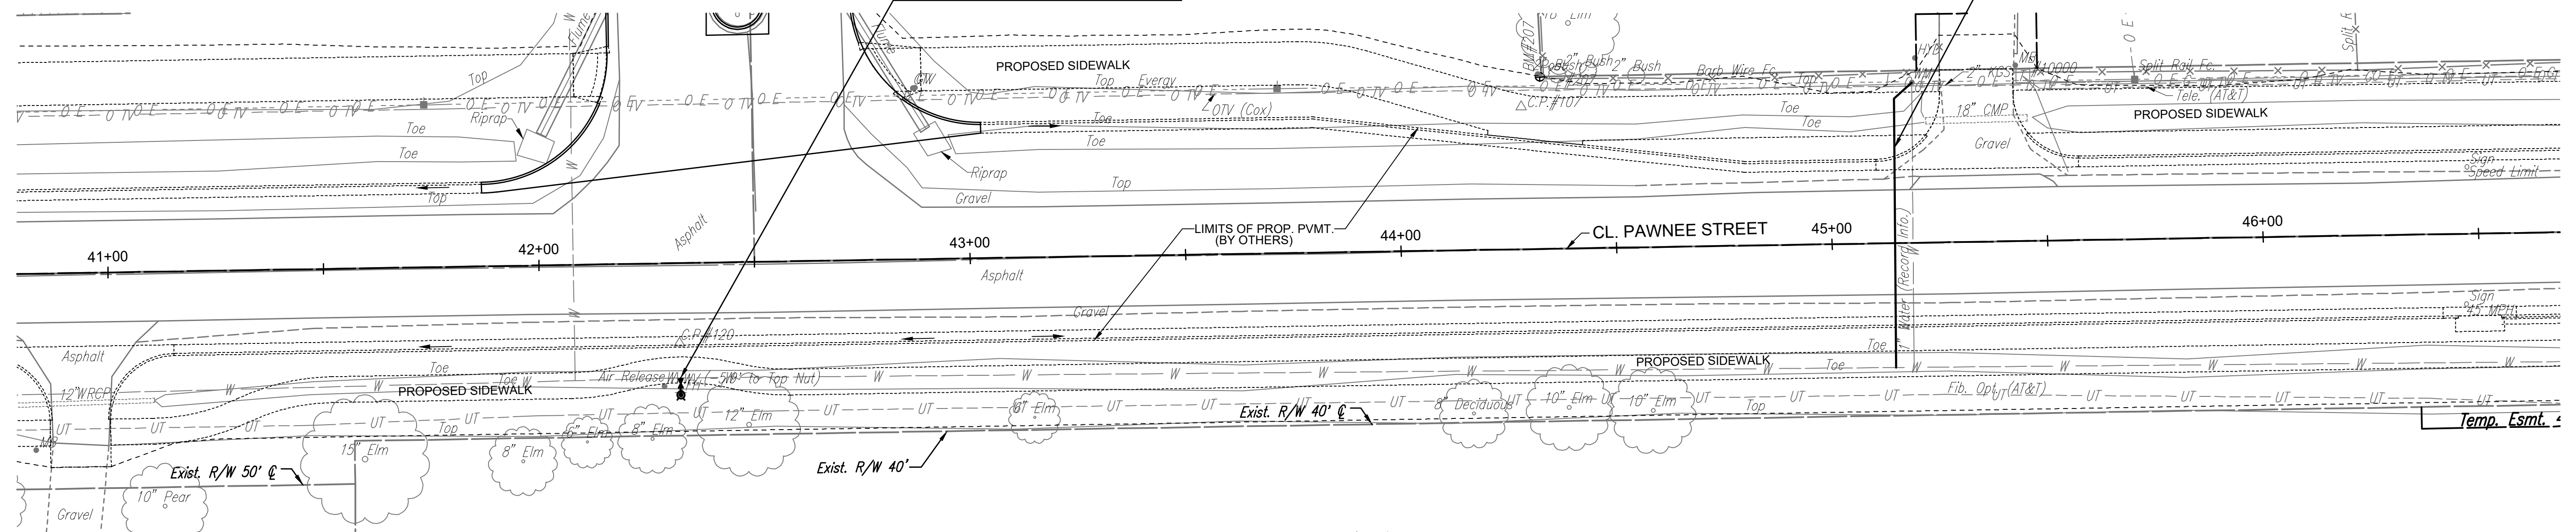

Saved: 04-09-2021 11:38:29 AM by: KURTIS DEKAT
 Plot Scale: 1" = 40'-0" (1:1600) 11/27/23 AM by: BLS
 U:\Wichita-Civil\2017\171395-004\Drawings\171395-004-E-WATER SERVICE AND FIRE HYDRANT REPLACEMENT

No.	Revision	By	Date
PAWNEE AVENUE FROM WEBB TO GREENWICH PAVING AND INCIDENTAL DRAINAGE IMPROVEMENTS WL SERV. & FIRE HYD. REPLACEMENT GARY JANZEN, P.E.—CITY ENGINEER CITY OF WICHITA PROJECT NO. 472-85434			
Designed by	TBK	Job No.	171395-004
Drawn by	KTD	Date	JANUARY 2021
			Sht. 8 of 15