


SOUTH SENECA
WATER MAIN ADJUSTMENTS
MAIN 3

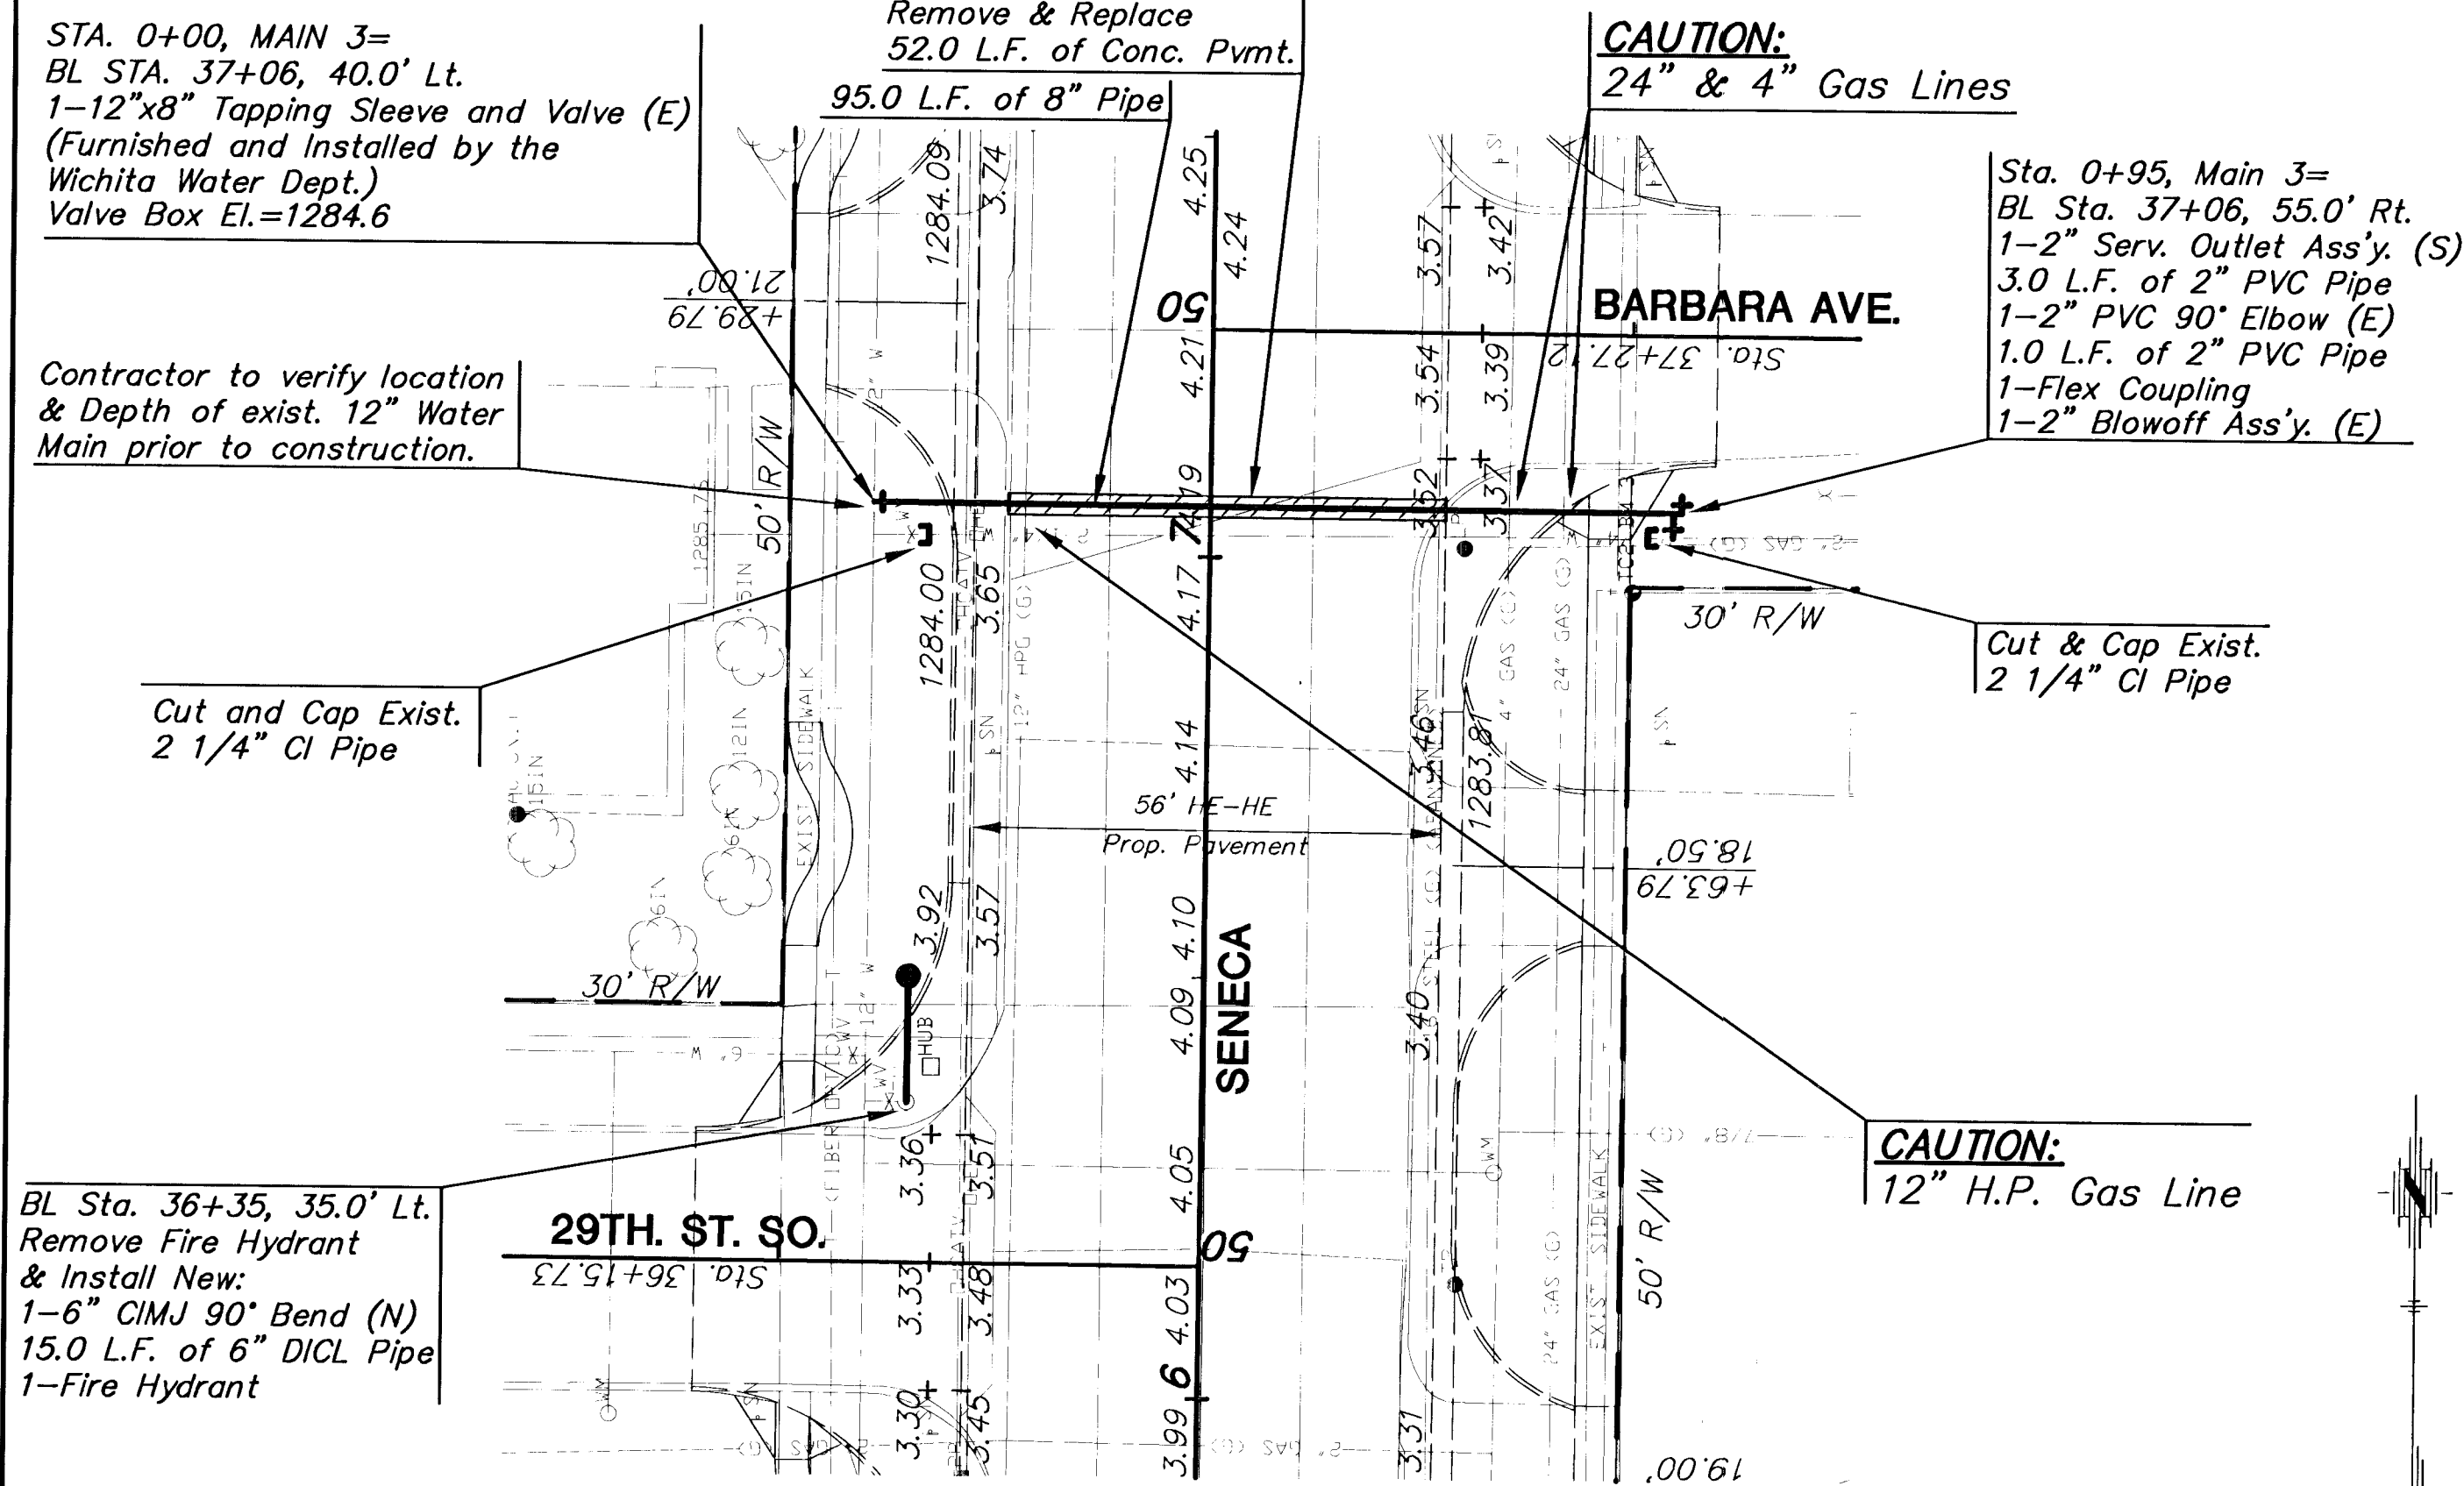

PLAN - MAIN 3
SCALE: 1" = 20'

SUMMARY OF QUANTITIES		
BID ITEM	QUANTITY	UNIT
8" Pipe	166	L.F.
8" DICL SJ Pipe	21	L.F.
6" DICL SJ Pipe	50	L.F.
4" Pipe	165	L.F.
2" Pipe PVC	99	L.F.
2" Service Outlet Assembly	3	EACH
Fire Hydrant Assembly	1	EACH
Fire Hydrant	5	EACH
2" Blowoff Assembly	3	EACH
1" Blowoff Assembly	1	EACH
Salvage Existing Fire Hydrant	6	EACH
Pavement Removal and Replacement	240	L.F.
Long Services Replaced	9	EACH
Short Services Replaced	12	EACH
Flowable Fill	233	L.F.
Cut and Cap 2 1/4" C.I. Pipe	4	EACH
Cut and Cap 2" PVC Pipe	1	EACH
Cut and Crimp 1" Service Line	1	EACH
6"x6" Tapping Sleeve and Valve *	1	EACH
12"x4" Tapping Sleeve and Valve *	1	EACH
12"x6" Tapping Sleeve and Valve *	1	EACH
12"x8" Tapping Sleeve and Valve *	2	EACH

* Furnished and installed by City of Wichita Water Department.

