


BENCHMARKS:
 BM #1: "□" Cut in face of curb inlet near SE corner of Lot 30, Block C, Gray's 5th Add. Elev. = 1297.86 NAVD88
 BM #2: "□" Cut in top of curb on east side of Flora, ±10' north of south property line of Gray's 5th Add. Elev. = 1302.40 NAVD88
 BM #3: "+" Cut in top of curb on east side of Flora, adjacent to common lot line of Lots 6&7, Block B, Trinity Point Add. Elev. = 1299.49 NAVD88

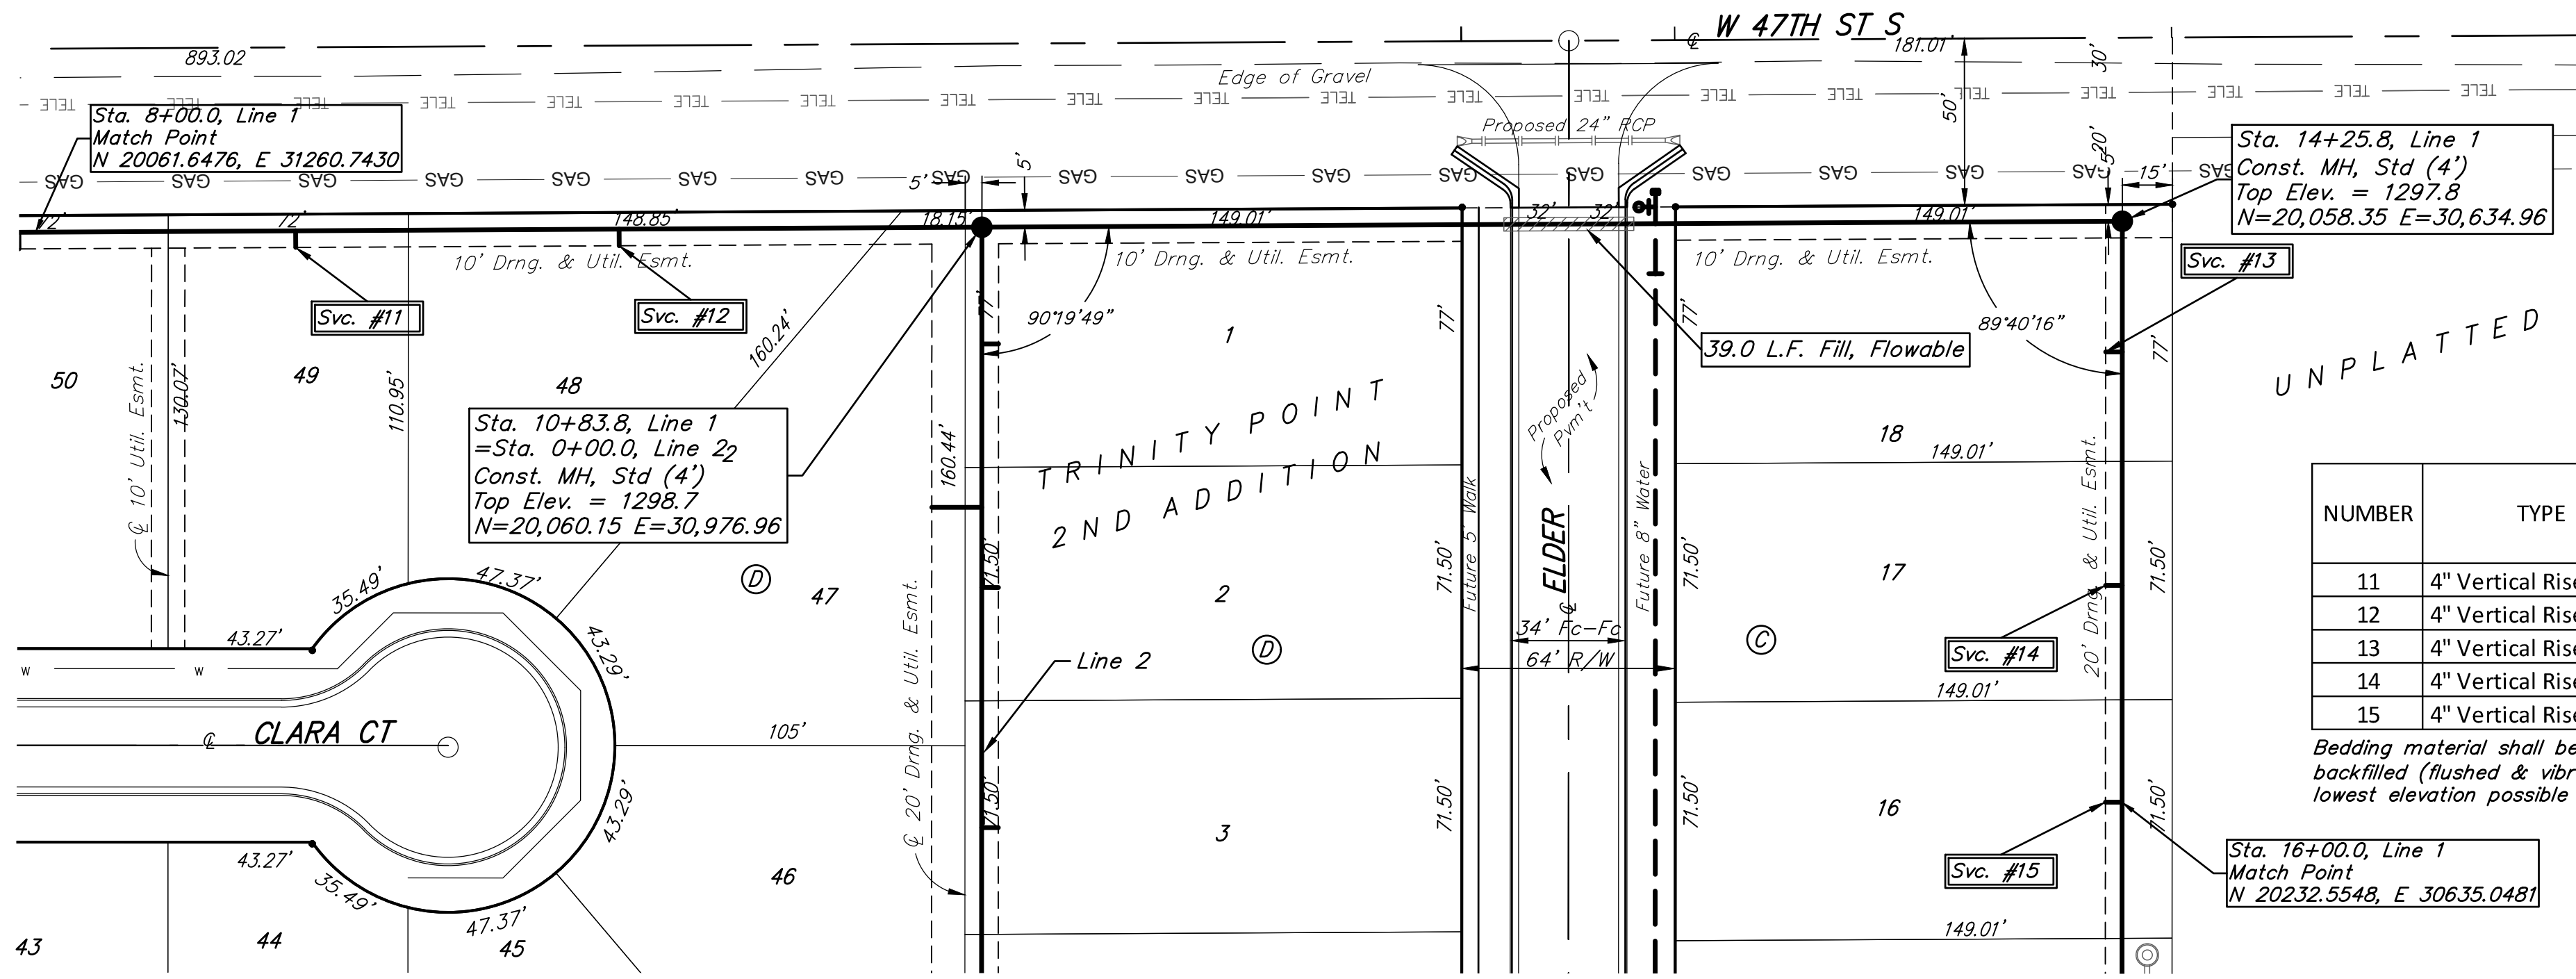

SEWER SERVICE TABLE

NUMBER	TYPE	LOCATION			FLOWLINE	FOR INFORMATION ONLY			
		LOT NO.	BLOCK	LINE NO.		APPROXIMATE LENGTH OF 4" PIPE			
						8" PIPE	4" PIPE	VERTICAL	HORIZONTAL
11	4" Vertical Riser Assy'	49	D	1	8+78.0 / Rt.	1283.13	1283.40	10.3'	5.0'
12	4" Vertical Riser Assy'	48	D	1	9+75.0 / Rt.	1283.52	1283.79	9.9'	5.0'
13	4" Vertical Riser Assy'	18	C	1	14+65.0 / Rt.	1285.68	1285.94	7.8'	5.0'
14	4" Vertical Riser Assy'	17	C	1	15+35.0 / Rt.	1285.96	1286.22	7.4'	5.0'
15	4" Vertical Riser Assy'	16	C	1	16+00.0 / Rt.	1286.22	1286.49	6.6'	5.0'

Bedding material shall be extended to an elevation 2' maximum below finished grade. All pipe including riser pipe shall be sand backfilled (flushed & vibrated). All service tees shall be rotated horizontally and extended at a 2% slope above horizontal to maintain lowest elevation possible to facilitate sewer service.

Contractor shall verify elevation and alignment of existing 8" stub prior to construction and notify Engineer of any discrepancy.

