


A PRESSBOX - HVAC DEMO PLAN
1/4" = 1'-0" 0' 1' 2' 4' 8'

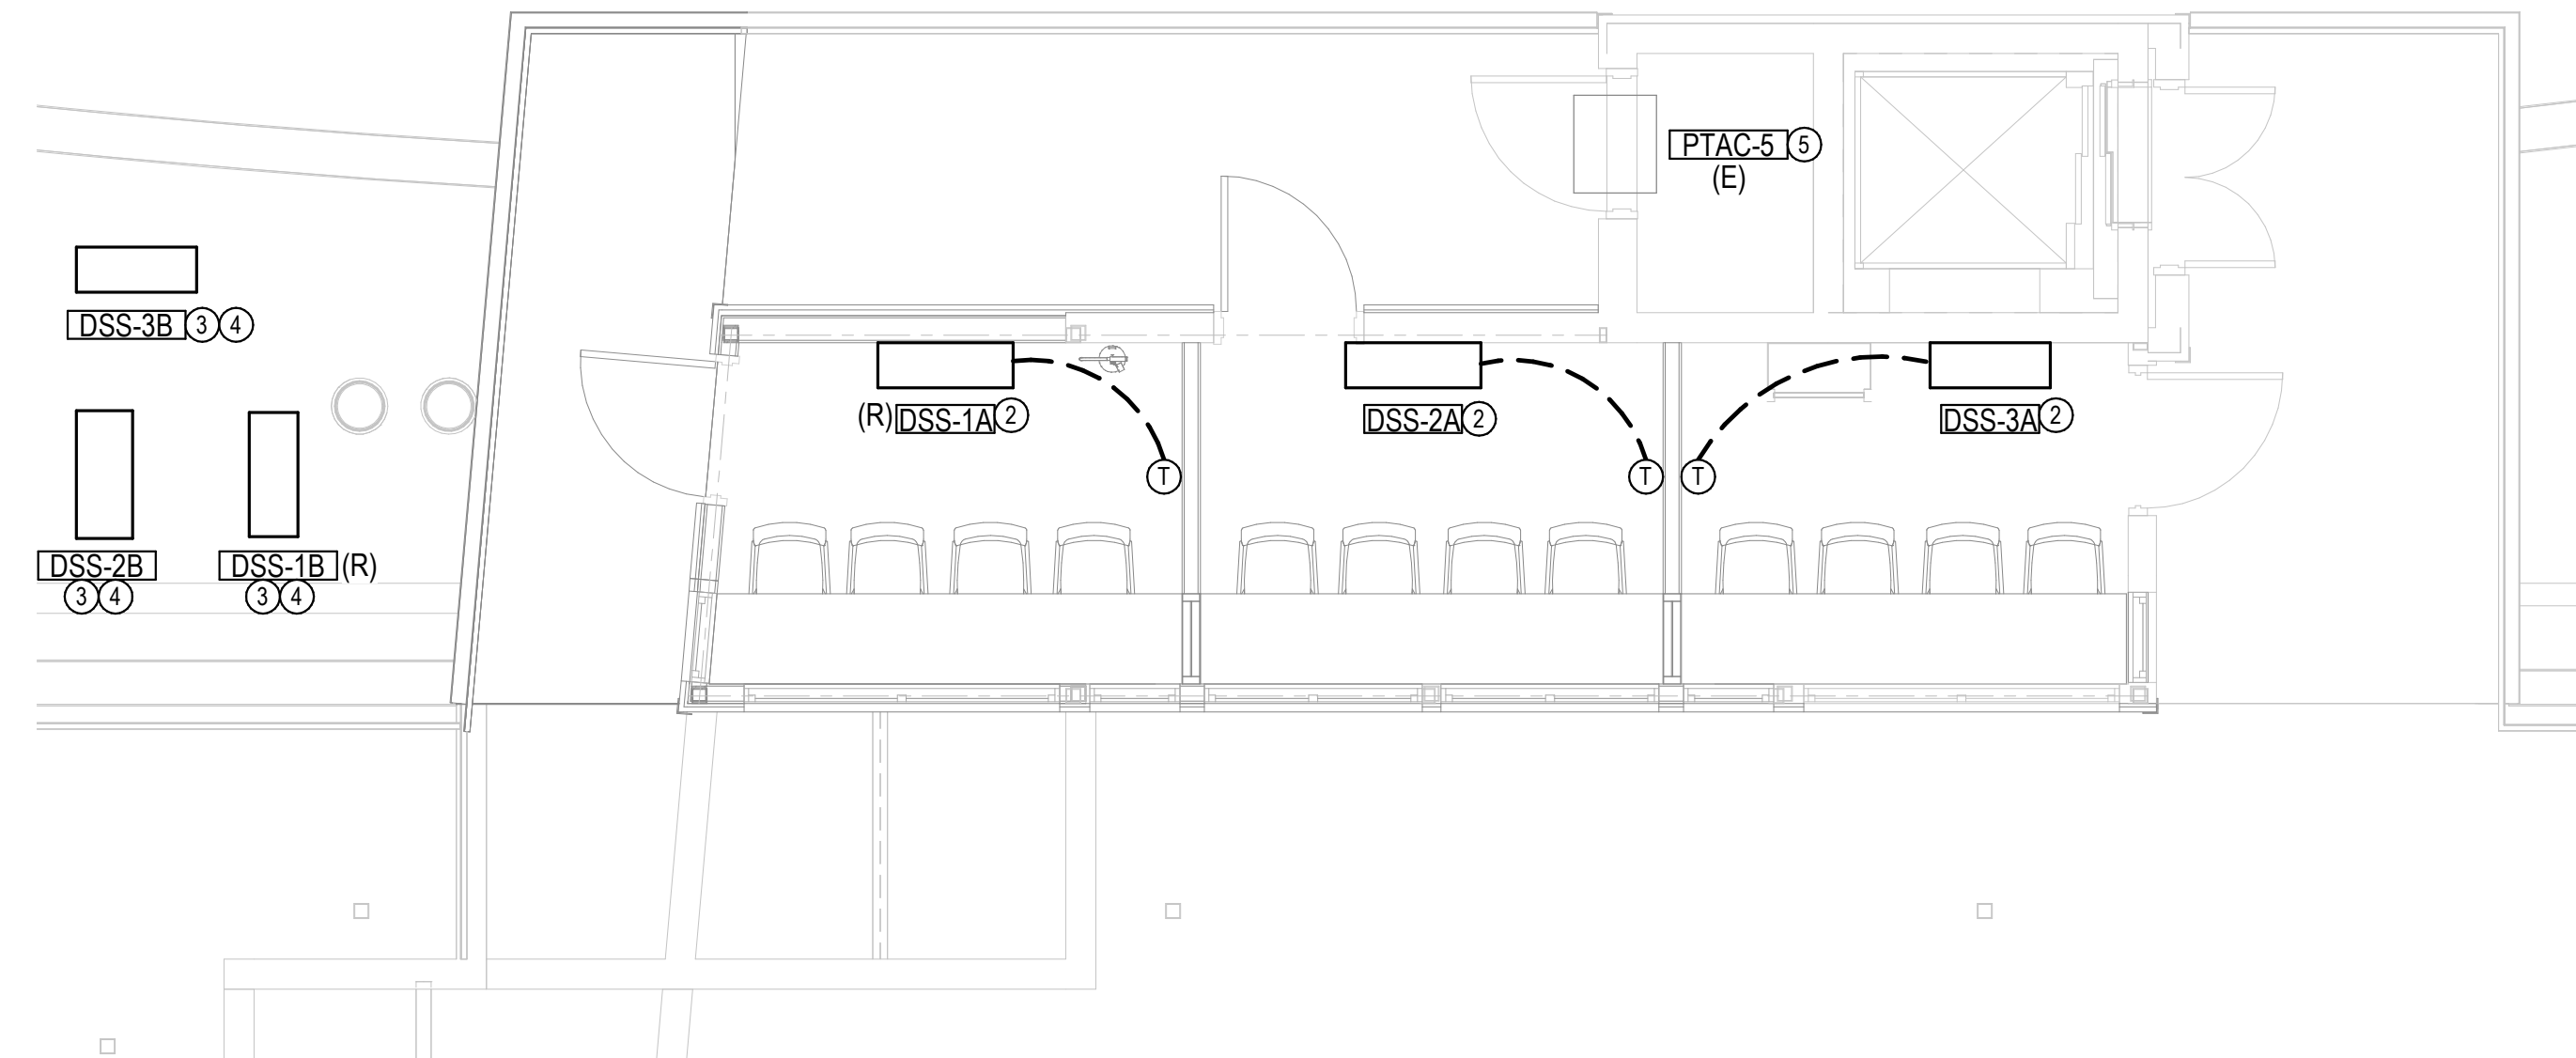


B PRESSBOX - HVAC IMPROVEMENT PLAN
1/4" = 1'-0" 0' 1' 2' 4' 8'

- KEYED NOTES SM1.2
1. REMOVE & RELOCATE EXISTING DUCTLESS SPLIT SYSTEM INDOOR AND OUTDOOR UNITS. SEE PLAN 'B' ON THIS SHEET FOR NEW INDOOR AND OUTDOOR UNIT LOCATIONS.
 2. PROVIDE AND INSTALL DUCTLESS SPLIT SYSTEM INDOOR UNIT ON WALL AS SHOWN. MOUNT UNIT AS HIGH AS PRACTICAL. COORDINATE INSTALLATION WITH OTHER TRADES. EXTEND 3/4" COPPER CONDENSATE DRAIN DOWN WITHIN WALL THROUGH FLOOR TO SPLASH BLOCK AT GRADE BELOW BLEACHERS.
 3. PROVIDE AND INSTALL DUCTLESS SPLIT SYSTEM OUTDOOR UNIT ON ROOF AS SHOWN. EXTEND REFRIGERANT PIPING AS NEEDED TO INDOOR UNIT. PROVIDE ROOF CURB.
 4. COORDINATE REFRIGERANT PIPING LENGTHS WITH ACTUAL PIPE ROUTING REQUIREMENTS FOR THIS INSTALLATION PRIOR TO PURCHASE OF EQUIPMENT. SEE PLAN B ON THIS SHEET FOR OUTDOOR UNIT LOCATION.
 5. EXISTING EQUIPMENT TO REMAIN.

DUCTLESS SPLIT SYSTEM SCHEDULE

MARK	MANUFACTURER	INDOOR UNIT MODEL	OUTDOOR UNIT MODEL	AIRFLOW (CFM)	COOLING (Mbh)		HEATING (Mbh)	ELECTRIC DATA					REMARKS
					SENSIBLE	TOTAL		VOLTS	PHASE	FLA	MCA	MOCP	
DSS-2A/2B	DAIKIN	MSZ-GL-09NA	MUZ-GL09NA	300	7.4	9	8.2	240	1	7.00	10	15	1,2,3,4,5
DSS-3A/3B	DAIKIN	MSZ-GL-09NA	MUZ-GL09NA	300	7.4	9	8.2	240	1	7.00	10	15	1,2,3,4,5

- REMARKS:
- (1) INDOOR UNIT IS POWERED FROM OUTDOOR UNIT.
 - (2) E.C. TO PROVIDE ELECTRICAL DISCONNECTS.
 - (3) ALL INDOOR UNITS SHALL BE FURNISHED FROM FACTORY WITH CONTROL RELAY / TRANSFORMER KITS AND 24 VOLT 7 DAY DIGITAL PROGRAMMABLE WALL-MOUNT THERMOSTATS.
 - (4) ALL OUTDOOR UNITS SHALL BE FURNISHED FROM FACTORY WITH HARD START KITS AND LOW AMBIENT CONTROLS. PROVIDE HAIL GUARDS.
 - (5) HEAT OUTPUT CONDITION AT 5° F.

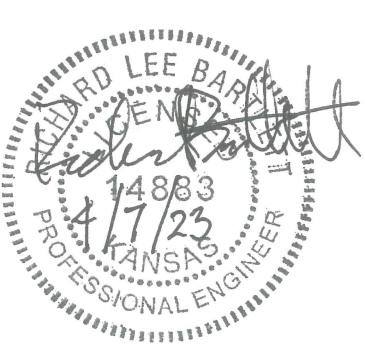

©2023 MKEC Engineering All Rights Reserved. www.mkec.com These drawings and their contents, including, but not limited to, all concepts, designs, & data are the exclusive property of MKEC Engineering (MKEC), and may not be used or reproduced in any way without the express consent of MKEC.

PRESS BOX - HVAC PLANS

PROJECT NO.	1701010567	
DATE	04-07-23	
SCALE	AS NOTED	
DESIGNED	DRAWN	CHECKED
RLB	JAC	RLB

0	ISSUED FOR CONSTRUCTION	04-07-23
NO.	REVISION	DATE

SHEET NO.
SM1.11