




SERVICE BOX CONSTRUCTION/INSTALLATION DETAILS

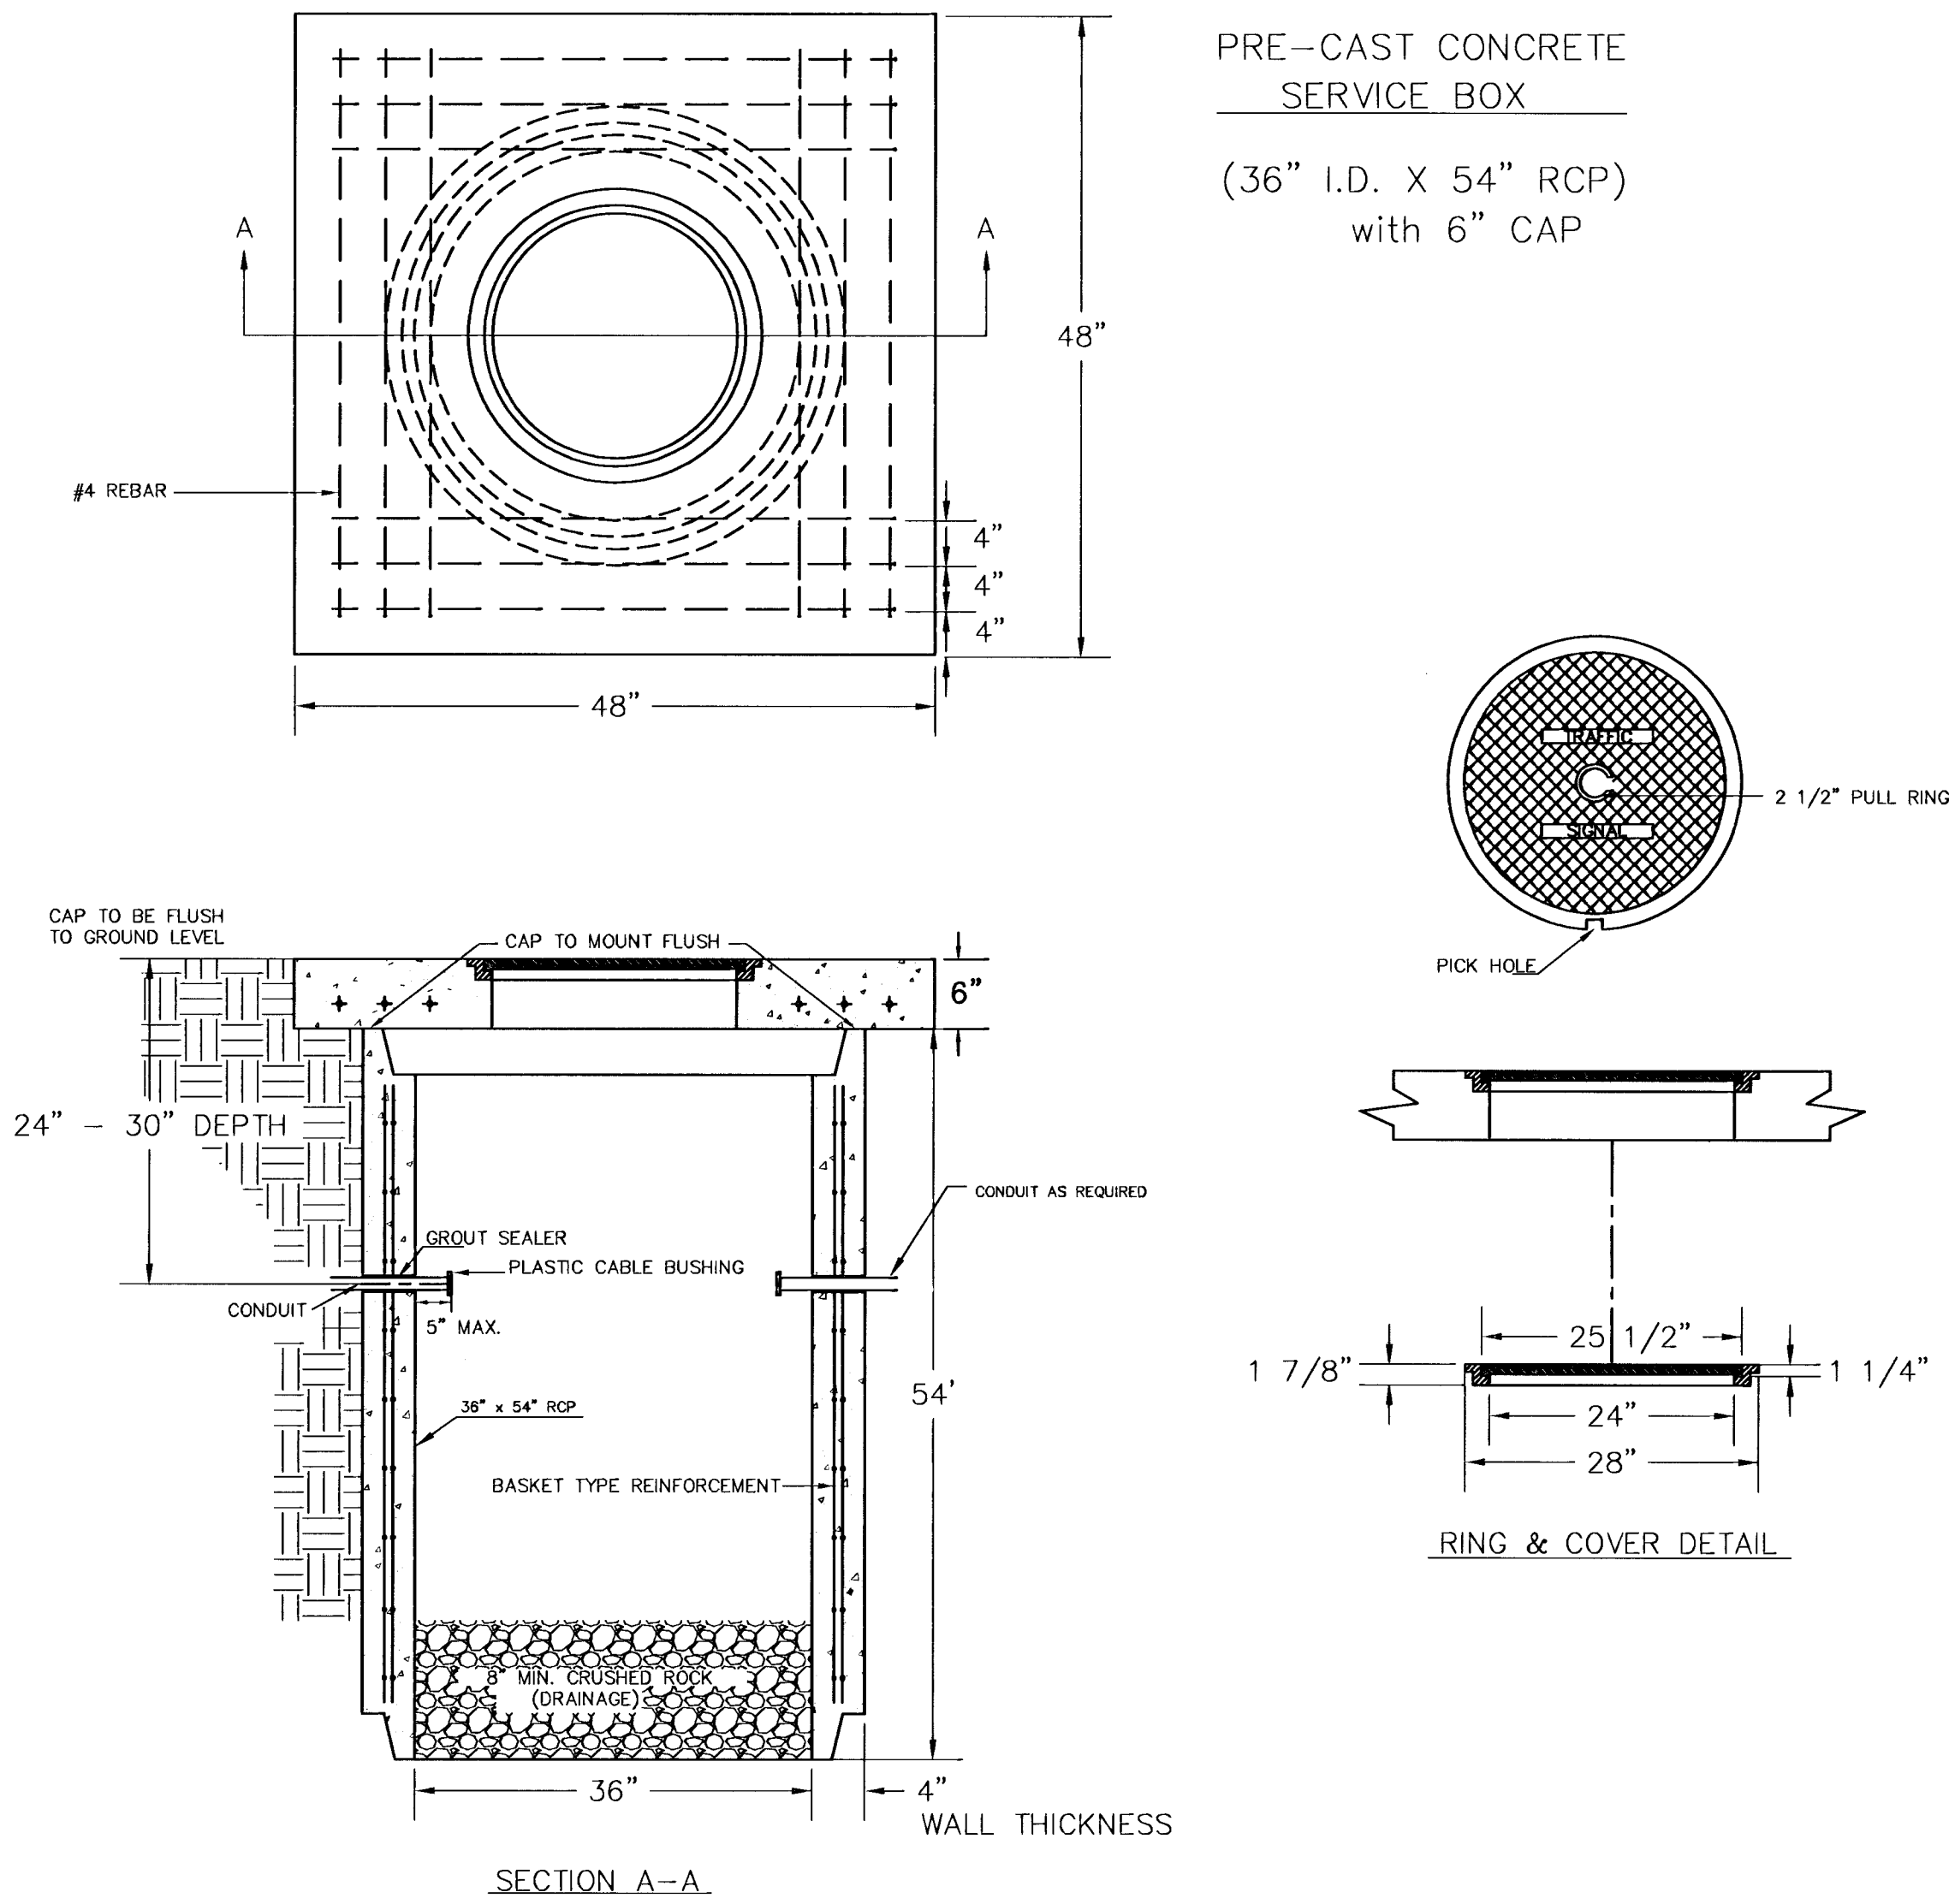


CONDUIT/DETECTOR WIRE INSTALLATION DETAILS

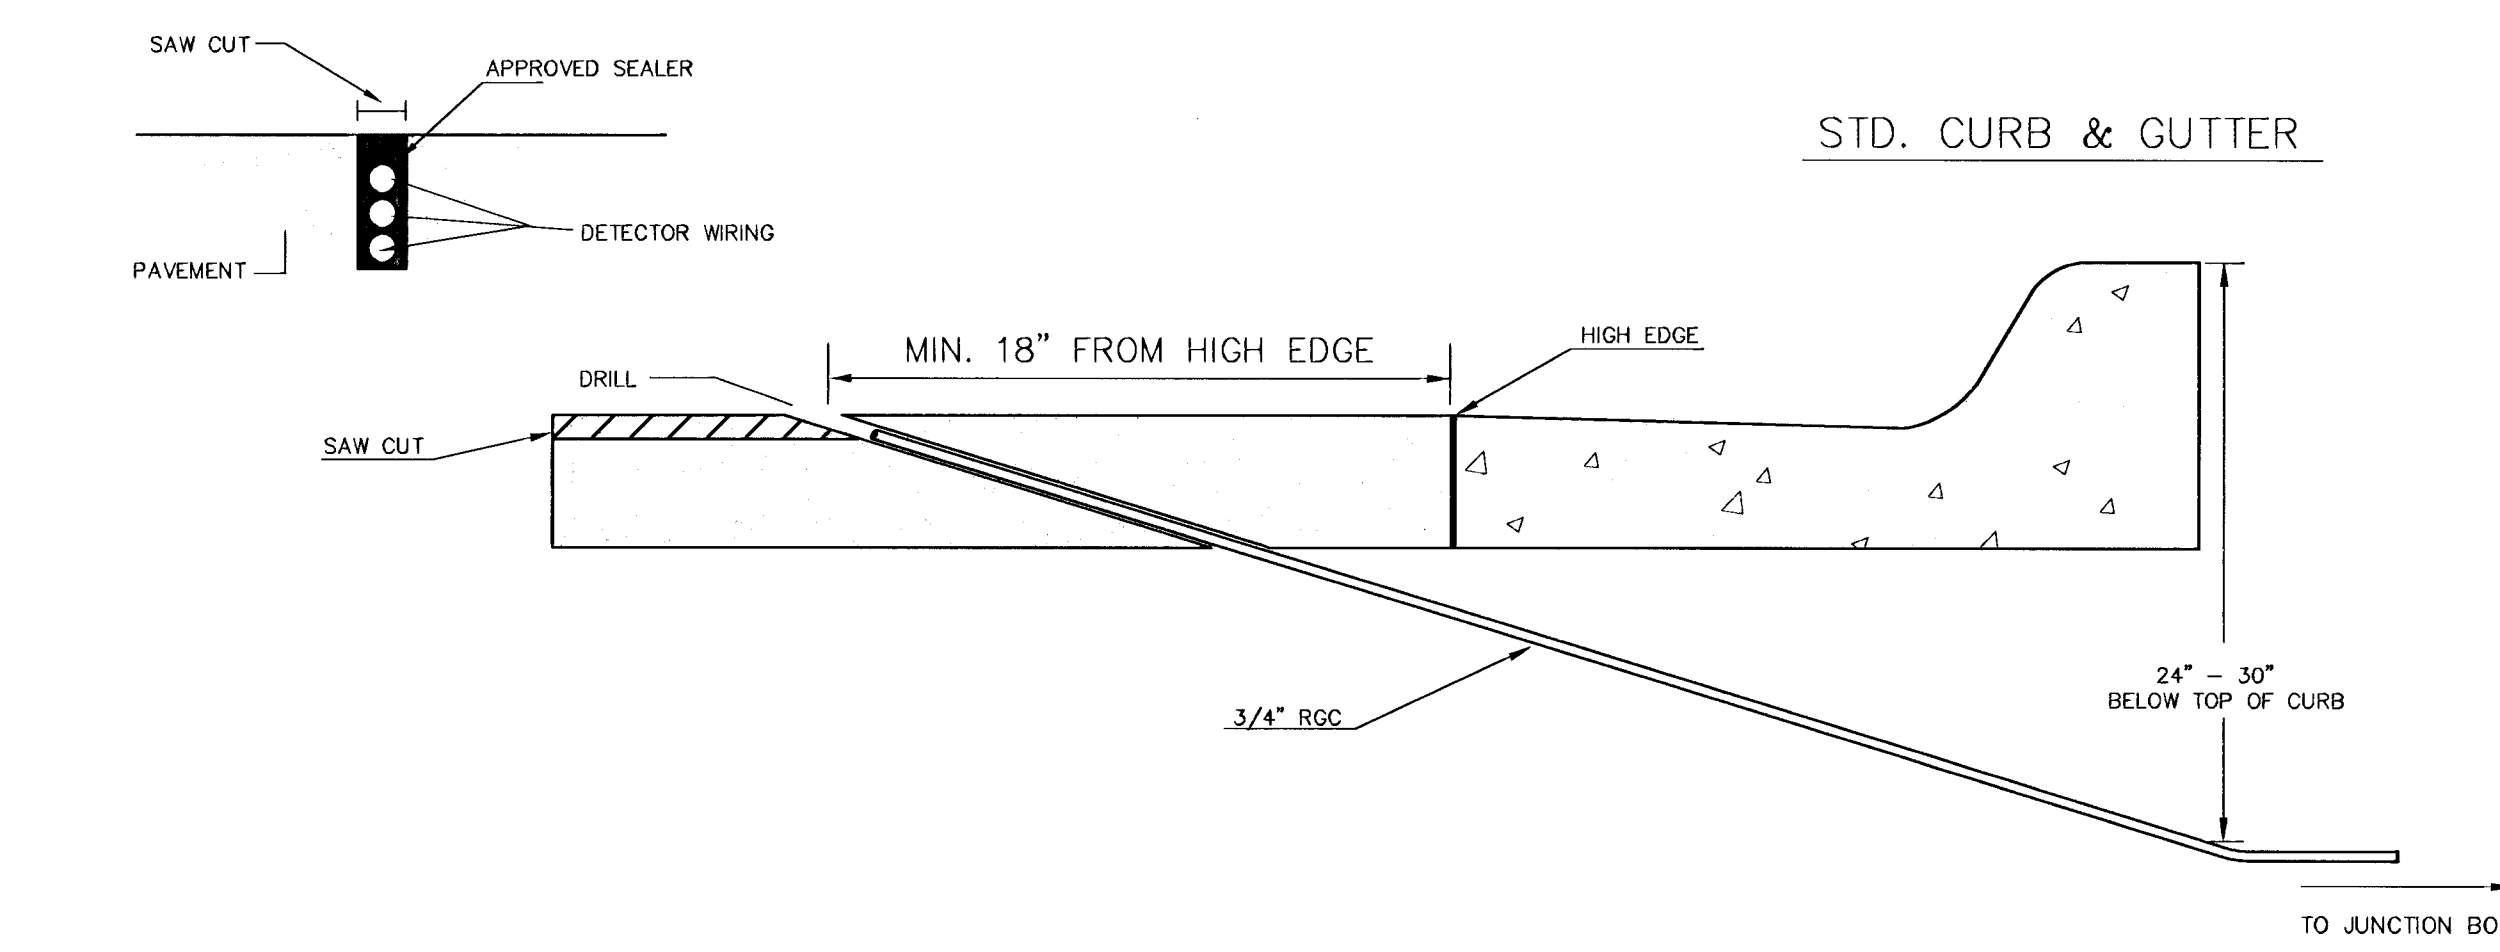

170 CONTROLLER PAD DETAILS

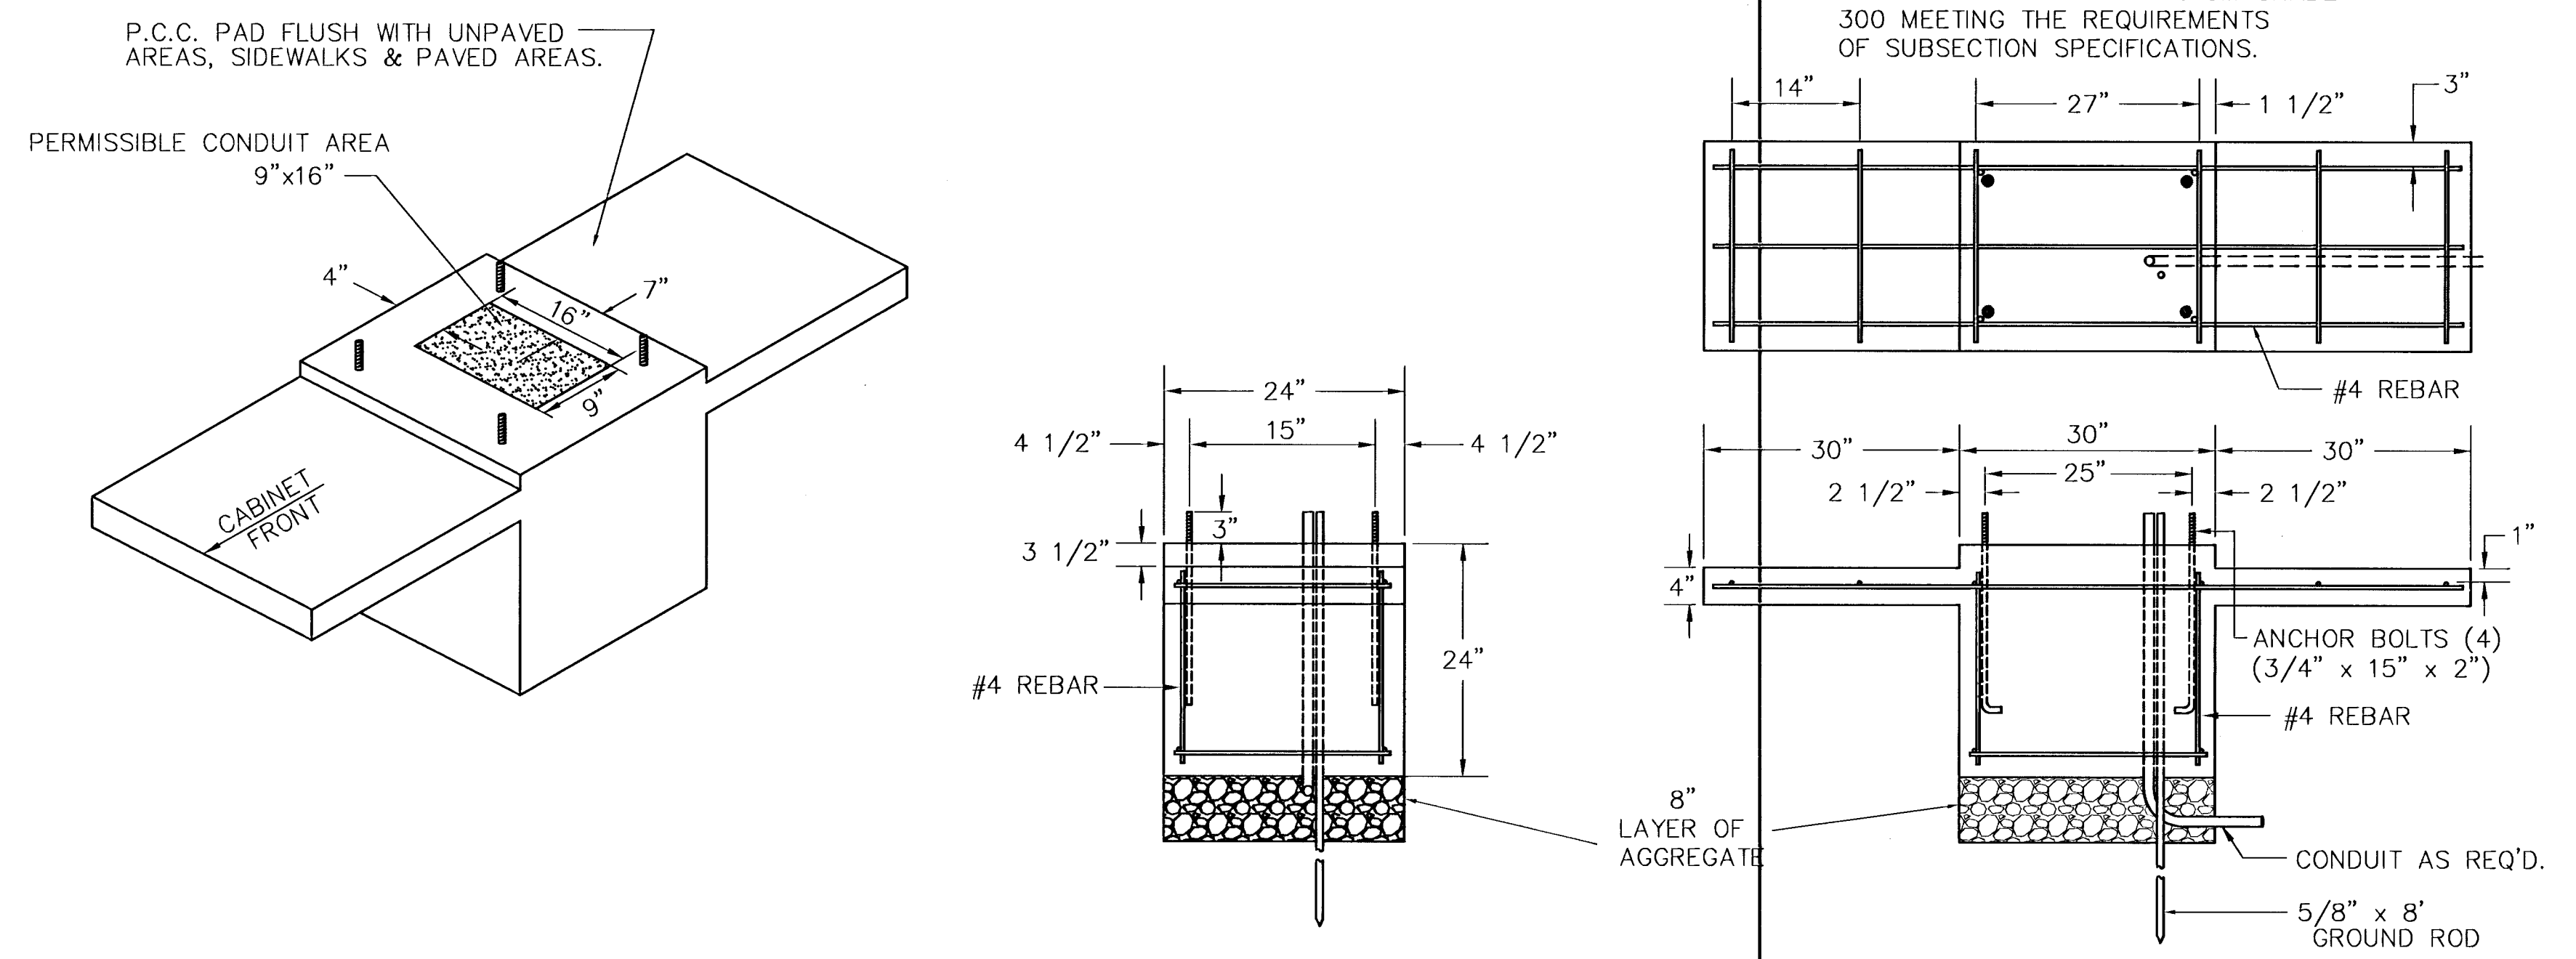

JUNCTION BOX DETAILS

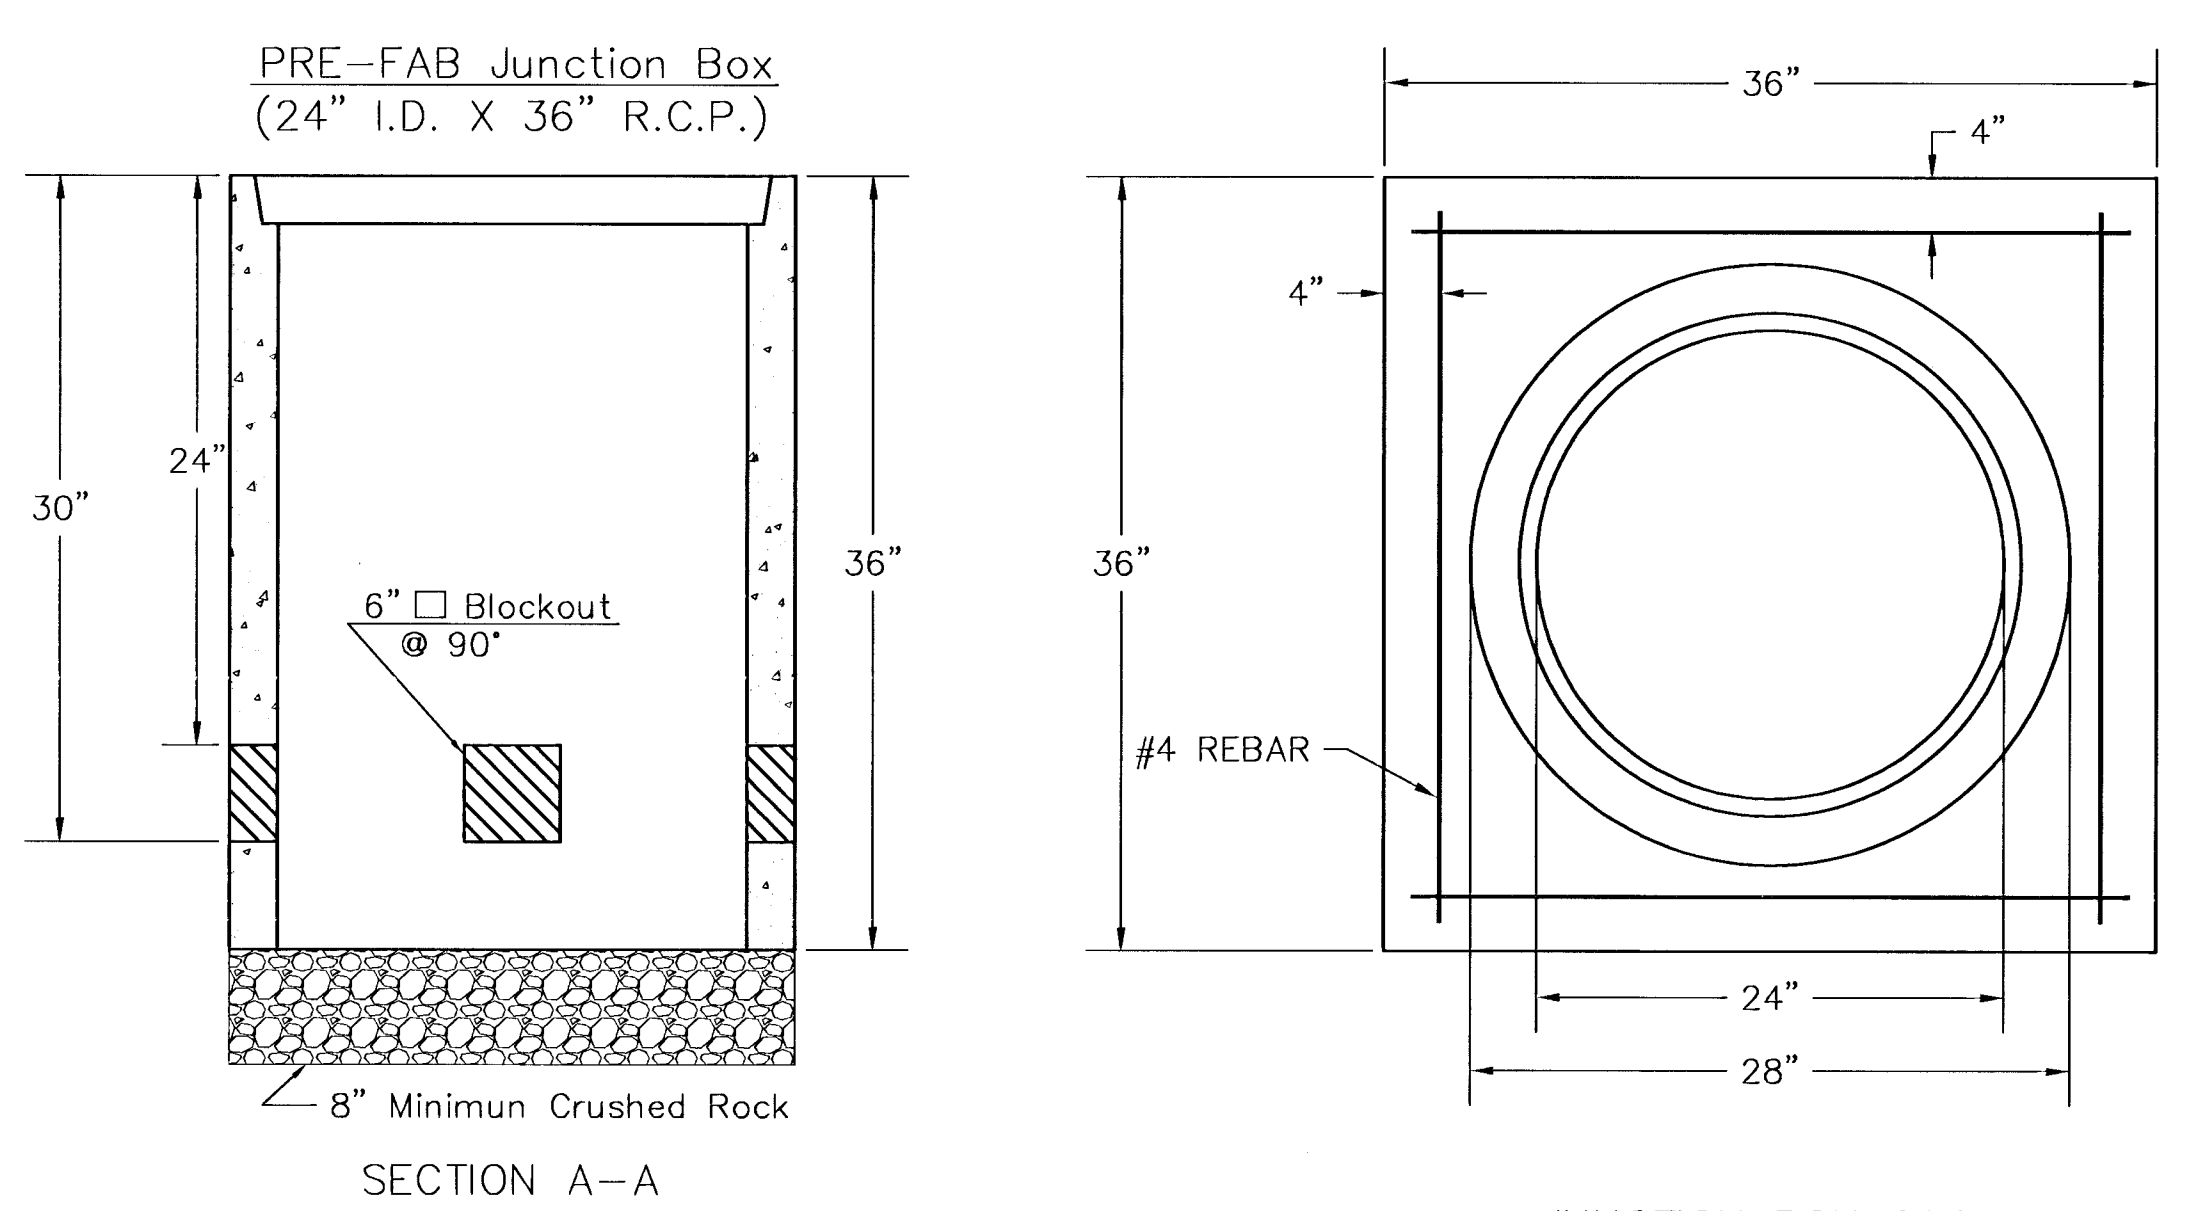

NOTES:

- SERVICE & JUNCTION BOX:
- CONDUIT CONNECTION TO BE FLUSH TO WITHIN 5" OF INSIDE FACE OF SIDE WALL, CONDUIT TO DRAIN INTO SERVICE BOX.
 - CONDUIT CONNECTIONS TO SERVICE BOX SHALL BE TERMINATED WITH PLASTIC CABLE BUSHING.
 - CONDUIT SHALL BE SEALED WITH APPROVED SEALER AT INSIDE WALL FACE.
 - ALL SERVICE & JUNCTION BOXES TO HAVE 8" OF CRUSHED ROCK.
- TRENCHING:
- DEPTH TO BE 30" MINIMUM WITH ROCK & STUBBLE FREE BACKFILL TO SERVE AS BEDDING MATERIAL. MAINTAIN MINIMUM CONDUIT DEPTH IN TRENCH.
 - BACKFILL TO BE COMPACTED IN 6" LOOSE LIFTS BY HAND OR MECHANICAL TAMPING TO A 95% STANDARD DENSITY.
- CONDUIT:
- SLOPE CONDUIT TO DRAIN AS DIRECTED BY THE ENGINEER.
 - 3" RIGID STEEL CONDUIT BTWN. SERVICE BOXES. 1 1/4" " " BTWN. SERVICE & JUNCTION BOXES. 3/4" " " BTWN. JUNCTION BOXES. 3/4" " " BTWN. JUNCTION BOX & DETECTOR LOOP SAW CUT

**SEE SERVICE BOX INSTALLATION FOR RING & COVER DETAILS.

REV. DATE	COMMENTS	INT

PROJECT DESCRIPTION		
SERVICE/JUNCTION BOX, CONTROLLER PAD CONSTRUCTION/INSTALLATION DETAILS		
PROJECT NUMBER		
DRAWN BY: T.M.	APPROVED BY:	REVISD:
DATE: Apr. 96	DATE:	DATE:
CITY OF WICHITA		
DEPARTMENT OF PUBLIC WORKS		
TRAFFIC ENGINEERING DIVISION		SCALE
WM. G. MCKINLEY P.E.	TRAFFIC ENGINEER	NO SCALE

SB-DTLONG

H:\CIVIL\SENECA\94005\DETAILS\SB-DTL F11 May 30 13:40:07 1997