


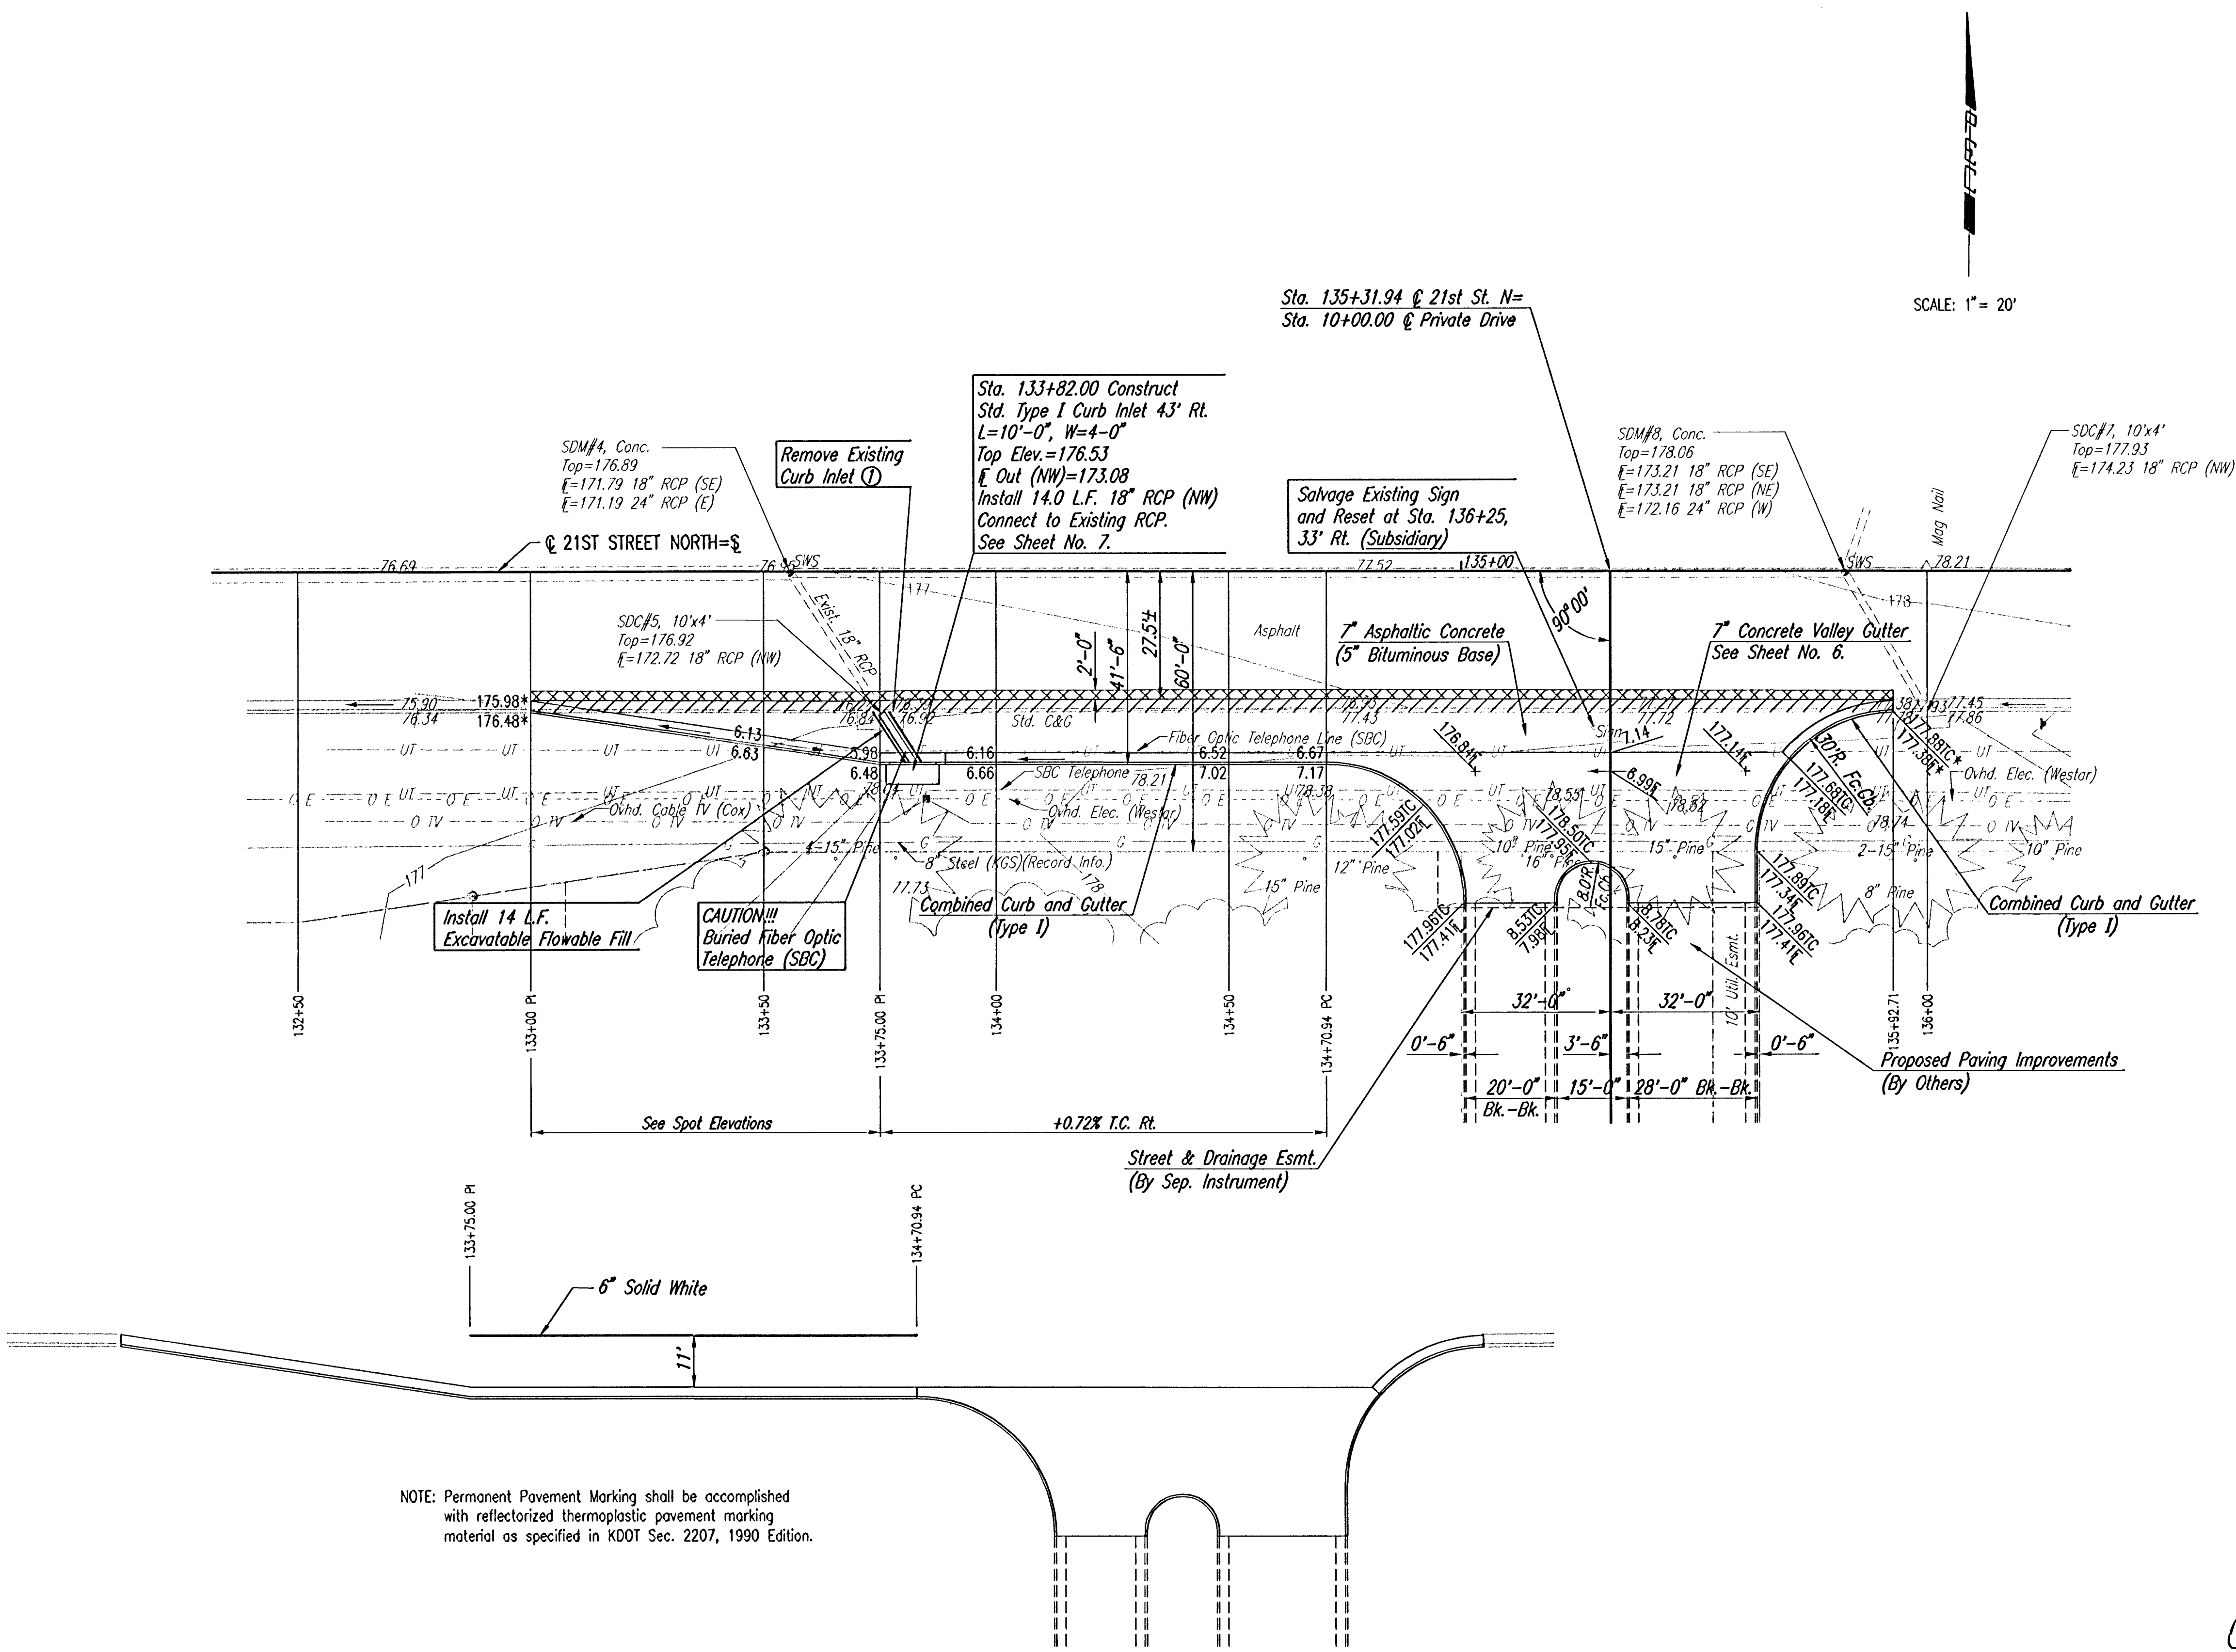

① Backfill overexcavated area as necessary and compact to minimum 90% std. density, or as otherwise required for pipe backfill. At contractor's option, this backfill may be accomplished using flowable fill. This work, including optional use of flowable fill, shall be considered Subsidiary to removal of the existing inlet.

- Saw Cut, Remove and Replace Asphalt Surface (Subsidiary to 7\"/>
- Remove Combined Curb and Gutter
- * Match Existing

NOTE: Permanent Pavement Marking shall be accomplished with reflectorized thermoplastic pavement marking material as specified in KDOT Sec. 2207, 1990 Edition.

MARKING PLAN

Professional Engineering Consultants, P.A.
303 S. TOPEKA • WICHITA, KANSAS 67202
316-262-2691 • FAX 316-262-3003

Designed by	BDB, BMM	Job No.	35-05548-000	Sheet	5 of 12
Drawn by	BMM, BJS	Date	October 2005		

Save: 02-13-2006 1:11:20 PM by BJS
Plot Scale: 1/20 02-13-2006 2:00:17 PM by JMU
C:\2005\05548\000\05548-000-C-SPR13-136