


SAVED 10/11/2023 3:56:39 PM BY JACOB BURNS
 PLOTTED 10/16/2023 9:35:11 AM BY JACOB BURNS
 U:\WICHITA-CIVIL\2020\200335\004\TELEC\DRAWINGS\E1.1 ELECTRICAL SITE PLAN.DWG

KEY NOTES:

- ① EXISTING POWER HANDHOLE.
- ② EXISTING CONTROLS HANDHOLE.

ELECTRICAL SITE PLAN NOTES:

1. UNLESS OTHERWISE NOTED, ALL CONDUIT ROUTED ON SITE SHALL BE 1" MINIMUM.
2. ALL RISERS SHALL BE PVC COATED RIGID GALVANIZED STEEL (RGS) ALL ELLS BELOW GRADE SHALL BE PVC COATED RIGID GALVANIZED STEEL (RGS). PROVIDE WITH PVC TO STEEL ADAPTER(S) AS NECESSARY. (THIS REQUIREMENT SHALL NOT APPLY TO FIXTURE POLE BASES)
3. ALL ELECTRICAL WORK AND FEES ASSOCIATED WITH UTILITIES SHALL BE VERIFIED AND COORDINATED WITH LOCAL SERVICE PROVIDER PRIOR TO BID.
4. CONTRACTOR SHALL REFERENCE ALL RELATED CONTRACT DOCUMENTS, SITE SURVEY, AND OTHER RESOURCES FOR POSSIBLE CONFLICTS WITH OTHER UNDERGROUND UTILITIES. AT UTILITY CROSSINGS, CONTRACTOR SHALL VERIFY UTILITY DEPTHS AND COORDINATE CONDUIT ROUTING AS NECESSARY.
5. CONTRACTOR SHALL VERIFY AND COORDINATE EXISTING CONDITIONS OF PROJECT SITE PRIOR TO BID.

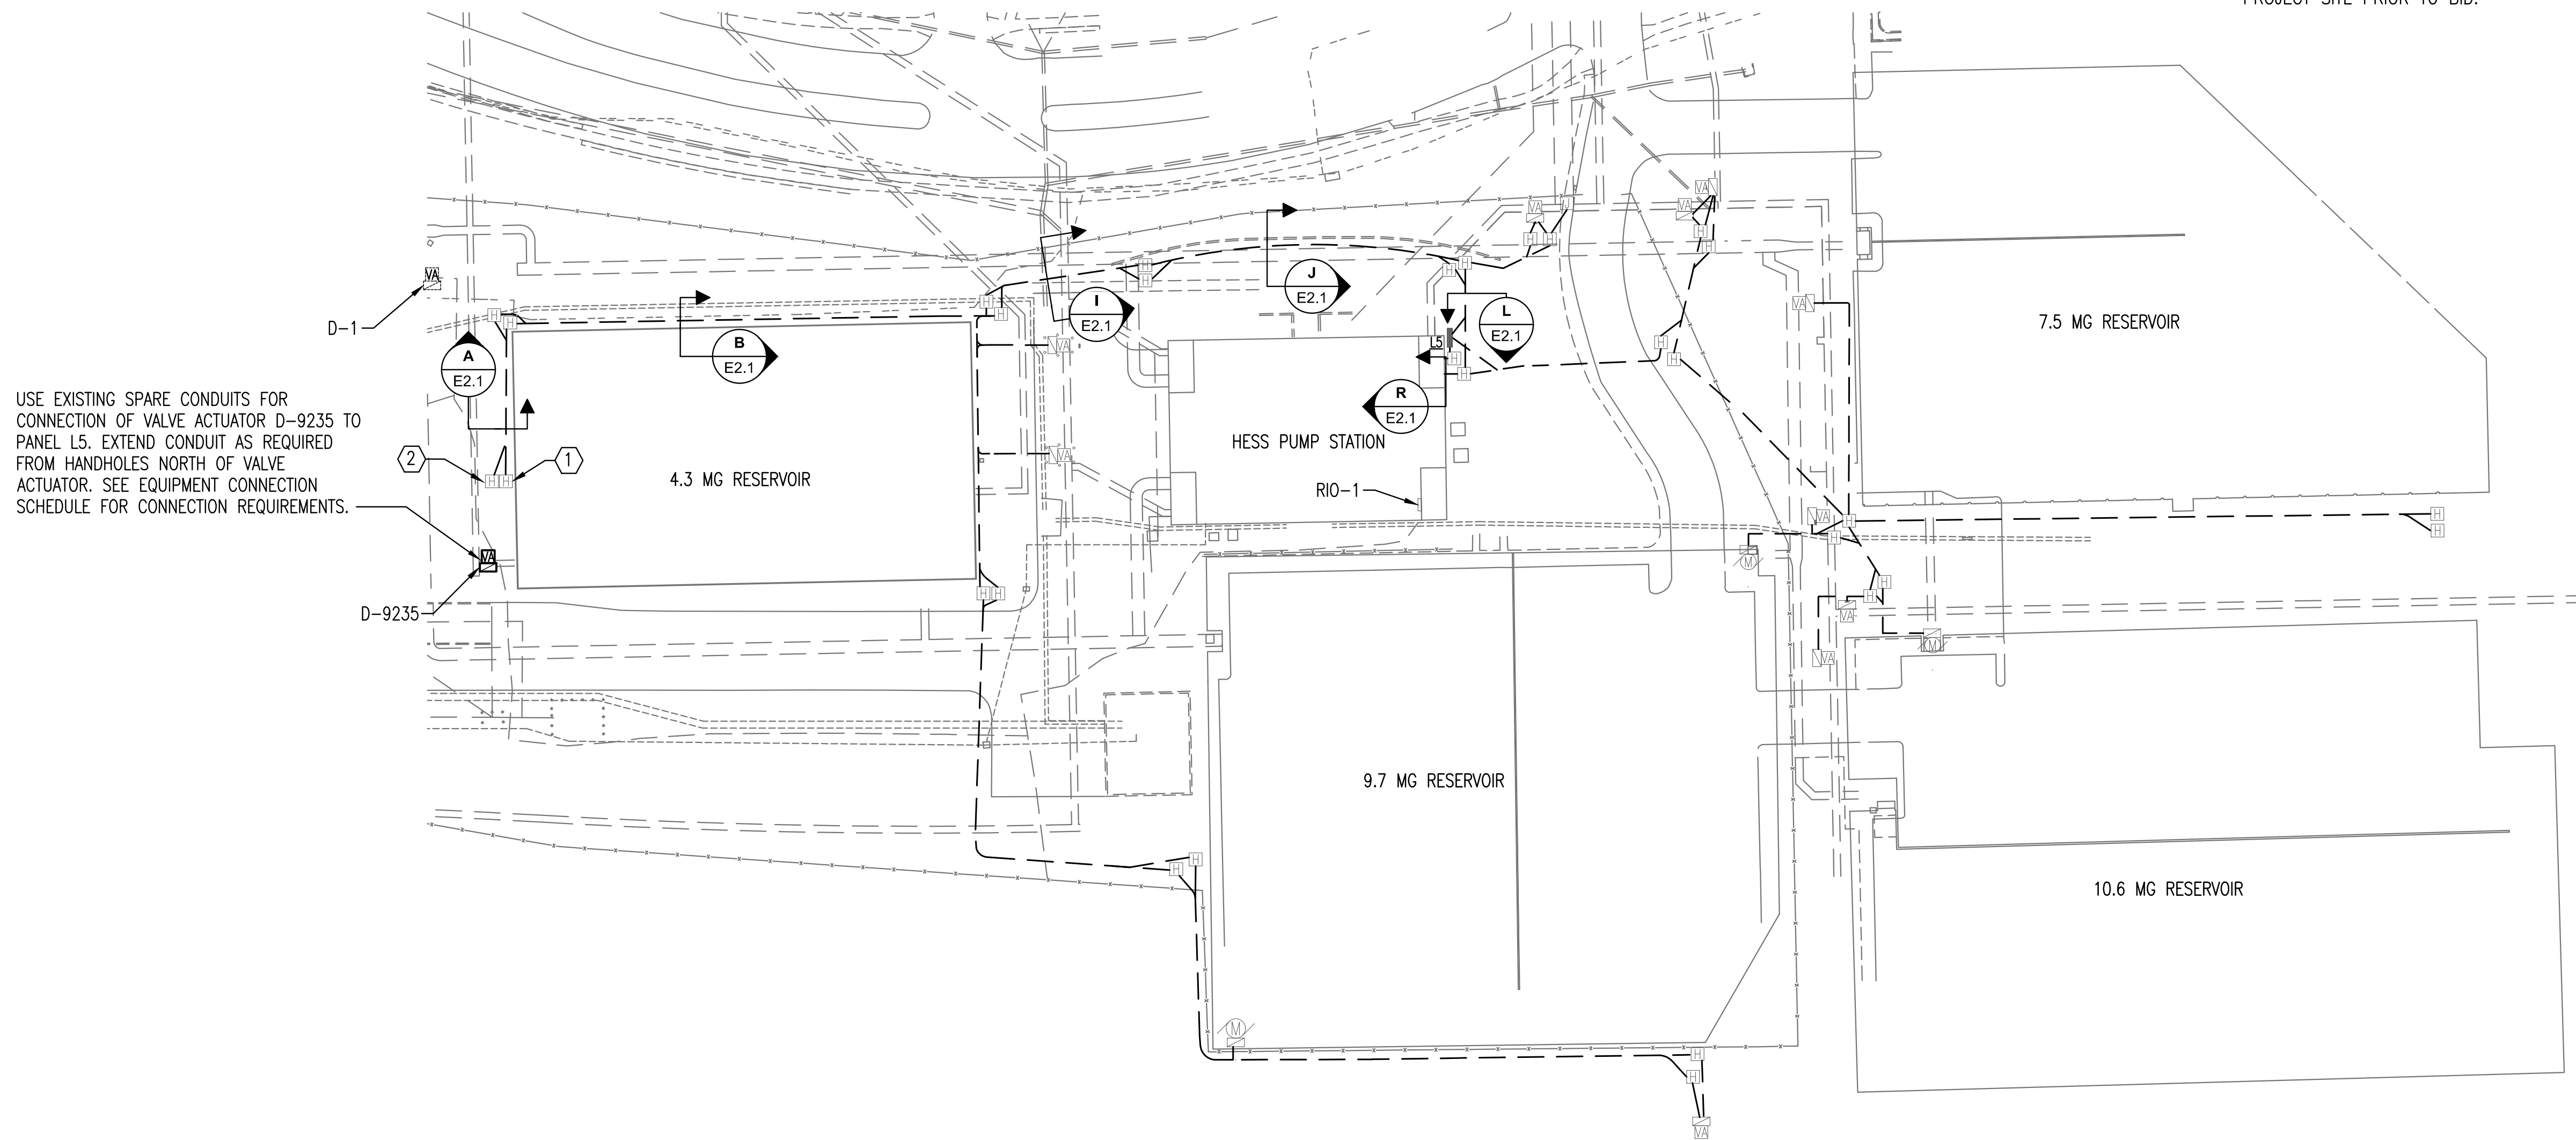

A ELECTRICAL SITE PLAN - HESS PUMP STATION

SCALE: 1"=60'-0" 0' 30' 60' 90' 150'



CONSTRUCTION PLANS
 FOR
HESS PUMP STATION
SITE VALVE REPLACEMENT
(PHASE 1 AND 2)
 PAUL GUNZELMAN, P.E. - INTERIM CITY ENGINEER
 CITY OF WICHITA PROJECT NO. 448-2021-005881

| | |
|-------------|---------------|
| Issue: | |
| | |
| | |
| | |
| | |
| JOB NO. | 200335-004 |
| DATE | OCTOBER, 2023 |
| PM | TBK |
| DESIGNED BY | RWW |
| DRAWN BY | JAB |
| CHECKED BY | RWW |

ELECTRICAL SITE PLAN

E1.1