SITE PLAN NOTES:

1. UNLESS OTHERWISE NOTED, ALL CONDUIT ROUTED ON SITE SHALL BE 1" MINIMUM.
2. ALL RISERS SHALL BE PVC COATED RIGID GALVANIZED STEEL (RGS) ALL ELLS BELOW GRADE SHALL BE PVC COATED RIGID GALVANIZED STEEL (RGS). PROVIDE WITH PVC TO STEEL ADAPTER(S) AS NECESSARY. (THIS REQUIREMENT SHALL NOT APPLY TO FIXTURE POLE BASES).
3. ALL ELECTRICAL WORK AND FEES ASSOCIATED WITH UTILITIES SHALL BE VERIFIED AND COORDINATED WITH LOCAL SERVICE PROVIDER PRIOR TO BID.
4. CONTRACTOR SHALL REFERENCE ALL RELATED CONTRACT DOCUMENTS, SITE SURVEY, AND OTHER RESOURCES FOR POSSIBLE CONFLICTS WITH OTHER UNDERGROUND UTILITIES. AT UTILITY CROSSINGS, CONTRACTOR SHALL VERIFY UTILITY DEPTHS AND COORDINATE CONDUIT ROUTING AS NECESSARY.
5. CONTRACTOR SHALL VERIFY AND COORDINATE EXISTING CONDITIONS OF PROJECT SITE PRIOR TO BID.

KEYED NOTES

#	
X2	WEATHER-PROOF J-BOX FOR CONNECTION OF SCOREBOARD.
X3	WEATHER-PROOF J-BOX FOR COMMUNICATIONS CABLING FOR SCOREBOARD. PROVIDE 1-1/2" CONDUIT AND STUB UP IN ROOM.

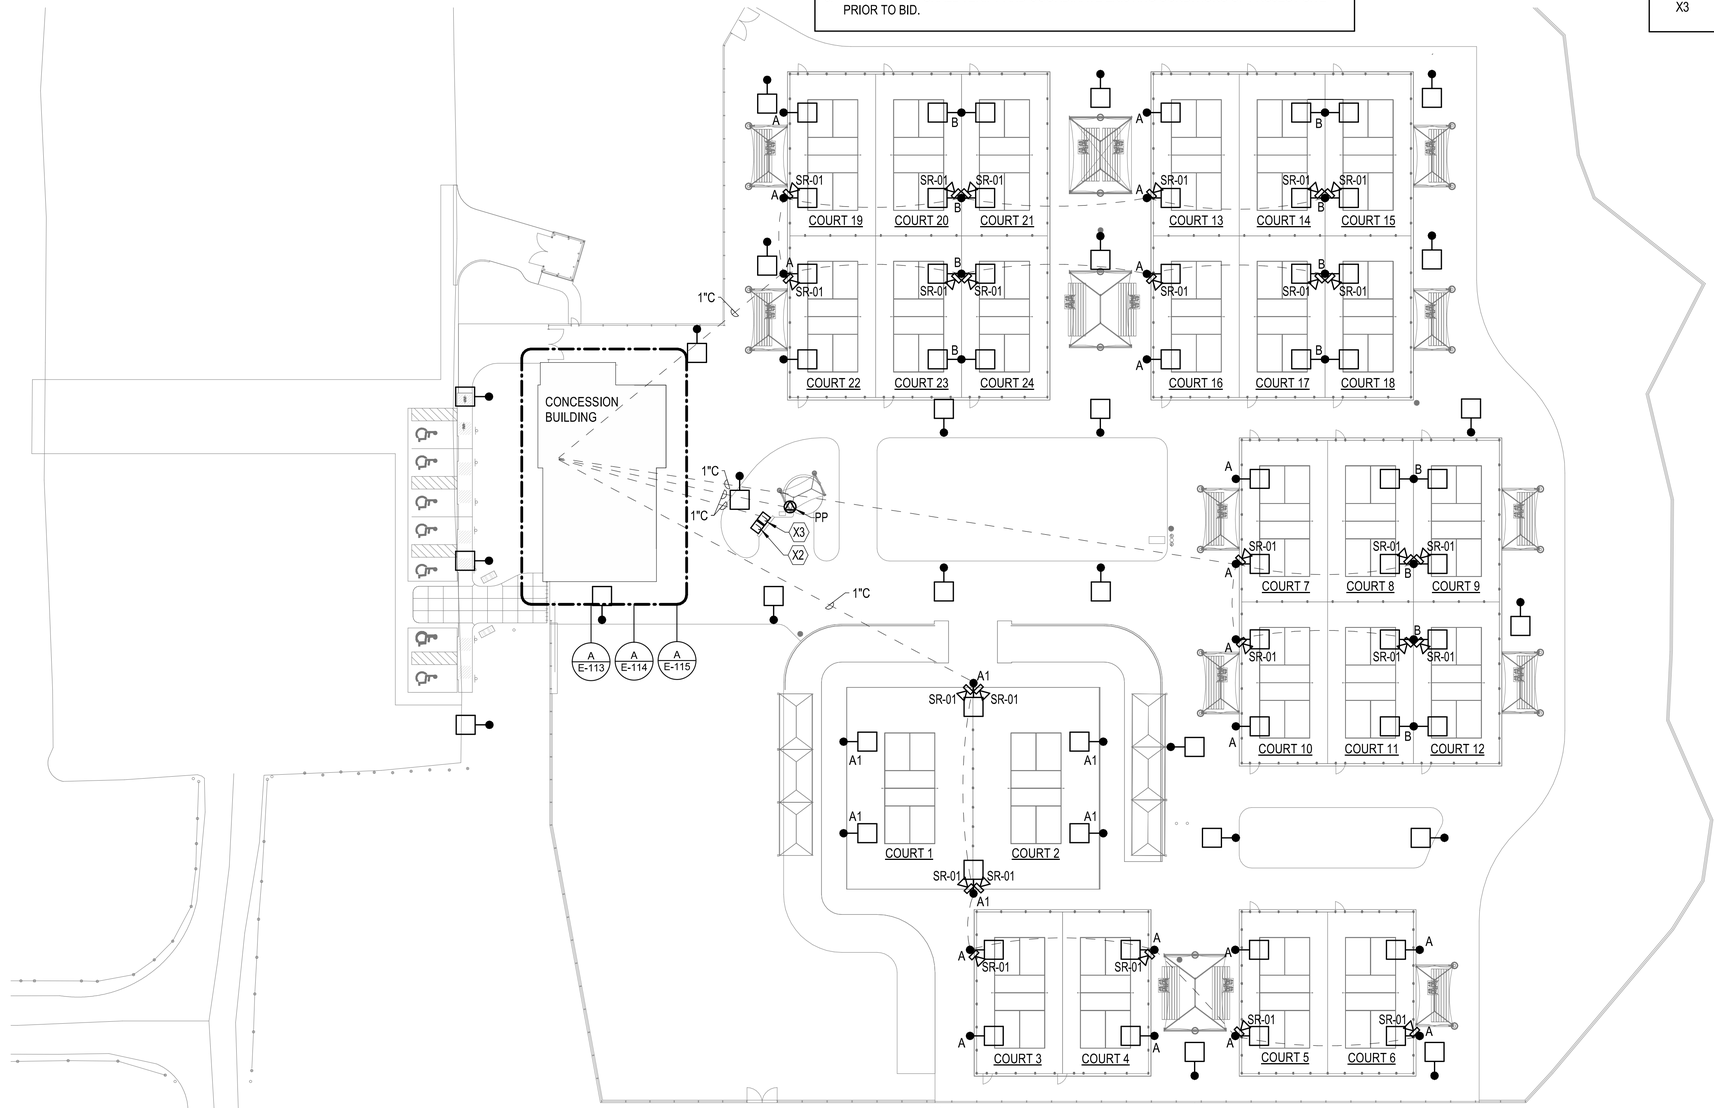

N

A AUDIO/VISUAL SITE PLAN

0' 15' 30' 45' 1" = 30'-0"

PEC
PROFESSIONAL ENGINEERING CONSULTANTS
303 SOUTH TOPEKA
WICHITA, KS 67202
316-262-2691 www.pec1.com

CITY OF WICHITA

SEAN PATRICK GERITY
LICENSED
28753
10/25/2023
MECHANICAL
PROFESSIONAL ENGINEER

SOUTH LAKES SPORTS PARK
WICHITA, KS

Issue:		
	100% PLANS	10/18/23
	BID SETS	10/25/23

JOB NO.	220008-003
DATE	18 OCTOBER 2023
PM	NLS
DESIGNED BY	DCG
DRAWN BY	SRM
CHECKED BY	SMS

AUDIO-VISUAL SITE PLAN

E-112

10/25/2023 4:16:28 PM
Autodesk Docs://220008-003 - South Lakes Pickleball - South/220008-003_ELEC_R22..rvt