

GENERAL NOTES

- The Contractor will be required to provide a minimum advance notice of forty-eight (48) hours to utility companies prior to excavation or working adjacent to utilities.
- The Contractor shall notify pipeline companies at least forty-eight (48) hours in advance of any work being performed over or adjacent to existing pipelines.
- The Contractor shall give all property owners and/or tenants of developed property directly abutting the construction of this project a minimum of ten (10) days notice prior to start of construction.
- All water mains and appurtenances shall be installed in accordance with City of Wichita, Kansas, Standard Specifications for Water Main Installations No. FW005240.
- Contractor shall not start work on the project until the Project Inspector is assigned to the project and is present on the site. Any work done without inspection will be required to be uncovered for inspection.
- The Contractor shall be responsible for preserving property irons. The Contractor will be required to re-establish any property irons which are damaged or destroyed by their construction operations. Such irons shall be re-established by a licensed land surveyor in accordance with state laws.
- Utility service lines, poles, gas valve boxes, meter, et cetera are to be adjusted as necessary by others prior to construction unless the plans specifically call for their adjustment by the Contractor or unless the plans specifically identify a utility to be adjusted by its owner during construction. Existing utilities and their location, as shown on the plans, represent the best information obtainable for design. The Contractor will be required to work around existing utilities within the right-of-way which do not conflict with proposed construction.
- Opening and closing of water valves shall be done slowly to prevent damage to the water distribution system from water hammer. All valves closed by the Contractor must be reopened as new construction permits. Project Inspector must ascertain that any valve closed by the Contractor is reopened. Contractor will be permitted to operate water valves only when the Project Inspector assigned to the project is present.
- A saw cut of at least one-half the depth of existing surface courses or one-fourth the depth of existing total pavement thickness shall be provided at locations where proposed construction abuts an existing surface course or pavement for which partial removal of that surface or pavement is required, except when such saw cuts are within three (3) feet of an existing joint the limits of removal shall be extended to the existing joint. Such saw cuts will not be paid for directly and this cost shall be considered as SUBSIDIARY to the removal of the surface or pavement.
- The bid item "Fire Hydrant Installation" shall include installation of a New Fire Hydrant, thrust blocking, fittings, and all necessary adjustments required to bring the hydrant into complete and working order.
- Each bidder shall visit the site of the project before submitting their proposal for the work so that they may inform themselves as to the existing field conditions and the obstacle which might be encountered.
- Interurban traffic generated outside the project area and local business or residential traffic generated within the project area is to be carried through construction as further promulgated by construction phasing plans and the project special provisions. The Contractor shall utilize barricades, signs, guards, and flagmen in accordance with the Manual on Uniform Traffic Control Devices.
- Rubble from the removal of miscellaneous structures including pavement, pipes, and etc. shall be disposed of on sites provided by the Contractor. These sites shall also be approved of by the Engineer as to suitability, appearance, and site location. Location that, in the opinion of the Engineer, leave an unsightly appearance will not be approved. All disposal sites must be approved by the Kansas Department of Health and Environment. Material either stockpiled or disposed of in a flood plain will require a Kansas State Board of Agriculture permit. Any material dumped in water of the United States or wetlands is subject to U.S. Corps of Engineers permitted regulations. Any material buried or stockpiled beyond approved construction limits may require archaeological investigations unless buried in a previously approved disposal location.
- Temporary Blowoff Valves necessary to flush lines at existing water line tie-ins shall not be paid for directly, but shall be considered SUBSIDIARY to other items in the bid.
- Connections to existing water lines shall not be paid for directly, but shall be considered SUBSIDIARY to other items in the bid.
- Contractor to coordinate with the United States Postal Service prior to any temporary or permanent relocation of existing mailboxes.
- Contractor to follow all current City of Wichita erosion control standards.
- Contractor to maintain access to all driveways at the end of each construction day, unless, prior approval from the Project Inspector.
- The Contractor shall understand that utilities may have been relocated to new locations and that additional coordination with Utility Companies may be required. The Contractor shall be required to work around existing utilities within the right-of-way.
- Taps larger than 12" shall be done by the Contractor, taps 12" or smaller will be done by the City of Wichita unless otherwise noted in the plans.
- All existing water line structures (i.e. water valve assemblies, fire hydrant assemblies, etc.) called out for removal in the plans shall be taken to the City of Wichita Water Department Material Yard located at 1701 Sim Park Drive.
- Any existing joint exposed during excavation shall be replaced if within four feet of proposed joint.
- Existing underground utilities are shown at estimated depths. The Contractor shall verify the exact depths of underground utilities that are critical to the construction before beginning work. The cost for this shall be SUBSIDIARY to the project.
- Contractor shall verify horizontal and vertical location, type size and class of existing waterlines prior to making connections. The existing waterline locations as shown on the plans are approximate. The contractor shall make adjustments as required and approved by the Engineer. Provisions and installation of pipe adaptors, short sections of pipe, and couplers shall be SUBSIDIARY to other pay items of work.
- Contractor shall make minor adjustments to the new construction if required by the location of any existing utility at no cost to the owner. Should a conflict occur Contractor shall contact Engineer and utility owner as shown in plans.
- All pipe 11.00 LF or less shall be DICL lined pipe.
- Temporary connections between the existing water main and the proposed water main to meet the construction phasing of the project shall be SUBSIDIARY to other pay items of work.

RECAPITULATION OF QUANTITIES

BID ITEM	QUANTITY	UNIT
Pipe, WL 4" (Restrained)(DICL)	153	L.F.
Pipe, WL 6" (Restrained)	92	L.F.
Pipe, WL 6" (Restrained)(DICL)	132	L.F.
Pipe, WL 8" (Restrained)	1716	L.F.
Pipe, WL 8" (Restrained)(DICL)	38	L.F.
Pipe, WL 8" Fuseable PVC	786	L.F.
Valve Assembly, Anchored 4"	5	EA.
Valve Assembly, Anchored 6"	4	EA.
Valve Assembly, Anchored 8"	4	EA.
Fire Hydrant Assembly	6	EA.
Fire Hydrant Assembly, Removed	6	EA.
Fill Sand (Flush & Vibrated)	2954	L.F.
Pipe, Cut and Cap 4"	4	EA.
Pipe, Cut and Cap 6"	5	EA.
Pipe, Cut and Cap 8"	3	L.F.
Pipe Removed	59	L.F.
Valve Box Assembly, Removed	17	EA.
1" Service Line, Long	14	EA.
1" Service Line, Short	4	EA.
2" Service Line, Long	5	EA.
2" Service Line, Short	1	EA.
Concrete Encasement 8", Reinforced	61	L.F.
AC Pavement 6", Temporary (Utility Patch)	217	L.F.

FIRE HYDRANTS REQUIRED

STATION	BURY LINE ELEVATION	TOP OF PIPE ELEVATION	FIRE HYDRANT BURY REQUIRED †	VALVE STEM EXT. REQUIRED (ft) †
203+53.11	1,295.82	1,291.83	3.99'	-
207+72.28	1,296.52	1,292.90	3.62'	-
210+49.00	1,296.74	1,292.74	4.00'	-
300+06.00	1,293.38	1,288.88	4.50'	-
303+18.00	1,294.17	1,289.99	4.20'	-
307+83.00	1,295.13	1,290.52	4.51'	-

† For Details See Sheet 123

UTILITY OWNERS

- AT&T**
c/o Jason Edwards
154 N. Broadway, Room 210
Wichita, KS 67202
Phone: 316-268-2008
- Cox Communications**
c/o Whit Taylor
901 George Washington Blvd.
Wichita, KS 67211
Phone: 316-761-9488
- Kansas Gas Service**
c/o Adam Knolla
1021 East 26th Street North
Wichita, KS 67219-4308
Phone: 316-832-3123
- Evergy Distribution**
c/o Shane Price
1900 E. Central
Wichita, KS 67201
Phone: 316-261-6315
- Zayo**
c/o Tommy Bunce
102 N. Main St.
Buhler, KS 67522
Phone: 620-200-3621
- Water**
City Of Wichita Water Dept.
c/o Greg Lolley
City Hall, 455 N. Main, 8th Floor
Wichita, KS 67202
Phone: 316-268-4555
- Storm Water**
City Of Wichita Storm Water
c/o Kelly Fleming
City Hall, 455 N. Main, 8th Floor
Wichita, KS 67202
Phone: 316-268-4545
- Sanitary Sewer**
City Of Wichita, Sanitary Sewer
c/o Deb Ary
City Hall, 455 N. Main, 8th Floor
Wichita, KS 67202
Phone: 316-268-4614


Utility Notes:

Visual indications of utilities are as shown. Underground locations shown, as furnished by their lessors, are approximate and should be verified in the field at the time of construction. For actual field locations of underground utilities, call 1-800-344-7233. Verification of utilities is the Contractor's responsibility.

SUMMARY OF WATERLINE ITEMS
(For Information Only)

WATERLINE NO.	4" WL PIPE DICL RESTRAINED (L.F.)	6" WL PIPE (L.F.)	6" WL PIPE DICL RESTRAINED (L.F.)	8" WL PIPE (L.F.)	8" WL PIPE PVC FUSEABLE (L.F.)	8" WL PIPE DICL RESTRAINED (L.F.)	4" VALVE ASSEMBLY ANCHORED (EA.)	6" VALVE ASSEMBLY ANCHORED (EA.)	8" VALVE ASSEMBLY ANCHORED (EA.)	FIRE HYDRANT ASSEMBLY (EA.)	REMOVE FIRE HYDRANT ASSEMBLY (EA.)	FILL SAND (FLUSH & VIBRATE) (L.F.)	4" PIPE CUT & CAP (EA.)	6" PIPE CUT & CAP (EA.)	8" PIPE CUT & CAP (EA.)	PIPE REMOVED (L.F.)	VALVE BOX ASSEMBLY REMOVED (EA.)	1" SVC. LINE, LONG (EA.)	2" SVC. LINE, LONG (EA.)	1" SVC. LINE, SHORT (EA.)	2" SVC. LINE, SHORT (EA.)
Line 1				372.70	785.72	19.22	3	3	1	1	3	1,195.58			2	10.0	11	8	3		1
Line 1A			18.93									18.93		1		5.0					
Line 1B			5.00							1		22.03									
Line 1C	21.41											21.41	1			5.0					
Line 1D	35.48											35.48	1			5.0					
Line 1E			8.62									8.62		1		3.0					
Line 1F			9.93									9.93		1		3.0					
Line 1G			11.83							1		31.83									
Line 1H	6.96											6.96	1			11.0					
Line 1I												7.75									
Line 2				1,172.24		18.68	2	1	3	1	3	1,190.92		1	1	10.0	6	6	1	5	
Line 2A			6.00									6.00									
Line 2B			35.00							1		35.00									
Line 2C			36.32							1		36.32									
Line 2D	42.08											37.00									
Line 2E	43.91											37.00	1			2.0					
Line 3				171.33								171.33									
Line 4		91.79										91.79		1		5.0					
TOTAL	152.84	91.79	131.63	1,716.27	785.72	37.91	5	4	4	6	6	2,963.88	4	5	3	59.0	17	14	4	5	1

TRANSYSTEMS
245 N. WACO
SUITE 222
WICHITA, KANSAS 67202
MAIN: 316-303-3000
FAX: 316-462-5629

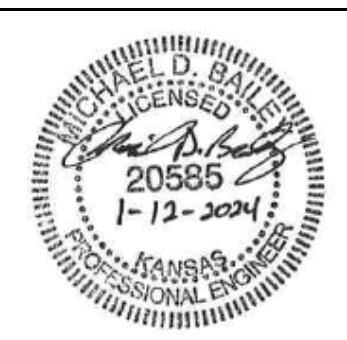

CONSULTANTS:

COMMERCE STREET & ST. FRANCIS AVENUE IMPROVEMENTS FROM WATERMAIN TO KELLOGG



REVISIONS:	DESCRIPTION	DATE	MARK

PROJ NO: 472-2021
SCALE: NTS
DATE: 2/21/2024
DESIGNED BY: DJK
DRAWN BY: DJK
CHECKED BY: MDB

SHEET TITLE:
WATERLINE GENERAL NOTES & SUMMARY OF QUANTITIES

SHEET NO.
113