

A. General Instructions:

- Codes, Permits and Inspections:
 - Wiring shall be in accordance with latest edition National Electrical Code (NEC), NFPA, and/or applicable local, state, and utility company rules, laws, codes, and ordinances.
 - Secure all permits and inspections required for the installation of the electrical work.
 - All work shall comply with the latest edition of the Americans With Disabilities Act (ADA).
 - Pay all fees associated with new utility services.

2. Verifications:

- Verify mounting heights and locations of electrical equipment before installation or rough-in.
- Verify exact location of electrical service entrance including point of service and system characteristics.

3. Wiring Methods:

- The Electrical Contractor shall cooperate with other Contractors and install equipment in proper sequence so as not to interfere with the progress of other Contractors.
- All materials shall be new and carry the Underwriter's Label or be "listed" by that group, and be fully equal to makes specified.
- Use only insulated copper conductors in conduit. Use flexible conduit for connections to motors and similar equipment.
- All wiring shall be concealed and all outlets shall be flush mounted in finished spaces except as noted otherwise.
- All systems wiring in return air plenums shall be in conduit or be plenum rated.

4. Tests:

- This Contractor shall be responsible for performing all tests necessary to prevent concealment of defective or improper work.
- Upon completion of work, test the installation thoroughly and render it free from shorts, grounds or improper connections.

- Guarantee - This Contractor shall guarantee that all defective items of workmanship, material, labor or mechanical operation developing within one (1) year from the date of final acceptance of completed installation shall be replaced to the complete satisfaction of the Owner.

- Workmanship - Electrical equipment shall be installed in a neat and workmanlike manner. Unsightly installations shall be removed or reworked at no additional expense to the Owner.

- Identification of disconnecting means - Provide a permanent nameplate for each disconnect switch indicating its purpose. The marking shall be of sufficient durability to withstand the environment it is installed in as required by N.E.C. Section 110-22 and 230-72(a).

B. Electrical Equipment:

1. Conduits:

- All conduit installed in earth, concrete, below concrete on earth, or exposed to weather shall be rigid steel or intermediate metal conduit. Electrical non-metallic tubing for all dry interior runs. Fittings shall be fully approved in accordance with N.E.C.
- Flexible or P.V.C. conduit may be used where not exposed to damage and approved by N.E.C. and local codes.
- Provide a ground wire sized per N.E.C. Art. 250-95 in all conduits, both metallic and nonmetallic.
- Conduit shall be installed and sized according to code requirements and protected from damage during construction.
- Conduit may be re-routed where such action does not adversely affect the intended design or circuiting.

2. Conductors:

- Conductors shall be copper, generally with 600 volt rated insulation. Branch circuit wiring min. size #12 Type "THW" or "THHN/THWN" as required. Service entrance, feeder conductors Type "THW/THHN" or "THWN". Low voltage wire shall be Type "IT" or "ITF" minimum #18 gauge unless noted otherwise. All other types shall be as required by N.E.C.
- All conductors shall be color coded with type and size marking. Connections to service equipment, feeder panels shall be made with solderless lugs. All splices, taps, connections to service entrance conductors shall be made by bronze solderless lugs. All other splices, connections shall be pressure type connectors.
- Insulate joints, splices with Scotch #33 plastic tape or plastic moulded jackets.

3. Lighting Fixtures and Lamps:

- Install lighting fixtures. Provide lamps as indicated on the drawings.
- No substitutions on lighting fixtures except as approved by Engineer prior to bidding.
- Verify exact locations of fixture outlets so as to cause no interference with piping, equipment and architectural treatment.
- Ballasts - by "Advance" or equal, internally or externally fused, high power factor, V.M.A. fully compatible with lamps and shall carry UL label, ETL and CBM certifications of compliance, even though indicated fixture number may indicate otherwise.
- Furnish all fixtures with lamps as scheduled and/or required by final fixture selection. Lamps equal to G.E.

4. Grounding:

- Provide system ground as required by N.E.C. and utility company if not already existing.
- Band mechanical equipment frames.
- Band all service entrance equipment and conduit system.
- An equipment grounding conductor sized per N.E.C. Art. 250-94 shall be provided in all conduits. The ground wire is required for both metallic and nonmetallic conduit installations.

5. Branch Circuit Panels:

- Branch circuit lighting panels equal to Square D, G.E., ITE, or Cutler Hammer, with thermal magnetic breakers and ground buses. Load center construction is not permitted. Electrical Contractor shall obtain available short circuit current from local utility co. Panelboards shall be U.L. listed for available fault current. Breakers and panels shall be fully rated or U.L. series rated with specified fuses (22,000 AIC minimum).
- Breakers shall have individual plastic covers sized as scheduled. Two pole breakers shall be common trip (single pole units with tie bars are not acceptable).
- Panel shall be mounted as noted on the drawings. Provide with a hinged door and a neatly typed circuit directory card.
- Re-assign circuits to properly balance the loads on the phases if final connections and tests show it to be advisable.

6. Contactors And Relays
 - Shall be as manufactured by Cutler-Hammer, Allen Bradley, G.E. or Square D. They shall be as sized on the drawings.
 - All contactors and relays shall be Tungsten rated.
7. Photo Electric Controls:
 - Photo Electric Controls by York, Intermatic and Paragon equal to those indicated below and approved by the Engineer will be acceptable.
 - Photo Electric Controls (Photo Switches; Photo Cells) shall be rated at 1800W, 120 volts, weatherproof. Mount on roof and orient photo electric controls to the north.
 - Photo-electric controls supplied as a part of a fixture assembly shall be as provided by Fixture Manufacturer.

TYPICAL SIGN LIGHTING TO INCLUDE DISCONNECT, TRANSFORMER & BREAKERS. NEMA-3R PAD MOUNTED, MAX. 18" HIGH. SUBMIT DETAIL FOR APPROVAL.

FUSE SIZED FOR 125% OF XFMR PRIMARY

SITE LIGHTING FIXTURES (TYP.)

GROUND LUG AT EACH POLE. BOND AS INDICATED IN POLE BASE DETAIL.

120V. TO GROUND LIGHTS NEMA-3R ENCLOSURE MOUNTED ON BACK SIDE OF WALL

NEMA-3R STEP-DOWN TRANSFORMER FOR GROUND LIGHTS

XFMR 480V 1Ø 240/120V

30A 240V 1P DISCONNECT

BOND GROUND CONDUCTORS AT DEVICES

20A 240V 2P BREAKER

#10 CU. TO FIXTURE(S). CONDUCTORS SHALL BE SUPPORTED WITHIN POLE. (TYPICAL)

NIGHT LIGHT WHERE INDICATED ON DRAWINGS

BUSSMAN HEB-AA FUSE HOLDER W/INSULATING WATERPROOF BOOT. MOUNT FUSE INSIDE POLE AT HAND HOLE LOCATION.

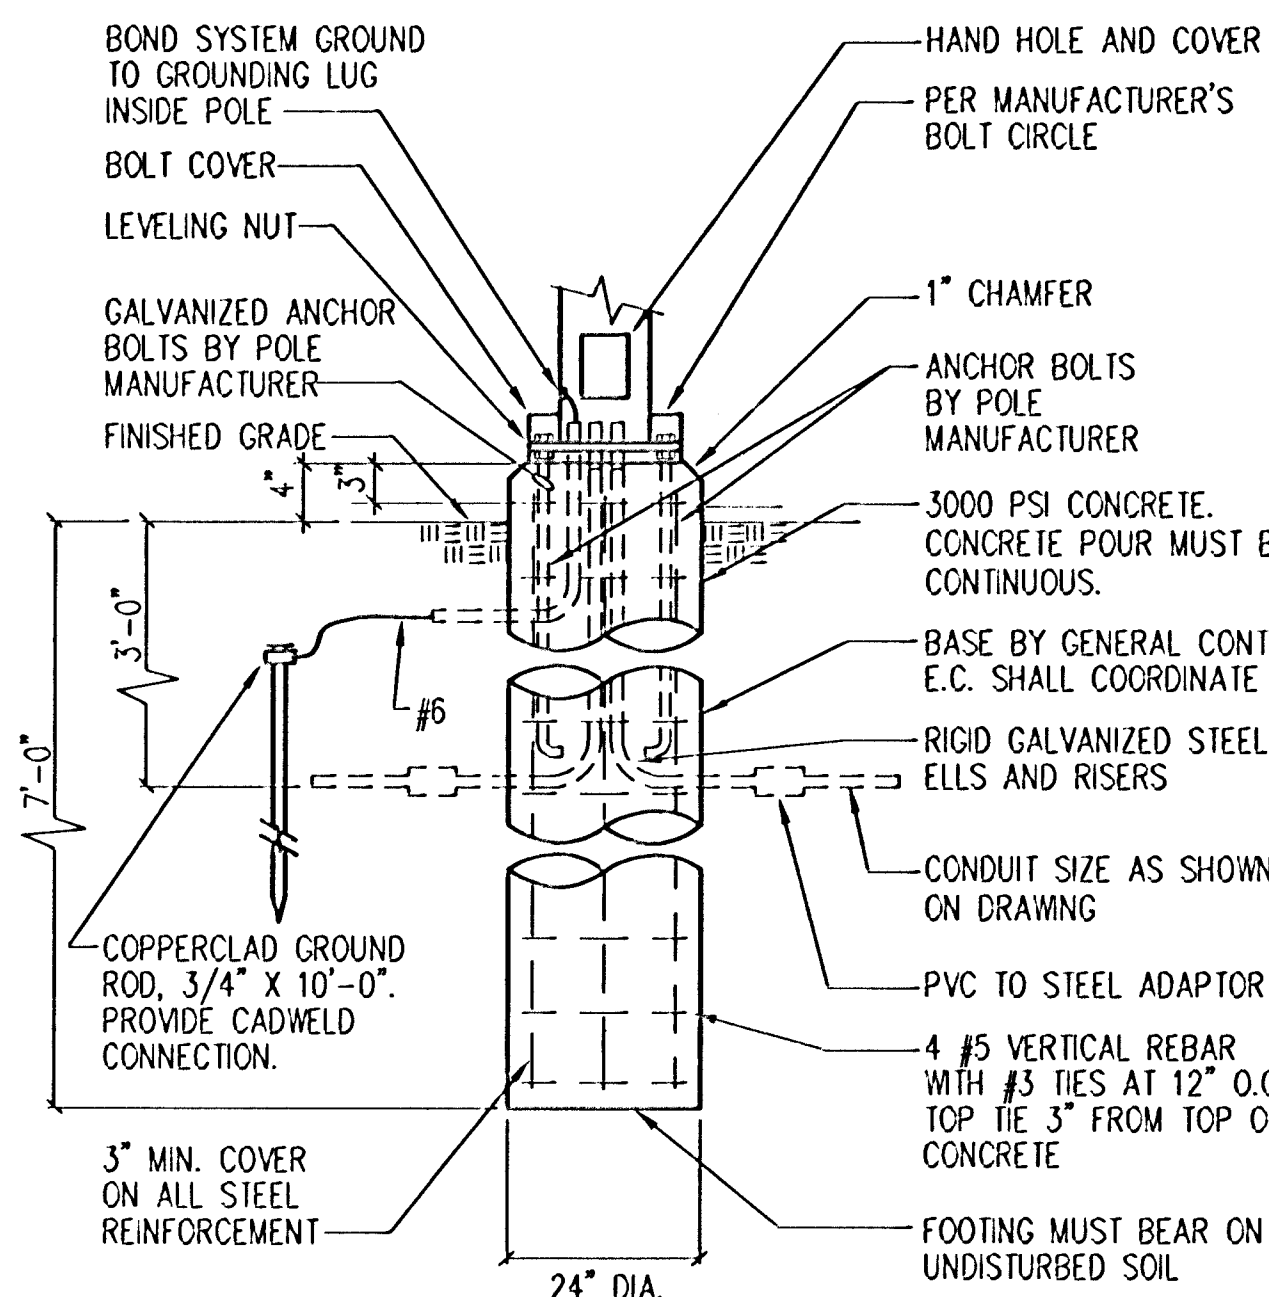
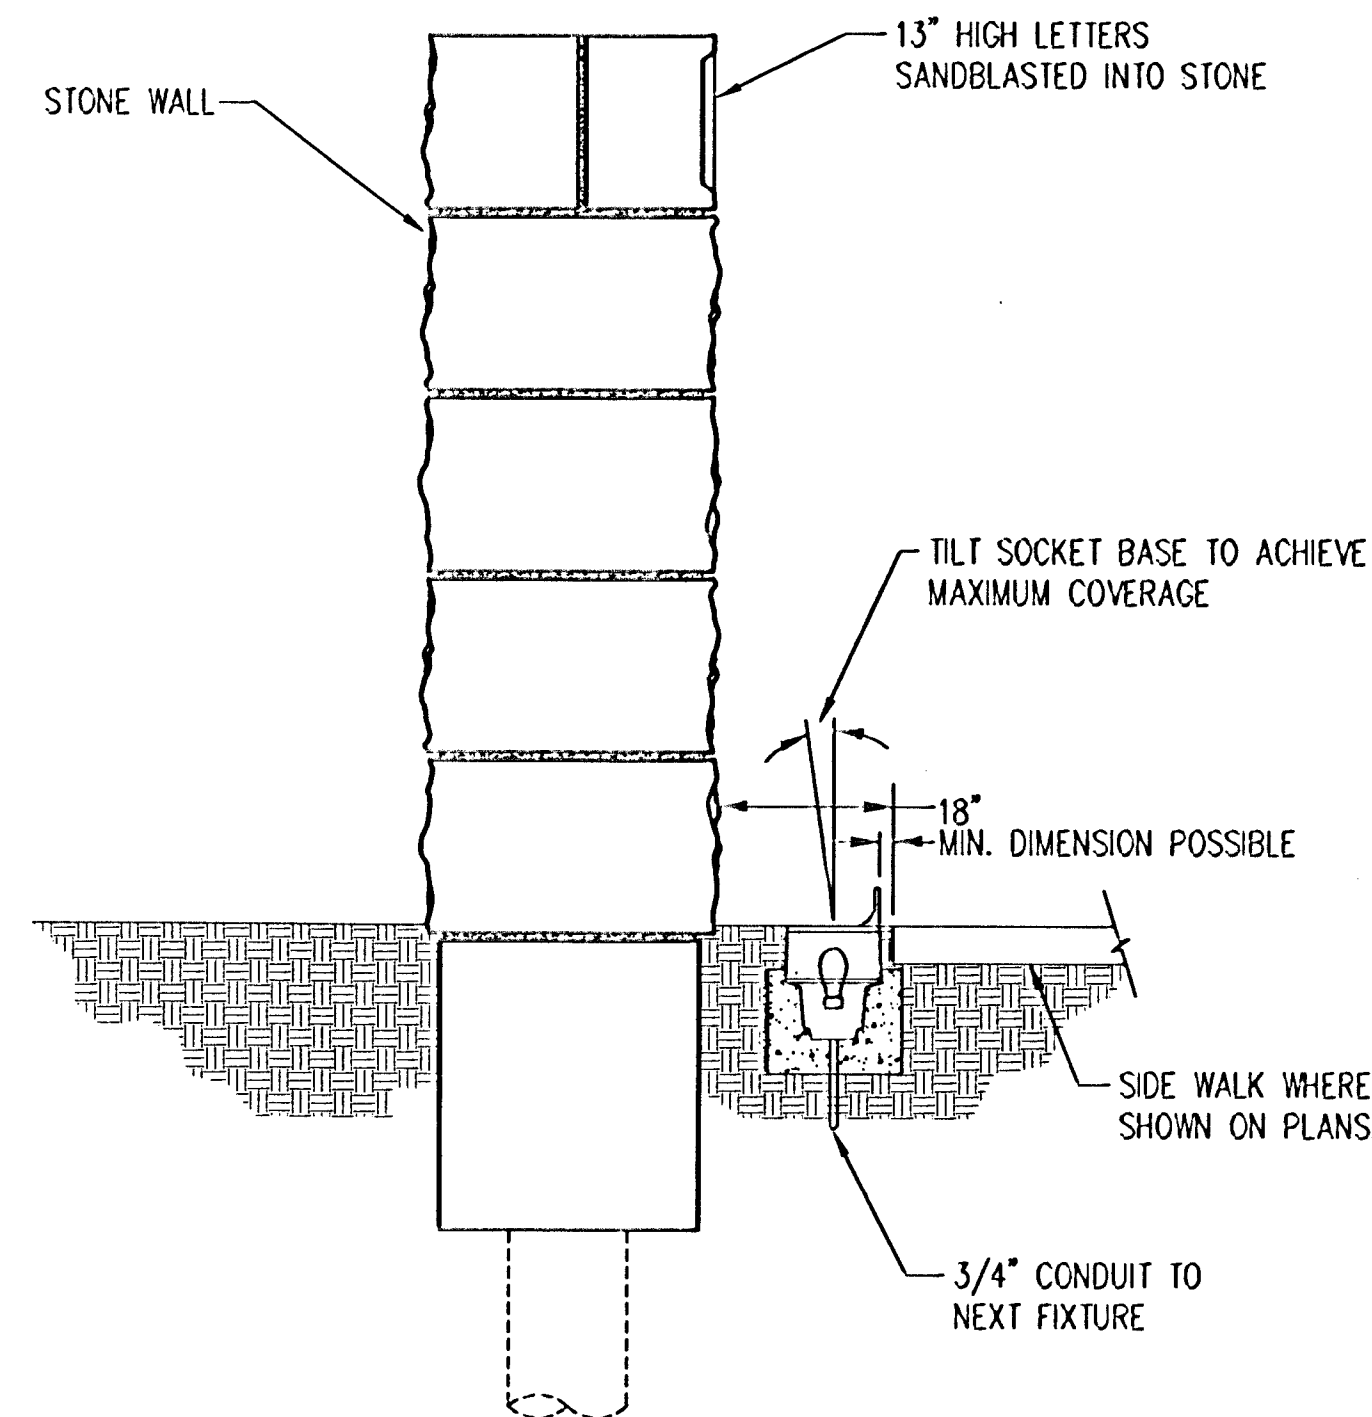
NOTE: NO FUSES AT TOP OF POLE.

PHASE A 480V. 1Ø CIRC.

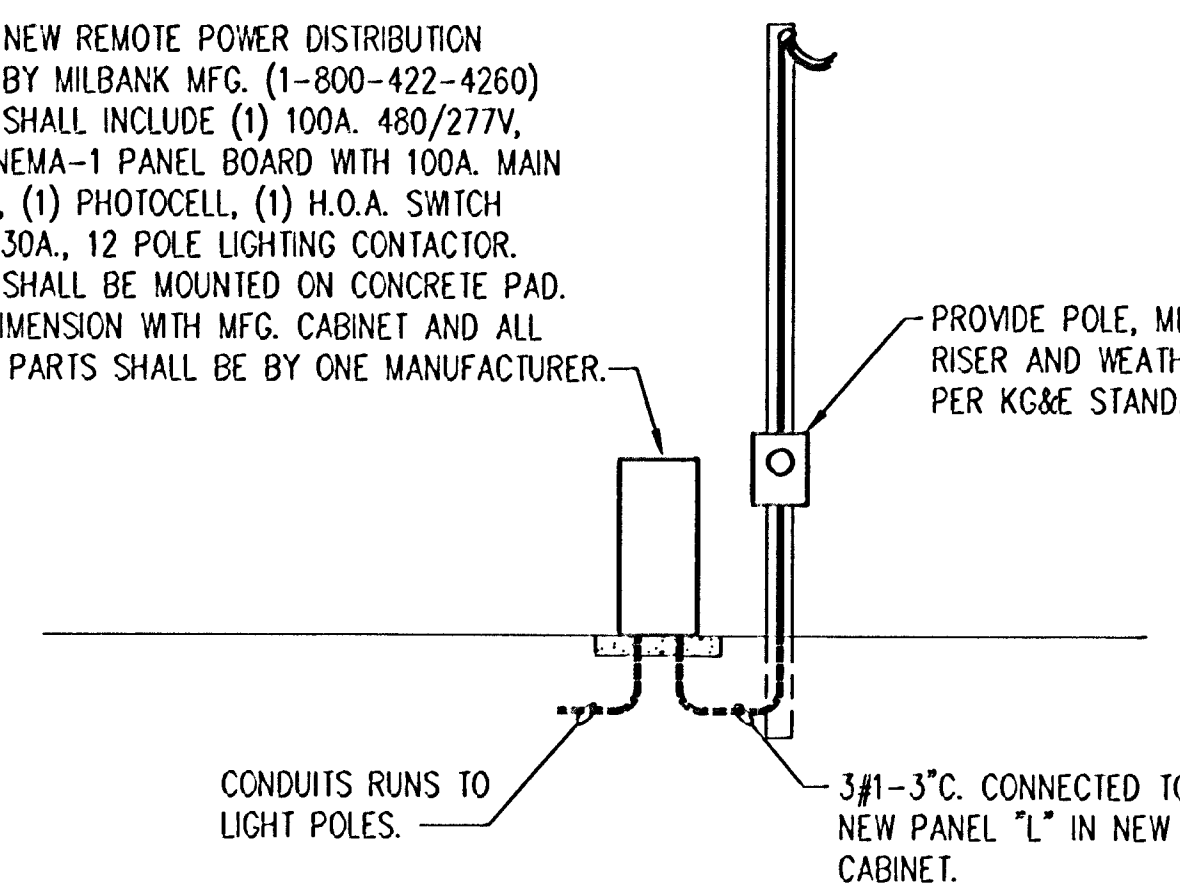
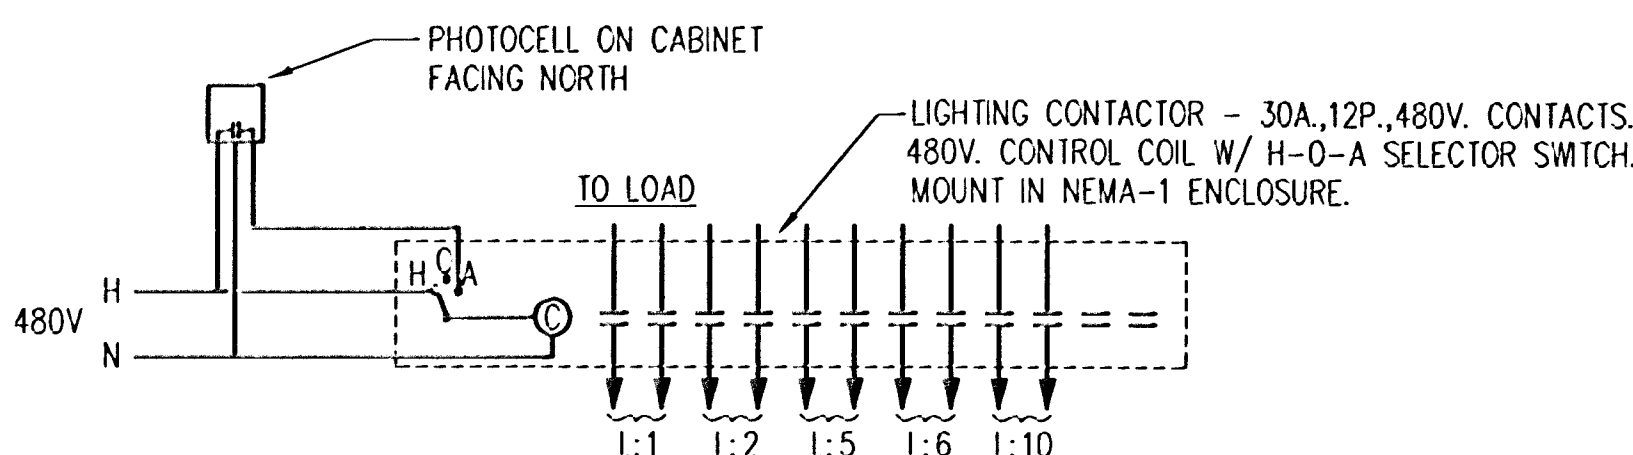
PHASE B POLE LIGHT CIRCUIT

NEXT 480V. 1Ø LIGHT CIRCUIT

GROUND

1 SITE LIGHTING WIRING DETAIL
NO SCALE2 POLE BASE DETAIL
N.T.S. (30' MAX. POLE)
(TYP. FOR FIXTURE "SD" & "SF")3 IN-GROUND FIXTURE DETAIL
N.T.S. (TYP. FOR FIXTURE "SC")

PROVIDE NEW REMOTE POWER DISTRIBUTION CABINET BY MILBANK MFG. (1-800-422-4260) CABINET SHALL INCLUDE (1) 100A. 480/277V, 1Ø, 3W. NEMA-1 PANEL BOARD WITH 100A. MAIN BREAKER, (1) PHOTOCELL, (1) H.O.A. SWITCH AND (1) 30A, 12 POLE LIGHTING CONTACTOR. CABINET SHALL BE MOUNTED ON CONCRETE PAD. VERIFY DIMENSION WITH MFG. CABINET AND ALL INTERIOR PARTS SHALL BE BY ONE MANUFACTURER.

4 ELECTRICAL RISER DIAGRAM
N.T.S. 480V, 1Ø OVERHEAD SERVICE5 LIGHTING CONTROL WIRING DIAGRAM
NO SCALE

LIGHTING FIXTURE SCHEDULE (P.E.C.)

FIXT. LTR.	MANUFACTURER CATALOG NUMBER	MANUFACTURER CATALOG NUMBER	MANUFACTURER CATALOG NUMBER	MANUFACTURER CATALOG NUMBER	DESCRIPTION	LAMP TYPE	LENS/LOUVER/FINISH	W	L	D
SC	KIM LTV30/N/50M120/HSS0/M00				IN-GROUND	50W MH ED-17	BRONZE			
SD	KIM 1A/AR2/400HPS480/DB-P				SITE LIGHT	400W HPS	BRONZE	1.0	1.43	5
SF	KIM 28/AR2/400HPS480/DB-P				SITE LIGHT	400W HPS	BRONZE	1.0	1.43	5

- MANUFACTURERS LISTED IN THIS SCHEDULE OR APPROVED BY WRITTEN ADDENDUM WILL BE THE ONLY APPROVED MANUFACTURERS TO BID THE LIGHTING FIXTURES FOR THIS PROJECT. CONTRACTORS AND SUPPLIERS USING PRICING FROM MANUFACTURERS NOT LISTED ON SCHEDULE OR BY ADDENDUM DO SO AT THEIR OWN RISK.
- REFER TO POLE BASE DETAIL THIS SHEET. POLE SHALL BE KIM #PIRS30-75120/A/DB-P.
- REFER TO POLE BASE DETAIL THIS SHEET. POLE SHALL BE KIM #PIRS30-75120/B/DB-P.

PANEL 'L'									
SURFACE MOUNTED, W/GROUND BUS									
CIRC. NO.	LOAD V. A.	LOAD TYPE	LOAD DESCRIPTION	AMP SIZE	WIRE SIZE	CIRC. NO.	LOAD V. A.	LOAD TYPE	LOAD DESCRIPTION
1	5300	GH	LTS/SIGN S SIDE	2	30	2	5300	GH	LTS/SIGN S SIDE
3						4			
5	5025	GH	LTS/SIGN S SIDE	2	30	6	5025	GH	LTS/SIGN S SIDE
7						8			
9						10			
11						12			
13						14			
15						16			
17						18			
19						20			
21						22			
23						24			

GENERAL NOTES

- ALL ELECTRICAL WORK SHALL COMPLY WITH THE LATEST EDITION OF THE NATIONAL ELECTRICAL CODE (NEC) & THE AMERICANS WITH DISABILITIES ACT (ADA).
- REFER TO RELATED ARCHITECTURAL AND CIVIL DRAWINGS FOR RELATED INFORMATION.
- REFER TO THE SPECIFICATIONS FOR DATA NOT ON THE DRAWINGS.
- CONDUIT RUN W/CONDUCTORS AS INDICATED & GROUND WIRE SIZED PER N.E.C. 250-122 (1999). CONDUIT SIZE AS REQUIRED.
- WHEN INCREASED CONDUCTOR SIZES ARE SHOWN ON THE PLANS, THE LARGER CONDUCTOR SIZE SHALL BE USED THROUGHOUT THE LENGTH OF THE CIRCUIT, INCLUDING NEUTRAL AND GROUND.
- E.C. SHALL FIELD VERIFY ALL CONDITIONS PRIOR TO CONSTRUCTION. DURING CONSTRUCTION USE EXTREME CAUTION WHEN TRENCHING AND BORING HOLES FOR POLE BASES, THERE ARE NUMEROUS EXISTING BURIED PIPES AND UTILITY LINES ON THIS PROJECT.
- E.C. SHALL COORDINATE WITH K&E NEW POLE LOCATION, METERING LOCATION AND REQUIREMENTS.

SYMBOL LIST

SYMBOL	DESCRIPTION	MOUNTING
A □	EXTERIOR POLE MTD. SINGLE HEAD	POLE
□ + □	EXTERIOR POLE MTD. DOUBLE HEAD	POLE
○ A	IN GROUND LIGHT FIXTURE	GROUND
— A	BRANCH CIRCUIT PANEL & PANEL DESIG.	CABINET
—	CONDUIT RUN 2#12 & 1#12 GRD.-3/4\"	EARTH/FLOOR
—	SEE GENERAL NOTE 7	

HELLMUTH, OBATA & KASSEBAUM, INC.
DALLAS, TEXAS

PROFESSIONAL ENGINEERING
CONSULTANTS, P.A.
WICHITA, KANSAS

BRAD J. GOLDBERG
DALLAS, TEXAS

MUSEUM DISTRICT ROADWAY AND
PEDESTRIAN IMPROVEMENTS
WICHITA, KANSAS

LIGHTING PLAN

PROJECT NO.
99773-000

SCALE:
1"=20'

SHEET
E-7

REV.	DATE	DESCRIPTION