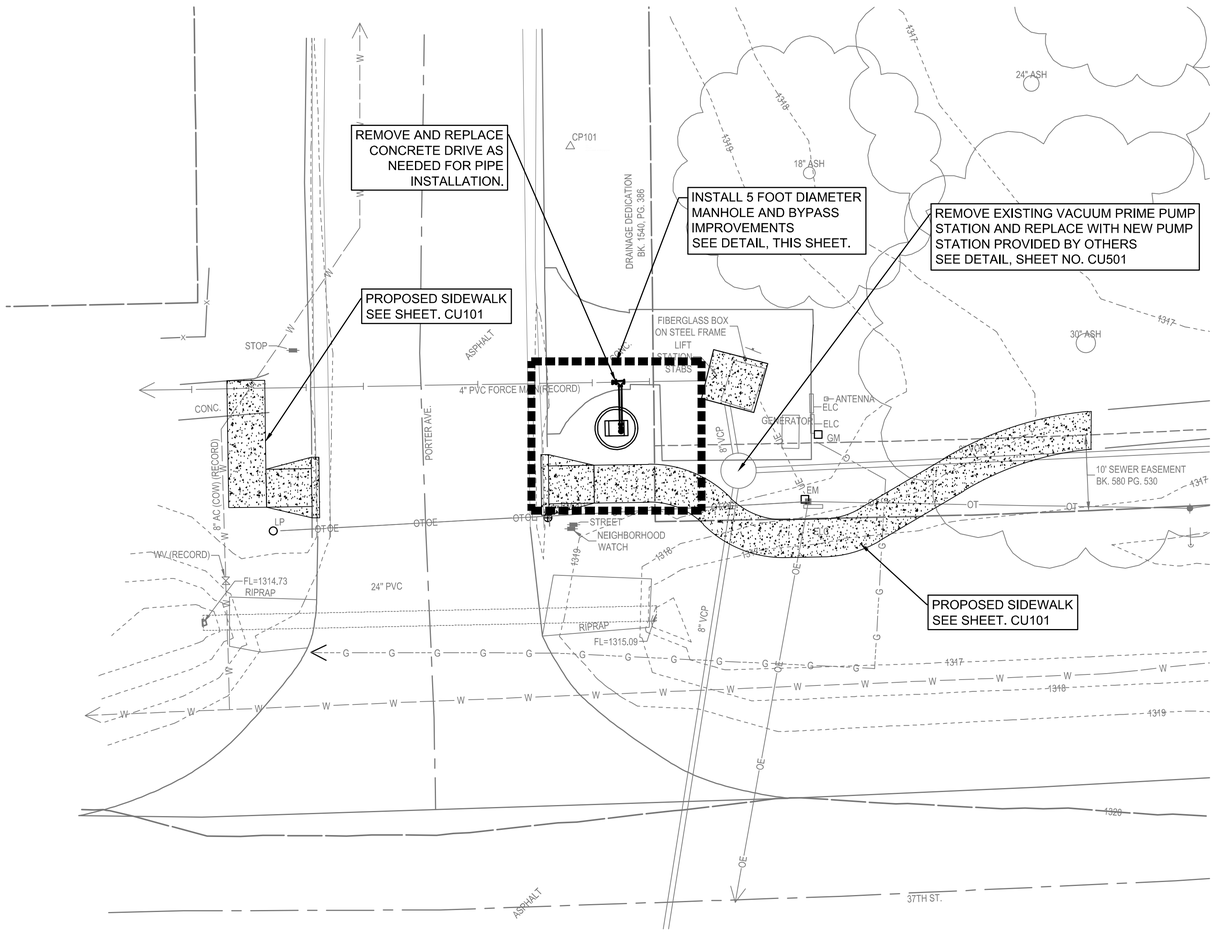

NOTES

1. DUCTILE IRON PIPE SHALL HAVE PROTECTO 401 EPOXY LINING.

LEGEND

(5000) = SEE SHEET NO. C003 FOR WATERLINE COORDINATES (TYP.)

SCALE: 0 10' 20'

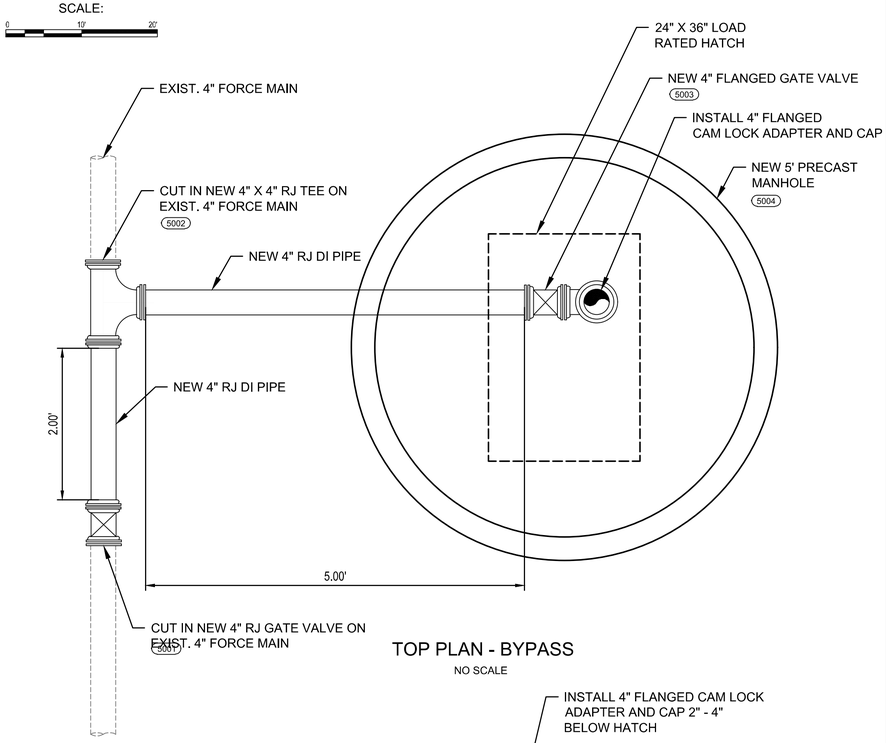

TOP PLAN - BYPASS

NO SCALE

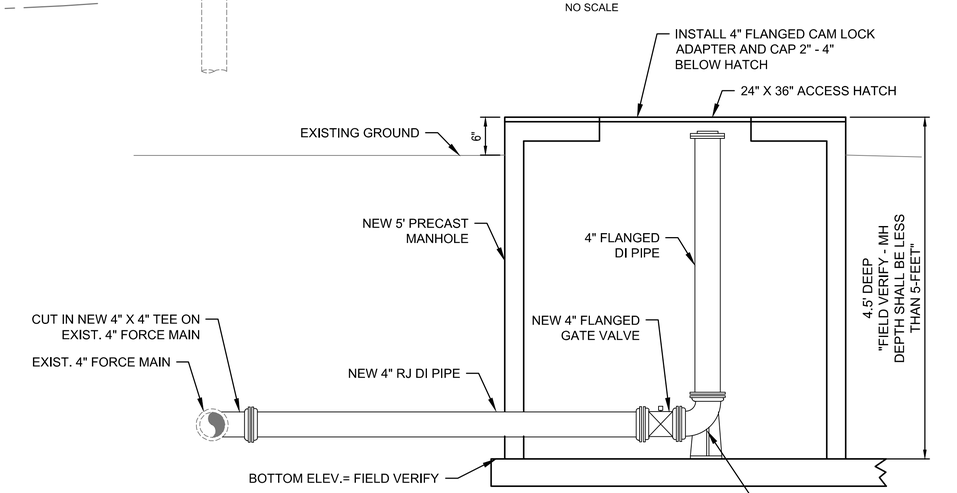

BYPASS IMPROVEMENTS

NO SCALE

PEC
PROFESSIONAL ENGINEERING CONSULTANTS
303 SOUTH TOPEKA
WICHITA, KS 67202
316-262-2691 www.pec1.com

CITY OF WICHITA

WILLIAM CLESSEN LICENSED 23090 02/26/2022 KANSAS PROFESSIONAL ENGINEER

SANITARY SEWER IMPROVEMENTS

LIFT STATION NO. 23
AT
W. 37TH STREET N AND PORTER AVE.

GARY JANZEN, P.E. - CITY ENGINEER
CITY OF WICHITA PROJECT NO. 468-2020-019218 S0015

Issue:		

JOB NO.	35-217043-008-0042
DATE	NOVEMBER 2021
PM	RWG
DESIGNED BY	RWG
DRAWN BY	KTD
CHECKED BY	TBK

SITE PIPING & PUMP STATION IMPROVEMENTS

CU102

SAVED 2/25/2022 9:13:36 AM BY KURTIS.DEKAT
PLOTTED 2/25/2022 1:38:34 PM BY KURTIS.DEKAT
U:\WICHITA-CIVIL\2021\217043\008\MUNI\DRAWINGS\217043-008-CU102-SITE PIPING & PUMP STATION IMPROVEMENTS.DWG